

ENCLOSURE 2

REVISED PAGES FOR THE UNIT 1
JANUARY 1992 MONTHLY OPERATING REPORT

9212160181 921212
PDR ADCK 05000528
R PDR

ORIGINAL
NRC MONTHLY OPERATING REPORT

DOCKET NO. 50-528
UNIT NAME PVNGS-1
DATE 2/10/92
COMPLETED BY K.A. Chavet
TELEPHONE (602) 340-4718


OPERATING STATUS

1. Unit Name: Palo Verde Nuclear Generating Station, Unit 1
2. Reporting Period: January 1992
3. Licensed Thermal Power (MWt): 3800
4. Nameplate Rating (Gross MWe): 1403
5. Design Electrical Rating (Net MWe): 1270
6. Maximum Dependable Capacity (Gross MWe): 1303
7. Maximum Dependable Capacity (Net MWe): 1221
8. If Changes Occur In Capacity Ratings (Item Numbers 3 Through 7)
Since Last Report, Give Reasons: N/A
9. Power Level to Which Restricted, If Any (Net MWe): None
10. Reasons For Restrictions, If Any: N/A

	UNIT 1 GENERATING STATISTICS	This Month	Yr. to-Date	Cumulative
11.	Hours in Reporting Period	744	744	52,680
12.	Hours Reactor was Critical	492.7	492.7	29,551.8
13.	Reactor Reserve Shutdown Hours	0.0	0.0	0.0
14.	Hours Generator was On-Line	472.0	472.0	28,794.1
15.	Unit Reserve Shutdown Hours	0.0	0.0	0.0
16.	Gross Thermal Energy Generated (MWH)	1,430,983	1,430,983	105,295,239
17.	Gross Electrical Energy Generated (MWH)	490,000	490,000	36,538,700
18.	Net Electrical Energy Generated (MWH)	451,025	451,025	34,275,817
19.	Unit Service Factor (%)	63.4%	63.4%	54.7%
20.	Unit Availability Factor (%)	63.4%	63.4%	54.7%
21.	Unit Capacity Factor (Using MDC Net)	49.6%	49.6%	53.3%
22.	Unit Capacity Factor (Using DER Net)	47.7%	47.7%	51.2%
23.	Unit Forced Outage Rate (%)	36.6%	36.6%	20.6%

24. Shutdowns Scheduled Over Next 6 Months (Type, Date and Duration of Each): Refueling outage, February 15, 1992, 70 days
25. If Shutdown At End of Report Period, Estimated Date of Start-up: N/A

	Forecast	Achieved
INITIAL CRITICALITY	<u>05/85</u>	<u>05/25/85</u>
INITIAL ELECTRICITY	<u>06/85</u>	<u>06/10/85</u>
COMMERCIAL OPERATION	<u>11/85</u>	<u>01/28/86</u>

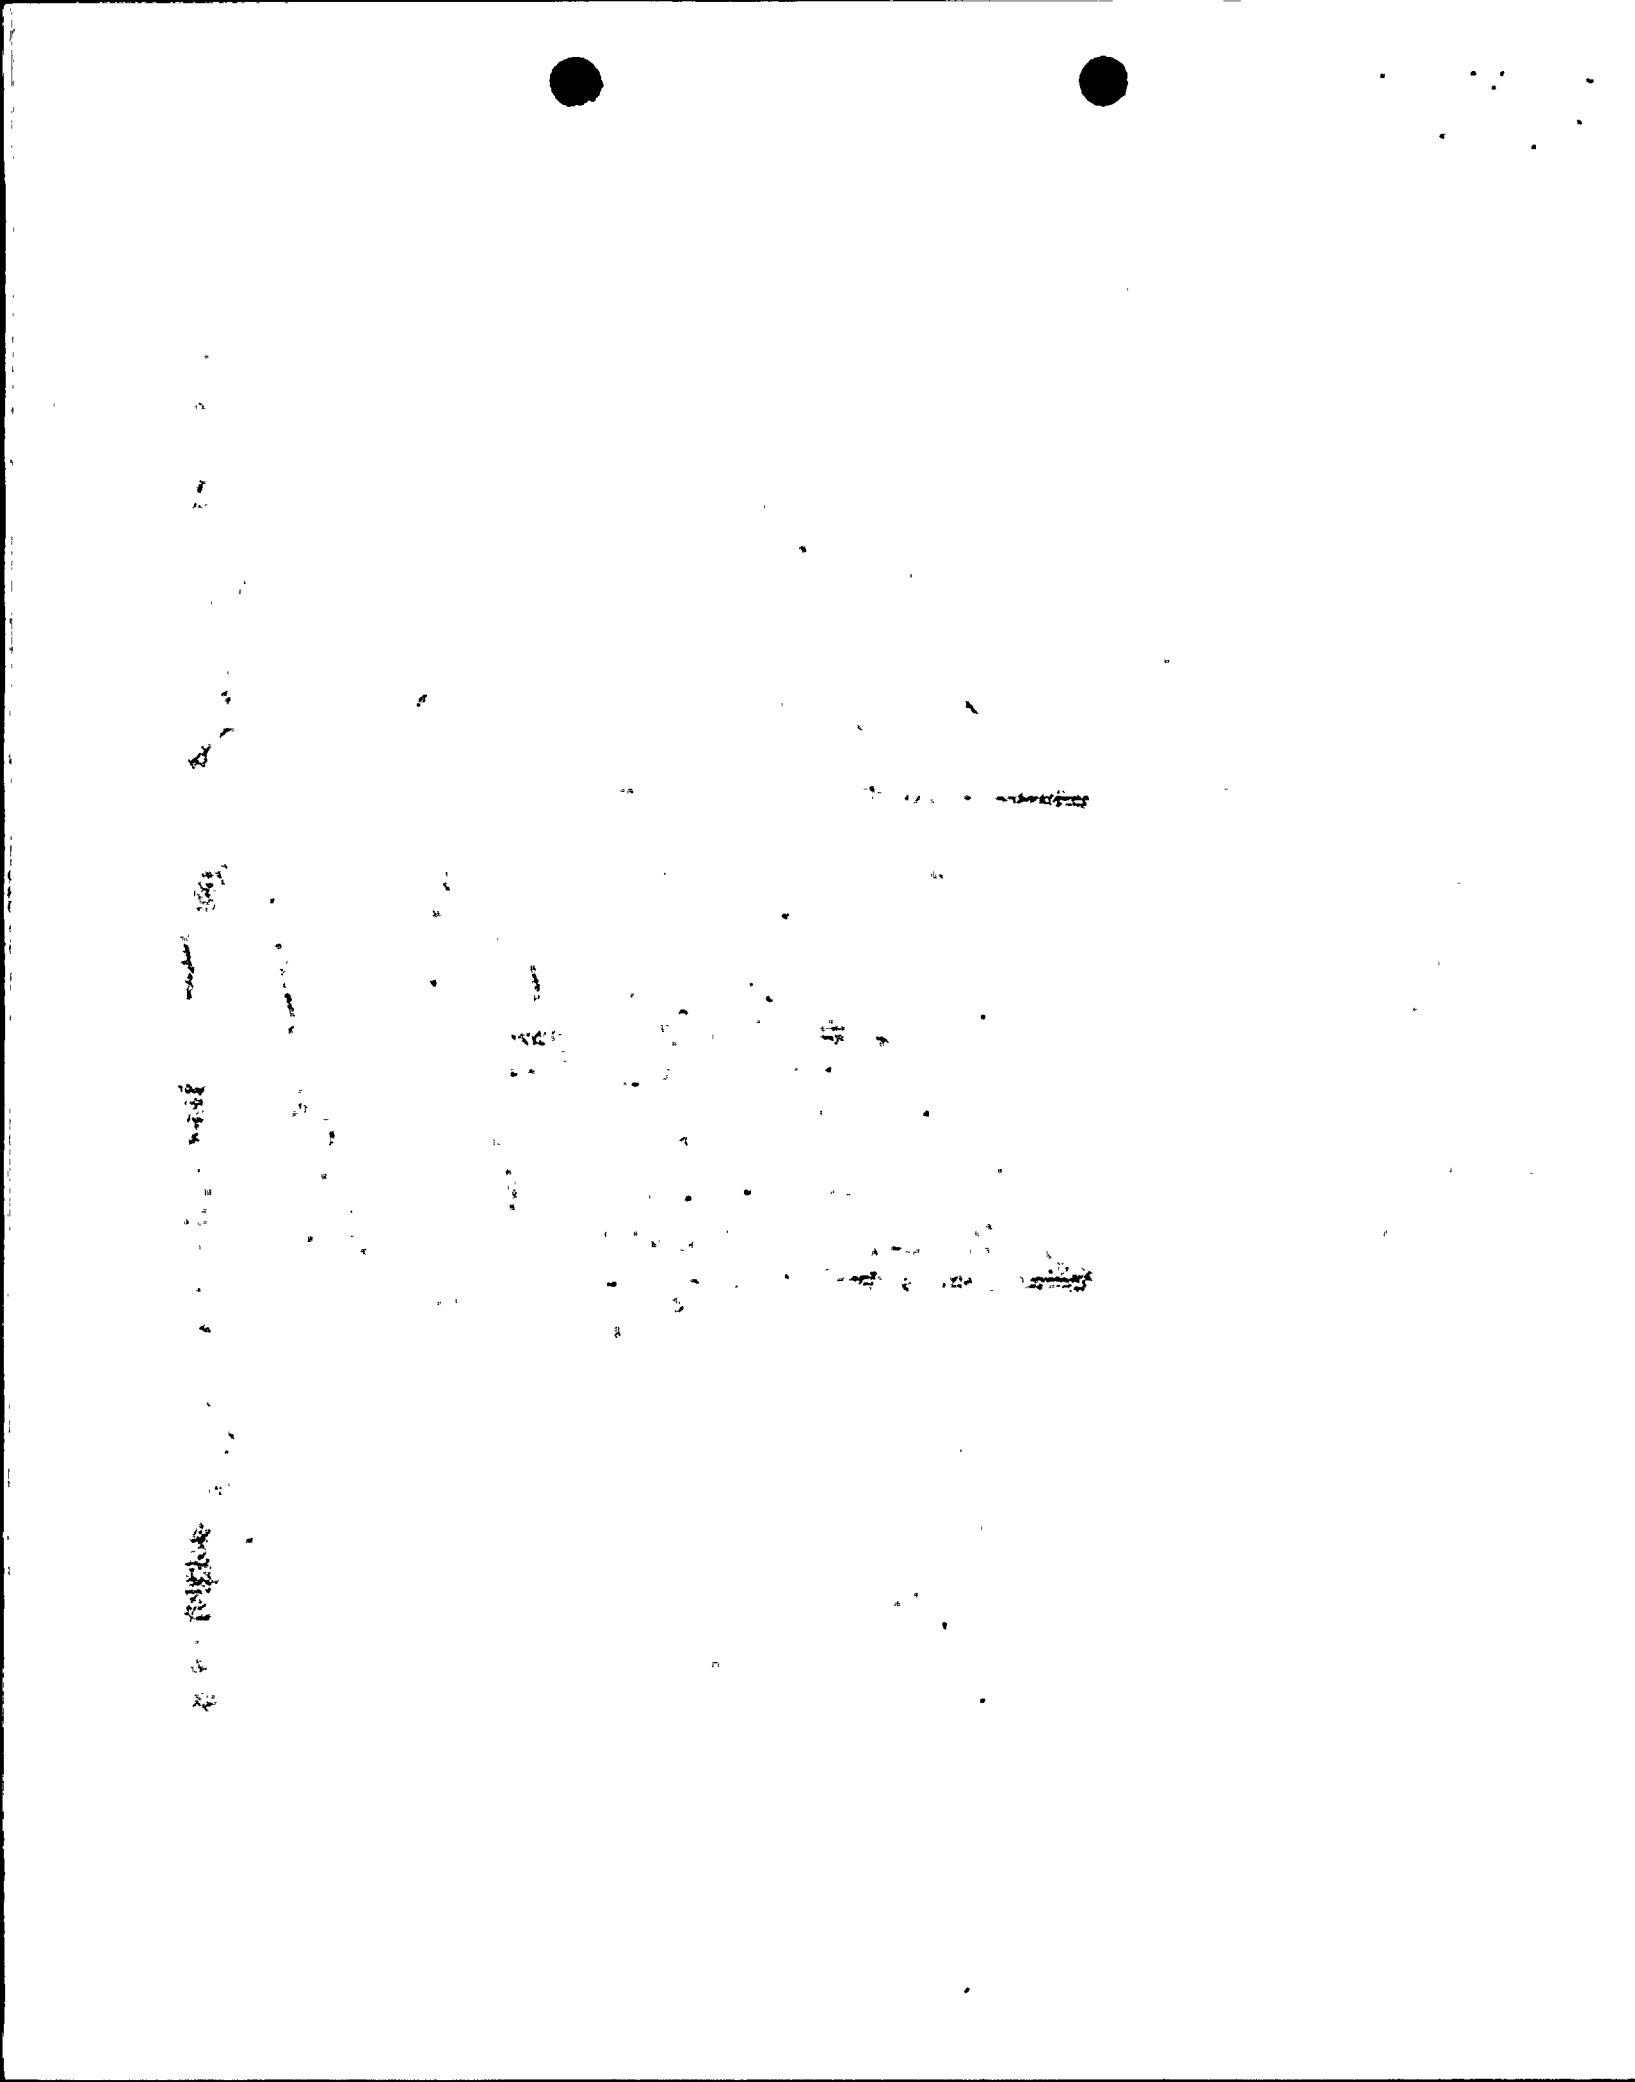

REVISED

NRC MONTHLY OPERATING REPORT

DOCKET NO. 50-528
 UNIT NAME PVNGS-1
 DATE 2/10/92
 COMPLETED BY K.A. Chavet
 TELEPHONE (602) 340-4718

OPERATING STATUS

1. Unit Name: Palo Verde Nuclear Generating Station, Unit 1
2. Reporting Period: January 1992
3. Licensed Thermal Power (MWt): 3800
4. Nameplate Rating (Gross MWe): 1403
5. Design Electrical Rating (Net MWe): 1270
6. Maximum Dependable Capacity (Gross MWe): 1303
7. Maximum Dependable Capacity (Net MWe): 1221
8. If Changes Occur In Capacity Ratings (Item Numbers 3 Through 7)
 Since Last Report, Give Reasons: N/A
9. Power Level to Which Restricted, If Any (Net MWe): None
10. Reasons For Restrictions, If Any: N/A

	UNIT 1 GENERATING STATISTICS	This Month	Yr. to Date	Cumulative
11.	Hours in Reporting Period	744	744	52,680
12.	Hours Reactor was Critical	483.7	483.7	29,502.8
13.	Reactor Reserve Shutdown Hours	0.0	0.0	0.0
14.	Hours Generator was On-line	472.0	472.0	28,794.1
15.	Unit Reserve Shutdown Hours	0.0	0.0	0.0
16.	Gross Thermal Energy Generated (MWH)	1,430,983	1,430,983	105,295,239
17.	Gross Electrical Energy Generated (MWH)	490,000	490,000	36,538,700
18.	Net Electrical Energy Generated (MWH)	451,025	451,025	34,275,817
19.	Unit Service Factor (%)	63.4%	63.4%	54.7%
20.	Unit Availability Factor (%)	63.4%	63.4%	54.7%
21.	Unit Capacity Factor (Using MDC Net)	49.6%	49.6%	53.3%
22.	Unit Capacity Factor (Using DER Net)	47.7%	47.7%	51.2%
23.	Unit Forced Outage Rate (%)	36.6%	36.6%	20.6%

24. Shutdowns Scheduled Over Next 6 Months (Type, Date and Duration of Each): Refueling outage, February 15, 1992, 70 days
25. If Shutdown At End of Report Period, Estimated Date of Start-up: N/A

	Forecast	Achieved
INITIAL CRITICALITY	<u>05/85</u>	<u>05/25/85</u>
INITIAL ELECTRICITY	<u>06/85</u>	<u>06/10/85</u>
COMMERCIAL OPERATION	<u>11/85</u>	<u>01/28/86</u>

