

ACCELERATED DOCUMENT DISTRIBUTION SYSTEM

REGULARY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9303220029 DOC. DATE: 93/03/11 NOTARIZED: NO DOCKET #
 FACILITY: STN-50-528 Palo Verde Nuclear Station, Unit 1, Arizona Public 05000528
 AUTH. NAME AUTHOR AFFILIATION
 LEVINE, J.M. Arizona Public Service Co. (formerly Arizona Nuclear Power
 RECIP. NAME RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk)

SUBJECT: Forwards LER 93-002-00 re discovery that design basis fire in control room, concurrent w/loss of offsite power could result in loss of control room power to Train B DG output breaker & essential exhaust fan breaker.

DISTRIBUTION CODE: IE22T COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 148
 TITLE: 50.73/50.9 Licensee Event Report (LER), Incident Rpt, etc.

NOTES: STANDARDIZED PLANT

05000528

	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
	PD5 LA	1 1	PD5 PD	1 1
	TRAMMELL, C	1 1	TRAN, L	1 1
INTERNAL:	ACNW	2 2	ACRS	2 2
	AEOD/DOA	1 1	AEOD/DSP/TPAB	1 1
	AEOD/ROAB/DSP	2 2	NRR/DE/EELB	1 1
	NRR/DE/EMEB	1 1	NRR/DORS/OEAB	1 1
	NRR/DRCH/HHFBHE	1 1	NRR/DRCH/HICB	1 1
	NRR/DRCH/HOLB	1 1	NRR/DRIL/RPEB	1 1
	NRR/DRSS/PRPB	2 2	NRR/DSSA/SPLB	1 1
	NRR/DSSA/SRXB	1 1	REG FILE 02	1 1
	RES/DSIR/EIB	1 1	RGN5 FILE 01	1 1
EXTERNAL:	EG&G BRYCE, J.H	2 2	L ST LOBBY WARD	1 1
	NRC PDR	1 1	NSIC MURPHY, G.A	1 1
	NSIC POORE, W.	1 1	NUDOCS FULL TXT	1 1

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK, ROOM P1-37 (EXT. 504-2065) TO ELIMINATE YOUR NAME FROM DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

FULL TEXT CONVERSION REQUIRED
 TOTAL NUMBER OF COPIES REQUIRED: LTTR 33 ENCL 33

Arizona Public Service Company
PALO VERDE NUCLEAR GENERATING STATION
P.O. BOX 52034 • PHOENIX, ARIZONA 85072-2034

JAMES M. LEVINE
VICE PRESIDENT
NUCLEAR PRODUCTION

192-00833-JML/TRB/NLT
March 11, 1993

U. S. Nuclear Regulatory Commission
Attention: Document Control Desk
Mail Station P1-37
Washington, D.C. 20555


Dear Sirs:

Subject: Palo Verde Nuclear Generating Station (PVNGS)
Unit 1
Docket No. STN 50-528 (License No. NPF-41)
Licensee Event Report 93-002-00
File: 93-020-404

Attached please find Licensee Event Report (LER) 93-002 prepared and submitted pursuant to Technical Specification 6.9.3 and 10CFR50.73. This LER reports that a design basis fire in the Control Room, concurrent with a loss of off-site power, could result in a loss of control power to the Train "B" Diesel Generator Output Breaker and Diesel Generator Room Essential Exhaust Fan Breaker, and loss of power to the Diesel Generator Control Panels prior to the repositioning of the transfer switches to the local position for alternate shutdown. In accordance with 10CFR50.73(d), a copy of this LER is being forwarded to the Regional Administrator, NRC Region V.

If you have any questions, please contact T. R. Bradish, Manager, Nuclear Regulatory Affairs at (602) 393-5421.

Very truly yours,

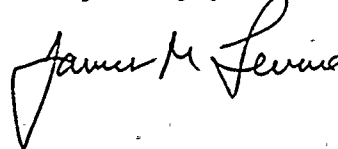

JML/TRB/nlt

Attachment

cc: W. F. Conway (all with attachment)
J. B. Martin
J. A. Sloan
INPO Records Center

9303220029 930311
PDR ADDCK 05000528
S PDR

406048

JK28

