

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 7902080165 DOC. DATE: 79/02/01 NOTARIZED: NO DOCKET #
 FACIL: 50-316 Donald C. Cook Nuclear Power Plant, Unit 2, Indiana & 05000316
 AUTH. NAME: SHALLER, D.V. AUTHOR AFFILIATION: Indiana & Michigan Power Co.
 RECIP. NAME: KEPPLER, J.G. RECIPIENT AFFILIATION: Region 3, Chicago, Office of the Director

SUBJECT: Confirms 790101 verbal rept re wrong setpoint on turbine
 low fluid oil pressure switches (LPS-090,091,092) from
 Jan 1978 to Aug 1978. Followup rept will be submitted to NRC
 by 790213.

DISTRIBUTION CODE: A002S . COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1
 TITLE: INCIDENT REPORTS


NOTES: I & E - 3 cys All Matt.

ACTION:	RECIPIENT	COPIES		RECIPIENT	COPIES	
	ID CODE/NAME	LTTR	ENCL		ID CODE/NAME	LTTR
ACTION:	05 BC ORB #1	4	4			
INTERNAL:	01 REG FILE	1	1	02 NRC PDR	1	1
	09 I&E	2	2	11 MPA	3	3
	14 TA/EDO	1	1	15 NOVAK/KNIEL	1	1
	16 EEB	1	1	17 AD FOR ENGR	1	1
	18 PLANT SYS BR	1	1	19 I&C SYS BR	1	1
	20 AD PLANT SYS	1	1	21 AD SYS/PROJ	1	1
	22 REAC SAFT BR	1	1	23 ENGR BR	1	1
	24 KREGER	1	1	25 PWR SYS BR	1	1
	26 AD/SITE ANAL	1	1	27 OPERA LIC BR	1	1
	28 ACIDENT ANLYS	1	1	E JORDAN/IE	1	1
EXTERNAL:	03 LPDR	1	1	04 NSIC	1	1
	29 ACRS	16	16			

FEB 9 1979

TOTAL NUMBER OF COPIES REQUIRED: LTTR 45 ENCL 45

MA-4
67

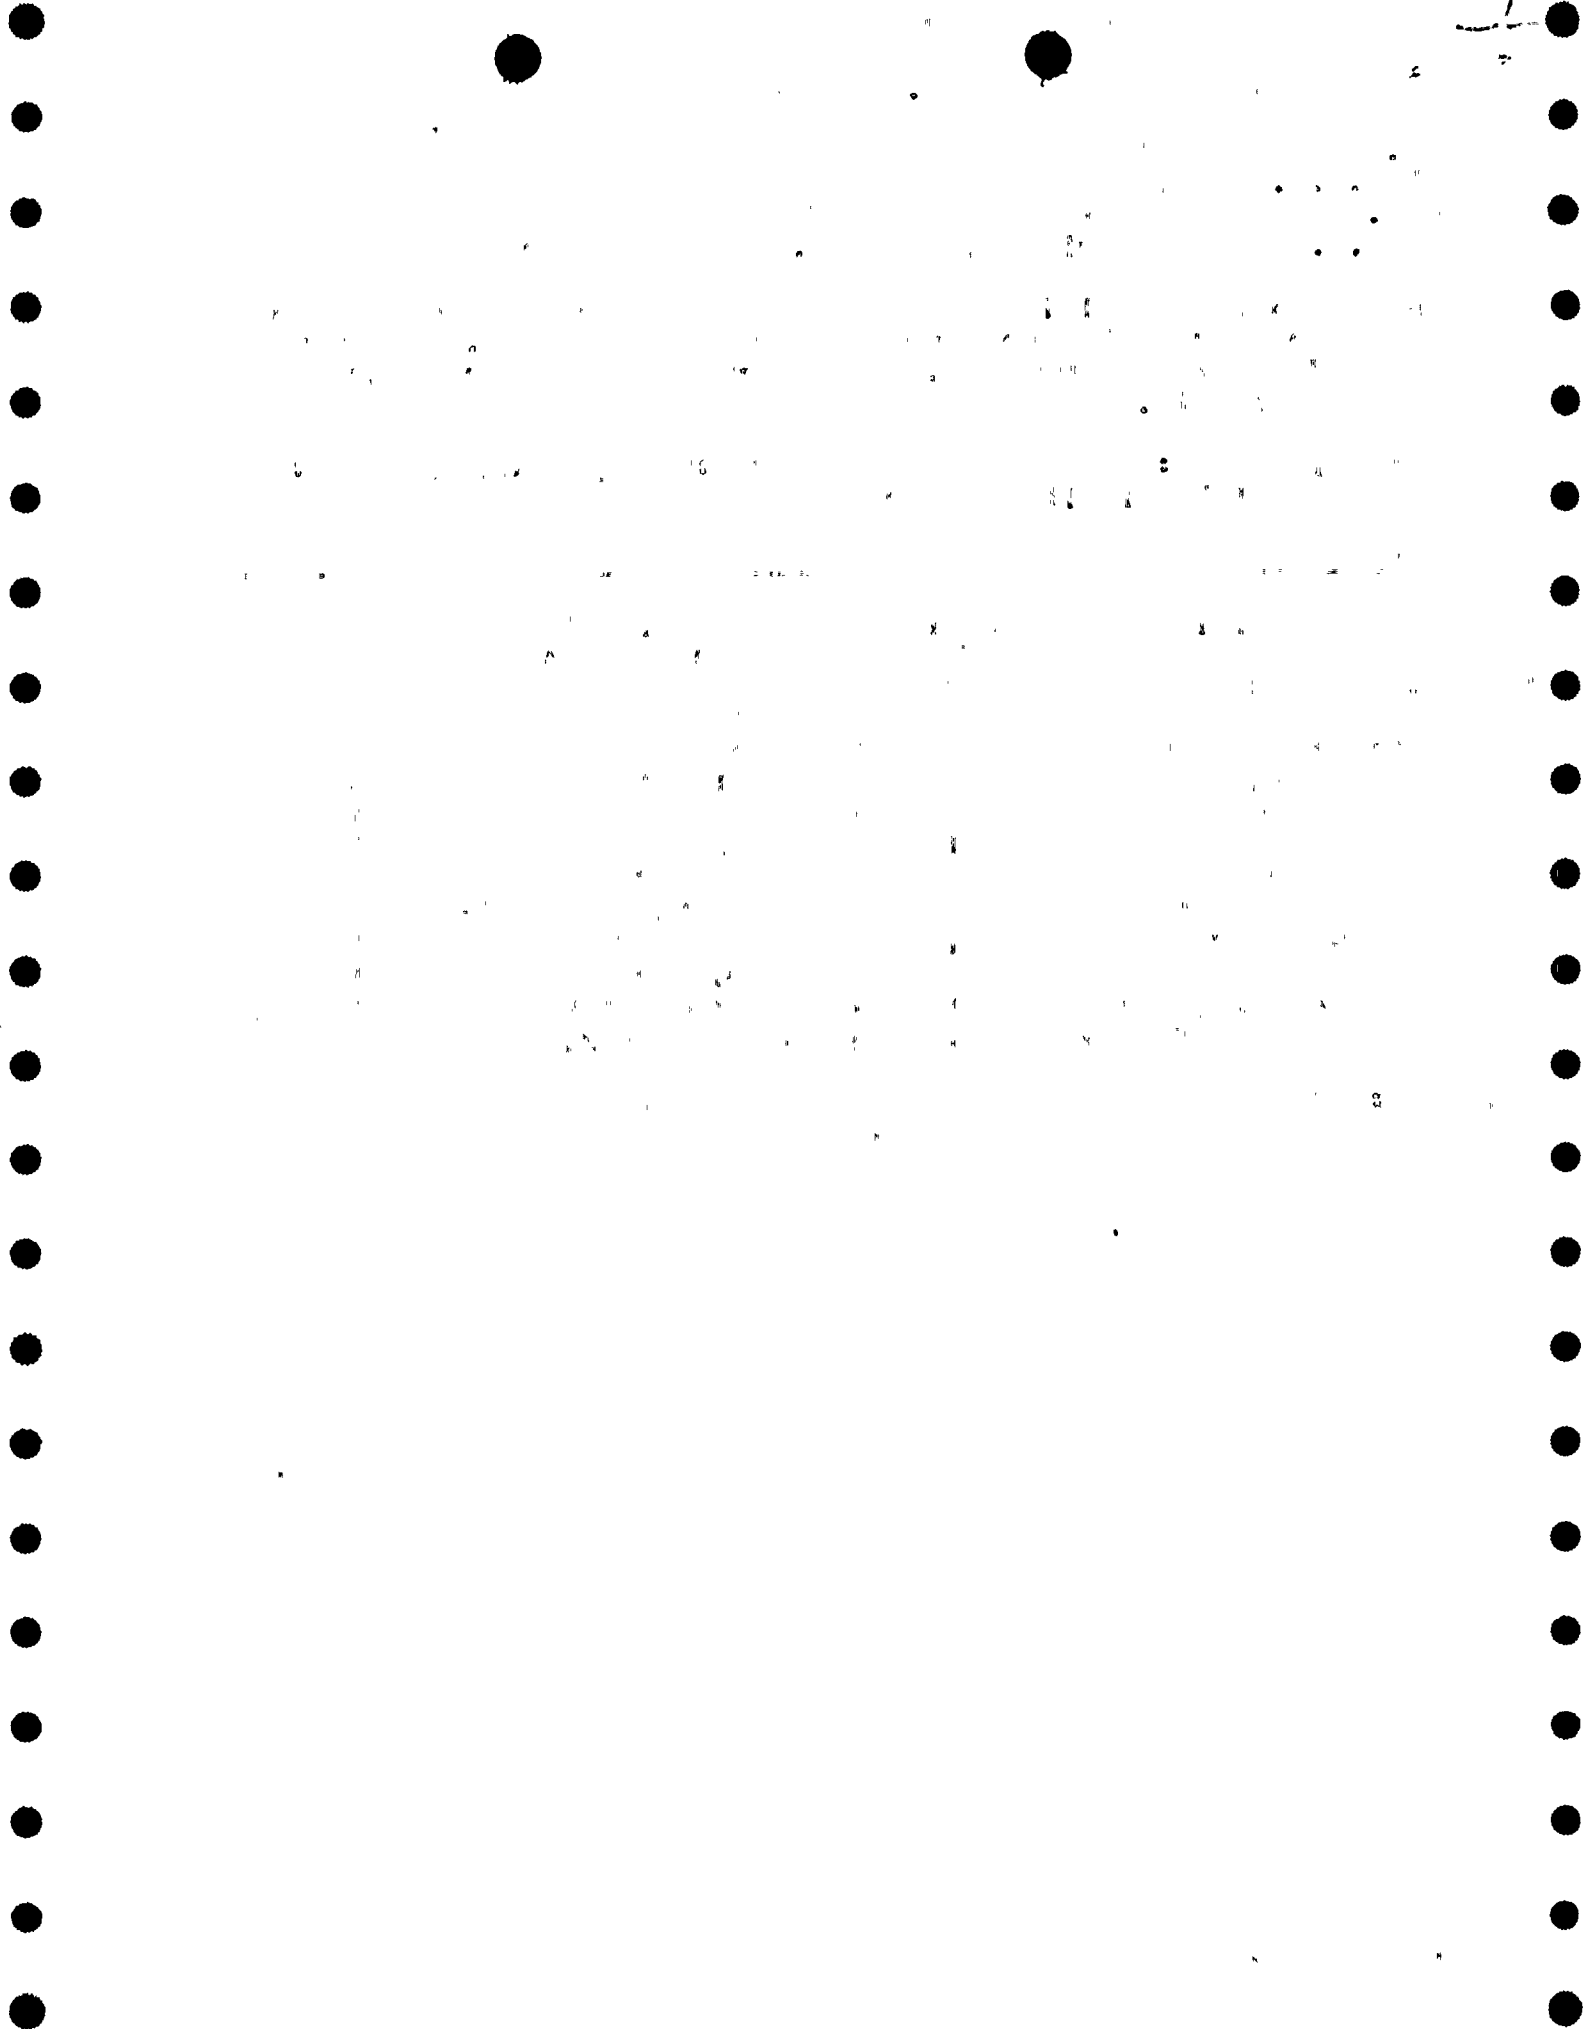



INDIANA & MICHIGAN POWER COMPANY

DONALD C. COOK NUCLEAR PLANT
P.O. Box 458, Bridgman, Michigan 49106

February 1, 1979

Mr. J.G. Keppler, Regional Director
Office of Inspection and Enforcement
United States Nuclear Regulatory Commission
Region III
799 Roosevelt Road
Glen Ellyn, IL 60137

Operating License DPR-74
Docket No. 50-316

Dear Mr. Keppler:

This is to confirm our verbal report to NRC Region III Inspector,
Mr. K.R. Baker, at 1110 hours on February 1, 1979.

At that time we reported that Unit 2 Turbine Low Fluid Oil Pressure
Switches (LPS-090, 091, 092) were set at the wrong setpoint from
January 1978 to August 2, 1978. (Technical Specification Table 2.2-1
Item 17)

A followup report will be submitted by February 13, 1979, as required
by Technical Specification Section 6.9.1.8.

Sincerely,

D.V. Shaller
Plant Manager

/bab

cc: J.E. Dolan
R.W. Jurgensen
R.F. Kroeger
R. Kilburn
R.J. Vollen BPI
K.R. Baker RO:III
R.C. Callen MPSC
P.W. Steketee, Esq.
G. Charnoff, Esq.
R. Walsh, Esq.

G. Olson
J.M. Hennigan
PNSRC
J.F. Stietzel
Dir., IE (40 copies)
Dir., MIPC (4 copies)

EB 5 1979

A002
5/10

dupe 7902080165

10/10/10

10/10/10