

# REGULATOR INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 7903020359 DOC. DATE: 79/02/27 NOTARIZED: NO DOCKET #  
 FACIL: 50-315 DONALD C. COOK NUCLEAR POWER PLANT, UNIT 1, INDIANA & 05000315  
 AUTH. NAME AUTHOR AFFILIATION  
 SHALLER, D.V. INDIANA & MICHIGAN POWER CO.  
 RECIP. NAME RECIPIENT AFFILIATION  
 KEPPLER, J.G. REGION 3, CHICAGO, OFFICE OF THE DIRECTOR

SUBJECT: ON 790226, UNIT 1 CD DIESEL WAS INOPERABLE & 1 AB DIESEL  
 STARTED. FIELD NOT ESTABLISHED FOR 1 AB DIESEL, CAUSING LATTER  
 TO BE DECLARED INOPERABLE FOR SEVEN MINUTES.

DISTRIBUTION CODE: A002S COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1  
 TITLE: INCIDENT REPORTS


NOTES: I + E - 3 cys all MATL

	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
ACTION:	05 BC ORB #1	4		
INTERNAL:	01 REG FILE	1	02 NRC PDR	1
	09 I&E	2	11 MPA	3
	14 TA/EDO	1	15 NOVAK/KNIEL	1
	16 EEB	1	17 AD FOR ENGR	1
	18 PLANT SYS BR	1	19 I&C SYS BR	1
	20 AD PLANT SYS	1	21 AD SYS/PROJ	1
	22 REAC SAFT BR	1	23 ENGR BR	1
	24 KREGER	1	25 PWR SYS BR	1
	26 AD/SITE ANAL	1	27 OPERA LIC BR	1
	28 ACIDENT ANALYS	1	29 AUX SYS BR	1
	E JORDAN/IE	1		
EXTERNAL:	03 LPDR	1	04 NSIC	1
	29 ACRS	16		

MAR 5 1979

TOTAL NUMBER OF COPIES REQUIRED: LTTR 46 ENCL 0

MA-4  
60

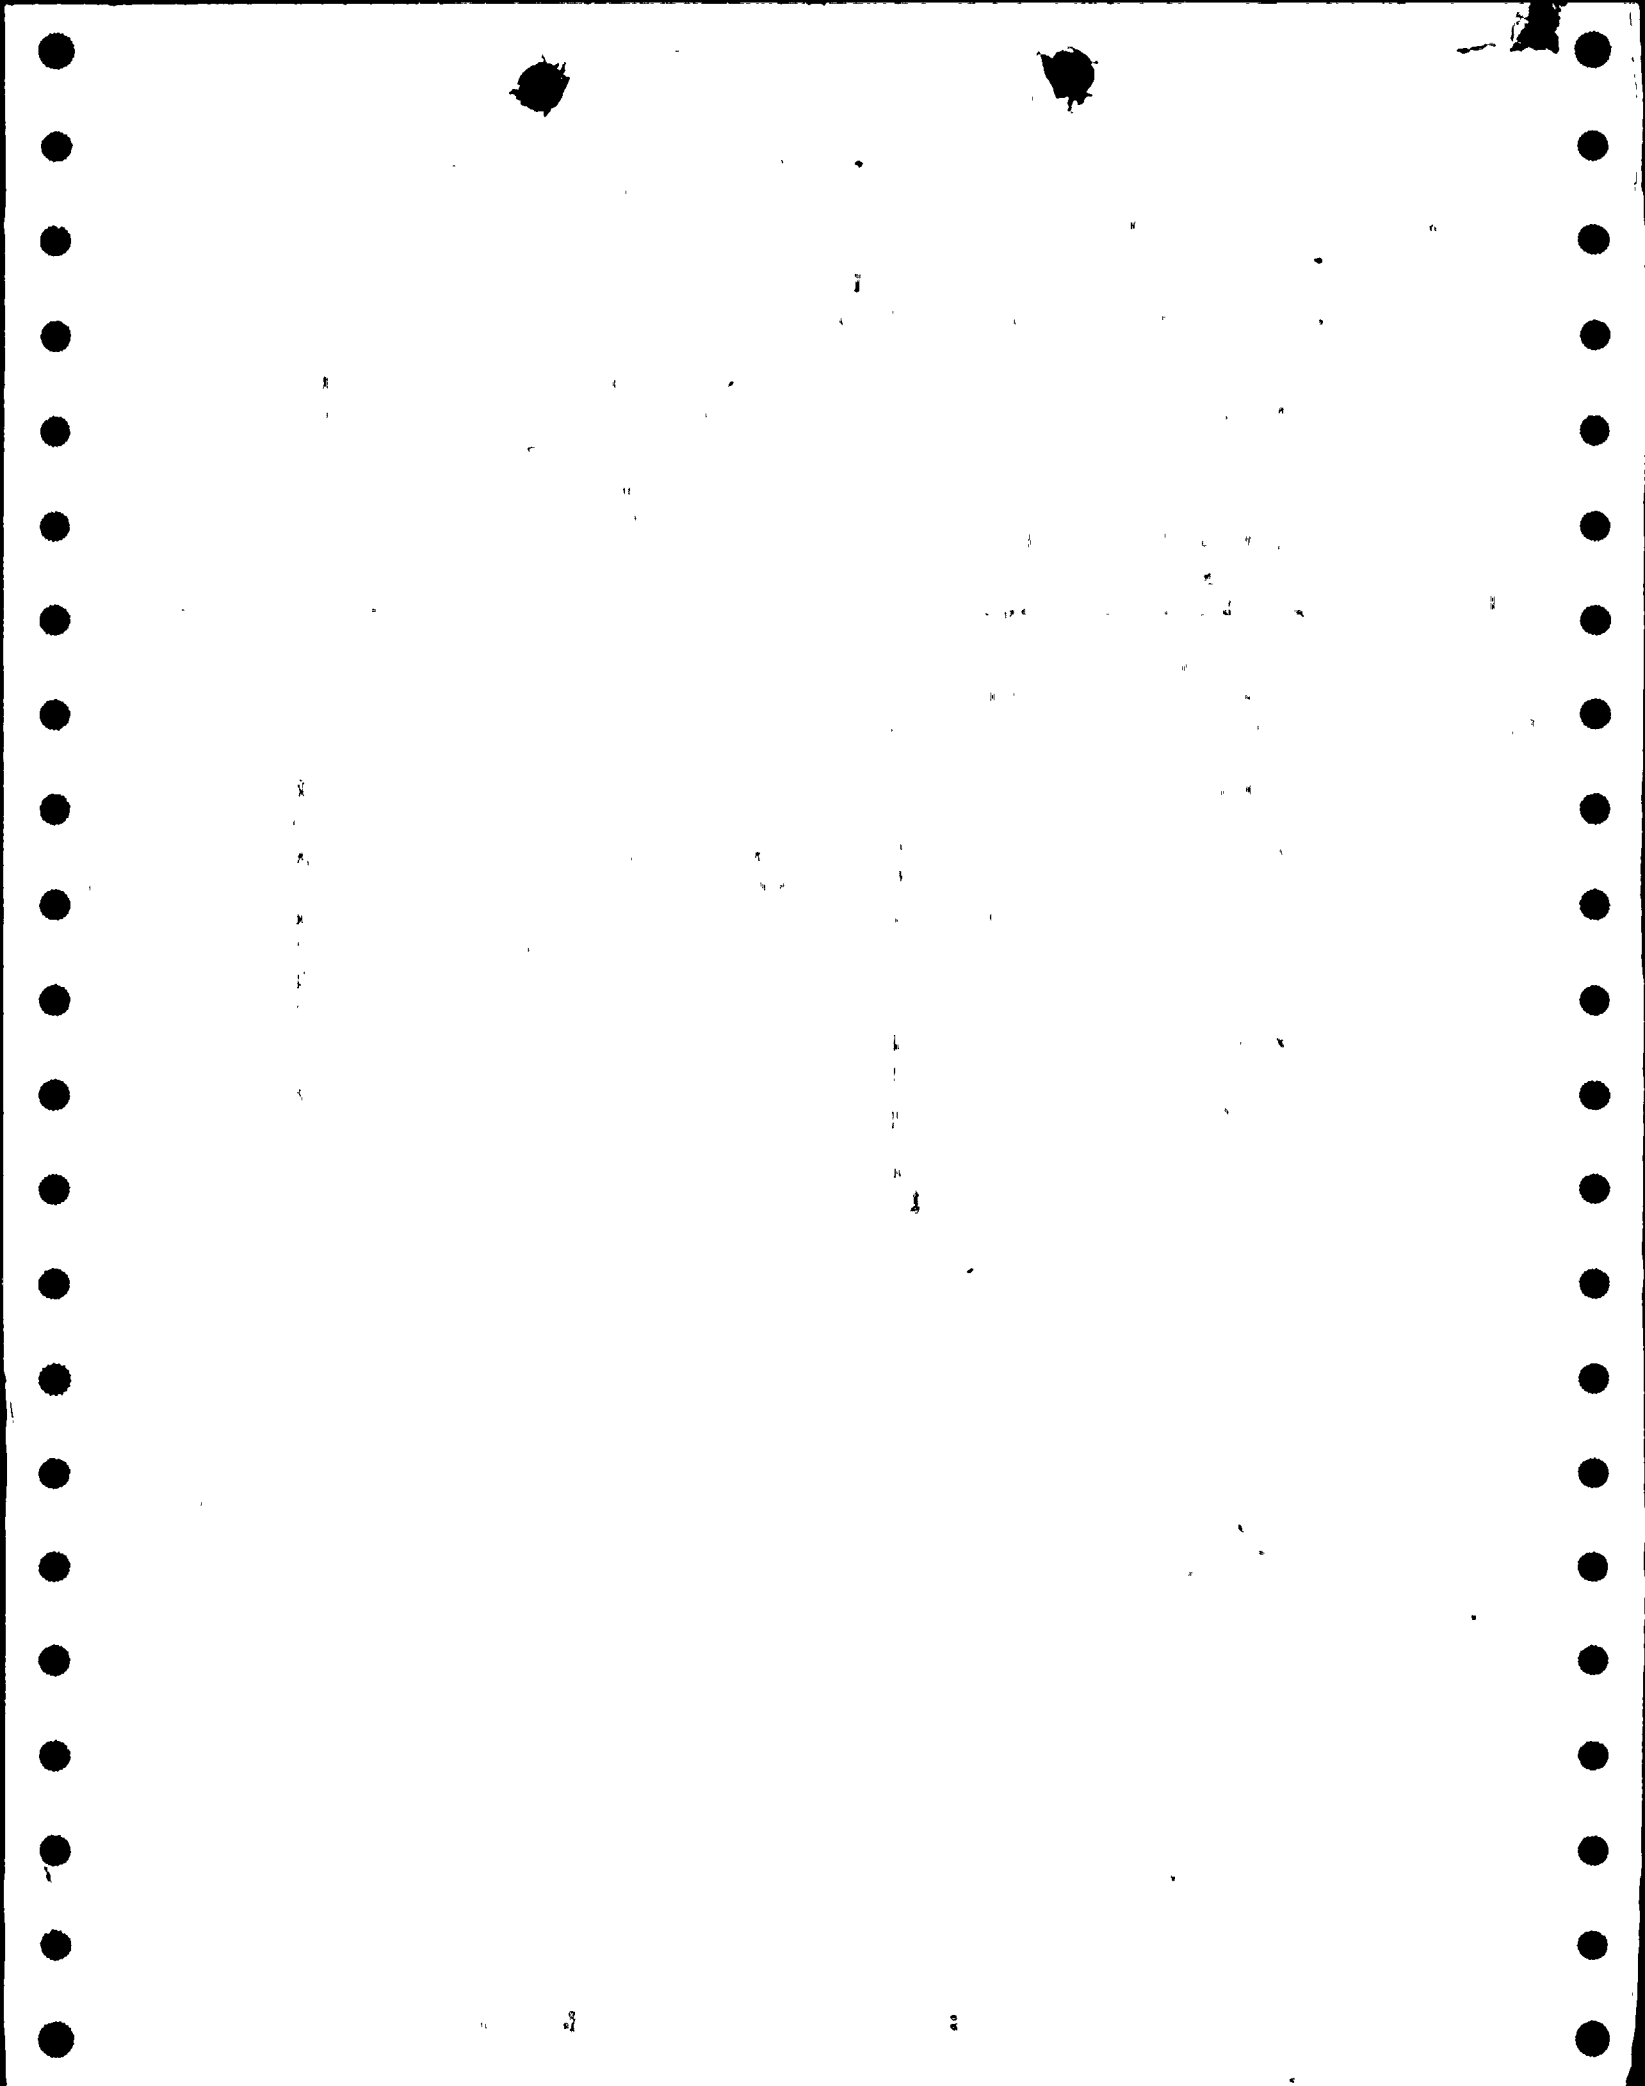



**INDIANA & MICHIGAN POWER COMPANY**

DONALD C. COOK NUCLEAR PLANT  
P.O. Box 458, Bridgman, Michigan 49106

February 27, 1979

Mr. J.G. Keppler, Regional Director  
Office of Inspection and Enforcement  
United States Nuclear Regulatory Commission  
Region III  
799 Roosevelt Road  
Glen Ellyn, IL 60137

Operating License DPR-58  
Docket No. 50-315

Dear Mr. Keppler:

This is to confirm our verbal report to NRC Region III Inspector,  
Mr. K.R. Baker, at 1600 hours on February 26, 1979.

At that time we reported that the Unit 1 CD Diesel was inoperable and  
the 1 AB Diesel was started to meet a surveillance requirement. The 1  
AB Diesel field was not established causing 1 AB Diesel to be declared  
inoperable for seven (7) minutes. (Technical Specification 3.8.1.1)

A followup report will be submitted by March 10, 1979, as required by  
Technical Specification Section 6.9.1.8.

Sincerely,

D.V. Shaller  
Plant Manager

/bab

cc: J.E. Dolan  
R.W. Jurgensen  
R.F. Kroeger  
R. Kilburn  
R.J. Vollen BPI  
K.R. Baker RO:III  
R.C. Callen MPSC  
P.W. Steketee, Esq.  
G. Charnoff, Esq.  
R. Walsh, Esq.  
G. Olson

J.M. Hennigan  
PNSRC  
J.F. Stietzel  
Dir., IE (40 copies)  
Dir., MIPC (4 copies)

REGULATORY DOCKET FILE 7903020359



A027-1

## REGULATOR INFORMATION DISTRIBUTION STEM

DOCKET NBR: 050-315 Cook 1  
 RECIPIENT: Denton, H.R.  
 ORIGINATOR: Tillinghast, J.  
 COMPANY: IN & MI Pwr  
 SUBJECT:

DOC DATE: 781024  
 ACCESSION NBR: 7811030103  
 COPIES RECEIVED:  
 LTR 1 ENCL 25  
 SIZE: 1+132

Forwards 2 copies of Startup Test Rept for Cycle 3 of subj facil.

*(see reports)*

DISTRIBUTION CODE: A027  
 DISTRIBUTION TITLE:  
 REACTOR STARTUP TEST RPT

NOTARIZED ✓

## NAME

## ENCL?

## FOR ACTION

BR CHIEF

W/2 ENCL

~~REG FILE~~

W/ENCL

NRC PDR

W/ENCL

I &amp; E

W/2 ENCL

MIPC

W/ENCL

HANAUER

W/ENCL

PLANT SYSTEMS BR

W/ENCL

EEB

W/ENCL

REACTOR SAFETY BR

W/2 ENCL

CORE PERFORMANCE BR

W/ENCL

LPDR

W/ENCL

TERA

W/ENCL

NSIC

W/ENCL

ACRS

W/ENCL

ORB#1 BC  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

TOTAL NUMBER OF COPIES REQUIRED:

LTR  
 ENCL

17  
 17

NOV 6 1978

NOTES: Repro ltrs

I & E - 3 cys all material.

MA 2  
 60