

REGULATOR INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 7909180340 DOC DATE: 79/09/11 NOTARIZED: NO DOCKET #
 FACIL: 50-315 Donald C. Cook Nuclear Power Plant, Unit 1, Indiana & 05000315
 50-316 Donald C. Cook Nuclear Power Plant, Unit 2, Indiana & 05000316
 AUTH. NAME: AUTHOR AFFILIATION
 NECHODOM, W.S. Exxon Nuclear Co., Inc. (subs. of Exxon Corp.)
 RECIP. NAME: RECIPIENT AFFILIATION
 DENTON, H.R. Office of Nuclear Reactor Regulation

SUBJECT: Forwards proprietary & nonproprietary versions of
 XN-NS-T-009, "Fuel Storage Racks Corrosion Program,
 Boral - Stainless Steel." Proprietary version withheld
 (ref 10CFR2.790).

(see reports 7909180342 prop & non prop)

DISTRIBUTION CODE: A001S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 1+22
 TITLE: General Distribution for After Issuance of Operating Lic

NOTES: I & E - 3 cys ALL MATL.

ACTION:	RECIPIENT		COPIES		RECIPIENT	COPIES	
	ID CODE/NAME	LTTR ENCL	ID CODE/NAME	LTTR ENCL			
INTERNAL:	01 REG FILE	1 1	02 NRC PDR	1 1			
	12 I&E	2 2	14 TA/EDO	1 1			
	15 CORE PERF BR	1 1	17 ENGR BR	1 1			
	18 REAC SFTY BR	1 1	19 PLANT SYS BR	1 1			
	20 EEB	1 1	21 EFLT TRT SYS	1 1			
	22 BRINKMAN	1 1	OELD	1 0			
EXTERNAL:	03 LPDR	1 1	04 NSIC	1 1			
	23 ACRS	16 16					

PROP NP
 FILES (2) #1 & 2 FILES
 D. WIGGINTON (2) #3 NRC PDR
 TERA
 I & E (2)


PROP cys ADVANCED TO:
 ENG BR
 SEISMIC REV-DOR
 D WIGGINTON

1 SEP 82

MA 2

GO

TOTAL NUMBER OF COPIES REQUIRED: LTR 38 ENCL 37

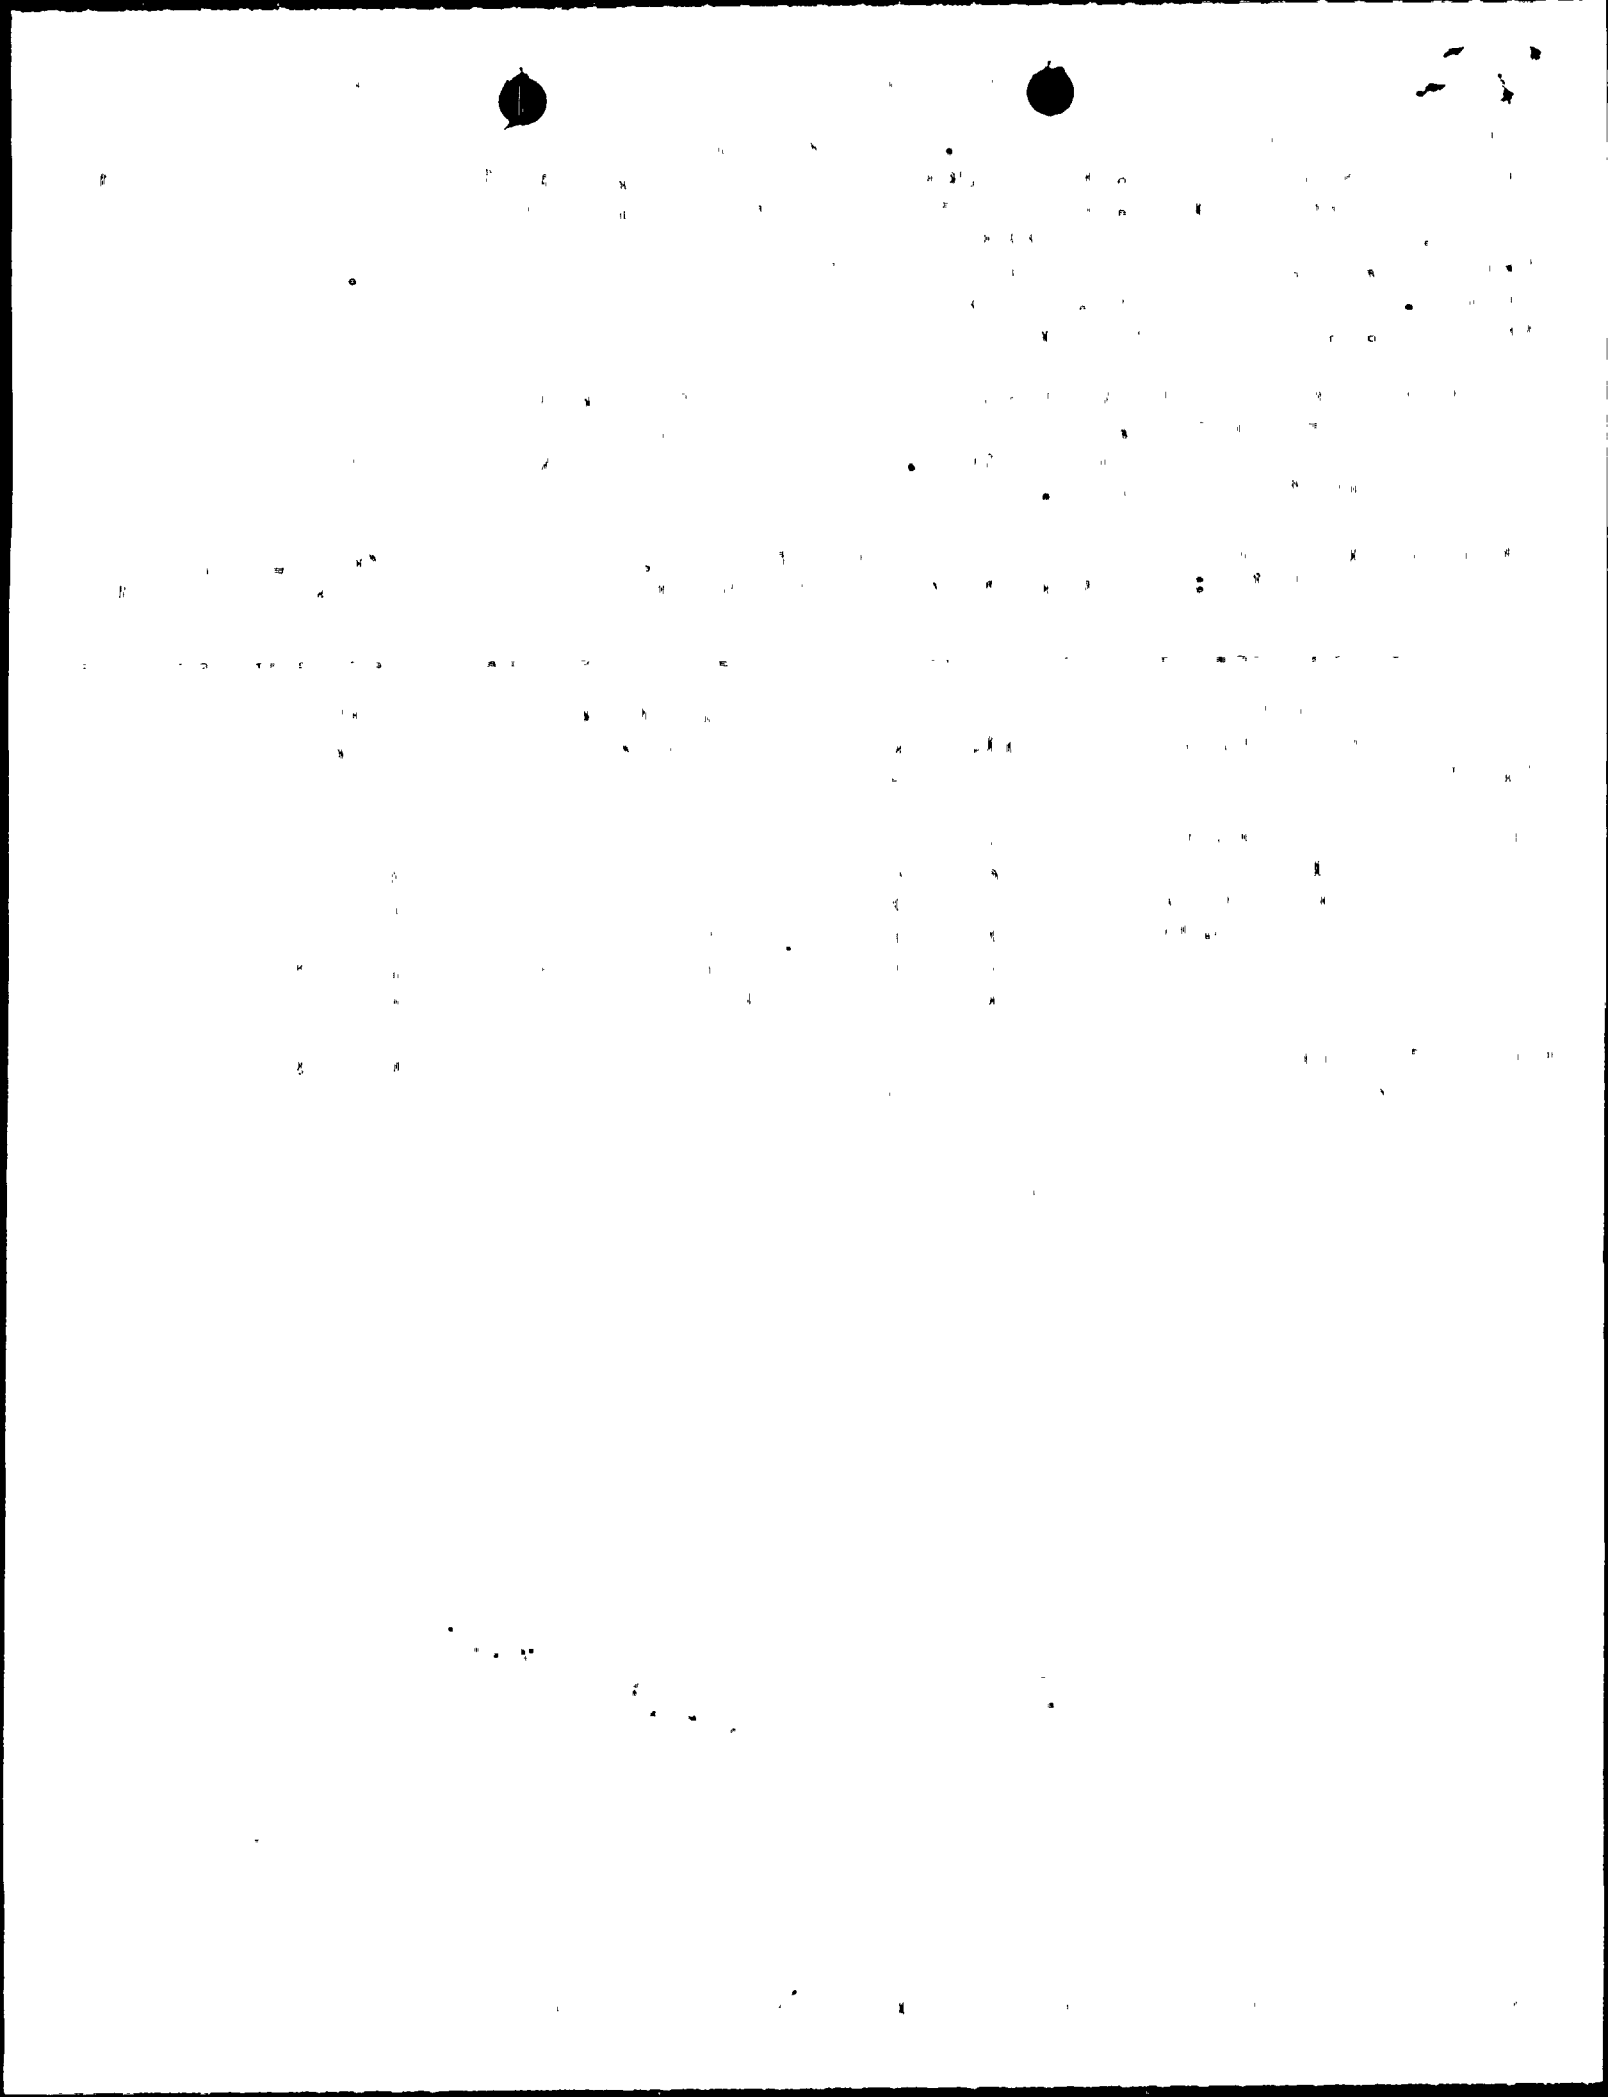

EXXON NUCLEAR COMPANY, Inc.
RESEARCH AND TECHNOLOGY CENTER
2955 George Washington Way, Richland, Washington 99352
PHONE: (509) 943-7100

September 11, 1979

U. S. Nuclear Regulatory Commission
Washington, D.C. 20555

Attn: Mr. Harold C. Denton

SUBJECT: DOCKET NO's. 50-315, 50-316 - D. C. COOK

Reference: 1) Letter, AEP:NRC:00213B to H. C. Denton.

- 2) XN-NS-TP-009, "Fuel Storage Racks Corrosion Program
Boral-Stainless Steel", Exxon Nuclear Co., November 9,
1978 (Proprietary).
- 3) XN-NS-TP-009-NP; "Fuel Storage Racks Corrosion Program,
Boral-Stainless Steel", Exxon Nuclear Co., March 1979,
(Non-Proprietary).

In reference 1, American Electric Power indicated that the referenced corrosion reports are being transmitted separately. Accordingly, I am enclosing seven copies each of References 2 and 3. In addition, at Mr. Wigginton's request I am transmitting one copy of Reference 3 directly to the local public docket file in St. Joseph, Michigan.

Sincerely,

Walter Nechodom

W. S. Nechodom, Manager
Licensing and Compliance

WSN:slr

REGULATORY DOCKET FILE COPY

8909180 340

AN AFFILIATE OF EXXON CORPORATION

A001
1/7
PROP
FILES(2)
WIGGINTON(2)
NRC FOR
TERA
I-E(2)
PROP CYS ADVANCED
TO:
ENG. BR
SEISMIC REV-DOR
D WIGGINTON

DOCKET NO. 50-315/316

DATE: _____

NOTE TO NRC AND/OR LOCAL PUBLIC DOCUMENT ROOMS

The following item submitted with letter dated 9/11/79
from Exxon Nuclear Co. is being withheld from public
disclosure in accordance with Section 2.790.

PROPRIETARY INFORMATION

Versions of KW-NS-T-009 "Fuel Storage Racks
Corrosion Program Base/ - Stainless steel

Roland Wood
0/6

Distribution Service's Branch