

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8104070270. DOC. DATE: 81/03/31. NOTARIZED: NO DOCKET #
 FACIL: 50-316 Donald C. Cook Nuclear Power Plant, Unit 2, Indiana & 05000316
 AUTH. NAME: AUTHOR AFFILIATION
 SHALLER, D.V. Indiana & Michigan Electric Co.
 RECIP. NAME: RECIPIENT AFFILIATION
 KEPPLER, J.G. Region 3, Chicago, Office of the Director

SUBJECT: RO: on 810331, low level alarm contacts on spray additive tank;
 discovered wired backwards precluding low level alarm from
 annunciating. Followup rept to be submitted by 810413.

DISTRIBUTION CODE: M007S COPIES RECEIVED: LTR 1 ENCL 2 SIZE: 1/11
 TITLE: LER (Backfit)

NOTES: Send 3 copies of all material to I&E.


05000316


RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
INTERNAL: AEOD	2	ASLBP/J. HARD	1
I&E	2	MPA	1
NRG PDR	1	OP EX EVAL BR	1
REG. FILE	1		
EXTERNAL: LPDR	03	NSIC	1

APR 9 1981

TOTAL NUMBER OF COPIES REQUIRED: LTTR


14 ENCL 0

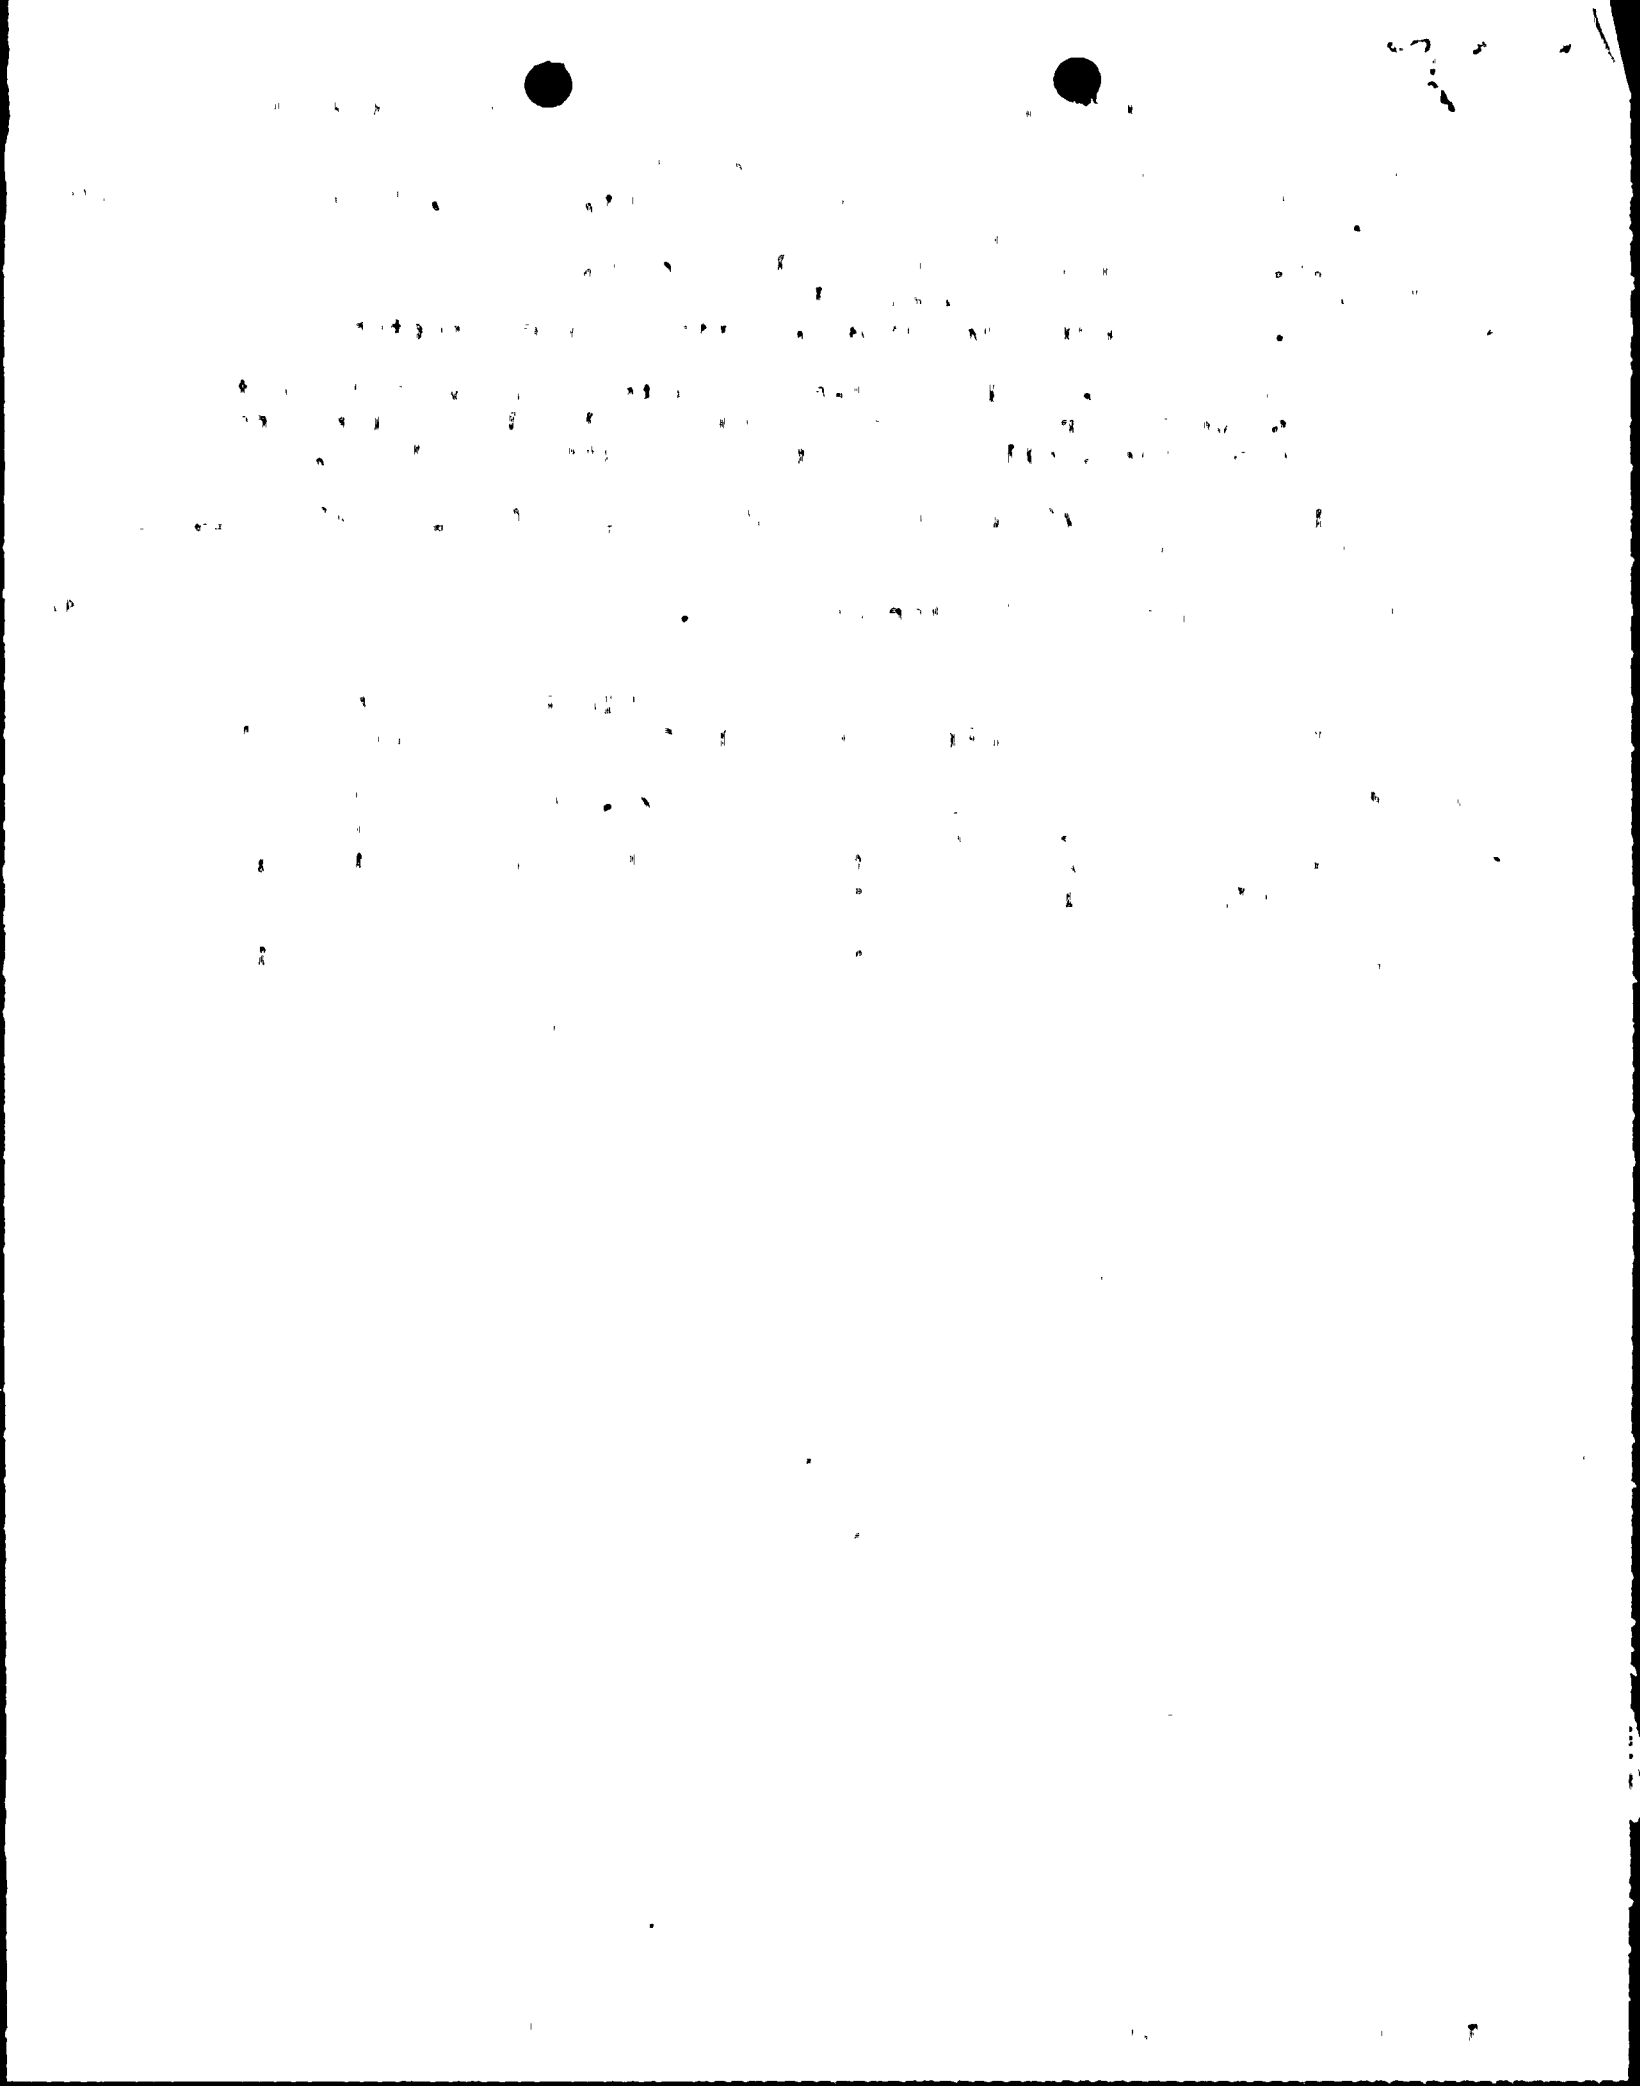



INDIANA & MICHIGAN ELECTRIC COMPANY

DONALD C. COOK NUCLEAR PLANT
P.O. Box 458, Bridgman, Michigan 49106
(616) 465-5901

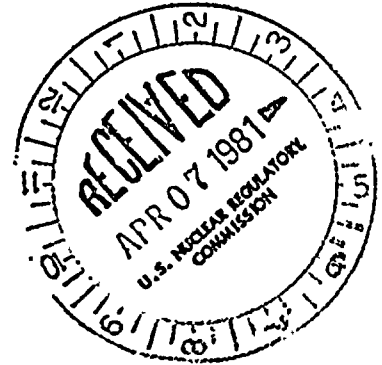

March 31, 1981

Mr. J.G. Keppler, Regional Director
Office of Inspection and Enforcement
United States Nuclear Regulatory Commission
Region III
799 Roosevelt Road
Glen Ellyn, IL 60137

Operating License DPR-74
Docket No. 50-316

Dear Mr. Keppler:

This is to confirm our verbal report to Mr. E. Swanson, NRC Region III Inspector, at 1000 hours on March 31, 1981. At that time we reported that during an eighteen month surveillance on the Unit #2 Spray Additive Tank it was discovered that the low level alarm contacts were wired backwards precluding the low level alarm from annunciating.

A followup report will be submitted by April 13, 1981, as required by Technical Specification Section 6.9.1.8.

Sincerely,

D.V. Shaller
Plant Manager

/bab

cc: J.E. Dolan
R.S. Hunter
R.W. Jurgensen
R.F. Kroeger
R.W. Kilburn
E. Swanson/N. DuBry RO:III
R.C. Callen MPSC
J.M. Hennigan
W. Lavallee EPRI
PNSRC
J.F. Stietzel
E.L. Townley
Dir., IE (40 copies)
Dir., MIPC (4 copies)

M007
S
1/0

APR 2 1981

