

# REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)


ACCESSION NBR: 8411280293 DOC. DATE: 84/11/21 NOTARIZED: NO DOCKET #  
 FACIL: 50-315 Donald C. Cook Nuclear Power Plant, Unit 1, Indiana & 05000315  
 50-316 Donald C. Cook Nuclear Power Plant, Unit 2, Indiana & 05000316  
 AUTH. NAME AUTHOR AFFILIATION  
 ALEXICH, M. P. Indiana & Michigan Electric Co.  
 RECIP. NAME RECIPIENT AFFILIATION  
 Record Services Branch (Document Control Desk)

SUBJECT: Forwards Rev 1 to General Procedure 15.1, "Noncompliance & Corrective Action." Rev corrects noncompliance identified during emergency response exercises.

DISTRIBUTION CODE: A045D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2+37  
 TITLE: OR Submittal Emergency Prep Correspondence

NOTES: OL: 10/25/74 05000315  
 OL: 12/23/72 05000316

|           | RECIPIENT<br>ID CODE/NAME | COPIES<br>LTTR ENCL |  | RECIPIENT<br>ID CODE/NAME | COPIES<br>LTTR ENCL |
|-----------|---------------------------|---------------------|--|---------------------------|---------------------|
|           | NRR ORB1 BC               | 1 1                 |  | NRR ORB1 LA               | 1 0                 |
|           | WIGGINGTON, D 01          | 1 1                 |  |                           |                     |
| INTERNAL: | IE/DEPER/EPB 06           | 2 2                 |  | IE/DEPER/IRB 12           | 1 1                 |
|           | NRR/DSI/AEB               | 1 1                 |  | NRR/DSI/RAB               | 1 1                 |
|           | REG FILES 04              | 1 1                 |  | RGN3                      | 1 1                 |
|           | RGN2/DRSS/EPRPB           | 1 1                 |  |                           |                     |
| EXTERNAL: | FEMA TECH HAZ             | 1 1                 |  | LPDR 03                   | 2 2                 |
|           | NRC PDR 02                | 1 1                 |  | NSIC                      | 1 1                 |
|           | NTIS 05                   | 1 1                 |  |                           |                     |

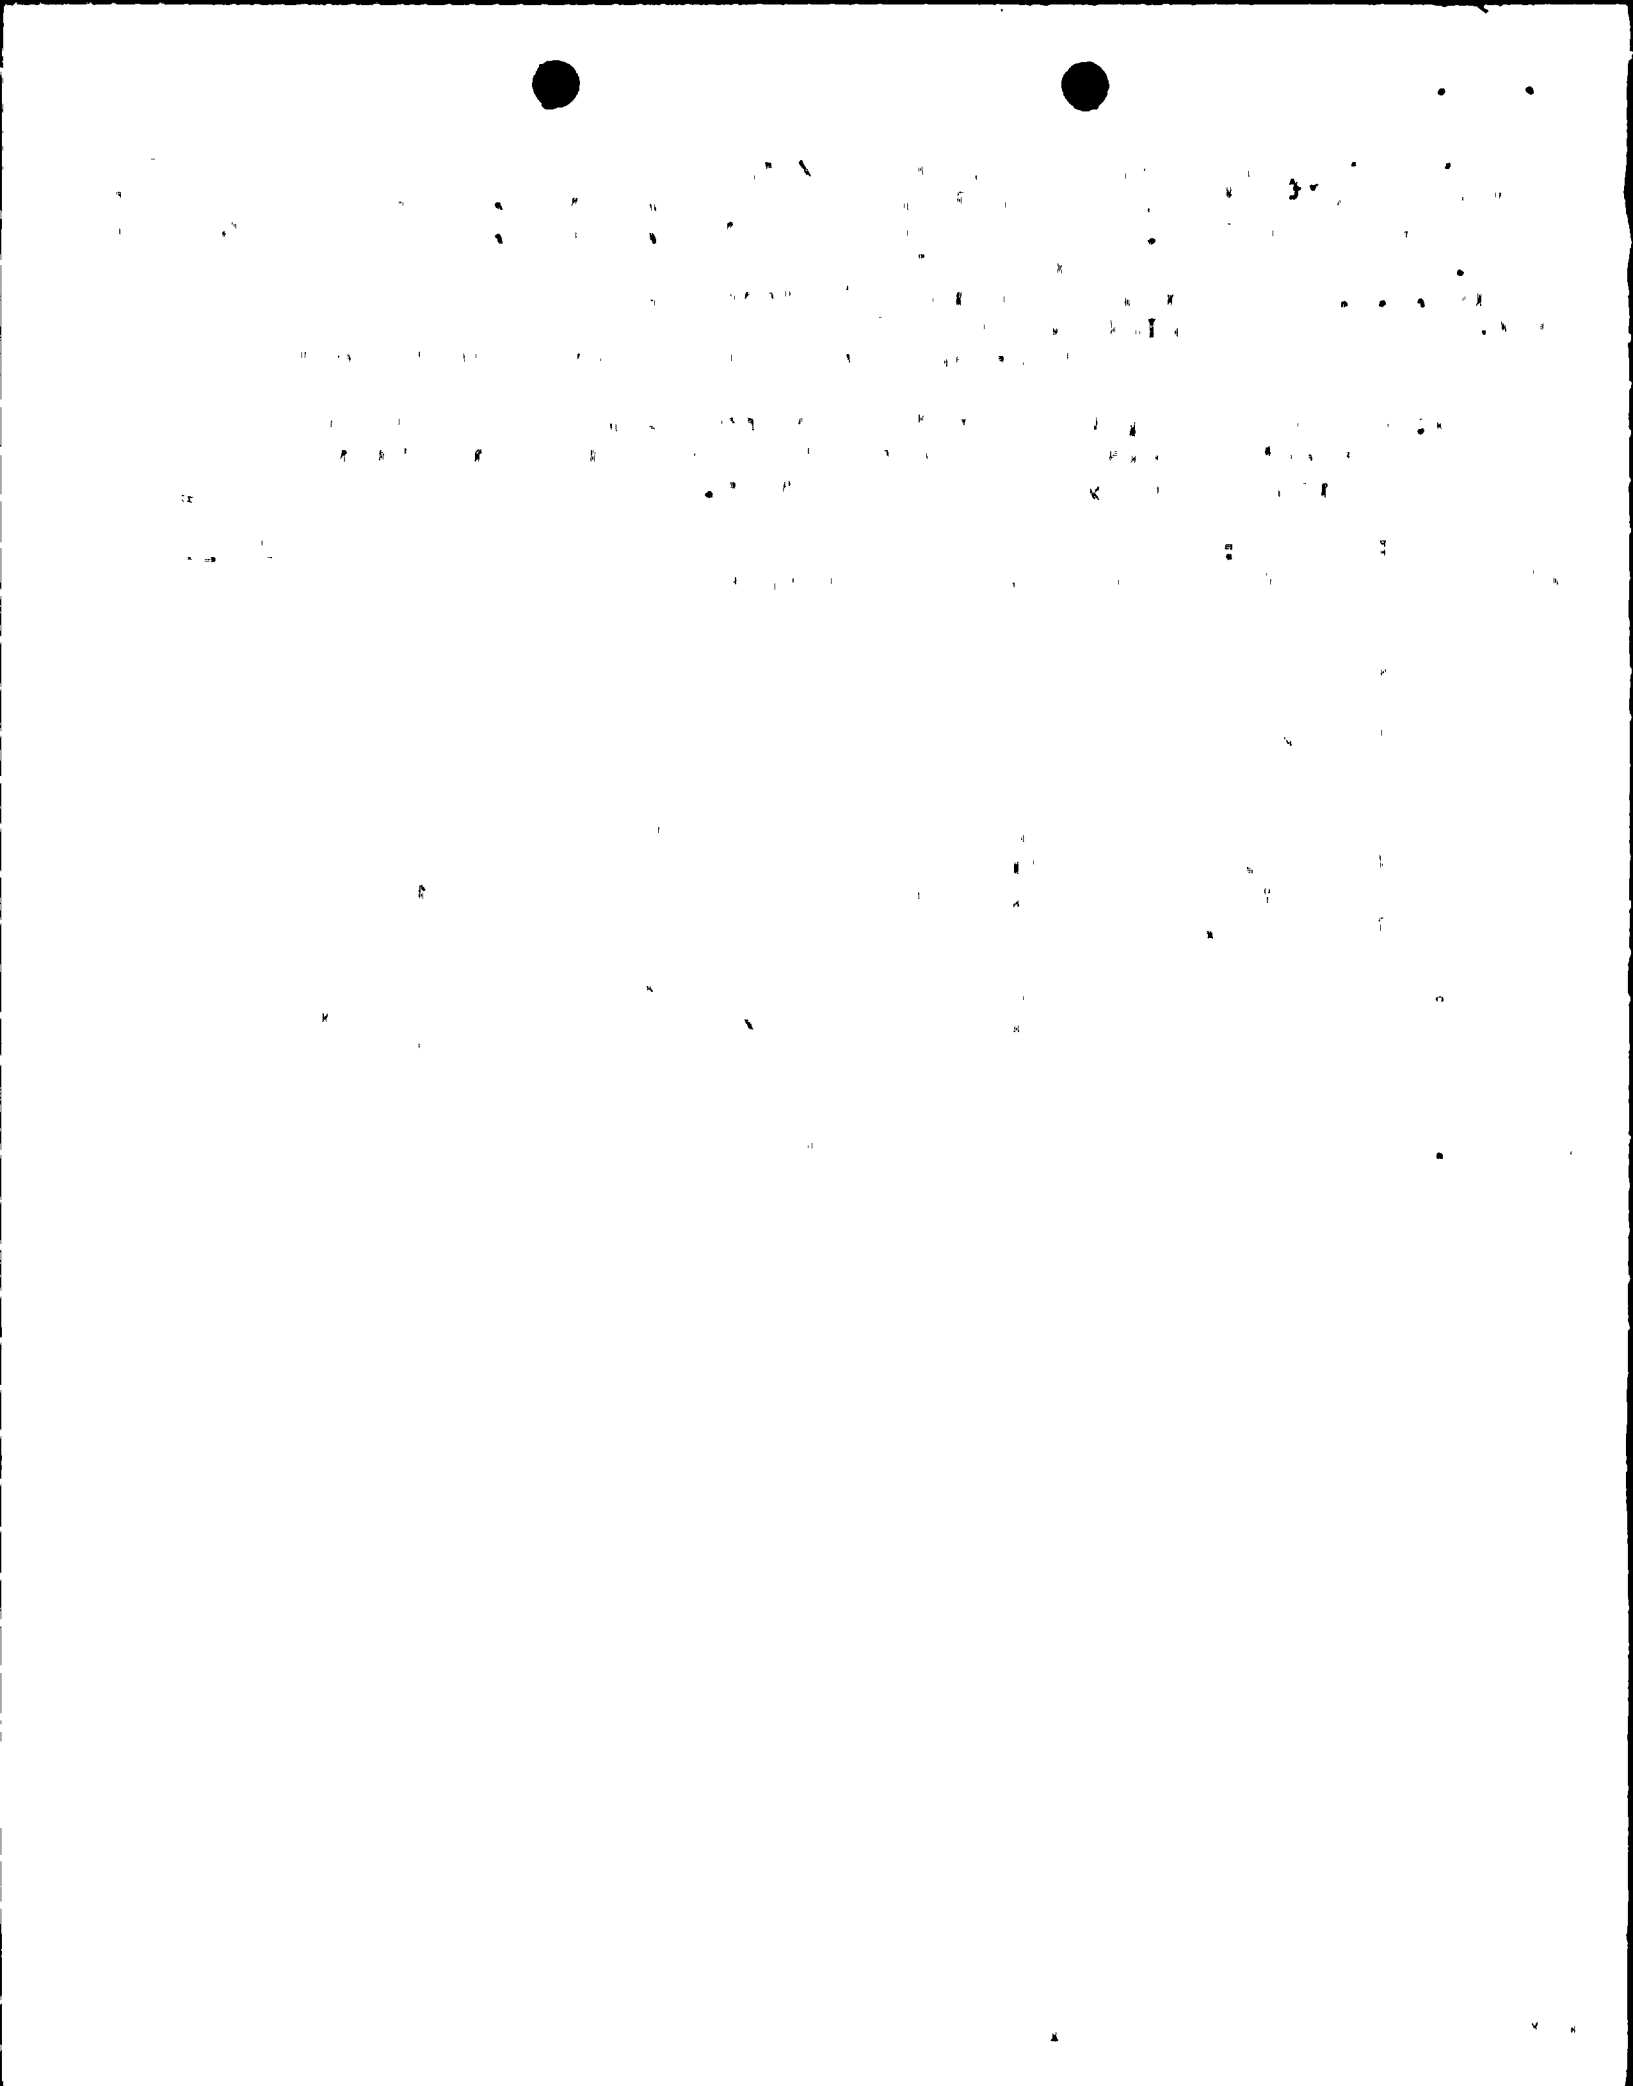

# INDIANA & MICHIGAN ELECTRIC COMPANY

P.O. BOX 16631  
COLUMBUS, OHIO 43216

November 21, 1984

AEP:NRC:0848M

Donald C. Cook Nuclear Plant Unit Nos. 1 and 2  
Docket Nos. 50-315 and 50-316  
License Nos. DPR-58 and DPR-74  
EMERGENCY RESPONSE PREPAREDNESS GENERAL PROCEDURES  
FOR AMERICAN ELECTRIC POWER SERVICE CORPORATION AND  
THE DONALD C. COOK NUCLEAR PLANT


Document Control Desk  
U.S. Nuclear Regulatory Commission  
Washington, D.C. 20555

To Whom It May Concern:

Pursuant to 10 CFR 50.54(q) and 10 CFR 50, Appendix E, Section V, enclosed are three copies of the latest revisions to AEPSC General Procedure No. 15.1, Rev. 1 (Change Sheet Nos. 3 and 4). This procedure is used to effect corrective action for noncompliances identified during AEPSC participation in emergency response exercises associated with the Donald C. Cook Nuclear Plant.

This document has been prepared following Corporate procedures which incorporate a reasonable set of controls to insure its accuracy and completeness prior to signature by the undersigned.

Very truly yours,

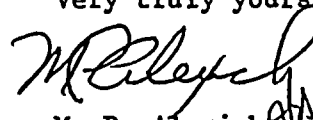  
M. P. Alexich  
Vice President

th

Enclosure

cc: John E. Dolan (w/o enclosure)  
W. G. Smith, Jr. - Bridgman (w/o enclosure)  
R. C. Callen (w/o enclosure)  
G. Bruchmann (w/o enclosure)  
G. Charnoff (w/o enclosure)  
NRC Resident Inspector - Bridgman (w/o enclosure)

8411280273 841121  
PDR ADDCK 05000315  
F PDR

A045  
11



# CONTROLLED DOCUMENT TRANSMITTAL ACKNOWLEDGEMENT

TO: NRC Bethesda

QA FILE NO.: G00002

DATE: 11-06-84

CONTROLLED COPY NO.:

THIS IS TO ACKNOWLEDGE RECEIPT OF THE  
CONTROLLED DOCUMENT ISSUE PACKAGE  
CONSISTING OF THE FOLLOWING:

| DOCUMENT TITLE  |                    |
|---|--------------------|
| AEPSC General Procedures Manual Index   |                    |
| THIS ISSUE IS: <input type="checkbox"/> ORIGINAL ISSUE <input type="checkbox"/> PARTIAL REVISION <input checked="" type="checkbox"/> RE-ISSUE OF COMPLETE DOCUMENT WITH REVISIONS |                    |
| QA-11-84  |                    |
| REV. NO. 58   | DATE: 11/09/84     |
| DCN: G00002   | CDRAR: REV. NO. 4  |
| DATE: 08-23-84  |                    |
| QA-11-84  |                    |
| CDAL: REV. NO. ---  | DATE: 08-16-84     |
| DCN: G00002   | QA FILE NO: G00002 |

| DOCUMENT TITLE  |                    |
|---|--------------------|
| AEPSC General Procedure Change Sheet No. 4  |                    |
| General Procedure 15.1 Noncompliance and Corrective Action  |                    |
| THIS ISSUE IS: <input type="checkbox"/> ORIGINAL ISSUE <input checked="" type="checkbox"/> PARTIAL REVISION <input type="checkbox"/> RE-ISSUE OF COMPLETE DOCUMENT WITH REVISIONS |                    |
| QA-11-84  |                    |
| REV. NO. 1  | DATE: 11/09/84     |
| DCN: G00002   | CDRAR: REV. NO. 4  |
| DATE: 08/23/84  |                    |
| QA-11-84  |                    |
| CDAL: REV. NO. ---  | DATE: 08/16/84     |
| DCN: G00002   | QA FILE NO: G00002 |

| DOCUMENT TITLE   |                       |
|--|-----------------------|
|  |                       |
| THIS ISSUE IS: <input type="checkbox"/> ORIGINAL ISSUE <input type="checkbox"/> PARTIAL REVISION <input type="checkbox"/> RE-ISSUE OF COMPLETE DOCUMENT WITH REVISIONS |                       |
| REV. NO. _____   | DATE: _____           |
| DCN: _____   | CDRAR: REV. NO. _____ |
| DATE: _____  |                       |
| CDAL: REV. NO. _____   | DATE: _____           |
| DCN: _____   | QA FILE NO: _____     |

RECEIPT ACKNOWLEDGEMENT SIGNATURE: \_\_\_\_\_

REGISTERED HOLDER

DATE:

RETURN TO: W.D. Geiger  
1 Riverside Plaza  
ROOM NO.: 20th floor (AEPSC QA)

ORIGINATOR

