

# REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)


ACCESSION NBR: 8710160368 DOC. DATE: 87/10/08 NOTARIZED: NO DOCKET #  
 FACIL: 50-315 Donald C. Cook Nuclear Power Plant, Unit 1, Indiana & 05000315  
 50-316 Donald C. Cook Nuclear Power Plant, Unit 2, Indiana & 05000316  
 AUTH. NAME AUTHOR AFFILIATION  
 SMITH, W. G. Indiana & Michigan Electric Co.  
 RECIP. NAME RECIPIENT AFFILIATION  
 DAVIS, A. B. Document Control Branch (Document Control Desk)

SUBJECT: Special rept: on 870911, fire door for facility pressurizer  
 heater transformer room inoperable for undetermined length  
 of time. Caused by personnel error. Safety pins immediately  
 removed & door returned to operable status.

DISTRIBUTION CODE: IE22D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 2  
 TITLE: 50.73 Licensee Event Report (LER), Incident Rpt, etc.

## NOTES:

	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
	PD3-3 LA	1	PD3-3 PD	1
	WIGGINGTON, D	1		
INTERNAL:	ACRS MICHELSON	1	ACRS MOELLER	2
	AEOD/DOA	1	AEOD/DSP/NAS	1
	AEOD/DSP/ROAB	2	AEOD/DSP/TPAB	1
	ARM/DCTS/DAB	1	DEDRO	1
	NRR/DEST/ADS	1	NRR/DEST/CEB	1
	NRR/DEST/ELB	1	NRR/DEST/ICSB	1
	NRR/DEST/MEB	1	NRR/DEST/MTB	1
	NRR/DEST/PSB	1	NRR/DEST/RSB	1
	NRR/DEST/SGB	1	NRR/DLPQ/HFB	1
	NRR/DLPQ/QAB	1	NRR/DOEA/EAB	1
	NRR/DREP/RAB	1	NRR/DREP/RPB	2
	NRR/DRIS/SIB	1	NRR/PMAS/ILRB	1
	<del>REG FILE</del> 02	1	RES DEPY GI	1
	RES TELFORD, J	1	RES/DE/EIB	1
	RGN3 FILE 01	1		
EXTERNAL:	EG&G GROH, M	5	H ST LOBBY WARD	1
	LPDR	1	NRC PDR	1
	NSIC HARRIS, J	1	NSIC MAYS, G	1

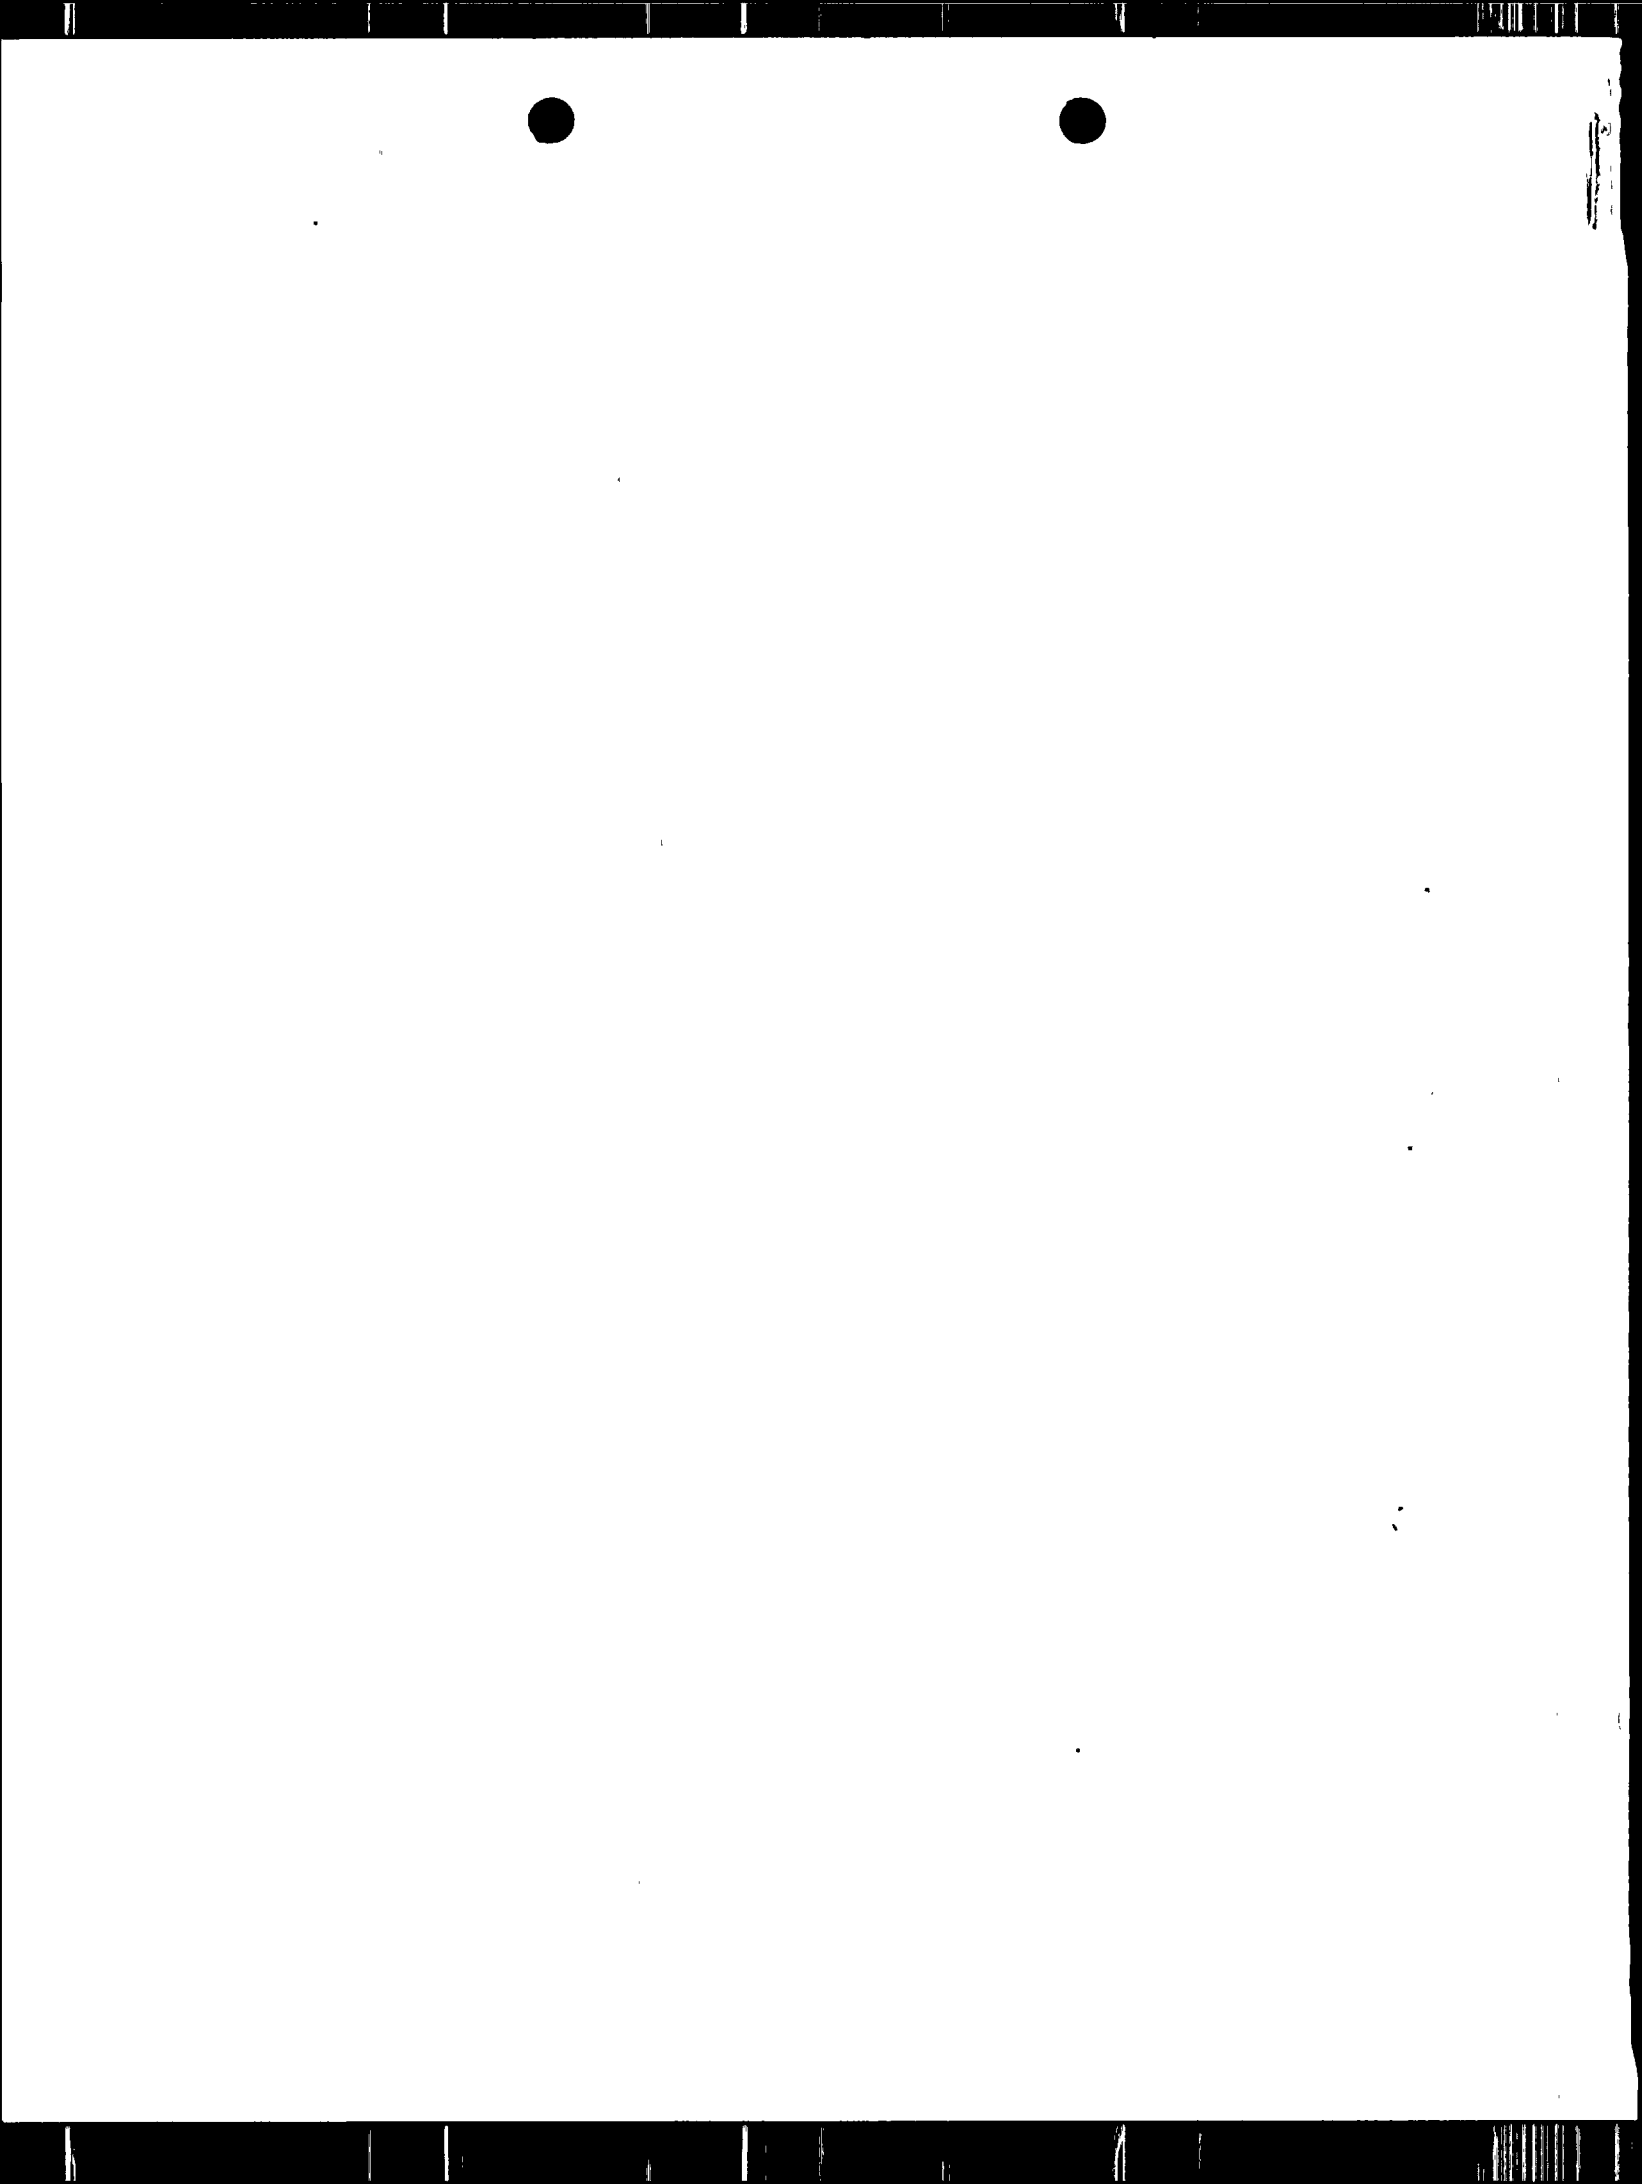

Indiana Michigan  
Power Company  
Cook Nuclear Plant  
P.O. Box 458  
Bridgman, MI 49106  
616 465 5901

USNRC-DS

1987 OCT 17 A 10:03



October 8, 1987

Donald C. Cook Nuclear Plant Unit Nos. 1 and 2  
Docket Nos. 50-315 and 50-316  
License Nos. DPR-58 and DPR-74.

U.S. Nuclear Regulatory Commission  
Document Control Desk  
Washington, D.C. 20555

Attn: A.B. Davis

Dear Mr. Davis:

This letter is to inform you that on September 11, 1987, Fire Door 314 for the Unit One Pressurizer Heater Transformer Room was inoperable for an undetermined length of time. During this time period the appropriate fire watch as required by Technical Specification 3.7.10 Action (a) was not established.

Fire Door 314 is an over head roll up fire door and provides the only entrance and exit from this area. Safety pins have been provided such, that, when inserted into holes in the door tracks, will prevent the door from closing all the way in the event of a fire or explosion while personnel are in the room. On September 11, 1987, a person unknown entered the Pressurizer Heater Transformer Room and upon exiting failed to remove the safety pins thus leaving the fire barrier in a degraded condition. Upon discovery the safety pins were immediately removed and the door returned to operable status.

A technical evaluation successfully demonstrated that, in the event of a fire, it is unlikely that the open fire door would have allowed damage to adjacent fire areas. Since it can not be determined that the door was left unattended less than one hour, the failure to post the required fire watch is being reported through this special report.

Respectfully,


  
W.G. Smith, Jr.  
Plant Manager

/jas

cc: See Attached Distribution List

8710160368 871008  
PDR ADDCK 05000315  
S PDR

IE22  
/b

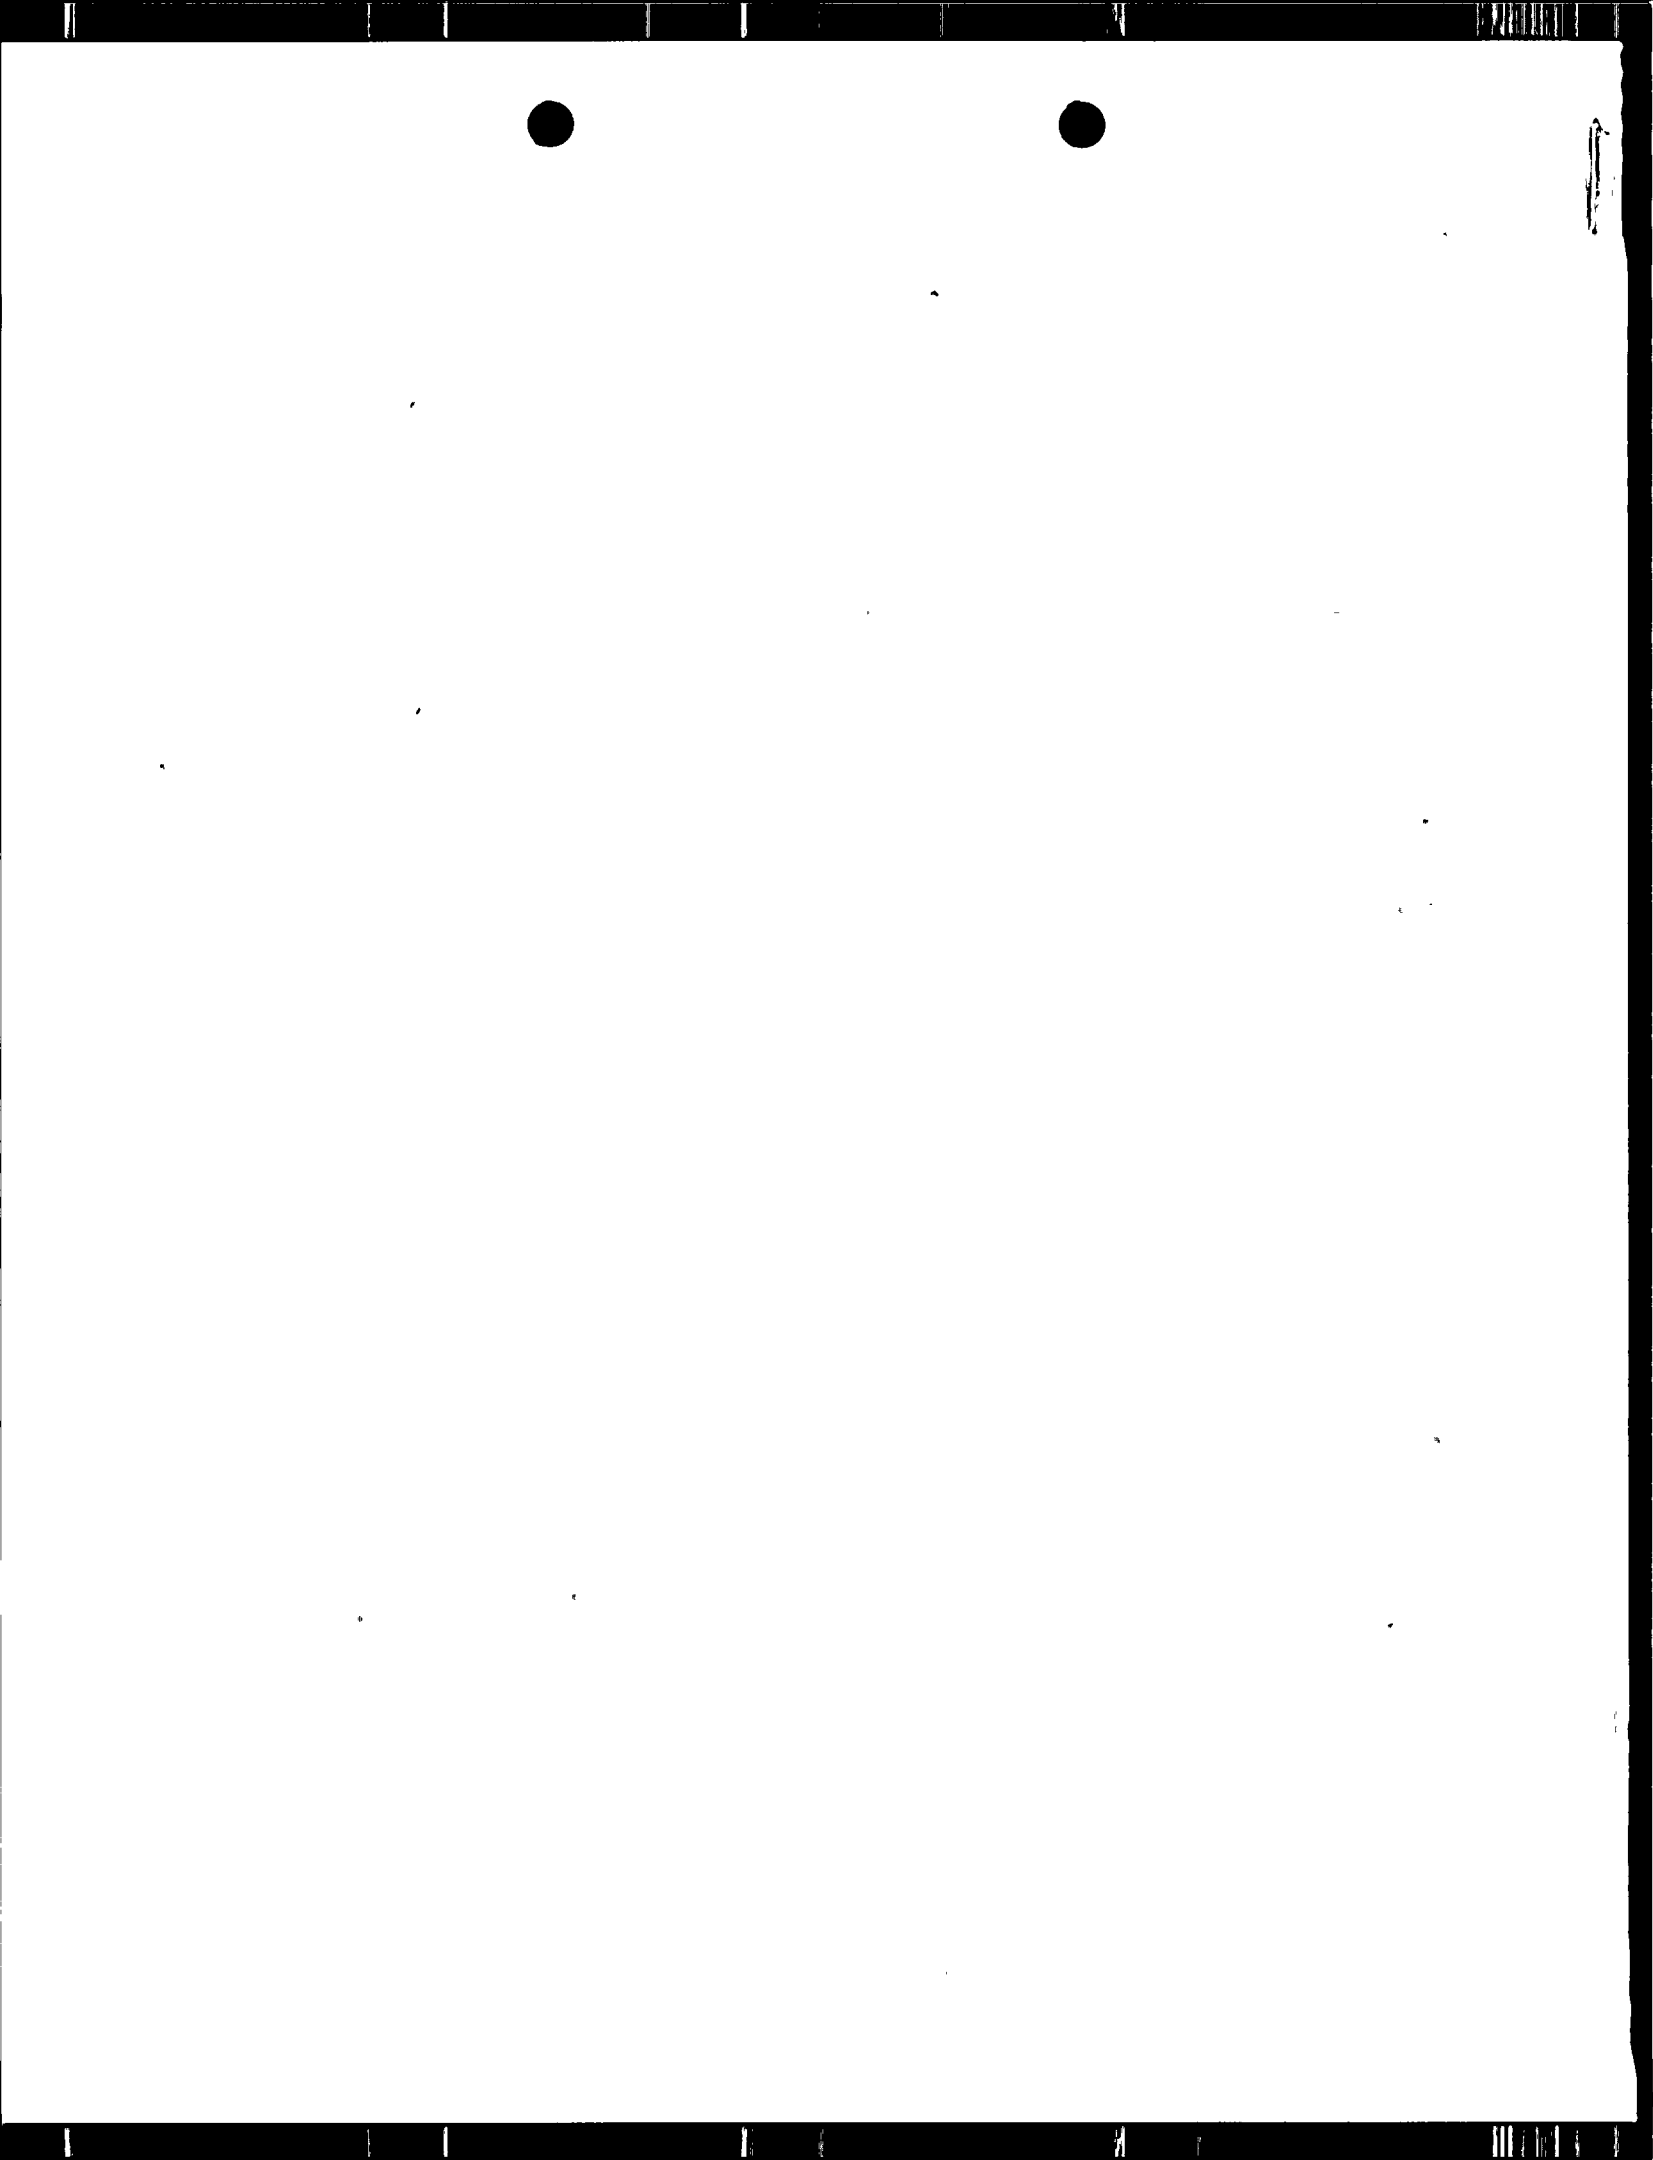

J. E. Dolan  
A. B. Davis, Region III  
M. P. Alexich  
R. F. Kroeger  
H. B. Brugger  
R. W. Jurgensen  
NRC Resident Inspector  
R. C. Callen  
G. Charnoff, Esq.  
D. Hahn  
Records Center, INPO  
D. L. Wigginton, NRC  
PNSRC  
A. A. Blind  
Dottie Sherman, ANI Library  
J. G. Feinstein/B. P. Lauzau

