

~~REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)~~

ACCESSION Nbr: 8509240219 DUC DATE: 85/09/18 NOTARIZED: NO DOCKET #
 FACIL: 50-316 Donald C. Cook Nuclear Power Plant, Unit 2, Indiana & 05000316
 AUTH. NAME AUTHUP AFFILIATION
 ALEXICH, M.P. Indiana & Michigan Electric Co.
 RECIP. NAME RECIPIENT AFFILIATION
 DENTON, H.R. Office of Nuclear Reactor Regulation, Director

SUBJECT: Advises that Exxon Nuclear Co reload fuel vendor for facility & intends to use methodology in XN-NF-84-73-(P), "Exxon Nuclear Methodology for PWRs: Analysis of Chapter 15 Events," for performing safety analysis for future reloads.

DISTRIBUTION CODE: IE26D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1
 TITLE: Start-Up Report/ Refueling Report (50 Dkt)

NOTES:


OL: 12/23/72

Add Reg. Files

05000316

	RECIPIENT ID CODE/NAME		COPIES LTTR ENCL		RECIPIENT ID CODE/NAME		COPIES LTTR ENCL
	NRK ORB1 BC 04		5 3				
INTERNAL:	ACRS 13		5 4		IE FILE 01		1
	NRK/DSI/CPB 12		1		RGN2/DRSS/EPRPB		1
	RM/DAMI/MIB 09		1				
EXTERNAL:	24X		1 1		LPDR 03		1
	NRC PDR 02		1 1		NSIC 05		1

TOTAL NUMBER OF COPIES REQUIRED: LTTR 17 ENCL 0

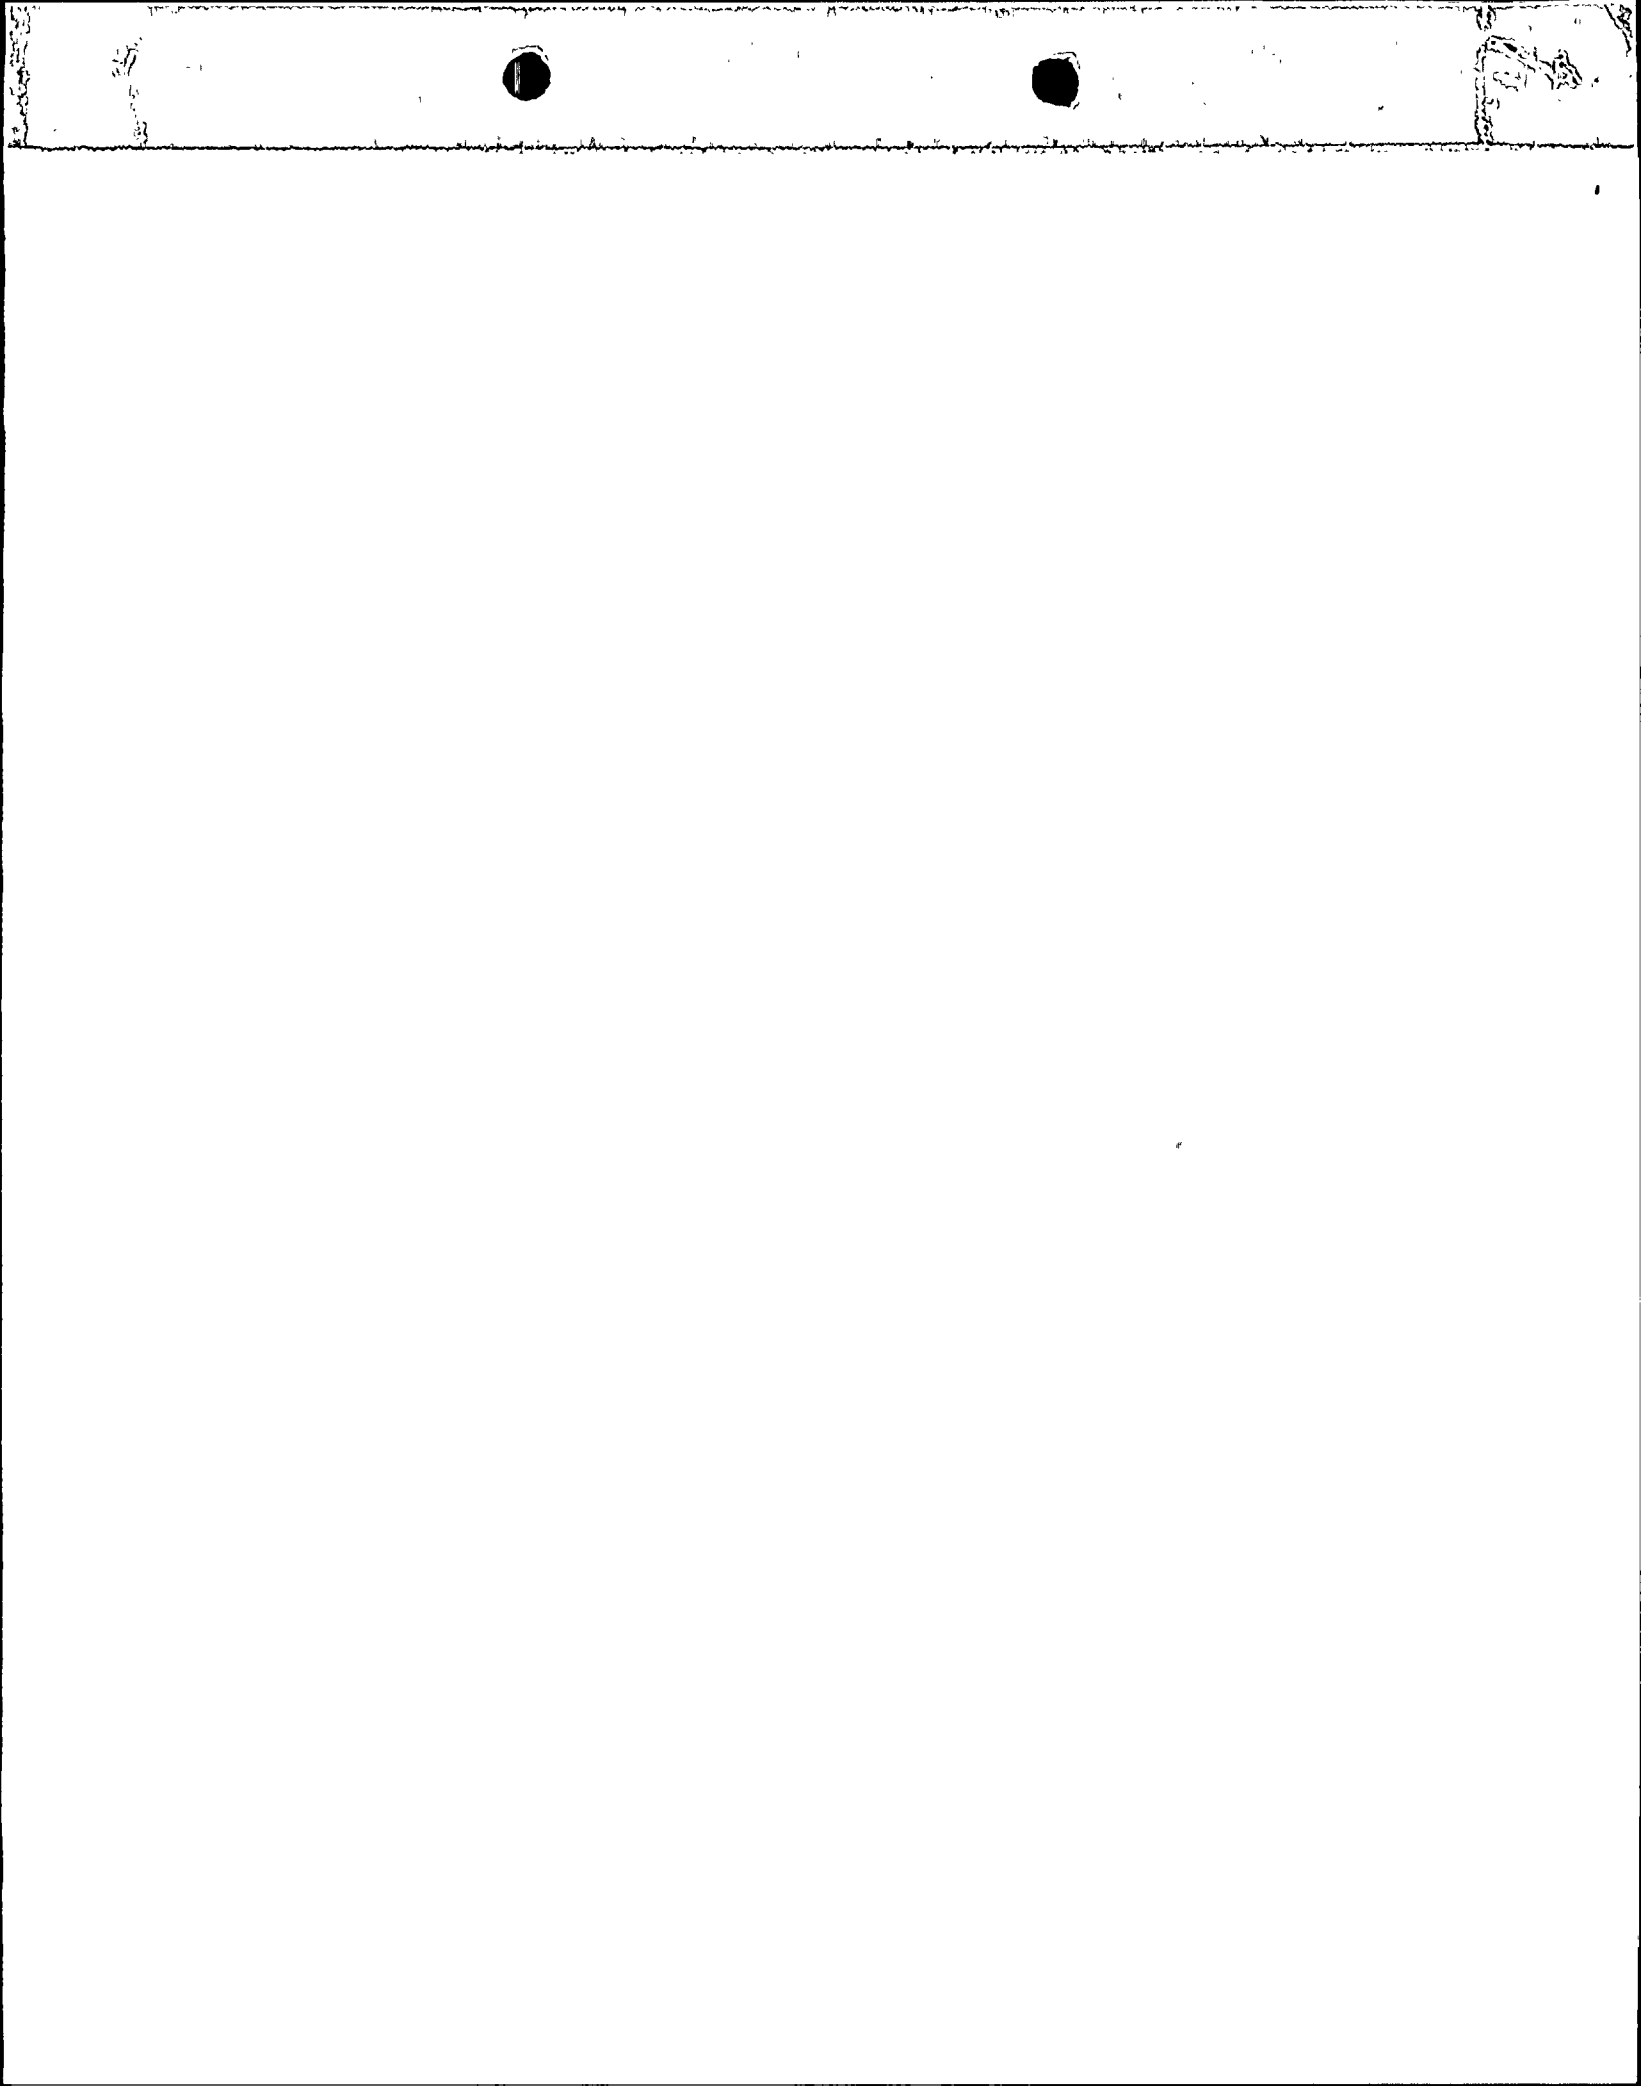

INDIANA & MICHIGAN ELECTRIC COMPANY

P.O. BOX 16631
COLUMBUS, OHIO 43216

September 18, 1985
AEP:NRC:0916B

Donald C. Cook Nuclear Plant Unit No. 2
Docket No. 50-316
License No. DPR-74
"Exxon Nuclear Methodology for Pressurized Water
Reactors: Analysis of Chapter 15 Events"
XN-NF-84-73(P)

Mr. Harold R. Denton, Director
Office of Nuclear Reactor Regulation
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555


Dear Mr. Denton:

On August 27, 1985, Exxon Nuclear Company, Inc. transmitted to Dr. C. O. Thomas, Chief, Standardization & Special Projects Branch, a letter (No. RAC:058:85) with the report, XN-NF-84-73-(P), entitled "Exxon Nuclear Methodology for Pressurized Water Reactors: Analysis of Chapter 15 Events."

Exxon Nuclear Company, the reload fuel vendor for Donald C. Cook Nuclear Plant Unit 2, intends to use the above-referenced methodology for performing the safety analysis for future reloads.

This document has been prepared following Corporate procedures which incorporate a reasonable set of controls to insure its accuracy and completeness prior to signature by the undersigned.

Very truly yours,


M. P. Alexich 9/18/85
Vice President

cm

cc: John E. Dolan
W. G. Smith, Jr. - Bridgman
R. C. Callen
G. Bruchmann
G. Charnoff
NRC Resident Inspector - Bridgman

8509240219 850918
PDR ADDCK 05000316
P PDR

IE26
1/0
Add:
Reg Files
original

