

# ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9106260210 DOC. DATE: 91/06/20 NOTARIZED: NO DOCKET #  
 FACIL: 50-315 Donald C. Cook Nuclear Power Plant, Unit 1, Indiana & 05000315  
 50-316 Donald C. Cook Nuclear Power Plant, Unit 2, Indiana & 05000316  
 AUTH. NAME AUTHOR AFFILIATION  
 FITZPATRICK, D. Indiana Michigan Power Co. (formerly Indiana & Michigan Ele  
 RECIP. NAME RECIPIENT AFFILIATION  
 MURLEY, T.E. Office of Nuclear Reactor Regulation, Director (Post 870411

SUBJECT: Corrects statement made in 890206 ltr (AEP:NRC:1033H) re.  
 Generic Ltr 88-17, "Loss of Decay Heat Removal."

DISTRIBUTION CODE: A061D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 3  
 TITLE: OR/Licensing Submittal: Loss of Residual Heat Removal (RHR) GL-87-12

### NOTES:


RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
PD3-1 LA	1 0	PD3-1 PD	1 1
COLBURN, T.	1 1		
INTERNAL: NRR BALUKJIAN, H	2 2	NRR TRAMMELL, C	1 1
NRR/DOEA/OTSB11	1 1	NRR/DST 8E2	1 1
OC/LEMB	1 0	OGC/HDS2	1 0
REG FILE 01	1 1	RES/DSIR/EIB	1 1
EXTERNAL: NRC PDR	1 1	NSIC	1 1

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,  
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION  
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 14 ENCL 11

MA-4

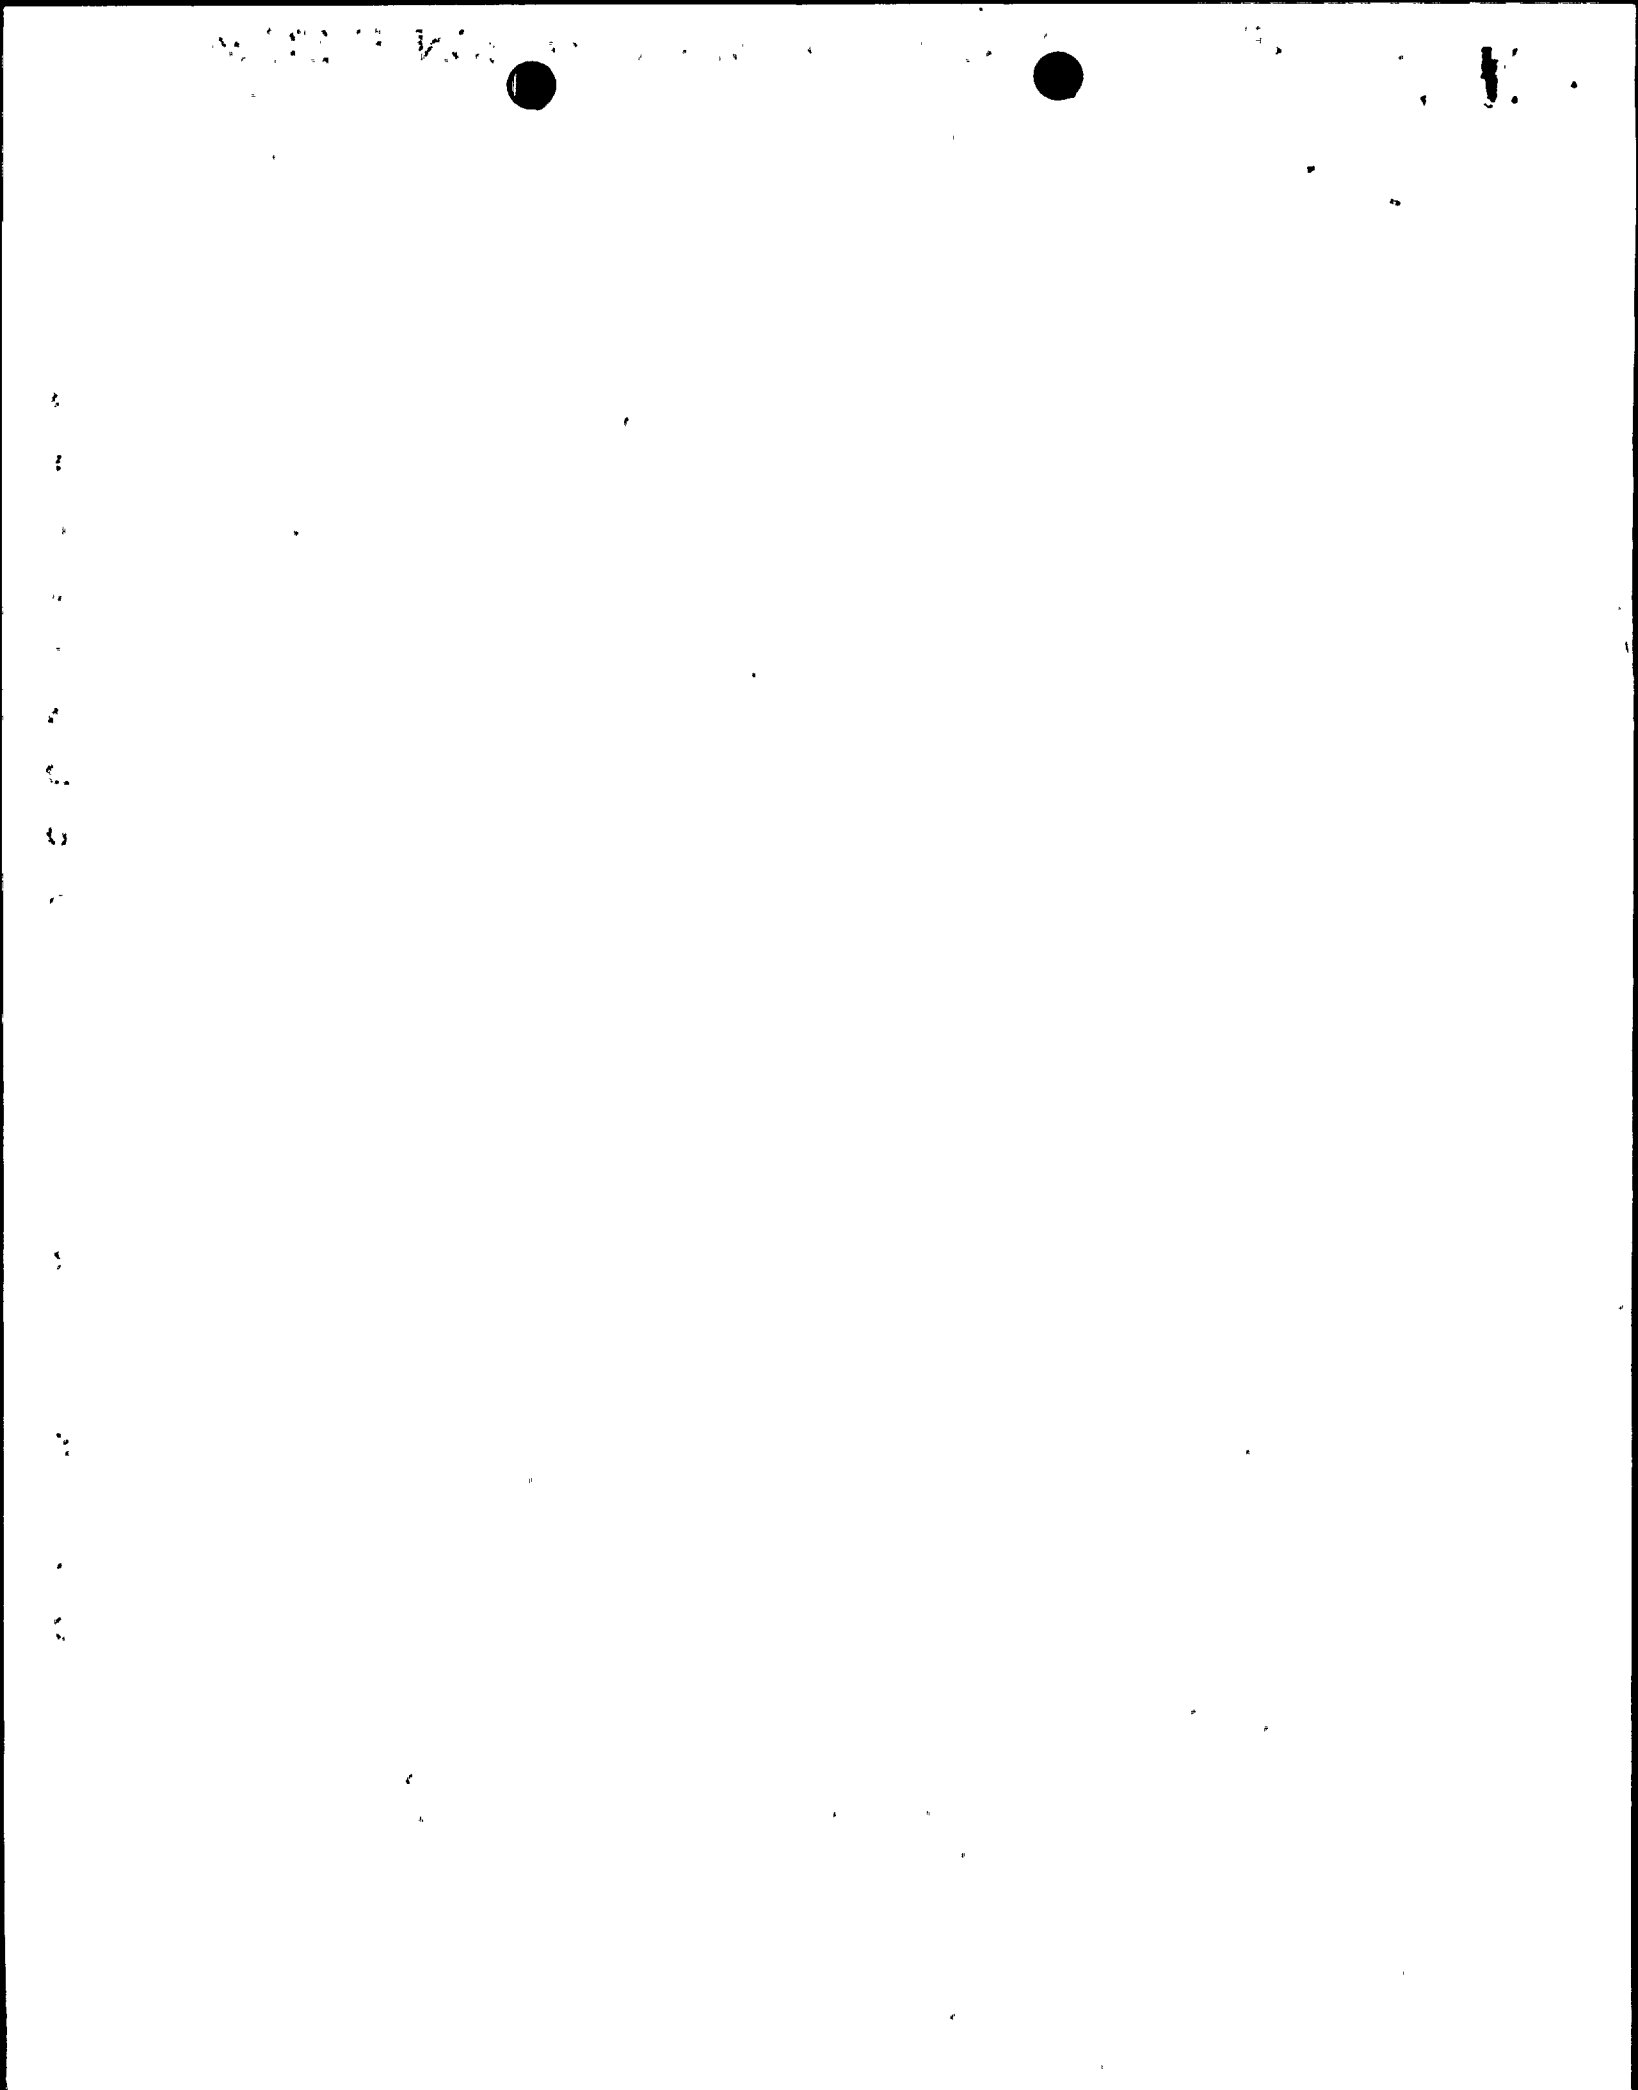



AEP:NRC:1033H

Donald C. Cook Nuclear Plant Units 1 and 2  
Docket Nos. 50-315 and 50-316  
License Nos. DPR-58 and DPR-74  
REVISION TO AEP:NRC:1033F;  
GENERIC LETTER 88-17 FOLLOW-UP

U. S. Nuclear Regulatory Commission  
Document Control Desk  
Washington, D. C. 20555

Attn: T. E. Murley

June 20, 1991

Dear Dr. Murley:

In our February 6, 1989 letter, AEP:NRC:1033C, we committed to certain programmatic enhancements in response to Generic Letter 88-17, "Loss of Decay Heat Removal." We informed you of the status of these enhancements in letter AEP:NRC:1033F dated May 21, 1991. This letter is written to correct a statement made in letter AEP:NRC:1033F.

In our original letter, we committed to develop a permanent procedure for loss of RHR once we received the Emergency Response Guidelines and Background Document from the Westinghouse Owners Group, which we expected to receive in the fall of 1989. In letter AEP:NRC:1033F, we informed you that we did not receive the WOG guidance until February 1991. This statement is inaccurate. The WOG guidance was actually provided in March of 1990. Between March 1990 and February 1991, we conducted a review of the generic WOG guidance to address Cook Nuclear Plant site-specific issues. A draft Emergency Operating Procedure has been written and is currently in routing for approval. With respect to the current status of our commitment, we still intend to issue the loss of RHR procedure this summer after the operators are trained.

Handwritten signature/initials: AOB



Dr. T. E. Murley


-2-

AEP:NRC:1033H

We apologize for any inconvenience this may have created.

This document has been prepared following Corporate procedures that incorporate a reasonable set of controls to ensure its accuracy and completeness prior to signature by the undersigned.

Sincerely,

A handwritten signature in cursive script, appearing to read "E. E. Fitzpatrick".

E. E. Fitzpatrick

EEF/eh

Dr. T. E. Murley

-3-

AEP:NRC:1033H

cc: D. H. Williams, Jr.  
A. A. Blind - Bridgman  
J. R. Padgett  
G. Charnoff  
A. B. Davis - Region III  
NRC Resident Inspector - Bridgman  
NFEM Section Chief

