

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8108040257 DOC. DATE: 81/07/29 NOTARIZED: NO DOCKET #
 FACIL: 50-315 Donald C. Cook Nuclear Power Plant, Unit 1, Indiana & 05000315
 50-316 Donald C. Cook Nuclear Power Plant, Unit 2, Indiana & 05000316
 AUTH. NAME: AUTHOR: AFFILIATION
 HUNTER, R. S. Indiana & Michigan Electric Co.
 RECIP. NAME: RECIPIENT AFFILIATION
 DENTON, H. R. Office of Nuclear Reactor Regulation, Director

SUBJECT: Forwards comments in response to SA Varga 810506 ltr re
 reactor safety study methodology applications program
 evaluation of Sequoyah 1. Based on plant design similarities,
 results applicable to Cook Units 1 & 2.

DISTRIBUTION CODE: A001S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 3
 TITLE: General Distribution for after Issuance of Operating License

NOTES: I&E: 3 copies all material. 05000315
 Send 3 copies of all material to I&E. 05000316

ACTION:	RECIPIENT ID CODE/NAME:		COPIES		RECIPIENT ID CODE/NAME		COPIES	
			LTTR	ENCL			LTTR	ENCL
ACTION:	ORB #1 BC	04	13	13				
INTERNAL:	D/DIR, HUM FAC08		1	1	DIR, DIV OF LIC		1	1
	I&E	06	2	2	NRC PDR	02	1	1
	OELD	11	1	0	OR ASSESS BR	10	1	0
	RAD ASMT BR.		1	1	<u>REG-FEE</u>	01	1	1
EXTERNAL:	ACRS	09	16	16	LPDR	03	1	1
	NSIC	05	1	1	NTIS		1	1

MA
4

AUG 06 1981

TOTAL NUMBER OF COPIES REQUIRED: LTTR 44 ENCL 42

27


INDIANA & MICHIGAN ELECTRIC COMPANY

P. O. BOX 18
BOWLING GREEN STATION
NEW YORK, N. Y. 10004

July 29, 1981
AEP:NRC:0570

Donald C. Cook Nuclear Plant Unit Nos. 1 and 2
Docket Nos. 50-315 and 50-316
License Nos. DPR-58 and DPR-74
RSSMAP Analysis of Sequoyah Unit No. 1 as it
Applies to the Donald C. Cook Nuclear Plant


Mr. Harold R. Denton, Director
Office of Nuclear Reactor Regulation
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

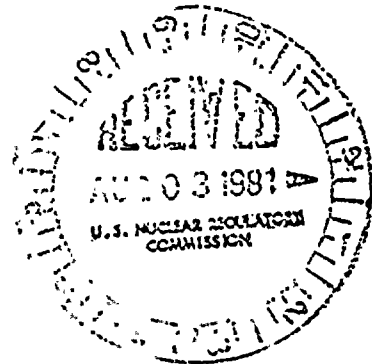

Dear Mr. Denton:

This letter and its attachment respond to Mr. S. A. Varga's letter of May 6, 1981 concerning the Reactor Safety Study Methodology Applications Program (RSSMAP) evaluation of Sequoyah Unit No. 1. Based on Plant design similarities we believe that the results of the RSSMAP analysis are generally applicable to the Cook Plant. We have reviewed the conclusions of the Sequoyah RSSMAP with respect to their applicability to the Cook Plant and our comments are provided in the attachment to this letter.

Very truly yours,


R. S. Hunter
Vice President

cc: John E. Dolan - Columbus
R. W. Jurgensen
G. Charnoff
R. C. Callen
D. V. Shaller - Bridgman
Joe Williams, Jr.
Region III Resident Inspector at Cook Plant

8108040257 810729
PDR ADOCK 05000315
PDR

*Adol
5/1*

ATTACHMENT TO AEP:NRC:0570

1. RSSMAP CONCLUSION

An important accident sequence occurring for the Sequoyah Plant results from the potential for blockage or closure of the drains between the upper and lower compartments. This causes a common-mode failure of the ECRS and CSRS when the sump runs dry (sequences S₁HF and S₂HF). The probability of these sequences could be reduced by improved checking procedures and improved fault detection capabilities.

COMMENTS

The Cook Plant design includes three drains from the refueling cavity to the lower compartments (Sequoyah is reported in the RSSMAP to have two). The drain lines at Cook are blanked-off (not valved closed) during refueling operations and verified to be open and free of debris prior to criticality and during periodic containment inspections.

The presence of lower volume containment sprays at the Cook Plant would also effectively increase the time to sump "dry-out" in the unlikely event that the drains were to become blocked following a LOCA.

2. RSSMAP CONCLUSION

Failure of the ECRS alone caused by component failures other than the drains also results in some important accident sequences.

COMMENTS

The ECRS is an important function not only for the Cook Plant but for most plants and the conclusion of the RSSMAP study logically reflects this fact. The relative importance of ECRS as a dominant accident sequence and the quantification of the ECRS failure probability may be somewhat different depending on individual plant designs.

3. RSSMAP CONCLUSION

Sequence V, in which check valve failures cause the high-pressure primary coolant to fail the low-pressure piping outside containment, remains an important sequence for Sequoyah. This sequence could be improved by a more strategic testing procedure of the check valves over the limited testing capability which now exists.

COMMENTS

The significant event "V" configuration in the Cook Plant is in the normal Residual Heat Removal (RHR) return line to the reactor coolant system. Both the inboard and outboard check valves are leak rate tested in accordance with plant technical specifications after each refueling outage, whenever the plant has been in COLD Shutdown

for 72 hours or more and if leakage testing has not been performed in the previous nine months, and prior to returning the valve to service following maintenance or replacement work on the valve. The maximum allowable leakage from any of these check valves is one gpm. This testing effectively reduces the probability of an event "V" sequence at the Cook Plant.

4. RSSMAP CONCLUSION

Unlike larger containments, core melting caused by failure of ECIS or ECRS fail the lower pressure, smaller ice condenser containment by over-pressure even though the containment cooling system continues to operate properly. The analysis of accident processes by Battelle Columbus Laboratories revealed that the smaller containment pressure and volume design would not withstand the pressure exerted by the noncondensable gases generated in the core meltdown accidents. (This result was similar to the RSS findings for the RSS BWR design).

COMMENTS

The design pressure of the Cook Plant containment is 12.0 psig. As reported in Attachment No. 3 to our AEP:NRC:00500E submittal dated July 2, 1981, the median limiting pressure capacity of the Cook Plant containment (based on actual material properties) is estimated to be 57.8 psig.

5. RSSMAP CONCLUSION

Sequence TMLB'-S, which was important for the Surry Plant as analyzed in the RSS, does not appear to be as significant to risk for Sequoyah due to lower unavailability of on-site ac power.

COMMENTS

The RSSMAP states that the load sequencing feature at Sequoyah was estimated to result in a decrease of at least one order of magnitude in the failure probability of the diesel generators (DGs), when compared to Surry. The Cook DGs also utilize a load sequencing feature and a similar reduction in failure probability should apply to the Cook Plant as well.

6. RSSMAP CONCLUSION

Failure of the containment cooling system causing core meltdown following a small LOCA (the S₂C sequence in the RSS) does not appear to lead to core meltdown at Sequoyah due to the difference in sump water temperature at the time of containment failure.

COMMENTS

The reduced sump water temperature noted for Sequoyah should also apply to the Cook Plant. The heat capacity of the ice condenser itself should significantly reduce the likelihood of a sequence involving the "C" events.

