

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8111170264 DOC. DATE: 81/11/11 NOTARIZED: NO
 FACIL: 50-315 Donald C. Cook Nuclear Power Plant, Unit 1, Indiana &
 50-316 Donald C. Cook Nuclear Power Plant, Unit 2, Indiana &
 AUTH. NAME AUTH. AFFILIATION
 MALONEY, G. P. Indiana & Michigan Electric Co.
 RECIP. NAME: RECIPIENT AFFILIATION
 DENTON, H. R. Office of Nuclear Reactor Regulation, Director

DOCKET #
 05000315
 05000316

SUBJECT: Forwards revised Tech Specs 3.7.8 & 4.7.8 re. surveillance requirements for safety-related snubbers in response to
 CG. Eisenhower 801120 ltr.

DISTRIBUTION CODE: A0015 COPIES RECEIVED: LTR __ ENCL __ SIZE: 2735
 TITLE: General Distribution for after issuance of Operating License

VOTES: I&E: 3 copies all material.
 I&E: 3 copies all material.

05000315
 05000316

ACTION:	RECIPIENT		COPIES		RECIPIENT	COPIES	
	ID CODE/NAME		LTR	ENCL		ID CODE/NAME	LTR
ACTION:	OR3, #1 BC:	01.	13	13			
INTERNAL:	ELQ.		1	0	I&E	06	2 2
	NRQ/DHFS DEPY08		1	1	VRR/DL DIR		1 1
	NRQ/DL/DRA8		1	0	VRR/DSI/RAB		1 1
	<u>REG. FILE</u>	04	1	1			
EXTERNAL:	ACRS	09.	16	16	LPDR	03.	1 1
	NRQ/PDR	02:	1	1	VSIC.	05	1 1
	VTIS		1	1			

MA
 4

TOTAL NUMBER OF COPIES REQUIRED: LTR

ENCL

44

42

39

201 15 1981

4


INDIANA & MICHIGAN ELECTRIC COMPANY

P. O. BOX 18
BOWLING GREEN STATION
NEW YORK, N. Y. 10004

November 11, 1981
AEP:NRC:0504

Donald C. Cook Nuclear Plant Unit Nos. 1 and 2
Docket Nos. 50-315 and 50-316
License Nos. DPR-58 and DPR-74
REVISED SAFETY-RELATED SNUBBER SURVEILLANCE

Mr. Harold R. Denton, Director
Office of Nuclear Reactor Regulation
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

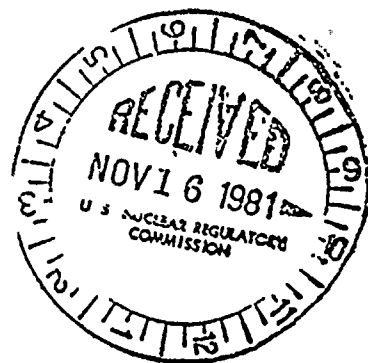

Dear Mr. Denton:

This letter and its attachments respond to Mr. D. G. Eisenhower's letter of November 20, 1980 regarding Technical Specification surveillance requirements for safety-related snubbers. Attachment Nos. 1 and 2 contain the revised Technical Specification pages for D. C. Cook Unit Nos. 1 and 2, respectively.

As noted in the footnotes on page 3/4 7-23 of the Attachment to Mr. Eisenhower's letter, the value "c" used in the determination of the number of snubbers to be tested was intended for use in plants with large numbers of safety-related snubbers (>500). Since each Unit of the Cook Plant utilizes approximately 100 safety-related snubbers, those portions of the 'sample' Technical Specifications referring to "c" in Mr. Eisenhower's letter have been deleted. Similarly, since mechanical snubbers are not used in safety-related systems at Cook Plant, the 'sample' Specifications have been modified to refer only to hydraulic snubbers. Other minor modifications have been made to the 'sample' Specifications to accommodate insertion into the existing Cook Plant Specifications.

The Technical Specifications contained in Attachment No. 1 reference Specification 4.0.5 which does not exist in the present Unit No. 1 Specifications. However, we plan to submit in the near future revisions to the Unit No. 1 Technical Specifications which will incorporate a Specification 4.0.5 very similar to the existing Unit No. 2 Specification.

8111170264 811111
PDR ADDOCK 05000315
PDR

App
S/11

Mr. Harold R. Denton

2


AEP:NRC:0504

The proposed Technical Specifications contained herein have been reviewed by the Plant Nuclear Safety Review Committee and the American Electric Power Service Corporation Nuclear Safety & Design Review Committee. As a result of these reviews, it has been concluded that implementation of the proposed Technical Specifications will not in any way endanger the health and safety of the general public.

Indiana & Michigan Electric Company interprets 10 CFR 170.22 such that no fee be required for this submittal.

This document has been prepared following Corporate procedures which incorporate a reasonable set of controls to insure its accuracy and completeness prior to signature by the undersigned.

Very truly yours,

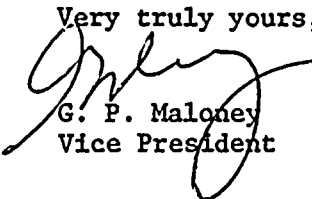
G. P. Maloney
Vice President

/emc

cc: John E. Dolan - Columbus
R. C. Callen
G. Charnoff
R. W. Jurgensen
D. V. Shaller - Bridgman
Joe Williams, Jr.
NRC Region III Resident Inspector - Bridgman