

Indiana Michigan
Power Company
Cook Nuclear Plant
One Cook Place
Bridgman, MI 49106
616 465 5901



September 1, 1993

United States Nuclear Regulatory Commission
Document Control Desk
Rockville, Maryland 20852


Operating Licenses DPR-74
Docket No. 50-316

Document Control Manager:

In accordance with the criteria established by 10 CFR 50.73
entitled Licensee Event Report System, the following report is
being submitted:

93-007-00

Sincerely,


A.A. Blind
Plant Manager

/jas

Attachment

c: J.B. Martin, Region III
E.E. Fitzpatrick
P.A. Barrett
R.F. Kroeger
W.E. Walters - Ft. Wayne
NRC Resident Inspector
B.A. Wetzel - NRC
M.R. Padgett
G. Charnoff, Esq.
D. Hahn
INPO
S.J. Brewer
B.A. Svensson

9309090345 930901
PDR ADDCK 05000316
S PDR



JE22

ENCLOSURE 4

2.0 ACCIDENT SEQUENCE PRECURSOR IDENTIFICATION AND QUANTIFICATION

2.1 Accident Sequence Precursor Identification

The ASP Program is concerned with the identification and documentation of operational events that have involved portions of core damage sequences, and with the estimation of frequencies and probabilities associated with them.

Identification of precursors requires the review of operational events for instances in which plant functions that provide protection against core damage have been challenged or compromised. For core damage to occur, fuel temperature must increase. Such an increase requires the heat generation rate in the core to exceed the heat removal rate. This can result from either a loss of core cooling or excessive core power. The following functions are provided at all plants to protect against these two conditions:

- Reactor subcriticality. The reactor must be placed in a subcritical condition, normally by inserting control rods into the core to terminate the chain reaction.
- Reactor coolant inventory makeup. Sufficient water must be provided to the reactor coolant system (RCS) to prevent core uncover.
- RCS integrity. Loss of RCS integrity requires the addition of a significant quantity of water to prevent core uncover.
- Decay heat removal (DHR). Heat generated in the core by fission product decay must be removed.
- Containment integrity. Containment integrity (containment heat removal, isolation, and hydrogen control) is not addressed in the precursor analyses unless core DHR capability is impacted.

System-based event trees were developed to model potential sequences to core damage. The event trees are specific to eight plant classes so as to reflect differences in design among plants in the U.S. LWR population. Three initiators are addressed in the event trees: trip [which includes loss of main feedwater (LOFW) within its sequences], loss of offsite power (LOOP), and small-break loss-of-coolant accident (LOCA). These three initiators are primarily associated with loss of core cooling. [Excessive core power associated with anticipated transient without scram (ATWS) is represented by a failure-to-trip sequence but is not developed.] Based on previous experience with reactor plant operational events, it is known that most operational events can be directly or indirectly associated with these initiators. Detailed descriptions of the plant classification scheme and the event tree models are included in Appendix A. Operational events that cannot be associated with one of these initiators are accommodated by-unique modeling.

Armed with a knowledge of the primary core damage initiator types plus the systems that provide protection against core damage (based on the event tree models), ASP Program staff members examine LERs to determine the impact of operational events on potential core damage sequences. While the sequences detailed on the event tree models do not describe all possible paths to core damage, they form a primary basis for selecting an operational event as a precursor. Operational events are also reviewed in a more general sense for their impact on the protective functions described above.

Identification of precursors within a set of LERs involved a two-step process. First, each LER was reviewed by two experienced engineers to determine if the reported event should be examined in detail. This initial review was a bounding review, meant to capture events that in any way appeared to deserve detailed review and to eliminate events that were clearly unimportant. This was done by eliminating events that satisfied pre-defined criteria for rejection and accepting all others as potentially significant and requiring analysis. In some cases, events are impractical to analyze due to lack of information or inability to reasonably model within a probabilistic risk assessment (PRA) framework, considering the level of detail typically available in PRA models. Events also were eliminated from further review if they had little impact on core damage sequences or provided little new information on the risk impacts of plant operation. Such events included single failures in redundant systems and uncomplicated reactor trips and LOFWs. Any event with an impact that can be mapped onto the ASP core damage models can, in principle, be assessed.

LERs were eliminated from further consideration as precursors if they involved at most one of the following:

- a component failure with no loss of redundancy,
- a loss of redundancy in only one system,
- a seismic design or qualification error,
- an environmental design or qualification error,
- a structural degradation,
- an event that occurred prior to initial criticality (since the core is not considered vulnerable to core damage at this time and since distinguishing initial testing failures from operational failures is difficult),
- a design error discovered by reanalysis,
- an event impact bounded by a reactor trip or LOFW,
- an event with no appreciable impact on safety systems, or
- an event involving only post-core damage impacts (selected containment-related events are documented).

Events identified for further consideration typically included

- unexpected core damage initiators (LOOP and small-break LOCA);
- all events in which reactor trip was demanded and a safety-related component failed;
- all support system failures, including failures in cooling water systems, instrument air, instrumentation and control, and electric power systems;
- any event where two or more failures occurred;
- any event or operating condition that was not predicted or that proceeded differently from the plant design basis; and
- any event that, based on the reviewers' experience, could have resulted in or significantly affected a chain of events leading to potential severe core damage.

Operational events that were not eliminated in the first review received a more extensive analysis to identify those events considered to be precursors to potential severe core damage accidents either because of an initiating event or because of failures that could have affected the course of postulated off-normal events or accidents. These detailed reviews were not limited to the LERs; they also used final safety analysis reports (FSARs), their amendments, and other information available at the Nuclear Operations Analysis Center.

The detailed review of each event considered (1) the immediate impact of an initiating event or (2) the potential impact of the equipment failures or operator errors on readiness of systems in the plant for mitigation of off-normal and accident conditions.

In the review of each selected event, three general scenarios (involving both the actual event and postulated additional failures) were considered:

1. If the event or failure was immediately detectable and occurred while the plant was at power, then the event was evaluated according to the likelihood that it and the ensuing plant response could lead to severe core damage.
2. If the event or failure had no immediate effect on plant operation (i.e., if no initiating event occurred), then the review considered whether the plant would require the failed items for mitigation of potential severe core damage sequences should a postulated initiating event occur during the failure period.
3. If the event or failure occurred while the plant was not at power, then the event was first evaluated according to whether it could have occurred while at power or at hot shutdown immediately following power operation. If the event could only occur at cold shutdown, then its impact on continued DHR was assessed.

For each actual occurrence or postulated initiating event associated with an operational event reported in an LER, the sequence of operation of various mitigating systems required to prevent core damage was considered. Events were selected and documented as precursors to potential severe core damage accidents (accident sequence precursors) if they included one of the following attributes that impacted core damage sequences and if the conditional probability of subsequent core damage (described later) was at least 1.0×10^{-6}

- an unexpected core damage initiator (such as a LOOP, steam-line break (SLB), or small-break LOCA);
- a failure of a system (all trains of a multiple train system) required to mitigate the consequences of a core damage initiator,
- concurrent degradation in more than one system required to mitigate the consequences of a core damage initiator, or
- a transient or LOFW with a degraded mitigating system.

Events of low significance are thus excluded, allowing the reader to concentrate on the more important events. This approach is consistent with the approach used to define 1987-1991 precursors, but is different from that of earlier ASP reports, which addressed all events meeting the precursor selection criteria, regardless of conditional core damage probability.

Events that occurred in 1992 were reviewed for precursors only if they satisfied an initial significance screening. This approach, which was similar to that used in the review of 1988-1991 events, eliminated many insignificant events from review and permitted some increase in the amount of documentation provided for precursors. Two approaches were used to select events to be reviewed for precursors.

First, events were reviewed for precursors if they were identified as significant by the Nuclear Regulatory Commission's (NRCs) Office for Analysis and Evaluation of Operational Data (AEOD). AEOD's screening process identifies operating occurrences involving, in part,

- violation of a safety limit;
- an alert or higher emergency classification;
- an on-demand failure of a safety system (except surveillance failures);
- events involving unexpected system or component performance with serious safety significance or generic implications;
- events where improper operation, maintenance, or design causes a common-mode/common-cause failure of a safety system or component, with safety significance or generic implications;
- safety-significant system interactions;
- events involving cognitive human errors with safety significance or generic implications;
- safety-significant events involving earthquakes, tornadoes, floods, and fires;
- a scram, transient, or engineered safety features (ESF) actuation with failure or inoperability of required equipment;
- on-site work-related or nuclear-incident-related death, serious injury, or exposure that exceeds administrative limits;
- unplanned or unmonitored releases of radioactivity, or planned releases that exceed Technical Specification limits; and
- infrequent or moderate frequency events.

AEOD-designated significant events also involve operating conditions, where a failure or accident has not occurred but where the potential for such an event is identified.

Second, LERs were also reviewed if they were identified through a computerized search using the sequence coding and search system (SCSS) data base of LERs. This computerized search identified LERs potentially involving (1) failures in plant systems that provided the protective functions described earlier and (2) initiating events addressed in the ASP models. Based on a review of the 1984-87 precursor evaluations, this computerized search successfully identifies almost all precursors within a subset of approximately one-third of all LERs.

While review of LERs identified by AEOD and through the use of SCSS is expected to identify almost all precursors, it is possible that a few precursors exist within the set of unreviewed LERs. Some potential precursors that would have been found if all 1992 LERs had been reviewed may not have been identified. Because of this (plus modeling changes that impact precursor probability somewhat), it should not be assumed that the set of 1988-92 precursors is consistent with precursors identified in 1984-87.

Following AEOD and SCSS computerized screening, 1022 LERs from 1992 were reviewed for precursors. Twenty-seven operational events with conditional probabilities of subsequent severe core damage greater than 1.0×10^{-6} were identified as accident sequence precursors.

Individual failures of boiling-water reactor (BWR) high-pressure coolant injection (HPCI), high-pressure core spray (HPCS), and reactor core isolation cooling (RCIC) systems (all single-train systems), and trips and LOFWs without additional mitigating system failures were not selected as precursors. The impact of such events was determined on a plant-class basis. The results of these evaluations are provided in Appendix A.

In addition to accident sequence precursors, events involving loss of containment functions — containment cooling, containment spray, containment isolation (direct paths to the environment only), and hydrogen control — were identified in the review of 1992 LERs. Other events that were not selected as precursors but that provided insight into unusual failure modes with the potential to compromise continued core cooling are also identified. Events identified as precursors are documented in Appendix B, the



containment-related events are documented in Appendix C, events considered "interesting" are documented in Appendix D, and events that were determined to be impractical to analyze are documented in Appendix E.

ENCLOSURE 5

APPENDIX A. ASP MODELS



A. ASP MODELS

This appendix provides information concerning the methods and models used to estimate event significance in the ASP Program. The basic models used in the analysis of 1992 precursors are the same as those used for 1989-91 precursors. However, the analysis of 1992 precursors considered the potential use of alternate equipment and procedures, beyond that addressed in the basic models, that recently have been added by the licensees to provide additional protection against core damage, if information regarding this equipment was available. This equipment is described in Sect. A.3.

A.1 Precursor Significance Estimation

Quantification of accident sequence precursor significance involves determination of a conditional probability of subsequent severe core damage given the failures observed during an operational event. This is estimated by mapping failures observed during the event onto event trees depicting potential paths to severe core damage and calculating a conditional probability of core damage through the use of event tree branch probabilities modified to reflect the event. In the quantification processes, it is assumed that the event tree branch failure probabilities for systems observed failed during an event are equal to the likelihood of not recovering from the failure or fault that actually occurred. Event tree branch failure probabilities for systems observed degraded during an operational event are assumed equal to the conditional probability that the system would fail (given that it was observed degraded) and the probability that it would not be recovered within the required time period. Event tree branch failure probabilities used for systems observed to be successful and systems unchallenged during the actual occurrence are assumed equal to a failure probability estimated from either system failure data (when available) or by the use of system success criteria and typical train and common-mode failure probabilities. The conditional probability estimated for each precursor is useful in ranking because it provides an estimate of the measure of protection against core damage remaining once the observed failures have occurred.

A.1.1 ASP Event Tree Models

Models used to rank precursors as to significance consist of plant-class specific event trees that are linked to simplified plant-specific system models. These models describe mitigation sequences for three initiating events: a nonspecific reactor trip [which includes LOFW within the model], LOOP, and small-break LOCA. The event tree models are system-based and include a model applicable to each of eight plant classes: three for BWRs and five for PWRs.

Plant classes are defined based on the use of similar systems in providing protective functions in response to transients, LOOPS, and small-break LOCAs. System designs and specific nomenclature may differ among plants included in a particular class; but functionally, they are similar in response. Plants where certain mitigating systems do not exist, but which are largely analogous in their initiator response, are grouped into the appropriate plant class. In modeling events at such plants, the event tree branch probabilities are modified to reflect the actual systems available at the plant. For operational events that cannot be described using the plant-class specific event trees, unique models are developed to describe the potential sequences to severe core damage.

Each event tree includes two undesired end states. The undesired end states are designated as (1) core damage (CD), in which inadequate core cooling is believed to exist; and (2) ATWS, for the failure-to-scrum sequence. The end states are distinct; sequences associated with ATWS are not subsets of core damage sequences. The ATWS sequence, if fully developed, would consist of a number of sequences ending in either success or core damage. Successful operation is designated "OK" in the event trees included in this appendix.

A.1.2 Precursor Impact on Event Tree Branches

The effect of a precursor on event tree branches is assessed by reviewing the operational event specifics against system design information and translating the results of the review into a revised conditional probability of system failure given the operational event. This translation process is simplified in many cases through the use of train-based models that represent an event tree branch. If a train-based model exists, then the impact of the operational event need only be determined at the train level, and not at the system level.

Once the impact of an operational event on systems included in the ASP event tree models has been determined, branch probability values are modified to reflect the event, and the event trees are then used to estimate a conditional probability of subsequent core damage, given the precursor.

A.1.3 Estimation of Initiating Event Frequencies and Branch Failure Probabilities Used with the Event Tree Models

A set of initiating event frequencies and system failure probabilities was developed for use in the quantification of the event tree models associated with the precursors. The approach used to develop frequency and probability estimates employs failure or initiator data in the precursors themselves when sufficient data exists. When precursor data are available for a system, its failure probability is estimated by counting the effective number of nonrecoverable failures in the observation period, making appropriate demand assumptions, and then calculating the effective number of failures per demand. The number of demands is calculated based on the estimated number of tests per reactor year plus any additional demands to which a system would be expected to respond. This estimate is then multiplied by the number of applicable reactor years in the observation period to determine the total number of demands. A similar approach is employed to estimate initiator frequencies per reactor year from observed initiating events.

The potential for recovery is addressed by assigning a recovery action to each system failure and initiating event. Four classes are currently used to describe the different types of recovery that could be involved:

Recovery class	Likelihood of nonrecovery	Recovery characteristic
R1	1.00	The failure did not appear to be recoverable in the required period, either from the control room or at the failed equipment.
R2	0.34	The failure appeared recoverable in the required period at the failed equipment, and the equipment was accessible; recovery from the control room did not appear possible.
R3	0.12	The failure appeared recoverable in the required period from the control room, but recovery was not routine or involved substantial operator burden.
R4	0.04	The failure appeared recoverable in the required period from the control room and was considered routine and procedurally based.

The assignment of an event to a recovery class is based on engineering judgment, which considers the specifics of each operational event and the likelihood of not recovering from the observed failure in a moderate to high-stress situation following an initiating event. For analysis purposes, consistent probabilities of failing to recover an observed failure are assigned to each event in a particular recovery class. It must be noted that the actual likelihood of failing to recover from an event at a particular plant is difficult to assess and may vary substantially from the values listed. This difficulty is demonstrated in the genuine differences in opinion among analysts, operations and maintenance personnel, etc., concerning the likelihood of recovering specific failures (typically observed during testing) within a time period that would prevent core damage following an actual initiating event.*

The branch probability estimation process is illustrated in Table A.1. Table A.1 lists two operational events that occurred in 1984-86 involving failure of SG isolation. For each event, the likelihood of failing to recover from the failure is listed (Column 3). The effective number of nonrecoverable events (1.04 in this case) is then divided by an estimate of the total number of demands in the 1984-86 observation period (1968) to calculate a failure on demand probability of 5.3×10^{-4} .

The likelihood of system failure as a result of hardware faults is combined with the likelihood that the system could not be recovered, if failed, and with an estimate of the likelihood of the operator failing to initiate the system, if manual initiation were required, to estimate the overall failure probability for an event-tree branch. Calculated failure probabilities are then used to tailor the probabilities associated with train-based system models. Such an approach results in system failure probability estimates that reflect, to a certain extent, the degree of redundancy actually available and permits easy revision of these probabilities based on train failures and unavailabilities observed during an operational event.

*Programmatic constraints have prevented substantial efforts in estimating actual recovery class distributions. The values currently used were developed based on a review of events with the potential for short-term recovery, in addition to consideration of human error during recovery. These values have been reviewed both within and outside the ASP Program. While it is acknowledged that substantial uncertainty exists in them, they are believed adequate for ranking purposes, which is the primary goal of the current precursor calculations. This assessment is supported by the sensitivity and uncertainty calculations documented in the 1980-81 report. These calculations demonstrated little impact on the relative ranking of events from variance in recovery class values.

A.1.4 Conditional Probability Associated with Each Precursor

The calculation process for each precursor involves a determination of initiators that must be modeled and their probability, plus any modifications to system probabilities necessitated by failures observed in an operational event. Once the branch probabilities that reflect the conditions of the precursor are established, the sequences leading to the modeled end states (core damage and ATWS) are calculated and summed to produce an estimate of the conditional probability of each end state for the precursor. So that only the additional contribution to risk (incremental risk) associated with a precursor is calculated, conditional probabilities for precursors associated with equipment unavailabilities (during which no initiating event occurred) are calculated a second time using the same initiating event probability but with all branches assigned normal failure probabilities (no failed or degraded states) and subtracted from the initially calculated values. This eliminates the contribution for sequences unimpacted by the precursor, plus the normal risk contribution for impacted sequences during the unavailability. This calculational process is summarized in Table A.2.

The frequencies and failure probabilities used in the calculations are derived in part from data obtained across the LWR population, even though they are applied to sequences that are plant-class specific in nature. Because of this, *the conditional probabilities determined for each precursor cannot be rigorously associated with the probability of severe core damage resulting from the actual event at the specific reactor plant at which it occurred.* The probabilities calculated in the ASP study are homogenized probabilities considered representative of probabilities resulting from the occurrence of the selected events at plants representative of the plant class.

A.1.5 Sample Calculations

Three hypothetical events are used to illustrate the calculational process.

1. The first event assumes a trip and LOFW but no other observed failures during mitigation. An event tree for this event is shown in Fig. A.1. On the event tree, successful operation is indicated by the upper branch and failure by the lower branch. With the exception of relief valve lift, failure probabilities for branches are indicated. For HPI, the lowest branch includes operator action to initiate feed and bleed. Success probabilities are $1 - p(\text{failure})$. The likelihood of not recovering the initiator (trip) is assumed to be 1.0, and the likelihood of not recovering MFW is assumed to be 0.34 in this example. Systems assumed available were assigned failure probabilities currently used in the ASP Program. The estimated conditional probabilities for undesirable end states associated with the event are then:

$$\begin{aligned}
 p(\text{cd}) &= p[\text{seq. 11}] \quad [1.0 \times (1 - 3.0 \times 10^{-5}) \times (1 - 9.9 \times 10^{-5}) \times 4.0 \times 10^{-2} \times \\
 &\quad 3.3 \times 10^{-4} \times (1 - 8.4 \times 10^{-4}) \times 1.1 \times 10^{-3}] \\
 &+ p[\text{seq. 12}] \quad [1.0 \times (1 - 3.0 \times 10^{-5}) \times (1 - 9.9 \times 10^{-5}) \times 4.0 \times 10^{-2} \times \\
 &\quad 3.3 \times 10^{-4} \times 8.4 \times 10^{-4}] \\
 &+ p[\text{seq. 13}] \quad [1.0 \times (1 - 3.0 \times 10^{-5}) \times 9.9 \times 10^{-5} \times (1 - 0.34) \times 4.0 \times \\
 &\quad 10^{-2} \times 3.3 \times 10^{-4} \times (1.0 - 8.4 \times 10^{-4}) \times 1.1 \times 10^{-3}]
 \end{aligned}$$

$$\begin{aligned}
 &+ p[\text{seq. 14}] + p[\text{seq. 15}] + p[\text{seq. 16}] + p[\text{seq. 17}] \\
 &= 7.7 \times 10^{-7}
 \end{aligned}$$

$$\begin{aligned}
 p(\text{ATWS}) &= p[\text{seq. 18}] \\
 &= 3.0 \times 10^{-5}
 \end{aligned}$$

2. The second example event involves failures that would prevent HPI if required to mitigate a small-break LOCA or if required for feed and bleed. Assume such failures were discovered during testing. This event impacts mitigation of a small-break LOCA initiator and potentially impacts mitigation of a trip and LOOP, should a transient-induced LOCA occur or should feed and bleed be required upon loss of AFW and MFW. The event tree for a postulated small-break LOCA associated with this example precursor is shown in Fig. A.2. The failure probability associated with the precursor event (unavailability of HPI) is assigned based on the likelihood of not recovering from the failure in a 20-30 min time frame (assumed to be 1.0 in this case). No initiating event occurred with the example precursor; however, a failure duration of 360 h was estimated based on one-half of a monthly test interval. The estimated small-break LOCA frequency (assumed to be $1.0 \times 10^{-6}/\text{h}$ in this example), combined with this failure duration, results in an estimated initiating event probability of 3.6×10^{-4} during the unavailability. The probabilities for small-LOCA sequences involving undesirable end states (employing the same calculational method as above and subtracting the nominal risk during the time interval) are 3.6×10^{-4} for core damage and 0.0 for ATWS. Note that the impact of the postulated failure on the ATWS sequence is zero because HPI success or failure does not impact that sequence as modeled.

For most unavailabilities, similar calculations would be required using the trip and LOOP event trees, since these postulated initiators could also occur. In this example, neither of these two initiators contributes substantially to the core damage probability associated with the event.

3. The third example event involves a trip with unavailability of one of two trains of service water (SW). Assumed unavailability of the SW train results in unavailability of one train of HPI, high-pressure recirculation (HPR), and AFW, all because of unavailability of cooling to the respective pumps. In this example, SW cooling of two motor-driven AFW pumps is assumed. An additional turbine-driven pump is assumed to be self-cooled. Since SW is not explicitly addressed in the ASP event trees, the probabilities of front-line systems impacted by the loss of SW are instead modified.

Figure A.3 shows a transient event tree with branch failure probabilities modified to reflect unavailability of one train of service water. The likelihoods of not recovering failed front line systems are assumed to be unchanged, since the failure mechanisms for (observed) non-faulted trains are expected to be consistent with historically observed failures. The conditional probability of core damage given the trip and one service water train unavailable is 1.1×10^{-6} . If the second train of service water were to fail, HPI and HPR (and hence feed and bleed) would be rendered unavailable; however, the turbine-driven AFW pump would still be operable. In this case, the likelihood of not recovering HPI and HPR is assumed to be 1.0 until service water is recovered. Sequences associated with loss of both service water trains increase the core damage probability associated with the event. The extent of this increase is dependent in PWRs on the likelihood of a reactor coolant pump seal failure following the loss of service water (since seal injection and seal cooling would be typically lost). Assuming that the conditional probability of loss of the second service water

train is 0.01, that the likelihood of not recovering SW is 0.34, and that the failure probability of the turbine-driven AFW pump is 0.05, the increase in core damage probability is 1.7×10^{-4} if no RCP seal failure occurs, and 3.4×10^{-3} if the likelihood of seal failure is 1.0.

A.1.6 Event Tree Changes Made to 1988-1991 Event Models

Two changes were made to the event trees used in the 1988-91 precursor assessments: core vulnerability sequences on trees used for 1984-87 assessments were reassigned as success or core damage sequences, and the likelihood of PWR RCP seal LOCA following station blackout was explicitly modeled.

In the prior models, the core vulnerability end state was assigned to sequences in which core protection was expected to be provided but for which no specific analytic basis was generally available or which involved non-proceduralized operator actions. Core vulnerability sequences were assigned to either success or core damage end states in the current models, as follows:


Core vulnerability sequence type	Revised end state
Stuck-open secondary-side relief valve with a failure of HPI in a PWR	Success
Steam generator (SG) depressurization and use of condensate system following failure of AFW, MFW, and feed and bleed in a PWR	Core damage (except for PWR Class H)
Use of containment venting as an alternate core cooling method in a BWR	Core damage

The net effect of this change is a significant reduction in the complexity of the event trees, with little impact on the relative significance estimated for each precursor. The impact of this modeling change on conditional probability estimates for 1987 precursors is described in Sect. 3.6 of Ref. 1. (Alternate calculations using models with the above changes were performed on 1987 events.) As illustrated in Ref. 1, modest differences existed between the core damage, core damage plus core vulnerability, and revised core damage model conditional probability estimates for most of the more significant events. Where differences did exist, the sum of probabilities of core damage and core vulnerability (all non-ATWS undesirable end states in the earlier models) was closer to the core damage probability estimated with the revised models.

Three 1987 events had substantially higher "sum" probabilities—these events involved trips with single safety-related train unavailabilities, for which the dominant core vulnerability sequence was a stuck-open secondary-side relief valve with HPI failure (assigned to success in the revised models).

The second modeling change was the inclusion of PWR RCP seal LOCA in blackout sequences. The impact of such a seal LOCA on the core damage probability estimated for an event had previously been bounded by the use of a conservative value for failure to recover ac power prior to battery depletion following a LOOP and loss of emergency power.

The PWR event trees have been revised to address potential seal LOCA during station blackout through the use of seal LOCA and electric power recovery branches, as shown below:

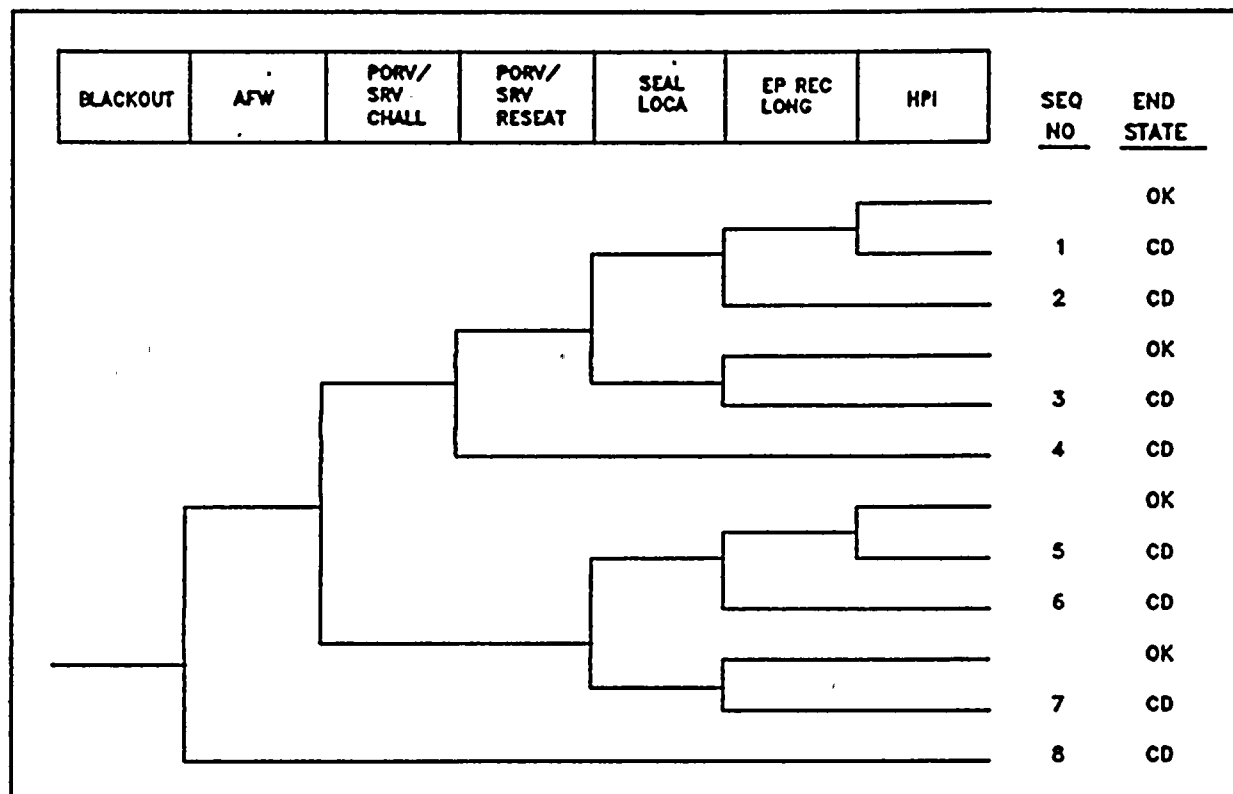

Two time periods are represented in the sequences in the above figure. Auxiliary feedwater, power-operated relief valve/safety relief valve (PORV/SRV) challenge, and PORV/SRV reseal are short-term responses following loss of the diesel generators. If turbine-driven AFW is unavailable, or if an open PORV/SRV fails to close, then core damage is assumed to occur, since no high-pressure injection is available as an alternate means of core cooling or for RCS makeup. SEAL LOCA, EP REC LONG, and HPI are branches applicable in the long term. SEAL LOCA represents the likelihood of a seal LOCA prior to restoration of ac power. EP REC LONG represents the likelihood of not restoring ac power prior to core uncover (if a seal LOCA exists) or prior to battery depletion (in the case of no seal LOCA). Once the batteries are depleted, core damage is assumed to occur, since control of turbine-driven pumps and the ability to monitor core and RCS conditions are lost. HPI represents the likelihood of failing to provide HPI following a seal LOCA to prevent core damage. The ASP models have been simplified somewhat by assuming that HPI is always adequate to make up for flow from a failed seal or seals.

The three seal LOCA-related sequences are illustrated in sequences 1, 2, and 3. In sequence 1, a seal LOCA occurs prior to restoration of ac power, ac power is successfully restored prior to core uncover, but HPI fails to provide makeup flow. In sequence 2, a seal LOCA also occurs, and ac power is not restored prior to core uncover. In sequence 3, no seal LOCA occurs, but ac power is not recovered prior to battery depletion. The likelihood of seal LOCA prior to ac power restoration and the likelihood of ac power recovery are time-dependent, and this time-dependency is accounted for in the analysis. A

more detailed description of the changes associated with explicitly modeling RCP seal LOCA is included in Ref. 2.

In addition to elimination of core vulnerability sequences, two other changes were made to simplify the previously complex BWR event trees:

- Failure to trip with soluble boron injection success was previously developed in detail and involved a large number of low probability sequences. All failure to trip sequences are now assigned to the ATWS end state.
- The condensate system was previously modeled as an alternate source of low-pressure injection water. This use of the condensate system is now considered a recovery action. This reduces the number of sequences on the event trees without substantially impacting the core damage probability estimates developed using the trees. Systems addressed on the event trees for low-pressure injection include LPCS, LPCI, and RHRSW.

A.2 Plant Categorization

Both the 1969-79 and 1980-81 precursor reports (Refs. 1 and 2) used simplified, functionally based event trees to model potential event sequences. One set of event trees was used to model for PWR initiating events: LOFW, LOOP, small-break LOCA, and steam line break. A separate set of event trees was used to model BWR response to the same initiators. Operational events that could not be modeled using these "standardized" event trees were addressed using models specifically developed for the event.

It was recognized during the review of the 1969-79 precursor report that plant designs were sufficiently different that multiple models would be required to more correctly describe the impact of an operational event in different plants. In 1985, substantial effort was expended to develop a categorization scheme for all U.S. LWRs that would permit grouping of plants with similar response to a transient or accident at the system or functional level, and to subsequently develop eight sets of plant-class specific event tree models. Much of the categorization and early event sequence work was done at the University of Maryland (Refs. 3 and 4). The ASP Program has generally employed these categorizations; however, some modifications have been required to reflect more closely the specific needs of the precursor evaluations.

In developing the plant categorizations, each reactor plant was examined to determine the systems used to perform the following plant functions required in response to reactor trip, LOOP, and small-break LOCA initiators to prevent core damage: reactor subcriticality, RCS integrity, reactor coolant inventory, short-term core heat removal, and long-term core heat removal.

Functions related to containment integrity (containment overpressure protection and containment heat removal) and post-accident reactivity removal are not included on the present ASP event trees (which only concern core damage sequences) and are not addressed in the categorization scheme.

For each plant, systems utilized to perform each function were identified. Plants were grouped based on the use of nominally identical systems to perform each function; that is, systems of the same type and function without accounting for the differences in the design of those systems.

Three BWR plant classes were defined. BWR Class A consists of the older plants, which are characterized by isolation condensers (ICs) and feedwater coolant injection (FWCI) systems that employ the MFW pumps. BWR Class B consists of plants that have ICs but a separate HPCI system instead of FWCI. BWR Class C includes the modern plants that have neither ICs nor FWCI. However, they have a RCIC system that Classes A and B lack. The Class C plants could be separated into two subgroups, those plants with turbine-driven HPCI systems and those with motor-driven HPCS systems. This difference is addressed instead in the probabilities assigned to branches impacted by the use of these different system designs.

PWRs are separated into five classes. One class represents most Babcock & Wilcox Company plants (Class D). These plants have the capability of performing feed and bleed without the need to open the PORV. Combustion Engineering plants are separated into two classes, those that provide feed and bleed capability (Class G) and those that provide for secondary-side depressurization and the use of the condensate system as an alternate core cooling method, and for which no feed and bleed is available (Class H).²²

The remaining two classes address Westinghouse plants — Class A is associated with plants that require the use of spray systems for core heat removal following a LOCA, and Class B is associated with plants that can utilize low-to-high pressure recirculation for core heat removal.

Plants in which initiator response cannot be described using plant-class models are addressed using unique models. For example, the now deactivated LaCrosse BWR.

Table A.17 lists the class associated with each plant.

A.3 Event Tree Models

The plant class event trees describe core damage sequences for three initiating events: a nonspecific reactor trip, a LOOP, and a small-break LOCA. The event trees constructed are system-based and include an event tree applicable to each plant class defined.

System designs and specific nomenclature may differ among plants included in a particular class; but functionally, they are similar. Plants where certain mitigating systems do not exist, but which are largely analogous in their transient response, were grouped into the plant classes accordingly. In modeling events at such plants, the event tree branch probabilities were modified to reflect the systems available at the plant. Certain events (such as a postulated steam line break) could not be described using the plant-class event trees presented in this appendix. In these cases, unique event trees were developed to describe the sequences of interest.

²²Maine Yankee Atomic Power Plant was built by Combustion Engineering but has a response to initiating events more akin to the Westinghouse Electric Corporation design, so it is grouped in a class with other Westinghouse plants. Davis-Besse Nuclear Power Station was also placed in a Westinghouse plant class because its HPI system design requires the operator to open the PORV for feed and bleed, as in most Westinghouse plants. The requirement to open the PORV for feed and bleed is a primary difference between event trees for Westinghouse and Babcock and Wilcox plants. Plant response differences resulting from the use of different SG designs are not addressed in the models.

This section (1) describes the potential plant response to the three initiating events described above, (2) identifies the combinations of systems required for the successful mitigation of each initiator, and (3) briefly describes the criteria for success of each system-based function. The sequences are considered first for PWRs and then separately for BWRs. PWR Class B event trees are described first, along with those for Class D, which are similar. (The major difference between Class B and Class D plants is that PORV operability is not required for feed and bleed on Class D plants.) The event trees for the combined group apply to the greatest number of operating PWRs. Therefore, these are discussed first, followed by those for PWR Classes G, H, and then A. For the BWR event trees, the plant Class C models are described first, because these are applicable to the majority of the BWRs, followed by discussions for the A and B BWR classes, respectively. The event trees are constructed with branch (event or system) success as the upper branch and failure as the lower branch. Each sequence path is read from left to right, beginning with the initiator followed by subsequent systems required to preclude or mitigate core damage.

The event trees can be found following the discussion sections and are grouped according to plant classes, beginning with the PWR classes and followed by the BWR classes. The abbreviations used in the event tree models are defined in Table A.16 preceding the event trees. Sequence numbers are provided on the event trees for undesirable end states (core damage and ATWS). Because of the similarities among PWR sequences for different plant classes, common sequence numbers have been assigned when possible. PWR Class B sequences were used as a basis for this. Sequence numbers beyond those for Class B are used for uncommon sequences on other plant classes. This approach facilitates comparison of sequences among plant classes. This approach could not be used for BWRs because of the significant difference in systems used on plants in the three plant classes. For BWRs, sequences are numbered in increasing order moving down each event tree. The following sequence number groups are employed for all event trees: transient with reactor trip success, 11-39; LOOP with reactor trip success, 40-69; small-break LOCA with reactor trip success, 71-79; ATWS sequences, 91-99.

The trees are presented in the following order:

<u>Figure No.</u>	<u>Event tree</u>
A.4	PWR Class A nonspecific reactor trip
A.5	PWR Class A loss of offsite power
A.6	PWR Class A small-break loss-of-coolant accident
A.7	PWR Classes B and D nonspecific reactor trip
A.8	PWR Classes B and D loss of offsite power
A.9	PWR Classes B and D small-break loss-of-coolant accident
A.10	PWR Class G nonspecific reactor trip
A.11	PWR Class G loss of offsite power
A.12	PWR Class G small-break loss-of-coolant accident
A.13	PWR Class H nonspecific reactor trip
A.14	PWR Class H loss of offsite power
A.15	PWR Class H small-break loss-of-coolant accident
A.16	BWR Class A nonspecific reactor trip
A.17	BWR Class A loss of offsite power
A.18	BWR Class A small-break loss-of-coolant accident
A.19	BWR Class B nonspecific reactor trip
A.20	BWR Class B loss of offsite power
A.21	BWR Class B small-break loss-of-coolant accident
A.22	BWR Class C nonspecific reactor trip

- A.23 BWR Class C loss of offsite power
 A.24 BWR Class C small-break loss-of-coolant accident

A.3.1 PWR Event Sequence Models

The PWR event trees describe the impact of the availability and unavailability of front-line systems in each plant class on core protection following three initiating events: reactor trip, LOOP, and small-break LOCA. The systems modeled in the event trees are those associated with the generic functions required in response to an initiating event, as described in Sect. A.2. The systems that are assumed capable of providing these functions are:

Function	System
Reactor subcriticality:	Reactor trip
Reactor coolant system integrity:	Addressed in small-break LOCA models plus trip and LOOP sequences involving failure of primary relief valves to close
Reactor coolant inventory:	High-pressure injection (assumed required only following a LOCA)
Short-term core heat removal:	Auxiliary feedwater Main feedwater High-pressure injection and PORV (feed and bleed, PWR Classes A, B, D, and G) Secondary-side depressurization and use of condensate system (PWR Class H)
Long-term core heat removal:	Auxiliary feedwater Main feedwater High-pressure recirculation (PWR Classes B and D) (also required to support RCS inventory for all classes) Secondary-side depressurization and use of condensate system (PWR Class H) Containment spray recirculation (PWR Classes A and G)

PWR Nonspecific Reactor Trip

The PWR nonspecific reactor trip event tree constructed for plant Classes B and D is shown in Fig. A.7. The event-tree branches and the sequences leading to severe core damage and ATWS follow.

1. **Initiating event (transient).** The initiating event for the tree is a transient or upset event that requires or is followed by a rapid shutdown of the plant. LOOP and small-break LOCA initiators are modeled in separate event trees. Large-break LOCA or large SLB initiators are not addressed in the models described here.
2. **Reactor trip.** To achieve reactor subcriticality and thus halt the fission process, the reactor protection system (RPS) is required to insert control rods into the core. If the automatically initiated RPS fails, a reactor trip may be initiated manually. Failure to trip was considered to lead to the end state ATWS and was not developed further.
3. **Auxiliary feedwater.** AFW must be provided following trip to remove the decay heat still being generated in the reactor core via the SGs. Successful AFW operation requires flow from one or more AFW pumps to one or more SGs over a period of time ranging from 12 to 24 h (typically, one pump to one SG is adequate).
4. **Main feedwater.** In lieu of AFW, MFW can be utilized to remove the post shutdown decay heat. Depending on the individual plant design, either main or AFW may be used as the primary source of secondary-side heat removal.
5. **PORV or SRV challenged.** For sequences in which both reactor trip and steam generator feedwater flow (MFW or AFW) have been successful, the pressurizer PORV may or may not lift, depending on the peak pressurizer pressure following the transient. (In most transients, these valves do not lift.) The upper branch indicates that the valve or valves were challenged and opened. Because of the multiplicity of relief and safety valves, it was assumed that a sufficient number would open if the demand from a pressure transient exists.

The lower branch indicates that the pressurizer pressure was not sufficiently high to cause opening of a relief valve. For the sequence in which both AFW and MFW fail following a reactor trip, at least one PORV or SRV was assumed to open for overpressure protection.

6. **PORV or SRV reseats.** Success for this branch requires the closure of any open relief valve once pressurizer pressure has decreased below the relief valve set point. If a PORV sticks open, most plants are equipped with an isolation valve that allows for manual termination of the blowdown. Failure of a primary-side relief valve to close results in a transient-induced LOCA that is modeled as part of this event tree.
7. **High-pressure injection.** In the case of a transient-induced LOCA, HPI is required to provide RCS makeup to keep the core covered. Success for this branch requires introduction of sufficient borated water to keep the core covered, considering core decay heat. (Typically, one HPI train is sufficient for this purpose.)
8. **HPI and PORV open.** If normal methods of achieving decay heat removal via the SGs (MFW and AFW) are unavailable, core cooling can be accomplished on most plants by establishing a feed and bleed operation. This operation (1) allows heat removal via discharge of reactor coolant to the containment through the PORVs and (2) RCS makeup via injection of borated water from the HPI system. Except at Class D plants, successful feed and bleed requires the operator to open the PORV manually. At Class D plants, the HPI discharge pressure is high enough to lift the primary-side safety valves, and feed and bleed can be accomplished without the operator manually opening the PORVs. HPI success is dependent on plant design but requires the introduction of sufficient

amounts of borated water into the RCS to remove decay heat and provide sufficient reactor coolant makeup to prevent core damage.

9. High-pressure recirculation. Following a transient-induced LOCA (a PORV or SRV fails to reseal), or failure of secondary-side cooling (AFW and MFW) and initiation of feed and bleed, continued core cooling and makeup are required. This requirement can be satisfied by using HPI in the recirculation mode. In this mode the HPI pumps recirculate reactor coolant collected in the containment sump and pass it through heat exchangers for heat removal. When MFW or AFW is available, heat removal is only required for HPI pump cooling; if AFW or MFW is not available, HPR is required to remove decay heat as well. Typically, at Class B and D plants, the LPI pumps are utilized in the HPR mode, taking suction from the containment sump, passing the pumped water through heat exchangers, and providing net positive suction head to the HPI pumps.

The event tree applicable to a PWR Class G nonspecific reactor trip is shown in Fig. A.10. Many of the event tree branches and the sequences leading to successful transient mitigation and core damage are similar to those following a nonspecific reactor trip transient for plant Class B. At Class G plants, however, the HPR system performs both the high- and low-pressure recirculation (LPR), function, taking suction directly from the containment sump without the aid of the low-pressure pumps. DHR is accomplished during recirculation by the containment spray recirculation (CSR) system. The event-tree branches and sequences are discussed further.

1. Initiating event (transient). The initiating event is a nonspecific reactor trip, similar to that described for PWR Classes B and D. The following branches have functions and success requirements similar to those following a transient at PWR Class B.
2. Reactor trip.
3. Auxiliary feedwater or main feedwater.
4. PORV or SRV challenged reseals.
5. High-pressure injection.
6. HPI and PORV open (feed and bleed). Success requirements for feed and bleed are similar to those following the plant Class B transient. Feed and bleed with operator opening of the PORV is required in the event that both AFW and MFW are unavailable for secondary-side cooling. In addition, DHR was assumed required to prevent potential core damage. This is provided by the CSR system.
7. High-pressure recirculation. In the event of a transient-induced LOCA, continued HPI via sump recirculation is needed to provide makeup to the break to prevent potential core damage. In addition, HPR is required when both AFW and MFW are unavailable following a transient, to recirculate coolant during the feed and bleed procedure. If HPR fails and normal secondary-side cooling is also failed, core damage will occur. In Class G plants, initiation of HPR realigns the HPI pumps to the containment sump. The use of LPI pumps for suction-pressure boosting is not required.

8. Containment spray recirculation. When feed and bleed (HPI, HPR, and PORV open) is required, the CSR system operates to remove decay heat from the reactor coolant being recirculated. Without the CSR system, the feed and bleed operation could not remove decay heat. Successful operation of feed and bleed and CSR was assumed to result in successful mitigation of core damage.

The event tree for PWR Class H non-specific reactor trip is shown in Fig. A.13. This class of plants is different than other PWR classes in that PORVs are not included in the plant design and feed and bleed cannot be used to remove decay heat in the event of main and AFW unavailability. If main or AFW cannot be recovered, the atmospheric dump valves can be used to depressurize the SGs to below the shutoff head of the condensate pumps, and these can be used, if available, for RCS cooling. Because of the need for secondary-side cooling for all success sequences, a requirement for CC to prevent core damage has not been modeled.

1. Initiating event (transient). The initiating event is a non-specific reactor trip, similar to that described for the previous PWR classes. The following branches have functions and success requirements similar to those following a transient at PWRs associated with previously described PWR classes.
2. Reactor trip.
3. Auxiliary feedwater.
4. Main feedwater.
5. SRV challenged. The upper branch indicates that at least one safety valve has lifted as a result of the transient. In most transients in which reactor trip has been successful and main or AFW is available, these valves do not lift. In the case where both main and AFW are unavailable, at least one SRV is assumed to lift. The lower branch indicates that the pressurizer pressure was not sufficiently high to cause the opening of a relief valve.
6. SRV reseal. Success for this branch requires the closure of any open safety valve once pressurizer pressure has been reduced below the safety valve set point.
7. High-pressure injection. In the case of a transient-induced LOCA, HPI is required to provide RCS makeup to keep the core covered.
8. High-pressure recirculation. The requirement for continued core cooling during mitigation of a transient-induced LOCA and following depletion of the refueling water tank can be satisfied by using HPI in the recirculation mode. In Class H plants, initiation of HPR realigns the HPI pumps to the containment sump. The use of LPI pumps for suction-pressure boosting is not required.
9. Steam generator depressurization. In the event that main and AFW are unavailable, the atmospheric dump valves (or turbine bypass valves if the main steam isolation valves are open) may be used on Class H plants to depressurize the SGs to the point that the condensate pumps can be used for SG cooling. In the event of main and AFW unavailability, failure to depressurize one SG to the operating pressure of the condensate system is assumed to result in core damage.
10. Condensate pumps. As described above, use of the condensate pumps on Class H plants along with secondary-side depressurization can provide adequate core cooling. Flow from one condensate

pump to one SG is assumed adequate. Unavailability of the condensate pumps in the event of failure to recover main and AFW is assumed to result in core damage.

The event tree applicable to PWR plant Class A nonspecific reactor trip is shown in Fig. A.4. Many of the event-tree branches and the sequences leading to successful transient mitigation and severe core damage are similar to those following a nonspecific reactor trip transient for plant Classes B and G.

Like the Class G plants, the Class A plants have a CSR system that provides DHR during HPR. Use of CSR for DHR was assumed to be required if AFW and MFW were unavailable. LPI pumps are required to provide suction to the HPI pumps during recirculation. The event-tree branches and sequences are discussed further below.

1. Initiating event (transient). The initiating event is a nonspecific reactor trip, similar to that described for the other PWR plant classes. The following branches have functions and success requirements similar to those following a transient at PWRs associated with plant Classes B, D, and G.
2. Reactor trip.
3. Auxiliary feedwater
4. Main feedwater.
5. PORV or SRV challenged.
6. PORV/SRV reseats.
7. High-pressure injection.
8. High-pressure recirculation. In the event of a transient-induced LOCA, HPR can provide sufficient makeup to the break to terminate the transient. The LPI pumps provide suction to the high-pressure pumps in the recirculation mode. In the event that feed and bleed is required (following a transient in which both AFW and MFW are unavailable), HPR success is required.
9. Containment spray recirculation. The CSR system provides DHR during HPR when AFW and MFW are not available. In transient-induced LOCA sequences, HPI and HPR success is required to mitigate the event. In the event that secondary-side cooling via AFW or MFW is unavailable, feed and bleed with CSR, for DHR is considered sufficient to prevent core damage.
10. PORV open. The PORV must be opened by the operator below its set point to establish feed and bleed operation in the event that secondary-side cooling via AFW or MFW is unavailable.

Sequences resulting in core damage or ATWS following a PWR transient, shown on event trees applicable to each plant class, are described in Table A.4.

Many of the sequences are the same for different plant classes, the primary differences being the use of CSR on Class G and Class A, and the use of SG depressurization and condensate pumps for RCS cooling in lieu of feed and bleed on Class H. Because of this similarity, consistent sequence numbers have been used for like sequences in different PWR plant classes. All sequences, required branch success and failure states, and the applicability of each sequence to each plant class are summarized in Table A.5.

PWR Loss of Offsite Power

The event trees constructed define representative plant responses to a LOOP. A LOOP (without turbine runback on plants with this feature) will result in reactor trip due to unavailability of power to the control rod drive (CRD) mechanisms and a loss of MFW because of the unavailability of power to components in the condensate and condenser cooling systems.

The PWR LOOP tree constructed for plant Classes B and D is shown in Fig. A.8. The event-tree branches and the sequences leading to core damage follow.

1. **Initiating event (LOOP).** The initiating event for the tree is a grid or switchyard disturbance to the extent that the generator must be separated from the grid and all offsite power sources are unavailable to plant equipment. The capability of a runback of the unit generator from full power to supply house loads exists at some plants but is not considered in the event tree. Only LOOPS that challenge the emergency power system (EPS) are addressed in the ASP Program.
2. **Reactor trip given LOOP.** Unavailability of power to the CRD mechanisms is expected to result in a reactor trip and rapid shutdown of the plant. If the reactor trip does not occur, the transient was considered to proceed to ATWS and was not developed further.
3. **Emergency power.** Given a LOOP and a reactor trip, electric power would be lost to all loads not backed by battery power. When power is lost, DGs are automatically started to provide power to the plant safety-related loads. Emergency power success requires the starting and loading of a sufficient number of DGs to support safety-related loads in systems required to mitigate the transient and maintain the plant in a safe shutdown condition.
4. **Auxiliary feedwater.** The AFW system functions to remove decay heat via the SG secondary side. Success requirements for this branch are equivalent to those following a nonspecific reactor trip and unavailability of MFW. Both MFW and condensate pumps would be unavailable following a LOOP. Therefore, with emergency power and AFW failed, no core cooling would be available, and core damage would be expected to occur. Because, specific AFW systems may contain different combinations of turbine-driven and motor-driven AFW pumps, the capability of the system to meet its success requirements will depend on the state of the EPS and the number of turbine-driven AFW pumps that are available.
5. **PORV or SRV challenged.** The upper and lower states for this branch are similar to those following a nonspecific reactor trip. The PORV or SRV may or may not lift, depending on the peak pressure following the transient.
6. **PORV or SRV reseats.** The success requirements for this branch are similar to those following a nonspecific reactor trip. However, for the sequence in which emergency power is failed and the PORV fails to reseat, the HPI/HPR system would be without power to mitigate potential core damage.
7. **Seal LOCA.** In the event of a loss of emergency power following LOOP, both SW and component cooling water (CCW) are faulted. This results in unavailability of RCP seal cooling and seal injection (since the charging pumps are also without power and cooling water). Unavailability of seal cooling and injection may result in seal failure after a period of time, depending on the seal

6. RHR (SDC mode) or RHR (SP cooling mode). Success requirements for these branches are similar to those following a nonspecific reactor trip transient, except that heat rejection to the environment may be required sooner than 24 h into the transient, depending on the break size. These methods each have the capability of providing long-term DHR. Long-term DHR is required in all sequences for LOCA mitigation.

The LOCA event tree constructed for BWR Class A plants is shown in Fig. A.18. The event tree is similar to the LOCA tree constructed for BWR Class C plants except that Class A plants have FWCI instead of HPCI or HPCS systems and are, in general, not equipped with LPCI systems (only LPCS systems). In addition, SP and CC systems are independent of the SDC system. The event tree branches and sequences leading to core damage follow.

1. Initiating event (small LOCA). The initiating event is a small LOCA similar to that described for BWR Class C plants. The following branches have functions and success requirements similar to those following a small LOCA at BWRs associated with the previously described BWR classes.
2. Reactor shutdown.
3. FWCI. The FWCI system has the capability to keep the core covered and provide interim core cooling. FWCI initiates automatically on low reactor water level.
4. Depressurization via SRV or ADS.
5. LPCS or fire water (or other water source). The success requirements for these branches are similar to those following a nonspecific reactor trip transient at Class A BWRs. Either of these systems (branches) can provide LPI for makeup and short-term core cooling if high-pressure systems are unavailable.
6. SDC or containment cooling. The success requirements for these branches are similar to those following a nonspecific reactor trip transient at Class A BWRs, except that heat rejection to the environment may be required sooner than 24 h into the transient, depending on the size of the break. Either of these methods can provide the long-term DHR required to mitigate a small LOCA.

The LOCA event tree constructed for BWR Class B plants is shown in Fig. A.21. The event tree is most similar to that constructed for BWR Class A plants. In fact, the branches and sequences are the same, except that some Class B plants are equipped with HPCI systems instead of FWCI systems and Class B BWRs have a LPCI system, which provides an additional capability for LPCI. At Class B BWRs the CC system uses the LPCI pumps rather than having its own dedicated pumps.

Sequences resulting in core damage following a BWR small-break LOCA, as shown on each plant-class event tree, are described in Table A.12. As in the case of BWR transients, similar sequence numbers do not imply similarity among the sequences. (Because of the lack of similarity among sequences for the three BWR classes, no sequence summary table has been provided.)

Alternate Recovery Actions

The BWR event trees have been developed on the basis that proceduralized recovery actions will be attempted if primary systems that provide protection against core damage are unavailable. If feedwater, HPCI, and RCIC are unavailable (FWCI and ICs on BWR Classes A and B) and cannot be recovered in

The event tree constructed for a BWR plant Class B LOOP is shown in Fig. A.20. The event tree is most similar to that constructed for BWR Class A plants. In fact, the branches and sequences are the same, except that Class B plants are equipped with HPCI systems instead of FWCI systems and are equipped with a LPCI system, which represents an additional capability for providing LPCI. At Class B BWRs the CC system utilizes the LPCI pumps rather than having its own dedicated pumps. In emergency power failure sequences, either the IC or HPCI system can provide the required core cooling for short-term transient mitigation. However, if an SRV sticks open (transient-induced LOCA), the ICs cannot provide the makeup needed, and HPCI is required. The ICs can also provide long-term cooling, but when only HPCI is operable, recovery of emergency power is necessary to power SDC-related loads.

Sequences resulting in core damage following a BWR LOOP, as shown on each plant-class event tree, are described in Table A.11. As in the case of BWR transients, similar sequence numbers do not imply similarity among the sequences. (Because of the lack of similarity among sequences for the three BWR classes, no sequence summary table has been provided.)

BWR Loss-of-Coolant Accident

The event trees constructed define the response of BWRs to a small LOCA in terms of sequences representing success and failure of plant systems. The LOCA chosen for consideration is a small LOCA, one that would require a reactor scram and continued operation of HPI systems. A large LOCA would require operation of the high-volume/low-pressure systems and is not addressed in the models.

The LOCA event tree constructed for BWR Class C plants is shown in Fig. A.24. The event-tree branches and sequences leading to core damage and core vulnerability follow.

1. Initiating event (small LOCA). Any breach in the RCS on the reactor side of the MSIVs that results in coolant loss in excess of the capacity of the CRD pumps is considered a LOCA. A small LOCA is considered to be one in which losses are not great enough to reduce the system pressure to the operating range of the LPI systems.
2. Reactor shutdown. Successful scram is defined as the rapid insertion of sufficient control rods to place the core in a subcritical condition.
3. HPCI or HPCS. HPCI (or HPCS, depending on the plant) can provide the required inventory makeup.
4. Depressurization via SRV or ADS. The success requirements for this branch are similar to those following a nonspecific reactor trip transient. SRV/ADS success allows the use of low-pressure systems to provide short-term core cooling and makeup.
5. LPCS, LPCI, or RHR service water. The success requirements for these branches are similar to those following a nonspecific reactor trip transient. Any one of these branches can provide short-term core cooling and makeup if SRV/ADS is successful.

Table A.15 shows that nonspecific reactor trips without additional observed failures have conditional core damage probabilities below 5×10^{-6} per trip, depending on plant class. The likelihood of LOFW in conjunction with a trip is included in these calculations. LOFW conditional core damage probabilities are less than 4×10^{-5} per LOFW event, again depending on plant class, except for BWR Class A plants (1.7×10^{-4}). The conditional core damage probabilities associated with unavailabilities of HPCI and HPCS (single-train BWR systems) are also above 10^{-5} , assuming a one-half month unavailability.

A.6 References

1. J. W. Minarick and C. A. Kukielka, Union Carbide Corp. Nuclear Div., Oak Ridge Natl. Lab., and Science Applications, Inc., *Precursors to Potential Severe Core Damage Accidents: 1969-1979, A Status Report*, USNRC Report NUREG/CR-2497 (ORNL/NOAC-232, Vol. 1 and 2), 1982.*
2. W. B. Cottrell, J. W. Minarick, P. N. Austin, E. W. Hagen, and J. D. Haltis, Martin Marietta Energy Systems, Inc., Oak Ridge Natl. Lab., and Science Applications International Corp., *Precursors to Potential Severe Core Damage Accidents: 1980-81, A Status Report*, USNRC Report NUREG/CR-359 1, Vols. 1 and 2 (ORNL/NSIC-217/V1 and V2), July 1984.
3. M. Modarres, E. Lois, and P. Amico, Martin Marietta Energy Systems, Inc., Oak Ridge Natl. Lab., *LER Categorization Report*, University of Maryland, College Park, MD, Nov. 13, 1984.*
4. E. Lois, *A Class-Specific Approach to Nuclear Power Plant Safety Studies with Applications*, PhD Dissertation, University of Maryland, College Park, MD, 1985.*
5. J. W. Minarick et al., Martin Marietta Energy Systems, Inc., Oak Ridge Natl. Lab., and Science Applications International Corp., *Precursors to Potential Severe Core Damage Accidents: 1986, A Status Report*, USNRC Report NUREG/CR-4674 (ORNL/NOAC-232, Vols. 5 and 6), May 1988.
6. J. W. Minarick, Martin Marietta Energy Systems, Inc., Oak Ridge Natl. Lab., Science Applications International Corp., *Revised LOOP Recovery and PWR Seal LOCA Models*, Technical Letter Report ORNL/NRC/LTR-89/11, August 1989.*

*Available for purchase from National Technical Information Service, Springfield, Virginia 22161.

the short term, the use of the CRD pumps (provided no LOCA exists) and the use of ADS (to depressurize below the operating pressure of low-pressure systems) are modeled. In addition, potential for short-term recovery of a faulted system is also included in the appropriate branch mode.

Alternate equipment and procedures, beyond the systems and functions included in the event tree, may be successful in mitigating the effects of an initiating event, provided the appropriate equipment or procedure is available at a particular plant. This may include:

- The use of supplemental diesel generators, beyond the normal safety-related units, to power equipment required for continued core cooling and reactor plant instrumentation. A number of plants have added such equipment, often for fire protection.
- The use of RCIC to provide RPV makeup for a single stuck-open relief valve. Thermal-hydraulic analyses performed to support a number of BWR probabilistic risk assessments have demonstrated the viability of RCIC for this purpose.
- The use of the condensate system for LPI. This recovery action requires that the condensate system be available (even though PCS and feedwater are unavailable) and that the plant has been depressurized.
- The use of containment venting for long-term DHR, provided an injection source is available. This core cooling method has been addressed in some PRAs.

The potential use of these alternate recovery actions was addressed in the analysis of the 1992 precursors when information concerning their plant specific applicability was available.

A.4 Branch Probability Estimates

Branch probability estimates used in the 1988-1992 precursor calculations were developed using information in the 1984-86 precursors when possible. Probability values developed from precursor information are shown in Table A.13. The process used to estimate branch probability values used in the precursor calculations is described in detail in Appendix C to Ref. 5 and in Ref. 6.

In addition to system failures caused by equipment failures, the likelihood of failing to actuate manually actuated systems was also included in the models. Examples of such systems are the DHR system in BWRs and feed and bleed in PWRs. For actions in the control room, revised failure to initiate probabilities consistent with those utilized for 1987 precursor calculations were also used for 1988-1992 calculations. These revised values typically assume a failure probability of 0.001 for an unburdened action and 0.01 for a burdened action. The failure probability for subsequent actions is assumed to be higher. Operator action failure probabilities used in the 1988-1992 calculations are shown in Table A.14.

A.5 Reference Event Calculations

Conditional core damage probability estimates were also calculated for nonspecific reactor trip, LOFW, and unavailabilities in certain single-train BWR systems (HPCI, HPCS, RCIC, and CRD cooling). These calculations indicate the relative importance of these events, which are too numerous to warrant individual calculation. The results of these calculations, performed without consideration of alternate recovery actions that were addressed in certain 1992 precursor assessments, are listed in Table A.15.

Table A.2 Rules for calculating precursor significance

1. Event sequences requiring calculation.

If an initiating event occurs as part of a precursor (i.e., the precursor consists of an initiating event plus possible additional failures), then use the event tree associated with that initiator; otherwise, use all event trees impacted by the observed unavailability.

2. Initiating event probability.

If an initiating event occurs as part of a precursor, then the initiator probability used in the calculation is the probability of failing to recover from the observed initiating event (i.e., the numeric value of the recovery class for the event).

If an initiating event does not occur as part of a precursor, then the probability used for the initiating event is developed using the initiating event frequency and event duration. Event durations (the period of time during which the failure existed) are based on information included in the event report, if provided. If the event is discovered during testing, then one-half of the test period (15 days for a typical 30-day test interval) is assumed, unless a specific failure duration is identified.

3. Branch probability estimation.

For event tree branches for which no failed or degraded condition is observed, a probability equal to the estimated branch failure probability is assigned.

For event tree branches associated with a failed system, a probability equal to the numeric value associated with the recovery class is assigned.

For event tree branches that include a degraded system (i.e., a system that still meets minimum operability requirements but with reduced or no redundancy), the estimated failure probability is modified to reflect the loss of redundancy.

4. Support system unavailabilities.

Systems or trains rendered unavailable as a result of support system failures are modeled recognizing that, as long as the affected support system remains failed, all impacted systems (or trains) are unavailable; but if the support system is recovered, all the affected systems are recovered. This can be modeled through multiple calculations that address support system failure and success. Calculated core damage probabilities for each case are normalized based on the likelihood of recovering the support system. (Support systems, except emergency power, are not directly modeled in the current ASP models.)

Table A.3 ASP reactor plant classes

Plant name	Plant class	Plant name	Plant class
ANO-Unit1	PWR Class D	Millstone 3	PWR Class A
ANO-Unit	PWR Class G	Monticello	BWR Class C
Beaver Valley 1	PWR Class A	Nine Mile Point 1	BWR Class A
Beaver Valley 2	PWR Class A	Nine Mile Point 2	BWR Class C
Big Rock Point	BWR Class A	North Anna 1	PWR Class A
Browns Ferry 1	BWR Class C	North Anna 2	PWR Class A
Browns Ferry 2	BWR Class C	Oconee 1	PWR Class D
Browns Ferry 3	BWR Class C	Oconee 2	PWR Class D
Braidwood 1	PWR Class B	Oconee 3	PWR Class D
Braidwood 2	PWR Class B	Oyster Creek	BWR Class A
Brunswick 1	BWR Class C	Palisades	PWR Class G
Brunswick 2	BWR Class C	Palo Verde 1	PWR Class H
Byron 1	PWR Class B	Palo Verde 2	PWR Class H
Byron 2	PWR Class B	Palo Verde 3	PWR Class H
Callaway 1	PWR Class B	Peach Bottom 2	BWR Class C
Calvert Cliffs 1	PWR Class G	Peach Bottom 3	BWR Class C
Calvert Cliffs 2	PWR Class G	Perry 1	BWR Class C
Catawba 1	PWR Class B	Pilgrim 1	BWR Class C
Catawba 2	PWR Class B	Point Beach 1	PWR Class B
Clinton 1	BWR Class C	Point Beach 2	PWR Class B
Cornanche Peak 1	PWR Class B	Prairie Island 1	PWR Class B
Cornanche Peak 2	PWR Class B	Prairie Island 2	PWR Class B
Cook 1	PWR Class B	Quad Cities 1	BWR Class C
Cook 2	PWR Class B	Quad Cities 2	BWR Class C
Cooper Station	BWR Class C	Rancho Seco	PWR Class D
Crystal River 3	PWR Class D	River Bend 1	BWR Class C
Davis-Besse	PWR Class B	Robinson 2	PWR Class B
Diablo Canyon 1	PWR Class B	Salem 1	PWR Class B
Diablo Canyon 2	PWR Class B	Salem 2	PWR Class B
Dresden 2	BWR Class B	San Onofre 1	Unique
Dresden 3	BWR Class B	San Onofre 2	PWR Class H
Duane Arnold	BWR Class C	San Onofre 3	PWR Class H
Farley 1	PWR Class B	Seabrook 1	PWR Class B
Farley 2	PWR Class B	Sequoyah 1	PWR Class B
Fermi 2	BWR Class C	Sequoyah 2	PWR Class B
Fitzpatrick	BWR Class C	South Texas 1	PWR Class B
Fort Calhoun	PWR Class G	South Texas 2	PWR Class B
Ginna	PWR Class B	St. Lucie 1	PWR Class G
Grand Gulf 1	BWR Class C	St. Lucie 2	PWR Class G
Haddam Neck	PWR Class B	Summer 1	PWR Class B
Harris 1	PWR Class B	Surry 1	PWR Class A
Hatch 1	BWR Class C	Surry 2	PWR Class A
Hatch 2	BWR Class C	Susquehanna 1	BWR Class C
Hope Creek 1	BWR Class C	Susquehanna 2	BWR Class C
Indian Point 2	PWR Class B	Three Mile Island 1	PWR Class D
Indian Point 3	PWR Class B	Trojan	PWR Class B
Kewaunee	PWR Class B	Turkey Point 3	PWR Class B
LaCrosse	Unique	Turkey Point 4	PWR Class B
LaSalle 1	BWR Class C	Vermont Yankee	BWR Class C
LaSalle 2	BWR Class C	Vogtle 1	PWR Class B
Limerick 1	BWR Class C	Vogtle 2	PWR Class B
Limerick 2	BWR Class C	WNPSS 2	BWR Class C
Maine Yankee	PWR Class B	Waterford 3	PWR Class H
McGuire 1	PWR Class B	Wolf Creek 1	PWR Class B
McGuire 2	PWR Class B	Yankee Rowe	PWR Class B
Millstone 1	BWR Class A	Zion 1	PWR Class B
Millstone 2	PWR Class G	Zion 2	PWR Class B

Table A.4 PWR transient core damage and ATWS sequences

Sequence No.	End state	Description
11	Core damage	Unavailability of HPR following successful trip and AFW initiation, primary relief valve lift and failure to reseal, and successful HPI. (PWR Classes A, B, D, G, and H)
12	Core damage	Unavailability of HPI following successful trip and AFW initiation, primary relief valve lift, and primary relief valve failure to reseal. (PWR Classes A, B, D, G, and H)
13	Core damage	Similar to sequence 11, but MFW provides SG cooling in lieu of AFW. (PWR Classes A, B, D, G, and H)
14	Core damage	Similar to sequence 12, but MFW provides SG cooling in lieu of AFW. (PWR Classes A, B, D, G, and H)
15	Core damage	Unavailability of AFW and MFW following successful trip. Feed and bleed is initiated, but the PORV fails to open. (PWR Classes A, B, and G)
16	Core damage	Unavailability of AFW and MFW following successful trip. Feed and bleed is initiated, but fails in the recirculation phase. (PWR Classes A, B, D, and G)
17	Core damage	Unavailability of AFW and MFW following successful trip. Feed and bleed fails in the injection phase. (PWR Classes A, B, D, and G)
18	ATWS	Failure to trip following a transient requiring trip. ATWS sequences are not further developed in the ASP models. (PWR Classes A, B, D, G, and H)
19	Core damage	Unavailability of AFW and MFW following successful trip. Feed and bleed is successful but CSR is unavailable. (PWR Class G)
20	Core damage	Unavailability of CSR following successful trip and AFW initiation, primary relief valve lift and failure to reseal, and successful HPI and HPR. (PWR Class A)
21	Core damage	Similar to sequence 11, but MFW provides SG cooling in lieu of AFW. (PWR Class A)
22	Core damage	Unavailability of AFW and MFW following successful trip. Feed and bleed is successful, but CSR is unavailable for containment heat removal. This sequence is distinguished from sequence 19 because of differences in the function of CSR on Class A and G plants. (PWR Class A)

Table A.4 PWR transient core damage and ATWS sequences

Sequence No.	End state	Description
23	Core damage	Unavailability of AFW and MFW following successful trip. The SGs are successfully depressurized, but the condensate pumps fail to provide SG cooling. (PWR Class H)
24	Core damage	Unavailability of AFW and MFW following successful trip, plus failure to depressurize the SGs to allow for the use of the condensate pumps for SG cooling. (PWR Class H)
25	Core damage	Unavailability of AFW and MFW following successful trip. At least one open SRV fails to reseal, but HPI and HPR are successful. SG depressurization is successful, but the condensate pumps fail to provide SG cooling. (PWR Class H)
26	Core damage	Similar to sequence 25 except that SG depressurization fails. (PWR Class H)
27	Core damage	Unavailability of AFW and MFW following successful trip. At least one SRV fails to reseal. HPI is initiated but HPR fails. (PWR Class H)
28	Core damage	Unavailability of AFW and MFW following successful trip. At least one SRV fails to reseal and HPI fails. (PWR Class H)

Table A.5 PWR transient sequences summary

Seq. No.	End State	RT	AFW	MFW	RV Chall	RV Reseat	HPI	HPR	PORV Open	CSR	SG Dep	Condensate Pumps	PWR Class				
													A	B	D	G	H
11	CD	S	S		S*	F	S	F					x	x	x	x	x
12	CD	S	S		S*	F	F						x	x	x	x	x
13	CD	S	F	S	S*	F	S	F					x	x	x	x	x
14	CD	S	F	S	S*	F	F						x	x	x	x	x
15	CD	S	F	F			S	S	F				x	x		x	
16	CD	S	F	F			S	F					x	x	x	x	
17	CD	S	F	F			F						x	x	x	x	
18	ATWS	F											x	x	x	x	x
19	CD	S	F	F			S	S	S	F						x	
20	CD	S	S		S*	F	S	S		F			x				
21	CD	S	F	S	S*	F	S	S		F			x				
22	CD	S	F	F			S	S	S	F			x				
23	CD	S	F	F		S					S	F					x
24	CD	S	F	F		S					F						x
25	CD	S	F	F		F	S	S			S	F					x
26	CD	S	F	F		F	S	S			F						x
27	CD	S	F	F		F	S	F									x
28	CD	S	F	F		F	F										x

Note:

CD - Core damage.

S - Required and successfully performs its function.

F - Required and fails to perform its function.

S* - Relief valve challenged during the transient (assumed for all losses of both AFW and MFW).

Table A.6 PWR LOOP core damage and ATWS sequences

Sequence No.	End state	Description
40	ATWS	Failure to trip following a LOOP. (PWR Classes A, B, D, G, and H)
41	Core damage	Unavailability of HPR following a LOOP with successful trip, emergency power, and AFW; primary relief valve lift and failure to reseal; and successful HPI. (PWR Classes A, B, D, G, and H)
42	Core damage	Unavailability of HPI following LOOP with successful trip, emergency power, and AFW; primary relief valve lift and failure to reseal. (PWR Classes A, B, D, G, and H)
43	Core damage	Failure of the PORV to open for feed and bleed cooling following successful trip and emergency power, and AFW failure. (PWR Classes A, B, and G)
44	Core damage	Failure of HPR for recirculation cooling following feed and bleed initiation. Trip and emergency power are successful, but AFW fails. (PWR Classes A, B, D, and G)
45	Core damage	Unavailability of HPI for feed and bleed cooling following successful trip and emergency power and AFW failure. (PWR Classes A, B, D, and G)
46	Core damage	Unavailability of HPR following HPI success for RCP seal LOCA mitigation. AC power is recovered following successful trip, emergency power failure, turbine-driven AFW train(s) success, primary relief valve lift and reseal, and a subsequent seal LOCA. (PWR Classes A, B, D, G, and H)
47	Core damage	This sequence is similar to sequence 46 except that HPI fails for RCP seal LOCA mitigation. (PWR Classes A, B, D, G, and H)
48	Core damage	Failure to recover AC power following an RCP seal LOCA. The seal LOCA occurs following successful trip, failure of emergency power, turbine-driven AFW train(s) success, and primary relief valve lift and closure. (PWR Classes A, B, D, G, and H)
49	Core damage	Failure to recover AC power following successful trip and emergency power system failure; AFW turbine train(s) success, and primary relief valve lift and reseal. No RCP seal LOCA occurs in the sequence. (PWR Classes A, B, D, G, and H)
50	Core damage	Failure of a primary relief valve to reseal following lift subsequent to a successful trip, emergency power system failure, and AFW turbine train(s) success. (PWR Classes A, B, D, G, and H)

Table A.6 PWR LOOP core damage and ATWS sequences

Sequence No.	End state	Description
51	Core damage	This sequence is similar to sequence 46 except that the primary relief valves are not challenged. (PWR Classes A, B, D, G, and H)
52	Core damage	This sequence is similar to sequence 47 except that the primary relief valves are not challenged. (PWR Classes A, B, D, G, and H)
53	Core damage	This sequence is similar to sequence 48 except that the primary relief valves are not challenged. (PWR Classes A, B, D, G, and H)
54	Core damage	This sequence is similar to sequence 49 except that the primary relief valves are not challenged. (PWR Classes A, B, D, G, and H)
55	Core damage	Failure of AFW following successful trip and emergency power system failure (PWR Classes A, B, D, G, and H)
56	Core damage	Failure of CSR in conjunction with successful feed and bleed following trip, emergency power system success, and AFW failure (PWR Class G)
57	Core damage	Failure of CSR following LOOP with successful trip, emergency power and AFW, primary relief valve challenge and failure to reseal, and successful HPI and HPR. (PWR Class A)
58	Core damage	Failure of CSR in conjunction with successful feed and bleed following LOOP with successful trip and emergency power initiation, and AFW failure. (PWR Class A)
59	Core damage	Failure of CSR following successful HPI and HPR required to mitigate a seal LOCA. This sequence involves a LOOP with successful trip, emergency power system failure, primary relief valve challenge and reseal, and a subsequent seal LOCA with AC power recovery prior to core uncover. (PWR Class A)
60	Core damage	This sequence is similar to sequence 59 except that the primary relief valves are not challenged. (PWR Class A)
61	Core damage	Failure of AFW following a LOOP with successful trip and emergency power. (PWR Class H)

Table A.7 PWR LOOP sequences summary

Seq. No.	End State	RT/ LOOP	EP	AFW	RV Chall	RV Reseat	Seal LOCA	EP Recov	HPI	HPR	PORV Open	CSR	PWR Class				
													A	B	D	G	H
40	ATWS	F											x	x	x	x	x
41	CD	S	S	S	S*	F			S	F			x	x	x	x	x
42	CD	S	S	S	S*	F			F				x	x	x	x	x
43	CD	S	S	F					S	S	F		x	x		x	
44	CD	S	S	F					S	F			x	x	x	x	
45	CD	S	S	F					F				x	x	x	x	
46	CD	S	F	S	S*	S	S*	S	S	F			x	x	x	x	x
47	CD	S	F	S	S*	S	S*	S	F				x	x	x	x	x
48	CD	S	F	S	S*	S	S*	F					x	x	x	x	x
49	CD	S	F	S	S*	S		F					x	x	x	x	x
50	CD	S	F	S	S*	F							x	x	x	x	x
51	CD	S	F	S			S*	S	S	F			x	x	x	x	x
52	CD	S	F	S			S*	S	F				x	x	x	x	x
53	CD	S	F	S			S*	F					x	x	x	x	x
54	CD	S	F	S				F					x	x	x	x	x
55	CD	S	F	F									x	x	x	x	x
56	CD	S	S	F					S	S	S	F				x	
57	CD	S	S	S	S*	F			S	S		F	x				
58	CD	S	S	F					S	S	S	F	x				
59	CD	S	F	S	S*	S	S*	S	S	S		F	x				
60	CD	S	F	S			S*	S	S	S		F	x				
61	CD	S	S	F													x

Note:

CD - Core damage.

S - Required and successfully performs its function.

F - Required and fails to perform its function.

S* - Relief valve challenged during the transient (assumed for all losses of both AFW and MFW).

Table A.8 PWR small-break LOCA core damage and ATWS sequences

Sequence No.	End state	Description
71	Core damage	Unavailability of HPR following a small-break LOCA with trip, AFW and HPI success. (PWR Classes A, B, D, G, and H)
72	Core damage	Unavailability of HPI following a small-break LOCA with trip and AFW success. (PWR Classes A, B, D, G, and H)
73	Core damage	This sequence is similar to sequence 71 except that MFW is utilized for SG cooling is AFW is unavailable. (PWR Classes A, B, D, G, and H)
74	Core damage	This sequence is similar to sequence 72 except that MFW is utilized for SG cooling is AFW is unavailable. (PWR Classes A, B, D, G, and H)
75	Core damage	Unavailability of AFW and MFW following a small-break LOCA and successful trip. The PORV is unavailable to depressurize the RCS to the HPI pump discharge pressure. (PWR Classes A, B, and G)
76	Core damage	Unavailability of AFW and MFW following a small-break LOCA with trip success. HPI is successful but HPR fails. (PWR Classes A, B, D, G, and H)
77	Core damage	Unavailability of AFW and MFW following trip success. HPI fails to provide RCS makeup. (PWR Classes A, B, D, G, and H)
78	ATWS	Failure of reactor trip following a small-break LOCA. (PWR Classes A, B, D, G, and H)
79	Core damage	Unavailability of CSR for containment heat removal following a small-break LOCA with trip success, AFW and MFW failure, and feed and bleed success. (PWR Class G)
80	Core damage	Unavailability of CSR following a small-break LOCA with trip, AFW, HPI and HPR success. (PWR Class A)
81	Core damage	This sequence is similar to sequence 80 except that MFW is used for SG cooling in the event AFW is unavailable. (PWR Class A)
82	Core damage	Unavailability of CSR for containment heat removal following a small-break LOCA with trip success, AFW and MFW unavailability, and feed and bleed success. (PWR Class A)
83	Core damage	Unavailability of the condensate pumps for SG cooling following a small-break LOCA with trip success, unavailability of AFW and MFW, and successful SG depressurization. (PWR Class H)
84	Core damage	This sequence is similar to sequence 83 except that SG depressurization is unavailable. (PWR Class H)

Table A.9 PWR small-break LOCA sequences summary

Seq. No.	End State	RT	AFW	MFW	HPI	HPR	PORV Open	CSR	SG Dep	Condensate Pumps	PWR Class				
											A	B	D	G	H
71	CD	S	S		S	F					x	x	x	x	x
72	CD	S	S		F						x	x	x	x	x
73	CD	S	F	S	S	F					x	x	x	x	x
74	CD	S	F	S	F						x	x	x	x	x
75	CD	S	F	F	S	S	F				x	x		x	
76	CD	S	F	F	S	F					x	x	x	x	x
77	CD	S	F	F	F						x	x	x	x	x
78	ATWS	F									x	x	x	x	x
79	CD	S	F	F	S	S	S	F						x	
80	CD	S	S		S	S		F			x				
81	CD	S	F	S	S	S		F			x				
82	CD	S	F	F	S	S	S	F			x				
83	CD	S	F	F	S	S			S	F					x
84	CD	S	F	F	S	S			F						x

Note:

CD - Core damage.

S - Required and successfully performs its function.

F - Required and fails to perform its function.

S* - Relief valve challenged during the transient (assumed for all losses of both AFW and MFW).

Table A.10 BWR transient core damage and ATWS sequences

Sequence No.	End state	Description
<i>BWR Class A sequences</i>		
11	Core damage	Unavailability of long-term core cooling (failure of shutdown cooling system and containment cooling) following successful scram and failure of continued power conversion system operation, safety relief valve challenge and successful reseal, failure of isolation condenser, and successful main feedwater.
12	Core damage	Similar to Sequence 11 except failure of main feedwater and successful feedwater coolant injection.
13	Core damage	Similar to Sequence 11 except failure of main feedwater and feedwater coolant injection, followed by successful control rod drive cooling.
14	Core damage	Unavailability of long-term core cooling (failure of shutdown cooling system and containment cooling) following successful scram and failure of continued power conversion system operation; safety relief valve challenge and successful reseal; failure of isolation condenser; failure of main feedwater, feedwater coolant injection and control rod drive cooling; followed by successful vessel depressurization and low-pressure core spray.
15	Core damage	Unavailability of fire water or other equivalent water source for vessel makeup following successful scram and failure of continued power conversion system operation; safety relief valve challenge and success of isolation condenser, main feedwater, feedwater coolant injection, and control rod drive cooling. Successful vessel depressurization and failure of low-pressure core spray.
16	Core damage	Similar to Sequence 15 except the shutdown cooling system fails followed by successful containment cooling.
17	Core damage	Unavailability of long-term core cooling (failure of shutdown cooling system and containment cooling) following successful scram and failure of continued power conversion system operation; safety relief valve challenge and successful reseal; failure of isolation condenser, main feedwater, feedwater coolant injection, and control rod drive cooling systems; followed by successful vessel depressurization and failure of low-pressure core spray.
18	Core damage	Unavailability of vessel depressurization following successful scram and failure of continued power conversion system operation, and safety relief valve challenge and successful reseal. Failure of the isolation condenser, main feedwater, feedwater coolant injection, and control rod drive cooling.

Table A.10 BWR transient core damage and ATWS sequences

Sequence No.	End state	Description
19	Core damage	Unavailability of long-term core cooling (failure of shutdown cooling system and containment cooling) following successful scram and failure of continued power conversion system operation, safety relief valve challenge and unsuccessful reseal, and successful main feedwater.
20	Core damage	Similar to Sequence 19 except unsuccessful main feedwater followed by successful feedwater coolant injection.
21	Core damage	Unavailability of long-term core cooling (failure of shutdown cooling system and containment cooling) following successful scram and failure of continued power conversion system operation, safety relief challenge and unsuccessful reseal, unsuccessful main feedwater and followed by successful vessel depressurization and low-pressure core spray.
22	Core damage	Unavailability of fire water or other equivalent water source for vessel makeup following successful scram and failure of continued power conversion system operation, safety relief valve challenge and unsuccessful reseal, and failure of main feedwater and feedwater coolant injection. Successful vessel depressurization and failure of low-pressure core spray.
23	Core damage	Similar to Sequence 22 except failure of the shutdown cooling system and successful containment spray.
24	Core damage	Unavailability of long-term core cooling (failure of shutdown cooling system and containment cooling) following successful scram and failure of continued power conversion system operation, safety relief valve challenge and unsuccessful reseal, unsuccessful main feedwater and feedwater coolant injection, successful vessel depressurization, and unsuccessful low-pressure core spray.
25	Core damage	Unavailability of vessel depressurization following successful scram and failure of continued power conversion system operation, safety relief valve challenge and unsuccessful reseal, and failure of the main feedwater and feedwater coolant injection.
26	Core damage	Similar to Sequence 11 except the safety relief valves are not challenged.
27	Core damage	Similar to Sequence 12 except the safety relief valves are not challenged.
28	Core damage	Similar to Sequence 13 except the safety relief valves are not challenged.
29	Core damage	Similar to Sequence 14 except the safety relief valves are not challenged.

Table A.10 BWR transient core damage and ATWS sequences

Sequence No.	End state	Description
30	Core damage	Similar to Sequence 15 except the safety relief valves are not challenged.
31	Core damage	Similar to Sequence 16 except the safety relief valves are not challenged.
32	Core damage	Similar to Sequence 17 except the safety relief valves are not challenged.
33	Core damage	Similar to Sequence 18 except the safety relief valves are not challenged.
99	ATWS	Failure to trip following a transient requiring trip. ATWS sequences are not further developed in the ASP models.
<i>BWR Class B sequences</i>		
11	Core damage	Unavailability of long-term core cooling (failure of shutdown cooling system and containment cooling mode of low-pressure coolant injection) following successful scram and failure of continued power conversion system operation, safety relief valve challenge and successful reseal, and failure of isolation condenser and successful main feedwater.
12	Core damage	Similar to Sequence 11 except failure of main feedwater followed by successful high-pressure coolant injection.
13	Core damage	Similar to Sequence 11 except failure of main feedwater and high-pressure coolant injection systems, followed by successful control rod drive cooling.
14	Core damage	Unavailability of long-term core cooling (failure of shutdown cooling system and containment cooling mode of low-pressure coolant injection) following successful scram and failure of continued power conversion system operation; safety relief valve challenge and successful reseal; failure of isolation condenser; failure of main feedwater, high-pressure coolant injection, and control rod drive cooling systems; followed by successful vessel depressurization and low-pressure core spray.
15	Core damage	Unavailability of long-term core cooling (failure of shutdown cooling system and containment cooling mode of low-pressure coolant injection) following successful scram and failure of continued power conversion system operation; safety relief valve challenge and successful reseal; failure of isolation condenser; failure of main feedwater, high-pressure coolant injection, and control rod drive cooling systems; followed by successful vessel depressurization, and failure of low-pressure core spray and successful low-pressure coolant injection.

Table A.10 BWR transient core damage and ATWS sequences

Sequence No.	End state	Description
16	Core damage	Unavailability of fire water or other equivalent water source for reactor vessel makeup following successful scram and failure of continued power conversion system operation; safety relief valve challenge and successful reseal; and failure of isolation condenser, main feedwater, high-pressure coolant injection, and control rod drive cooling systems. Successful vessel depressurization, failure of low-pressure core spray and low-pressure coolant injection, and successful shutdown cooling system.
17	Core damage	Similar to Sequence 16 except the shutdown cooling system fails followed by successful containment cooling mode of the low-pressure coolant injection system.
18	Core damage	Similar to Sequence 15 except low-pressure coolant injection system fails.
19	Core damage	Unavailability of vessel depressurization following successful scram and failure of continued power conversion system operation, and safety relief valve challenge and successful reseal. Failure of the isolation condenser, main feedwater, high-pressure coolant injection, and control rod drive cooling.
20	Core damage	Unavailability of long-term core cooling (failure of shutdown cooling system and containment cooling mode of low-pressure injection) following successful scram and failure of continued power conversion system operation, safety relief valve challenge and unsuccessful reseal, and successful main feedwater.
21	Core damage	Similar to Sequence 20 except unsuccessful main feedwater followed by successful high-pressure coolant injection.
22	Core damage	Similar to Sequence 20 except unsuccessful main feedwater and high-pressure coolant injection, followed by successful vessel depressurization and low-pressure core spray.
23	Core damage	Similar to Sequence 20 except failure of main feedwater and high-pressure coolant injection, followed by successful vessel depressurization, failure of low-pressure core spray, and successful low-pressure coolant injection.
24	Core damage	Unavailability of fire water or other equivalent water source for reactor vessel makeup following successful scram and failure of continued power conversion system operation, safety relief valve challenge and unsuccessful reseal, and failure of main feedwater and high-pressure coolant injection. Successful vessel depressurization, failure of low-pressure core spray and low-pressure coolant injection, and successful shutdown cooling.

Table A.10 BWR transient core damage and ATWS sequences

Sequence No.	End state	Description
25	Core damage	Similar to Sequence 24 except failure of the shutdown cooling system and successful containment spray mode of low-pressure core injection.
26	Core damage	Similar to Sequence 23 except unsuccessful low-pressure coolant injection.
27	Core damage	Unavailability of vessel depressurization following successful scram and failure of continued power conversion system operation, safety relief valve challenge and unsuccessful reseal, and failure of the main feedwater and high-pressure coolant injection.
28	Core damage	Similar to Sequence 11 except the safety relief valves are not challenged.
29	Core damage	Similar to Sequence 12 except the safety relief valves are not challenged.
30	Core damage	Similar to Sequence 13 except the safety relief valves are not challenged.
31	Core damage	Similar to Sequence 14 except the safety relief valves are not challenged.
32	Core damage	Similar to Sequence 15 except the safety relief valves are not challenged.
33	Core damage	Similar to Sequence 16 except the safety relief valves are not challenged.
34	Core damage	Similar to Sequence 17 except the safety relief valves are not challenged.
35	Core damage	Similar to Sequence 18 except the safety relief valves are not challenged.
36	Core damage	Similar to Sequence 19 except the safety relief valves are not challenged.
99	ATWS	Failure to trip following a transient requiring trip. ATWS sequences are not further developed in the ASP models.

BWR Class C sequences

11	Core damage	Unavailability of long-term core cooling (residual heat removal shutdown cooling and suppression pool cooling modes fail) following successful scram and failure of continued power conversion system operation, safety relief valve challenge and successful reseal, and successful main feedwater.
----	-------------	--

Table A.10 BWR transient core damage and ATWS sequences

Sequence No.	End state	Description
12	Core damage	Similar to Sequence 11 except failure of main feedwater with successful high-pressure coolant injection.
13	Core damage	Similar to Sequence 11 except failure of main feedwater and high-pressure coolant injection systems, with successful reactor core isolation cooling.
14	Core damage	Similar to Sequence 11 except failure of main feedwater, high-pressure coolant injection, and reactor core isolation cooling, with successful control rod drive cooling.
15	Core damage	Unavailability of long-term core cooling (residual heat removal shutdown cooling and suppression pool cooling modes fail) following successful scram and failure of continued power conversion system operation, safety relief valve challenge and successful reseal, failure of main feedwater, high-pressure coolant injection, reactor core isolation cooling, and control rod drive cooling, with successful vessel depressurization and low-pressure core spray.
16	Core damage	Similar to Sequence 15 except failure of low-pressure core spray and successful low-pressure coolant injection.
17	Core damage	Unavailability of fire water or other equivalent water source for reactor vessel makeup following successful scram and failure of continued power conversion system operation; safety relief valve challenge and successful reseal; failure of main feedwater, high-pressure coolant injection, reactor core isolation cooling, and control rod drive cooling systems. Successful vessel depressurization, failure of low-pressure core spray and low-pressure coolant injection, and successful residual heat removal system in shutdown cooling mode.
18	Core damage	Similar to Sequence 17 except the residual heat removal system fails in the shutdown cooling mode and succeeds in the suppression pool cooling mode.
19	Core damage	Similar to Sequence 16 except failure of low-pressure coolant injection.
20	Core damage	Unavailability of vessel depressurization following successful scram and failure of continued power conversion system operation, safety relief valve challenge and successful reseal. Failure of the main feedwater, high-pressure coolant injection, reactor core isolation cooling, and control rod drive cooling.

Table A.10 BWR transient core damage and ATWS sequences

Sequence No.	End state	Description
21	Core damage	Unavailability of long-term core cooling (residual heat removal shutdown and suppression pool cooling modes fail) following successful scram and failure of continued power conversion system operation, safety relief valve challenge with unsuccessful reseal, and successful main feedwater.
22	Core damage	Similar to Sequence 21 except unsuccessful main feedwater with successful high-pressure coolant injection.
23	Core damage	Unavailability of long-term core cooling (residual heat removal shutdown and suppression pool cooling modes fail) following successful scram and failure of continued power conversion system operation, safety relief valve challenge with unsuccessful reseal, unsuccessful main feedwater and high-pressure coolant injection, followed by successful vessel depressurization and low-pressure core spray
24	Core damage	Similar to Sequence 23 except failure of low-pressure core spray and successful low-pressure coolant injection.
25	Core damage	Unavailability of fire water or other equivalent water source for reactor vessel makeup following successful scram and failure of continued power conversion system operation, safety relief valve challenge and unsuccessful reseal, and failure of main feedwater and high-pressure coolant injection. Successful vessel depressurization, failure of low-pressure core spray and low-pressure coolant injection, and successful residual heat removal in shutdown cooling mode.
26	Core damage	Similar to Sequence 25 except the residual heat removal system fails in the shutdown cooling mode and succeeds in the suppression pool cooling mode.
27	Core damage	Similar to Sequence 24 except failure of low-pressure coolant injection.
28	Core damage	Unavailability of vessel depressurization following successful scram and failure of continued power conversion system operation, safety relief valve challenge and unsuccessful reseal, and failure of the main feedwater and high-pressure coolant injection systems.
29	Core damage	Similar to Sequence 11 except the safety relief valves are not challenged.
30	Core damage	Similar to Sequence 12 except the safety relief valves are not challenged.
31	Core damage	Similar to Sequence 13 except the safety relief valves are not challenged.

Table A.10 BWR transient core damage and ATWS sequences

Sequence No.	End state	Description
32	Core damage	Similar to Sequence 14 except the safety relief valves are not challenged.
33	Core damage	Similar to Sequence 15 except the safety relief valves are not challenged.
34	Core damage	Similar to Sequence 16 except the safety relief valves are not challenged.
35	Core damage	Similar to Sequence 17 except the safety relief valves are not challenged.
36	Core damage	Similar to Sequence 18 except the safety relief valves are not challenged.
37	Core damage	Similar to Sequence 19 except the safety relief valves are not challenged.
38	Core damage	Similar to Sequence 20 except the safety relief valves are not challenged.
99	ATWS	Failure to trip following a transient requiring trip. ATWS sequences are not further developed in the ASP models.

Table A.11 BWR LOOP core damage and ATWS sequences

Sequence No.	End state	Description
<i>BWR Class A sequences</i>		
41	Core damage	Unavailability of long-term core cooling (failure of shutdown cooling system and containment cooling) following a loss of offsite power with successful emergency power, reactor scram, safety relief valve challenge and reseal. Failure of isolation condenser and successful feedwater coolant injection.
42	Core damage	Similar to Sequence 41 except failure of the feedwater coolant injection and successful control rod drive cooling.
43	Core damage	Unavailability of long-term cooling (failure of shutdown cooling system and containment cooling) following a loss of offsite power with successful emergency power, reactor scram, and safety relief valve challenge and reseal. Failure of isolation condenser, failure of the feedwater coolant injection and control rod drive cooling systems, with successful vessel depressurization and low-pressure core spray.
44	Core damage	Unavailability of fire water or other equivalent water source for vessel makeup following a loss of offsite power with successful emergency power, scram, and safety relief valve challenge and successful reseal. Failure of isolation condenser, feedwater coolant injection, and control rod drive cooling. Successful vessel depressurization and failure of low-pressure core spray.
45	Core damage	Similar to Sequence 44 except failure of the shutdown cooling system and successful containment spray.
46	Core damage	Unavailability of long-term cooling (failure of shutdown cooling system and containment cooling) following a loss of offsite power with successful emergency power, reactor scram, and safety relief valve challenge and reseal. Failure of isolation condenser, failure of feedwater coolant injection and control rod drive cooling, with successful vessel depressurization and failure of the low-pressure core spray.
47	Core damage	Unavailability of vessel depressurization following a loss of offsite power with successful emergency power and reactor scram. Challenge of the safety relief valves and successful reseal with unsuccessful isolation condenser, feedwater coolant injection, and control rod drive cooling.
48	Core damage	Unavailability of long-term cooling (failure of shutdown cooling system and containment cooling) following a loss of offsite power with successful emergency power, reactor scram, and safety relief valve challenge and unsuccessful reseal, and successful feedwater coolant injection.

Table A.11 BWR LOOP core damage and ATWS sequences

Sequence No.	End state	Description
49	Core damage	Similar to Sequence 48 except failure of feedwater coolant injection followed by successful vessel depressurization and low-pressure core spray.
50	Core damage	Unavailability of fire water or other equivalent water source for vessel makeup following a loss of offsite power, successful emergency power and scram, safety relief valve challenge and unsuccessful reseal, and failure of feedwater coolant injection. Successful vessel depressurization, failure of low-pressure core spray, and successful shutdown cooling system.
51	Core damage	Similar to Sequence 50 except failure of shutdown cooling system and successful containment cooling.
52	Core damage	Unavailability of long-term core cooling (failure of shutdown cooling system and containment cooling) following a loss of offsite power with successful emergency power, reactor scram, and safety relief valve challenge and unsuccessful reseal. Failure of feedwater coolant injection, successful vessel depressurization, and failure of low-pressure core spray.
53	Core damage	Unavailability of vessel depressurization following a loss of offsite power with successful emergency power and reactor scram. Safety relief valve challenge and unsuccessful reseal, and failure of the feedwater coolant injection system.
54	Core damage	Similar to Sequence 41 except the safety relief valves are not challenged.
55	Core damage	Similar to Sequence 42 except the safety relief valves are not challenged.
56	Core damage	Similar to Sequence 43 except the safety relief valves are not challenged.
57	Core damage	Similar to Sequence 44 except the safety relief valves are not challenged.
58	Core damage	Similar to Sequence 45 except the safety relief valves are not challenged.
59	Core damage	Similar to Sequence 46 except the safety relief valves are not challenged.
60	Core damage	Similar to Sequence 47 except the safety relief valves are not challenged.
61	Core damage	Unavailability of the isolation condenser following a loss of offsite power, failure of emergency power, successful scram, and safety relief valve challenge and successful reseal.

Table A.11 BWR LOOP core damage and ATWS sequences

Sequence No.	End state	Description
62	Core damage	Failure of an SRV to reseal following challenge after a loss of offsite power with failure of emergency power and successful reactor scram.
63	Core damage	Similar to Sequence 61 except the safety relief valves are not challenged.
64	Core damage	Failure of recovery of electric power in the long-term following a loss of offsite power, failure of emergency power, and successful reactor scram.
97	ATWS	ATWS following a loss of offsite power and unavailability of emergency power. ATWS sequences are not further developed in the ASP models.
98	ATWS	ATWS following a loss of offsite power, successful emergency power, and failure to scram the reactor. ATWS sequences are not further developed in the ASP models.

BWR Class B sequences

41	Core damage	Unavailability of long-term core cooling (failure of shutdown cooling system and containment cooling mode of low-pressure coolant injection) following a loss of offsite power with successful emergency power, reactor scram, and safety relief valve challenge and reseal. Failure of isolation condenser and successful high-pressure coolant injection.
42	Core damage	Similar to Sequence 41 except failure of high-pressure coolant injection and successful control rod drive cooling.
43	Core damage	Similar to Sequence 41 except failure of the high-pressure coolant injection and control rod drive cooling, with successful vessel depressurization and low-pressure core spray.
44	Core damage	Unavailability of long-term core cooling (failure of shutdown cooling system and containment cooling mode of low-pressure coolant injection) following a loss of offsite power with successful emergency power, reactor scram, and safety relief valve challenge and reseal. Failure of isolation condenser, failure of the high-pressure coolant injection and control rod drive cooling systems, with successful vessel depressurization, failure of low-pressure core spray, and successful low-pressure coolant injection.

Table A.11 BWR LOOP core damage and ATWS sequences

Sequence No.	End state	Description
45	Core damage	Unavailability of fire water or other equivalent water source for reactor vessel makeup following a loss of offsite power with successful emergency power, scram, and safety relief valve challenge and successful reseal. Failure of isolation condenser, high-pressure coolant injection, and control rod drive cooling. Successful vessel depressurization, failure of low-pressure core spray, and low-pressure coolant injection with successful shutdown cooling.
46	Core damage	Similar to Sequence 45 except failure of the shutdown cooling system and successful containment spray mode low-pressure coolant injection.
47	Core damage	Similar to Sequence 44 except failure of low-pressure coolant injection.
48	Core damage	Unavailability of vessel depressurization following a loss of offsite power with successful emergency power and reactor scram, challenge of the safety relief valves and successful reseal with unsuccessful isolation condenser, high-pressure coolant injection, and control rod drive cooling.
49	Core damage	Unavailability of long-term core cooling (failure of shutdown cooling system and containment cooling mode of low-pressure coolant injection) following a loss of offsite power with successful emergency power, reactor scram, and safety relief valve challenge and unsuccessful reseal, and successful high-pressure coolant injection.
50	Core damage	Unavailability of long-term core cooling (failure of shutdown cooling system and containment cooling mode of low-pressure coolant injection) following a loss of offsite power with successful emergency power, reactor scram, safety relief valve challenge and unsuccessful reseal, and failure of high-pressure coolant injection followed by successful vessel depressurization and low-pressure core spray.
51	Core damage	Similar to Sequence 50 except failure of low-pressure core spray and successful low-pressure coolant injection.
52	Core damage	Unavailability of fire water or other equivalent water source for reactor vessel makeup following a loss of offsite power, successful emergency power and scram, safety relief valve challenge and unsuccessful reseal, and failure of high-pressure coolant injection. Successful vessel depressurization, failure of low-pressure core spray and low-pressure core injection, and successful shutdown cooling system.

Table A.11 BWR LOOP core damage and ATWS sequences

Sequence No.	End state	Description
53	Core damage	Similar to Sequence 52 except failure of shutdown cooling system and successful containment cooling mode of low-pressure coolant injection.
54	Core damage	Unavailability of long-term core cooling (failure of shutdown cooling system and containment cooling mode of low-pressure coolant injection) following a loss of offsite power with successful emergency power, reactor scram, and safety relief valve challenge and unsuccessful reseal. Failure of high-pressure coolant injection, successful vessel depressurization and failure of low-pressure core spray and low-pressure coolant injection.
55	Core damage	Unavailability of vessel depressurization following a loss of offsite power with successful emergency power and reactor scram. Safety relief valve challenge and unsuccessful reseal, and failure of the high-pressure coolant injection system.
56	Core damage	Similar to Sequence 41 except the safety relief valves are not challenged.
57	Core damage	Similar to Sequence 42 except the safety relief valves are not challenged.
58	Core damage	Similar to Sequence 43 except the safety relief valves are not challenged.
59	Core damage	Similar to Sequence 44 except the safety relief valves are not challenged.
60	Core damage	Similar to Sequence 45 except the safety relief valves are not challenged.
61	Core damage	Similar to Sequence 46 except the safety relief valves are not challenged.
62	Core damage	Similar to Sequence 47 except the safety relief valves are not challenged.
63	Core damage	Similar to Sequence 48 except the safety relief valves are not challenged.
64	Core damage	Unavailability of long-term cooling (failure of shutdown cooling system and containment cooling mode of low-pressure coolant injection) following a loss of offsite power, failure of emergency power, successful reactor scram, successful long-term recovery of electric power, safety relief valve challenge and reseal, failed isolation condenser, and successful high-pressure coolant injection.
65	Core damage	Unavailability of high-pressure core injection following a loss of offsite power, failure of emergency power, successful reactor scram, safety relief valve challenge and reseal, and failed isolation condenser and high-pressure coolant injection systems.

Table A.11 BWR LOOP core damage and ATWS sequences

Sequence No.	End state	Description
66	Core damage	Unavailability of long-term core cooling (failure of shutdown cooling system and containment cooling mode of low-pressure coolant injection) following a loss of offsite power, failure of emergency power, successful reactor scram, successful long-term recovery of electric power, safety relief valve challenge and failure to reseal, and successful high-pressure coolant injection.
67	Core damage	Unavailability of long-term core cooling (failure of shutdown cooling system and containment cooling mode of low-pressure coolant injection) following a loss of offsite power, failure of emergency power, successful reactor scram, successful long-term recovery of electric power, safety relief valve challenge and failure to reseal, and failure of high-pressure coolant injection.
68	Core damage	Similar to Sequence 64 except the safety relief valves are not challenged.
69	Core damage	Similar to Sequence 65 except the safety relief valves are not challenged.
84	Core damage	Failure of long-term recovery of electric power following a loss of offsite power, with failure of emergency power and successful reactor scram.
97	ATWS	ATWS following a loss of offsite power and unavailability of emergency power. ATWS sequences are not further developed in the ASP models.
98	ATWS	ATWS following a loss of offsite power, successful emergency power, and failure to scram the reactor. ATWS sequences are not further developed in the ASP models.
<i>BWR Class C sequences</i>		
40	Core damage	Unavailability of long-term core cooling (failure of residual heat removal in shutdown and suppression cooling modes) following a loss of offsite power with successful emergency power, reactor scram, safety relief valve challenge and reseal, and successful high-pressure coolant injection.
41	Core damage	Similar to Sequence 40 except failure of the high-pressure coolant injection system and successful reactor core isolation cooling.
42	Core damage	Similar to Sequence 40 except failure of the high-pressure coolant injection and reactor core isolation cooling systems with successful control rod drive cooling.

Table A.11 BWR LOOP core damage and ATWS sequences

Sequence No.	End state	Description
43	Core damage	Unavailability of long-term core cooling (failure of residual heat removal in shutdown and suppression cooling modes) following a loss of offsite power with successful emergency power, reactor scram, safety relief valve challenge and reseal; failure of the high-pressure coolant injection, reactor core isolation cooling and control rod drive cooling systems, with successful vessel depressurization and low-pressure core spray.
44	Core damage	Similar to Sequence 43 except failure of low-pressure core spray and successful low-pressure coolant injection.
45	Core damage	Unavailability of fire water or other equivalent water source for reactor makeup following a loss of offsite power with successful emergency power, scram, and safety relief valve challenge and successful reseal. Failure of high-pressure coolant injection, reactor core isolation cooling, and control rod drive cooling systems. Successful vessel depressurization, and failure of low-pressure core spray and low-pressure coolant injection with successful residual heat removal in shutdown cooling mode.
46	Core damage	Similar to Sequence 45 except failure of the residual heat removal system in shutdown cooling mode and success in suppression pool cooling mode.
47	Core damage	Similar to Sequence 44 except failure of low-pressure coolant injection.
48	Core damage	Unavailability of vessel depressurization following a loss of offsite power with successful emergency power and reactor scram. Challenge of the safety relief valves and successful reseal with high-pressure coolant injection, reactor core isolation cooling, and control rod drive cooling.
49	Core damage	Unavailability of long-term core cooling (failure of residual heat removal system in shutdown and suppression pool cooling modes) following a loss of offsite power with successful emergency power, reactor scram, safety relief valve challenge and unsuccessful reseal, and successful high-pressure coolant injection.
50	Core damage	Unavailability of long-term core cooling (failure of residual heat removal system in shutdown and suppression pool cooling modes) following a loss of offsite power with successful emergency power, reactor scram, safety relief valve challenge and unsuccessful reseal, and failure of high-pressure coolant injection followed by successful vessel depressurization and low-pressure core spray
51	Core damage	Similar to Sequence 50 except failure of low-pressure core spray and successful low-pressure coolant injection.

Table A.11 BWR LOOP core damage and ATWS sequences

Sequence No.	End state	Description
52	Core damage	Unavailability of fire water or other equivalent water source following a loss of offsite power, successful emergency power and scram, safety relief valve challenge and unsuccessful reseal, and failure of high-pressure coolant injection. Successful vessel depressurization, failure of low-pressure core spray and low-pressure coolant injection, and successful residual heat removal in shutdown cooling mode.
53	Core damage	Similar to Sequence 52 except failure of the residual heat removal system in shutdown cooling mode and success in suppression pool cooling mode.
54	Core damage	Similar to Sequence 51 except failure of low-pressure coolant injection.
55	Core damage	Unavailability of vessel depressurization following a loss of offsite power with successful emergency power and reactor scram. Safety relief valve challenge and unsuccessful reseal, and failure of the high-pressure coolant injection system.
56	Core damage	Similar to Sequence 40 except the safety relief valves are not challenged.
57	Core damage	Similar to Sequence 41 except the safety relief valves are not challenged.
58	Core damage	Similar to Sequence 42 except the safety relief valves are not challenged.
59	Core damage	Similar to Sequence 43 except the safety relief valves are not challenged.
60	Core damage	Similar to Sequence 44 except the safety relief valves are not challenged.
61	Core damage	Similar to Sequence 45 except the safety relief valves are not challenged.
62	Core damage	Similar to Sequence 46 except the safety relief valves are not challenged.
63	Core damage	Similar to Sequence 47 except the safety relief valves are not challenged.
64	Core damage	Similar to Sequence 48 except the safety relief valves are not challenged.

Table A.11 BWR LOOP core damage and ATWS sequences

Sequence No.	End state	Description
65	Core damage	Unavailability of long-term core cooling (failure of the residual heat removal system in shutdown and suppression pool cooling modes) following a loss of offsite power, failure of emergency power, successful reactor scram, successful long-term recovery of electric power, safety relief valve challenge and reseal, and successful high-pressure coolant injection.
66	Core damage	Similar to Sequence 65 except high-pressure coolant injection fails with successful reactor core isolation cooling.
67	Core damage	Unavailability of long-term core cooling (failure of the residual heat removal system in shutdown and suppression pool cooling modes) following a loss of offsite power, failure of emergency power, successful reactor scram, successful long-term recovery of electric power, safety relief valve challenge and reseal, with failures of high-pressure coolant injection and reactor core isolation cooling.
68	Core damage	Similar to Sequence 65 except the safety relief valves fail to reseal.
69	Core damage	Failure of high-pressure coolant injection following a loss of offsite power, with emergency power failure, successful reactor scram, safety relief valve challenge, and unsuccessful reseal.
80	Core damage	Unavailability of long-term core cooling (failure of residual heat removal system in shutdown and suppression cooling modes) following a loss of offsite power, failure of emergency power, successful reactor scram, and long-term recovery of electric power. The safety relief valves are not challenged, and high-pressure coolant injection is successful.
81	Core damage	Similar to Sequence 66 except the safety relief valves are not challenged.
82	Core damage	Similar to Sequence 67 except the safety relief valves are not challenged.
83	Core damage	Unable to recover long-term electric power following a loss of offsite power, failure of emergency power, and successful reactor scram.
97	ATWS	ATWS following a loss of offsite power and unavailability of emergency power. ATWS sequences are not further developed in the ASP models.
98	ATWS	ATWS following a loss of offsite power, successful emergency power, and failure to scram the reactor. ATWS sequences are not further developed in the ASP models.

Table A.12 BWR small-break LOCA core damage and ATWS sequences

Sequence No.	End state	Description
<i>BWR Class A sequences</i>		
71	Core damage	Unavailability of long-term core cooling (failure of shutdown cooling system and containment cooling) following a loss-of-coolant accident, successful scram, and successful feedwater coolant injection.
72	Core damage	Unavailability of long-term core cooling (failure of shutdown cooling system and containment cooling) following a loss-of-coolant accident, successful scram, failure of feedwater coolant injection system, and successful vessel depressurization and low-pressure core spray.
73	Core damage	Unavailability of fire water or other equivalent water source for reactor vessel makeup following a loss-of-coolant accident, successful reactor scram, and failure of feedwater coolant injection. Successful vessel depressurization and failure of low-pressure core spray, and successful shutdown cooling system.
74	Core damage	Similar to Sequence 73 except failure of the shutdown cooling system and successful containment cooling.
75	Core damage	Similar to Sequence 72 except failure of the low-pressure core spray.
76	Core damage	Unavailability of vessel depressurization following a loss-of-coolant accident, successful reactor scram, and failure of the feedwater coolant injection system.
96	ATWS	ATWS following a loss-of-coolant accident. ATWS sequences are not further developed in the ASP models.
<i>BWR Class B sequences</i>		
71	Core damage	Unavailability of long-term core cooling (failure of shutdown cooling system and containment cooling mode of low-pressure coolant injection) following a loss-of-coolant accident, successful scram, and successful high-pressure coolant injection.
72	Core damage	Unavailability of long-term core cooling (failure of shutdown cooling system and containment cooling mode of low-pressure coolant injection) following a loss-of-coolant accident, successful scram, failure of high-pressure coolant injection, and successful vessel depressurization and low-pressure core spray.
73	Core damage	Similar to Sequence 72 except failure of low-pressure core spray and successful low-pressure coolant injection.
74	Core damage	Unavailability of fire water or other equivalent water source for reactor vessel makeup following a loss-of-coolant accident, successful reactor scram, and failure of the high-pressure coolant injection system. Successful vessel depressurization, failure of low-pressure core spray and low-pressure coolant injection, and successful shutdown cooling system.

Table A.12 BWR small-break LOCA core damage and ATWS sequences

Sequence No.	End state	Description
75	Core damage	Similar to Sequence 74 except failure of the shutdown cooling system and successful containment cooling mode of low-pressure coolant injection.
76	Core damage	Similar to Sequence 73 except failure of low-pressure coolant injection.
77	Core damage	Unavailability of vessel depressurization following a loss-of-coolant accident, successful reactor scram, and failure of the high-pressure coolant injection.
96	ATWS	ATWS following a loss-of-coolant accident. ATWS sequences are not further developed in the ASP models.
<i>BWR Class C sequences</i>		
71	Core damage	Unavailability of long-term core cooling (failure of residual heat removal system in shutdown and suppression pool cooling modes) following a loss-of-coolant accident, successful scram, and successful high-pressure coolant injection.
72	Core damage	Unavailability of long-term core cooling (failure of residual heat removal system in shutdown and suppression pool cooling modes) following a loss-of-coolant accident, successful scram, failure of the high-pressure coolant injection system, and successful vessel depressurization and low-pressure core spray.
73	Core damage	Similar to Sequence 72 except failure of low-pressure core spray, and successful low-pressure coolant injection.
74	Core damage	Unavailability of fire water or other equivalent water source for reactor vessel makeup following a loss-of-coolant accident, successful reactor scram, and failure of the high-pressure coolant injection system. Successful vessel depressurization, failure of low-pressure core spray and low-pressure coolant injection, and successful residual heat removal system in shutdown cooling mode.
75	Core damage	Similar to Sequence 74 except failure of the residual heat removal system in the shutdown cooling mode and success in the suppression pool cooling mode.
76	Core damage	Similar to Sequence 73 except failure of low-pressure coolant injection.
77	Core damage	Unavailability of vessel depressurization following a loss-of-coolant accident, successful reactor scram, and failure of the high-pressure coolant injection system.
96	ATWS	ATWS following a loss-of-coolant accident. ATWS sequences are not further developed in the ASP models.

Table A.13 Average initiating event frequency and branch failure probability estimates developed from 1984-1986 precursors.

Initiator/branch	Initial estimate (no recovery attempted)	Nonrecovery estimate	Total
<i>PWRs</i>			
LOOP	$4.1 \times 10^{-2}/\text{year}$	0.39	$1.6 \times 10^{-2}/\text{year}^*$
Small-break LOCA	$1.5 \times 10^{-2}/\text{year}$	0.43	$6.4 \times 10^{-3}/\text{year}$
Auxiliary feedwater	3.8×10^{-4}	0.26	9.9×10^{-5}
High-pressure injection	6.1×10^{-4}	0.84	5.1×10^{-4}
Long-term core cooling (high-pressure recirculation)	1.5×10^{-4}	1.00	1.5×10^{-4}
Emergency power	6.4×10^{-4}	0.78	5.0×10^{-4}
SG isolation (MSIVs)	8.3×10^{-4}	0.64	5.3×10^{-4}
<i>BWRs</i>			
LOOP	$1.0 \times 10^{-1}/\text{year}$	0.32	$3.3 \times 10^{-2}/\text{year}^*$
Small-break LOCA	$2.0 \times 10^{-2}/\text{year}$	0.50	$1.0 \times 10^{-2}/\text{year}$
HPCI/RCIC	1.7×10^{-3}	0.49	8.4×10^{-4}
RV isolation	1.7×10^{-3}	1.00	1.7×10^{-3}
LPCI	1.0×10^{-3}	0.71	7.4×10^{-4}
Emergency power	1.0×10^{-4}	0.85	8.9×10^{-5}
Automatic depressurization	3.7×10^{-3}	0.71	2.6×10^{-3}

*Precursor calculations utilize plant-specific LOOP frequency estimates developed from information in P.W. Baranowsky, *Evaluation of Station Blackout Accidents at Nuclear Power Plants*, NUREG-1032, June 1988.

Table A.14 Operator action failure probabilities

Operation action	Failure probability
<i>BWRs</i>	
Condensate/feedwater recovery	0.001
Containment venting	0.01
Control rod drive water use	0.01
Initiation of RHR service water, fire water	0.01
Shutdown cooling	0.001
Standby liquid control initiation	0.01
<i>PWRs</i>	
Condensate/MFW recovery	0.01
Containment spray recirculation	0.001
Emergency core cooling recirculation	0.001
Fail to block stuck-open PORVs	0.001
Open PORVs for feed and bleed	0.0004
SG depressurization	0.001
Use feed and bleed to cool core	0.01

Table A.15 Reference event conditional probability values

Postulated operational event	Conditional core damage probability
BWR Class A nonspecific reactor trip	2.8×10^{-6}
BWR Class A LOFW	1.7×10^{-4}
BWR Class B nonspecific reactor trip	7.7×10^{-8}
BWR Class B LOFW	4.3×10^{-6}
BWR Class C (turbine-driven feed pumps) nonspecific reactor trip	1.2×10^{-6}
BWR Class C (turbine-driven feed pumps) LOFW	1.5×10^{-5}
PWR Class A nonspecific reactor trip	1.8×10^{-7}
PWR Class A LOFW	2.4×10^{-6}
PWR Class B nonspecific reactor trip	1.8×10^{-7}
PWR Class B LOFW	2.2×10^{-6}
PWR Class D nonspecific reactor trip	4.7×10^{-7}
PWR Class D LOFW	6.8×10^{-6}
PWR Class G nonspecific reactor trip	1.8×10^{-7}
PWR Class G LOFW	2.4×10^{-6}
PWR Class H nonspecific reactor trip	4.9×10^{-6}
PWR Class H LOFW	3.9×10^{-5}
BWR Class C HPCI unavailability (turbine-driven feed pumps, 360-h unavailability) ^a	1.0×10^{-5}
BWR Class C HPCS unavailability (turbine-driven feed pumps, 360-h unavailability) ^a	1.4×10^{-5}
BWR Class C RCIC unavailability (turbine-driven feed pumps, 360-h unavailability) ^a	3.8×10^{-8}
BWR Class C CRD cooling unavailability (turbine-driven feed pumps, 360-h unavailability) ^a	6.2×10^{-8}

^aThe probability of a transient, LOOP, or small-break LOCA during the 360-h unavailability was estimated as described in Sect. A.1.

Table A.16 Abbreviations used in event trees

Abbreviation	Description
<i>PWR event trees</i>	
AFW	auxiliary feedwater fails
ATWS	anticipated transient without scram end state
COND	condensate system fails
CD	core damage end state
CSR	containment spray recirculation fails
EP	emergency power fails
EP REC (LONG)	long-term recovery from LOOP or emergency power failure fails
HPI	high-pressure injection fails
HPR	high-pressure recirculation fails
LOCA	small-break loss-of-coolant accident
LOOP	loss of offsite power
MFW	main feedwater fails
PORV OPEN	power-operated relief valve fails to open for feed and bleed cooling
PORV/SRV CHALL	power-operated relief valve or safety relief valves challenged (challenge rate)
PORV/SRV RESEAT	power-operated relief valve and/or safety relief valve fails to reseal
RT	reactor trip fails
RT/LOOP	reactor trip fails given a loss of offsite power
SEAL LOCA	RCP seal LOCA occurs
SEC SIDE DEP	secondary-side depressurization fails
SEQ NO	sequence number
SRV CHALL	safety relief valves challenged
SRV RESEAT	safety relief valve fails to reseal
TRANS	nonspecific reactor-trip transient

Table A.16 Abbreviations used in event trees

Abbreviation	Description
<i>BWR Event Trees</i>	
CC	containment cooling fails
CRD	control-rod-drive cooling fails
EP	emergency power fails
FIREWTR or OTHER	fire water or other equivalent water source fails
FW	unavailability of main feedwater
FWCI	failure of feedwater coolant injection system
HPCI OR HPCS	high-pressure coolant injection or high-pressure core spray fails
IC/IP MUP	isolation condenser or isolation condenser makeup fails
LOCA	small-break loss-of-coolant accident
LOOP	loss of offsite power
LOOP REC (LONG)	long-term recovery from LOOP or emergency power failure fails
LPCI	low-pressure coolant injection fails
LPCI (CC MODE)	containment cooling mode of low-pressure coolant injection system fails
LPCI (RHR)	residual heat removal mode of low-pressure coolant injection core spray fails
LPCS	low-pressure core spray fails
PCS	failure of continued power conversion system operation
RCIC	reactor core isolation cooling fails
RHR (SDC MODE)	residual-heat-removal shutdown cooling mode fails
RHR (SP COOLING MODE)	residual-heat-removal suppression pool cooling mode fails
RHR SW or OTHER	residual-heat-removal service water or other water source fails
RX SHUTDOWN	reactor fails to scram
SDC	shutdown cooling system fails
SRVs/ADS	safety relief valve(s) fail to open for depressurization or automatic depressurization system fails
SRV CHAL	safety relief valve(s) challenged (challenge rate)
SRV-C	safety relief valve fails to close
TRANSIENT	nonspecific reactor-trip transient

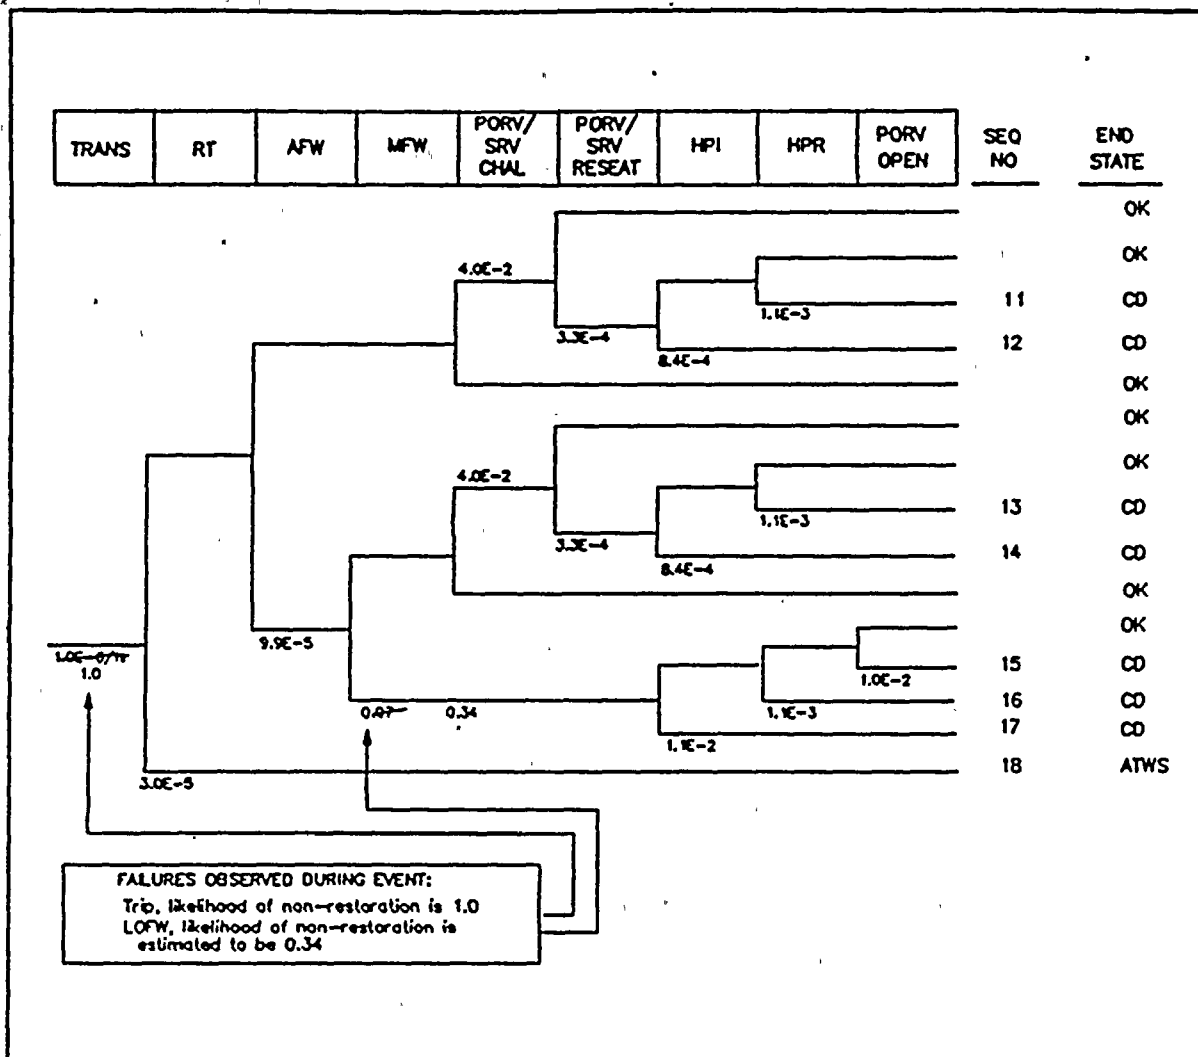


Fig. A.1. Example initiator calculation.

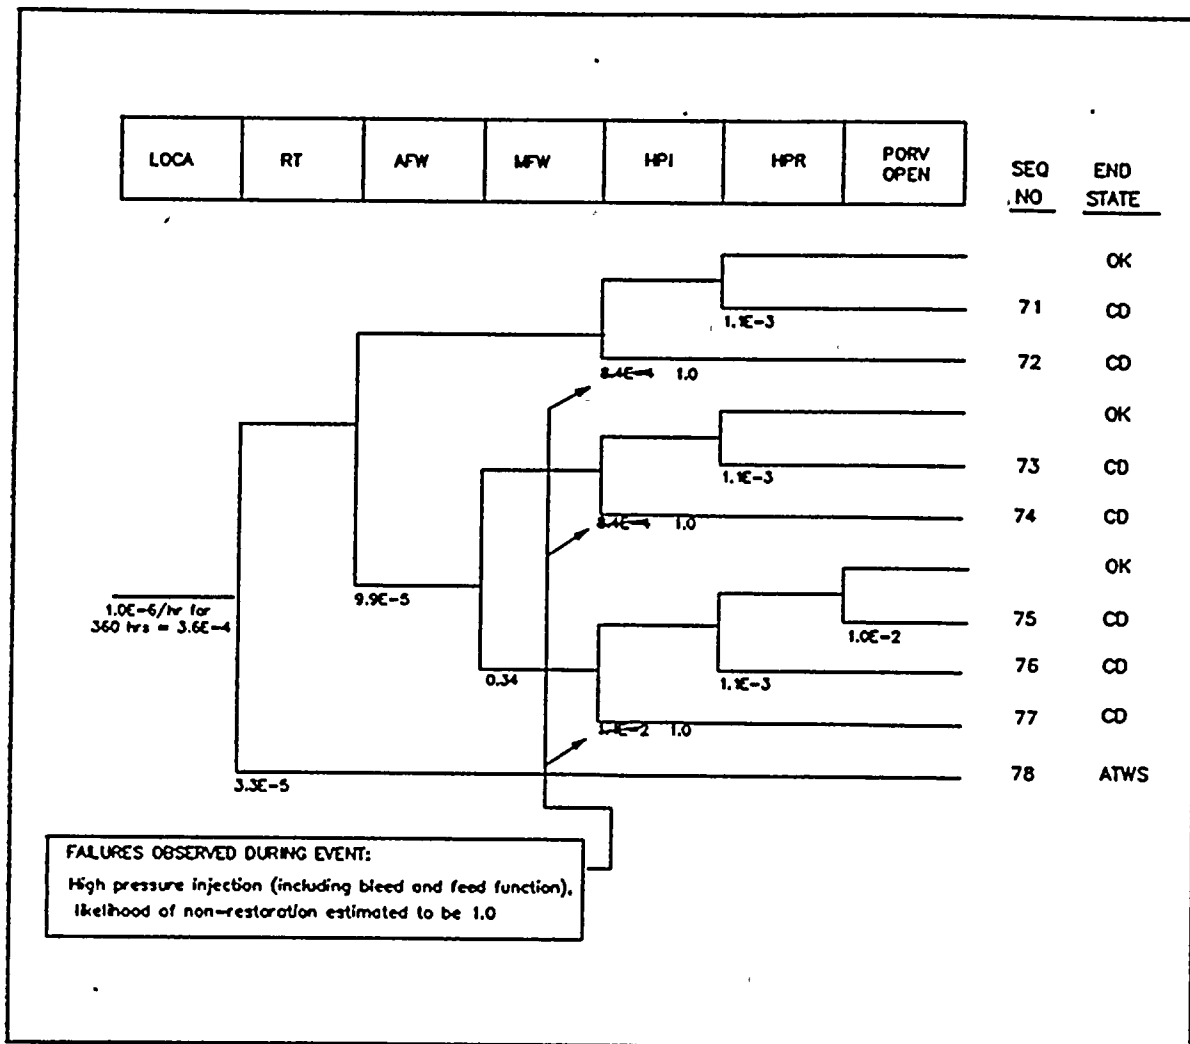


Fig. A.2. Example unavailability calculation

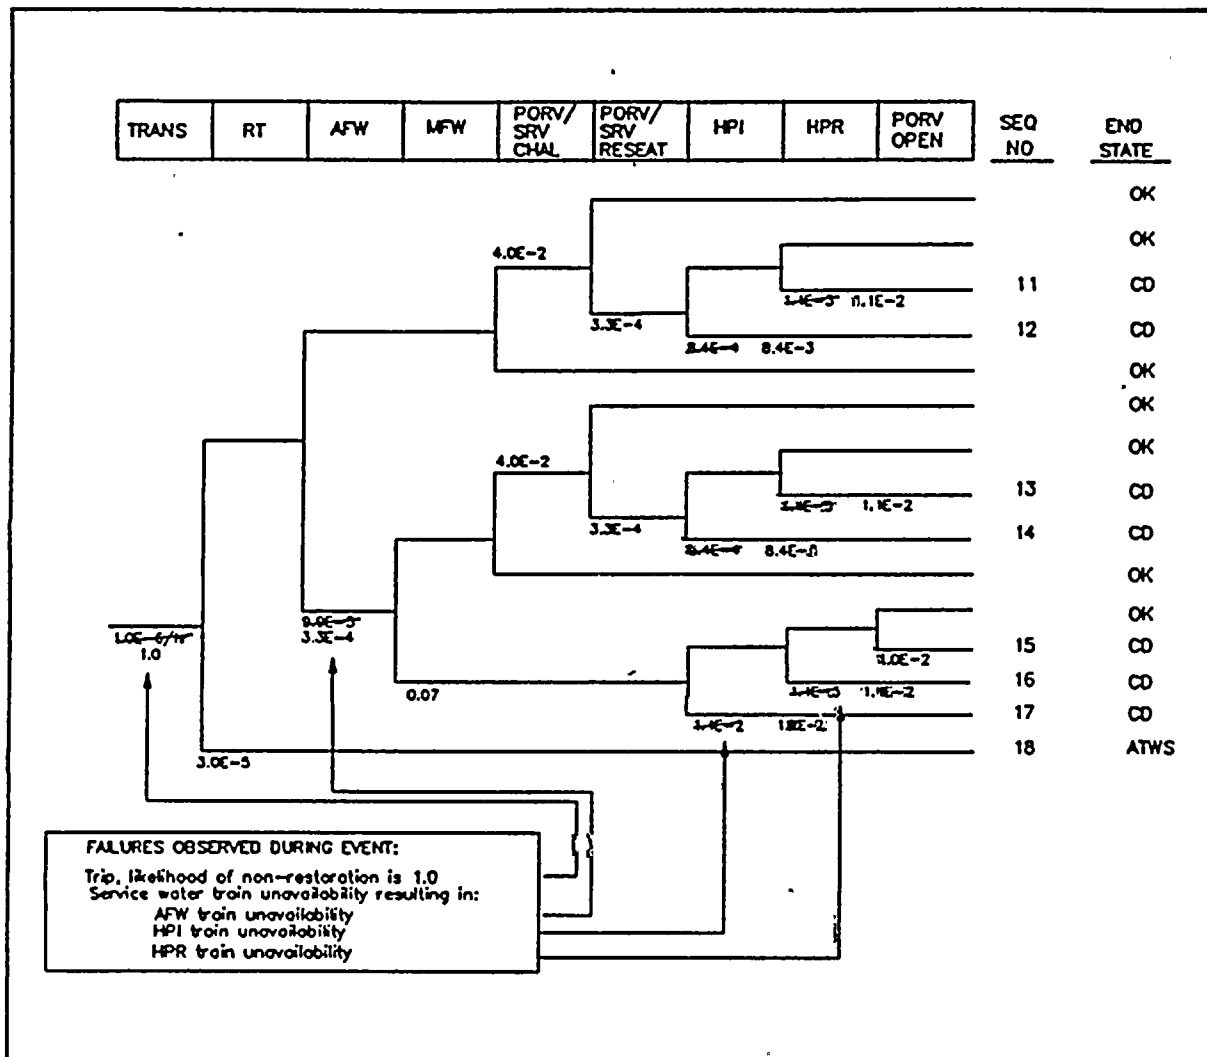


Fig. A.3. Example trip with support system degraded

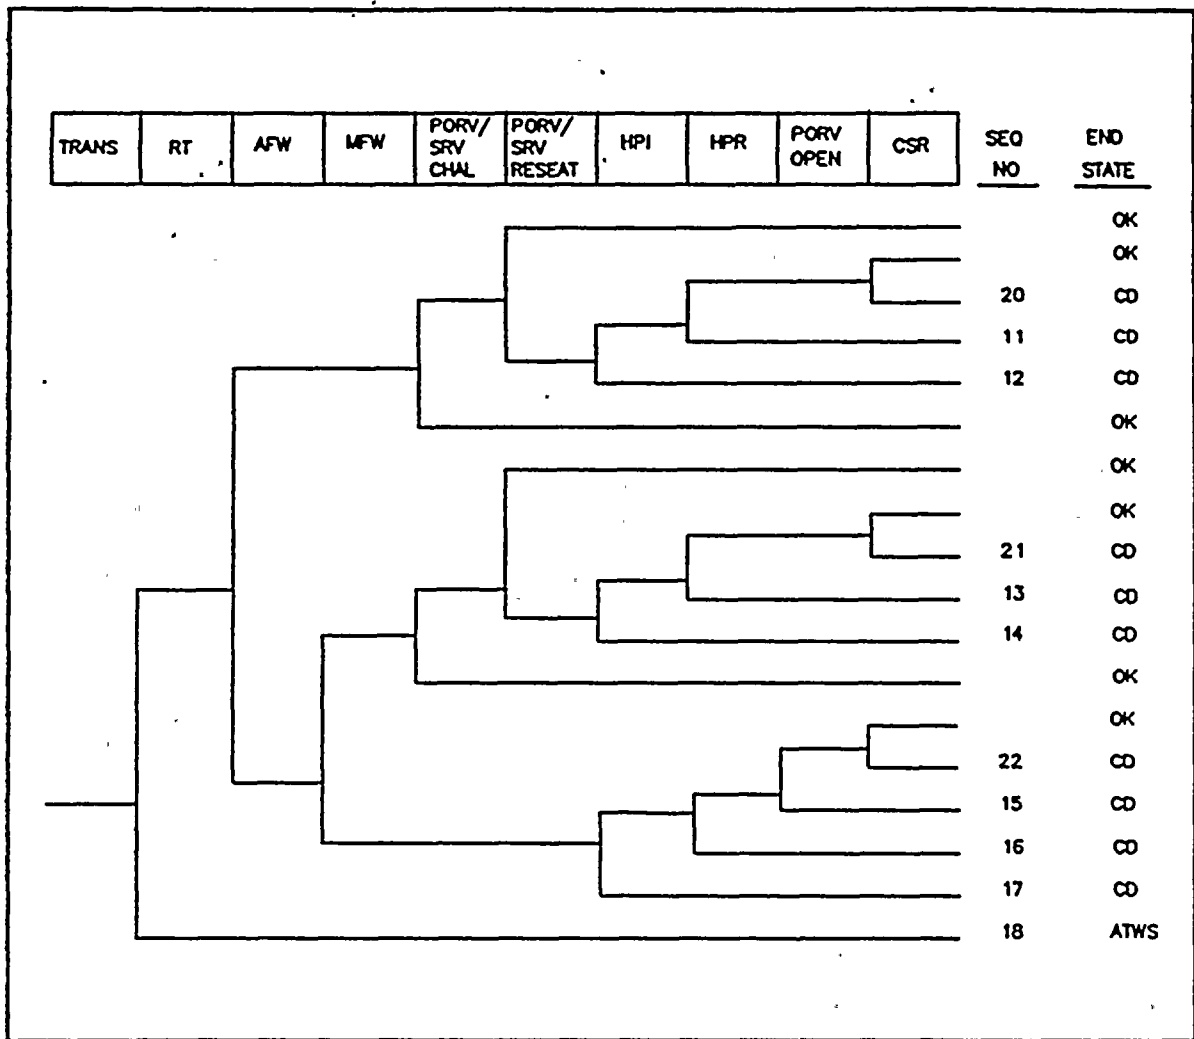


Fig. A.4. PWR class A nonspecific reactor trip

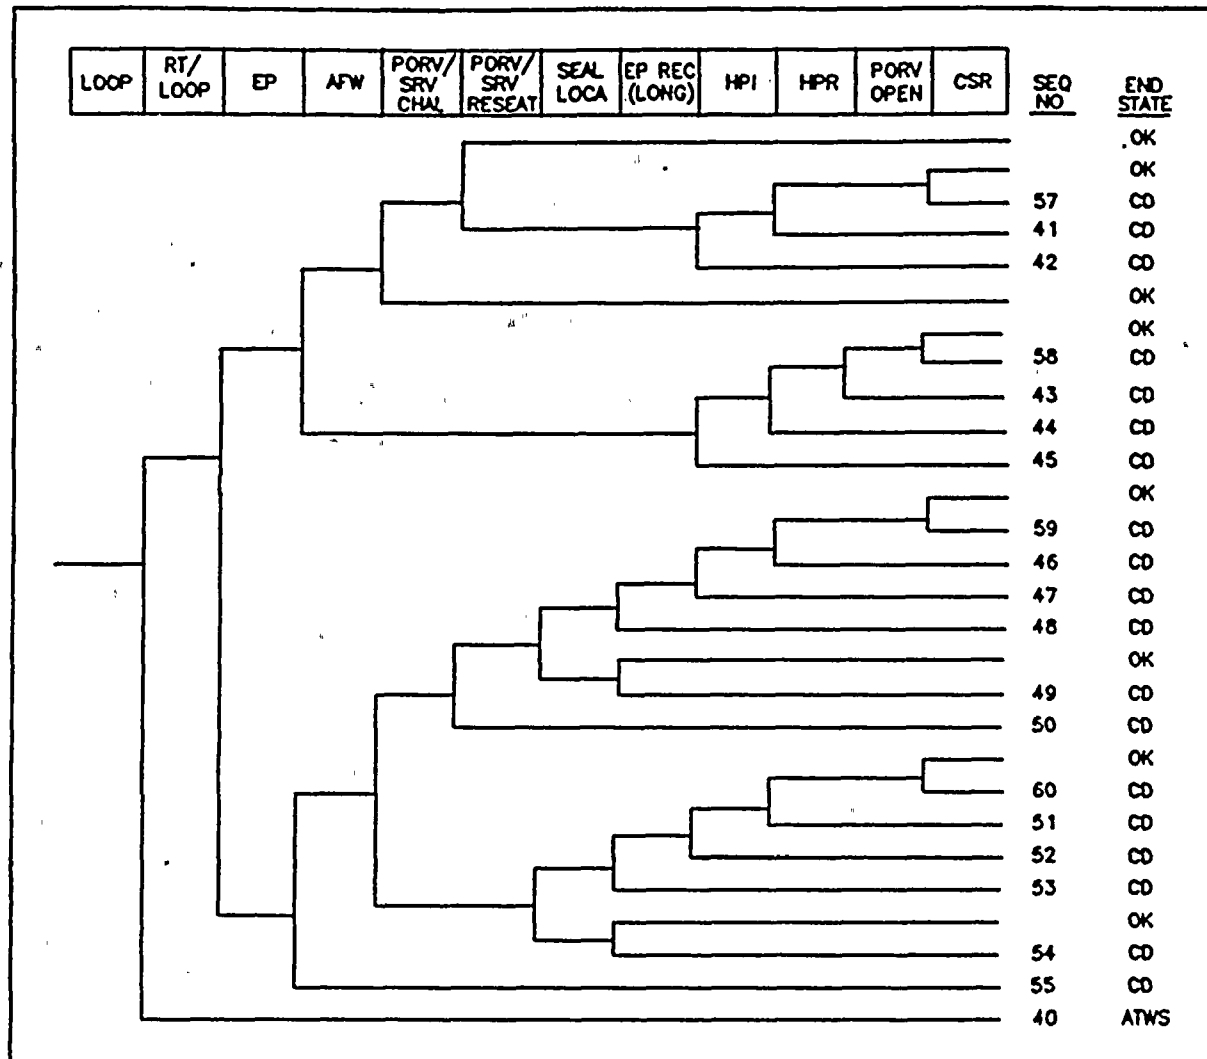


Fig. A.5. PWR class A loss of offsite power

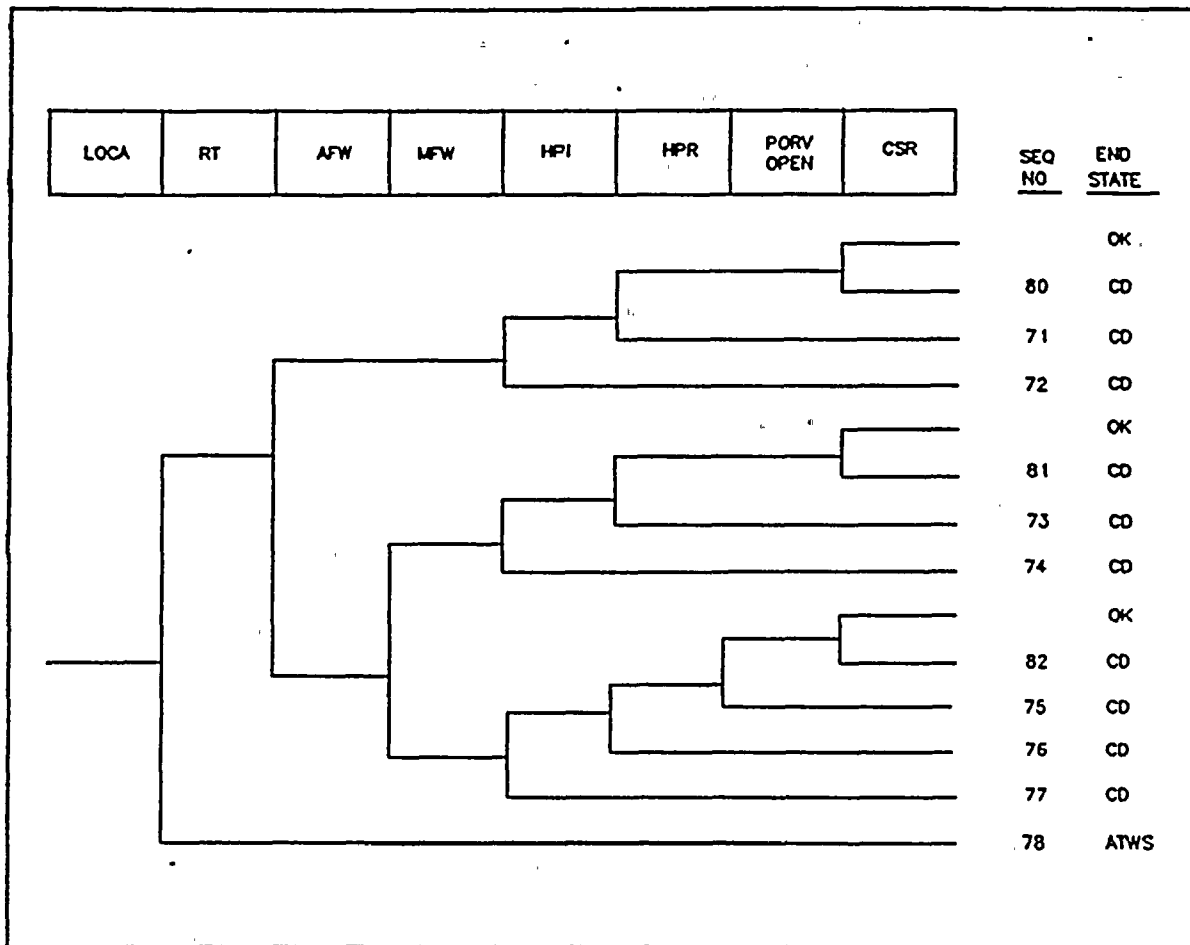


Fig. A.6. PWR class A small-break loss-of-coolant accident

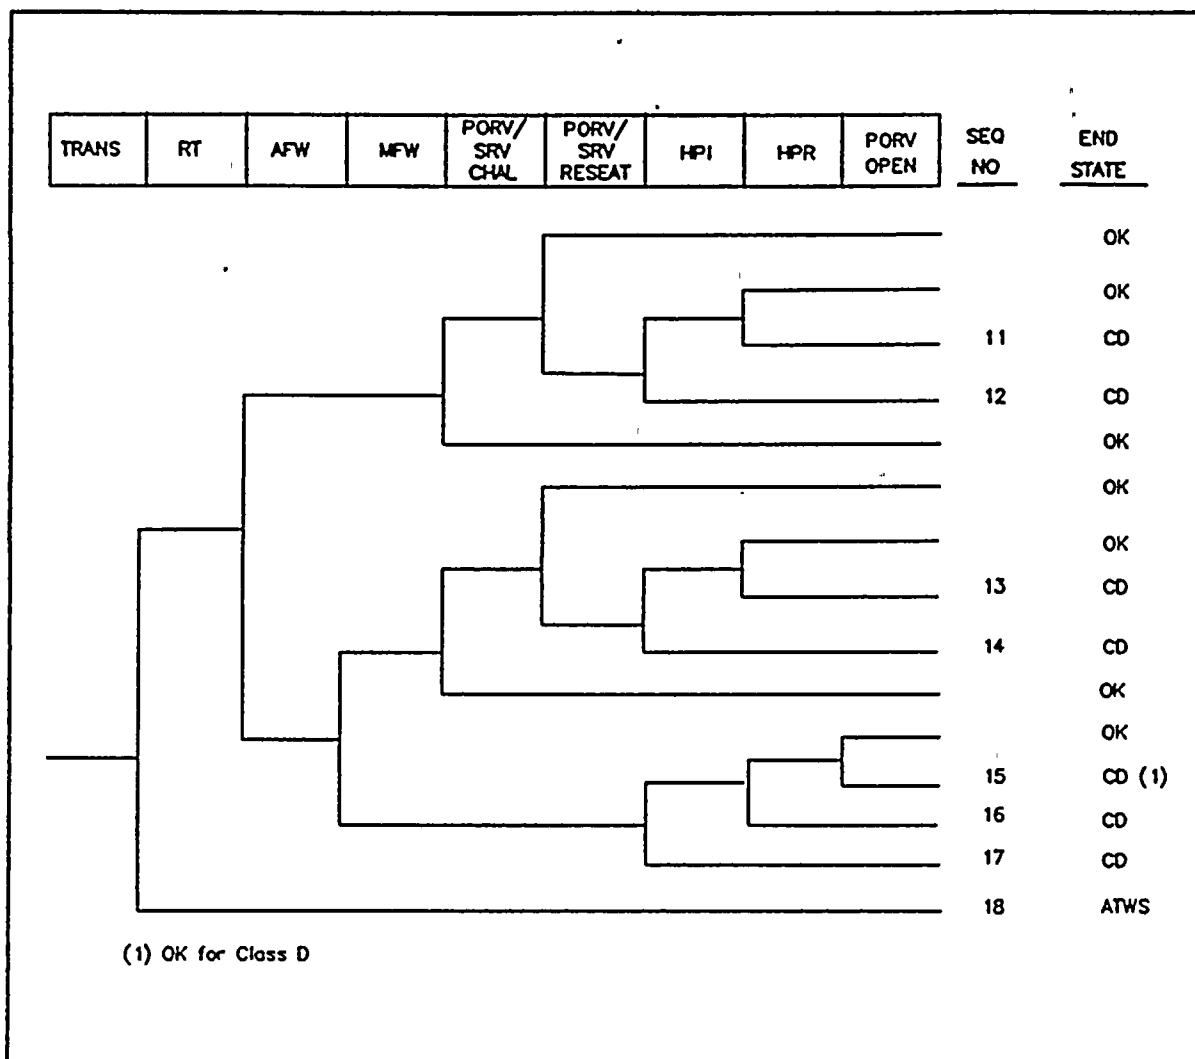


Fig. A.7. PWR class B and D nonspecific reactor trip

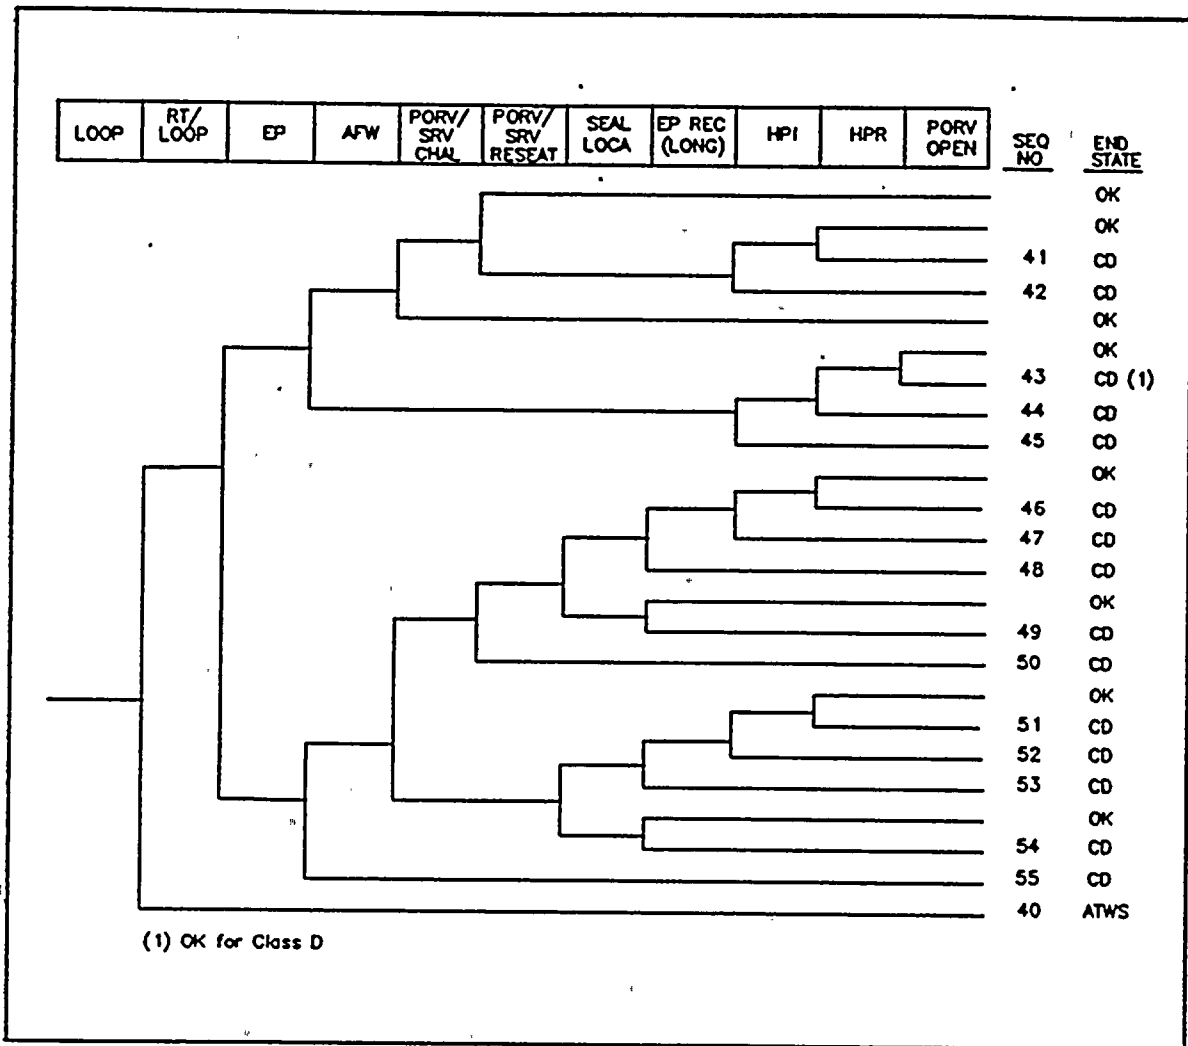


Fig. A.8. PWR class B and D loss of offsite power

Fig. A.9. PWR class B and D small-break loss-of-coolant accident

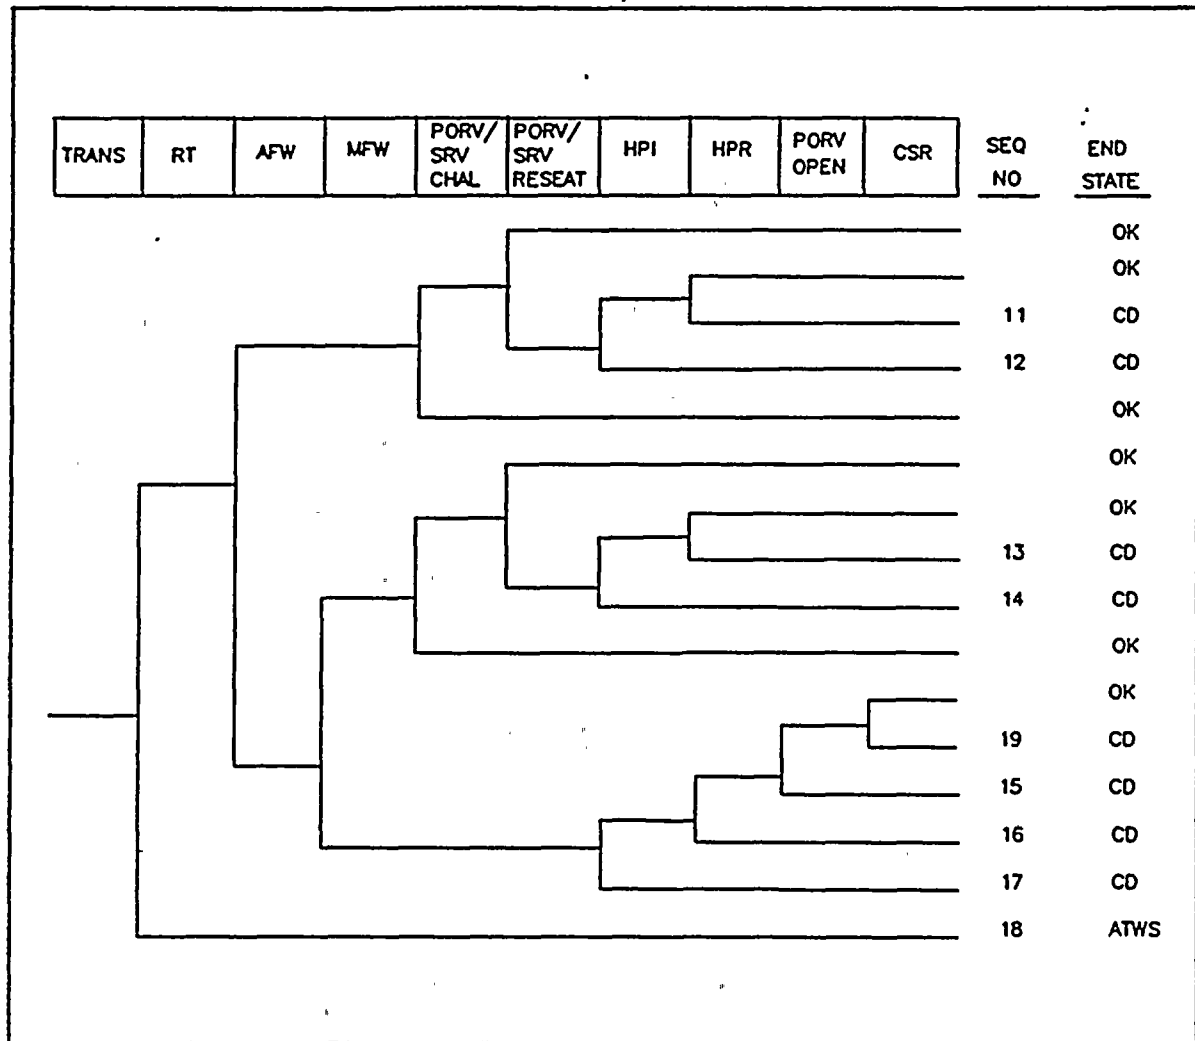


Fig. A.10. PWR class G nonspecific reactor trip

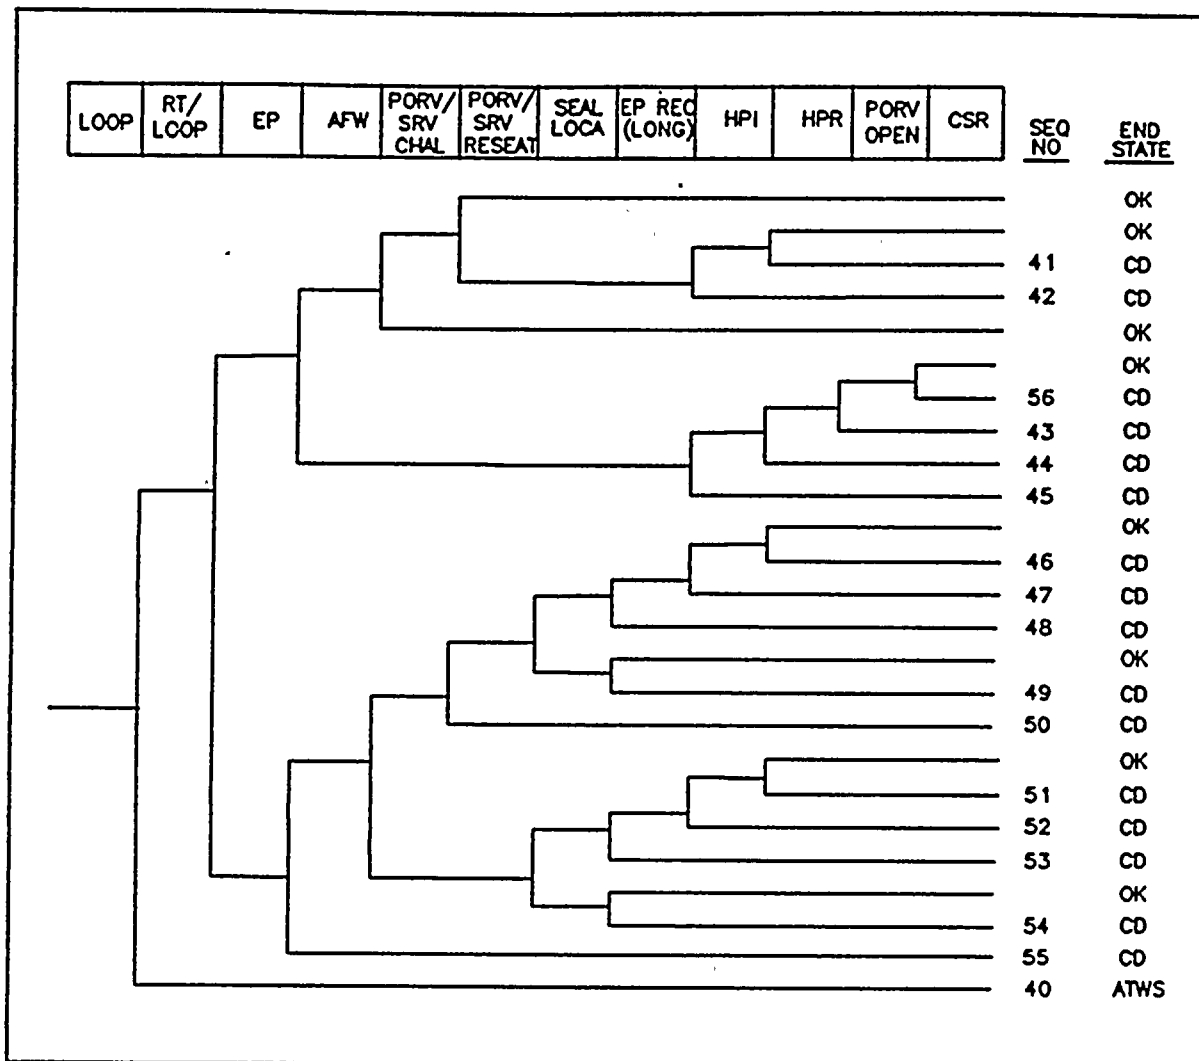


Fig. A.11. PWR class G loss of offsite power

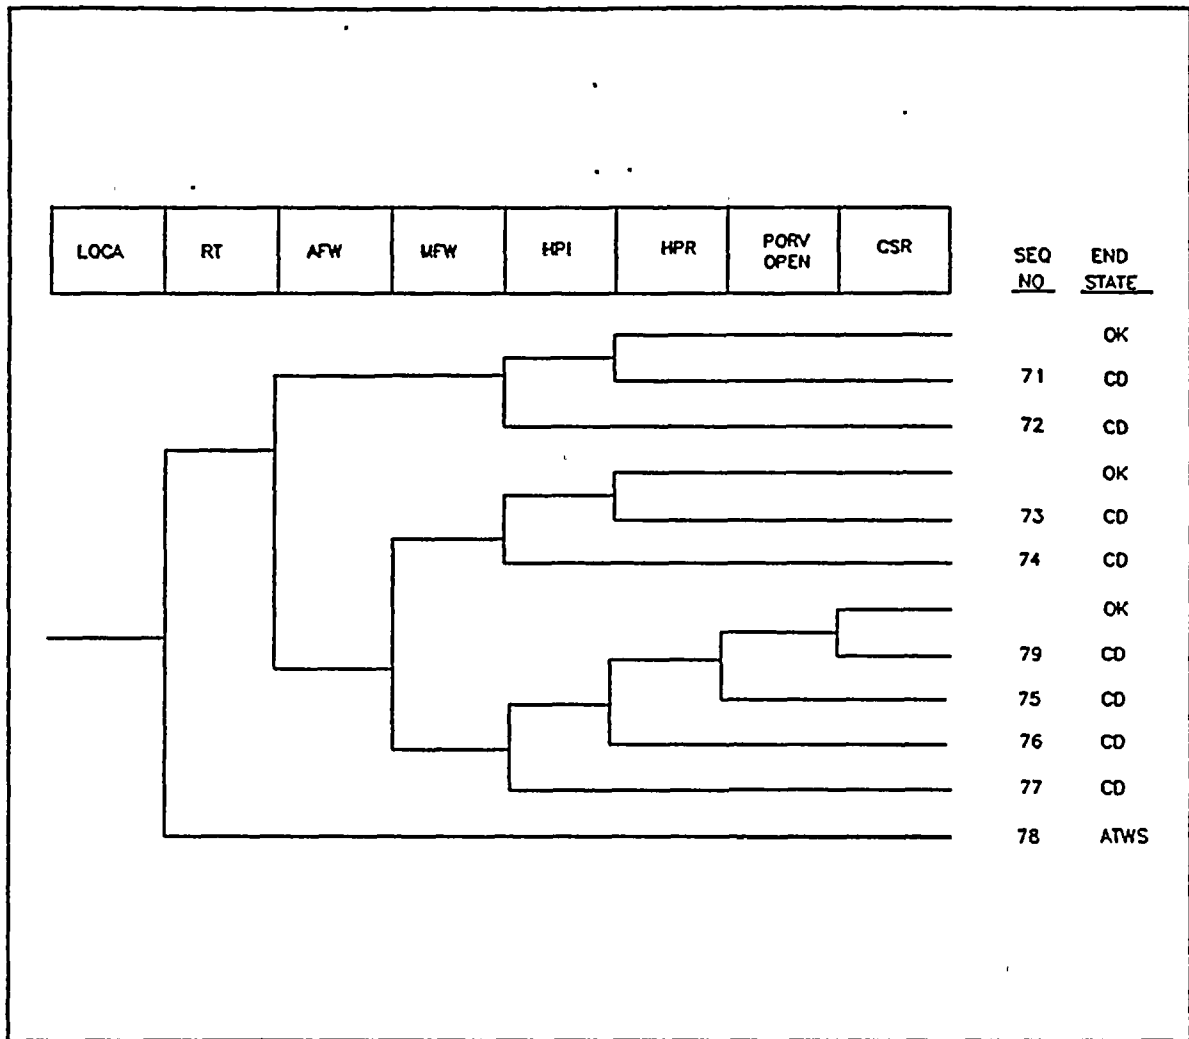


Fig. A.12. PWR class G small-break loss-of-coolant accident

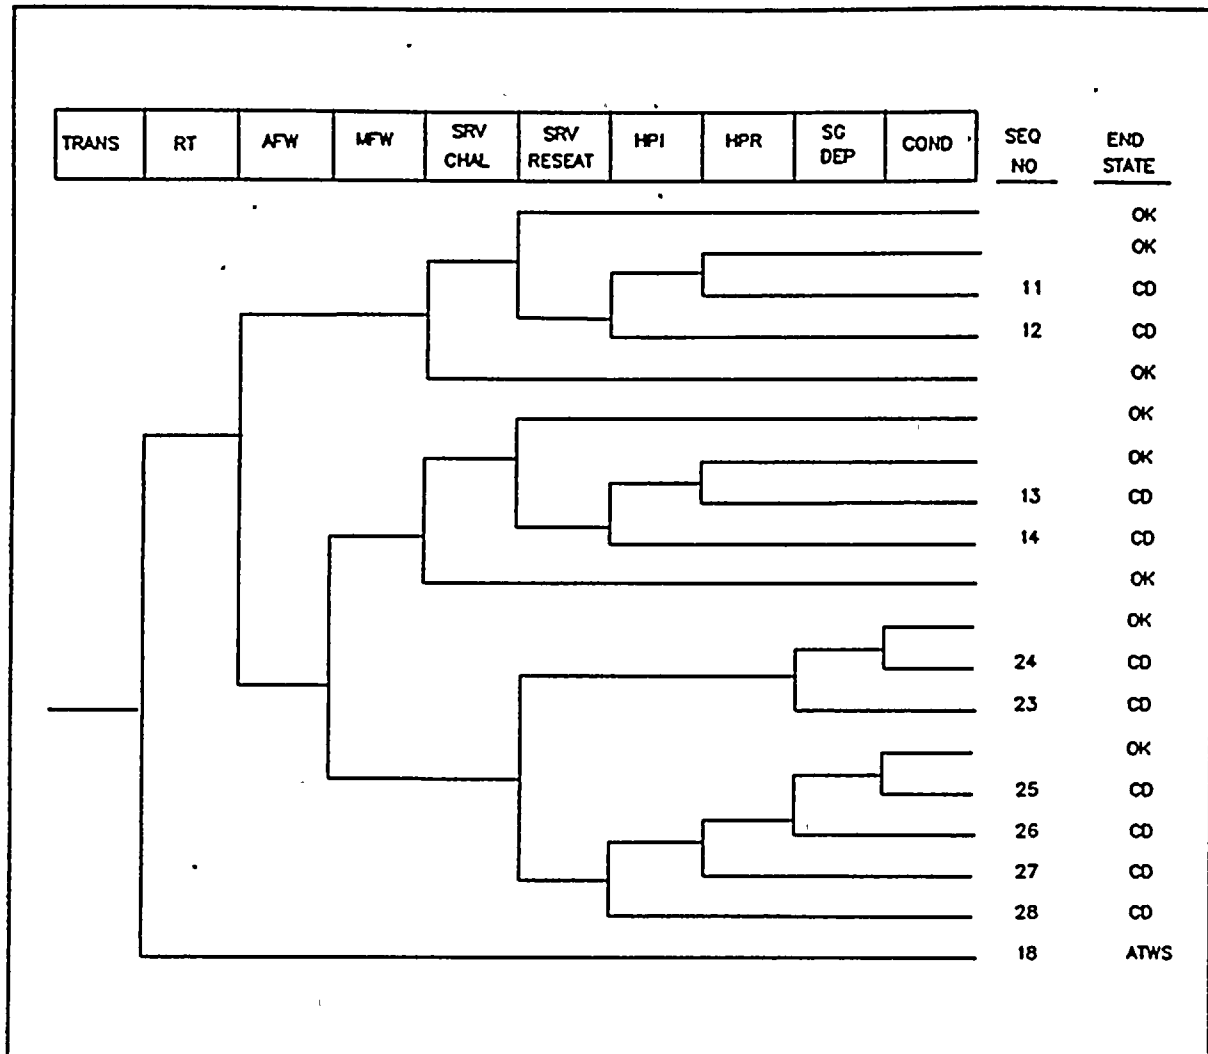


Fig. A.13. PWR class H nonspecific reactor trip

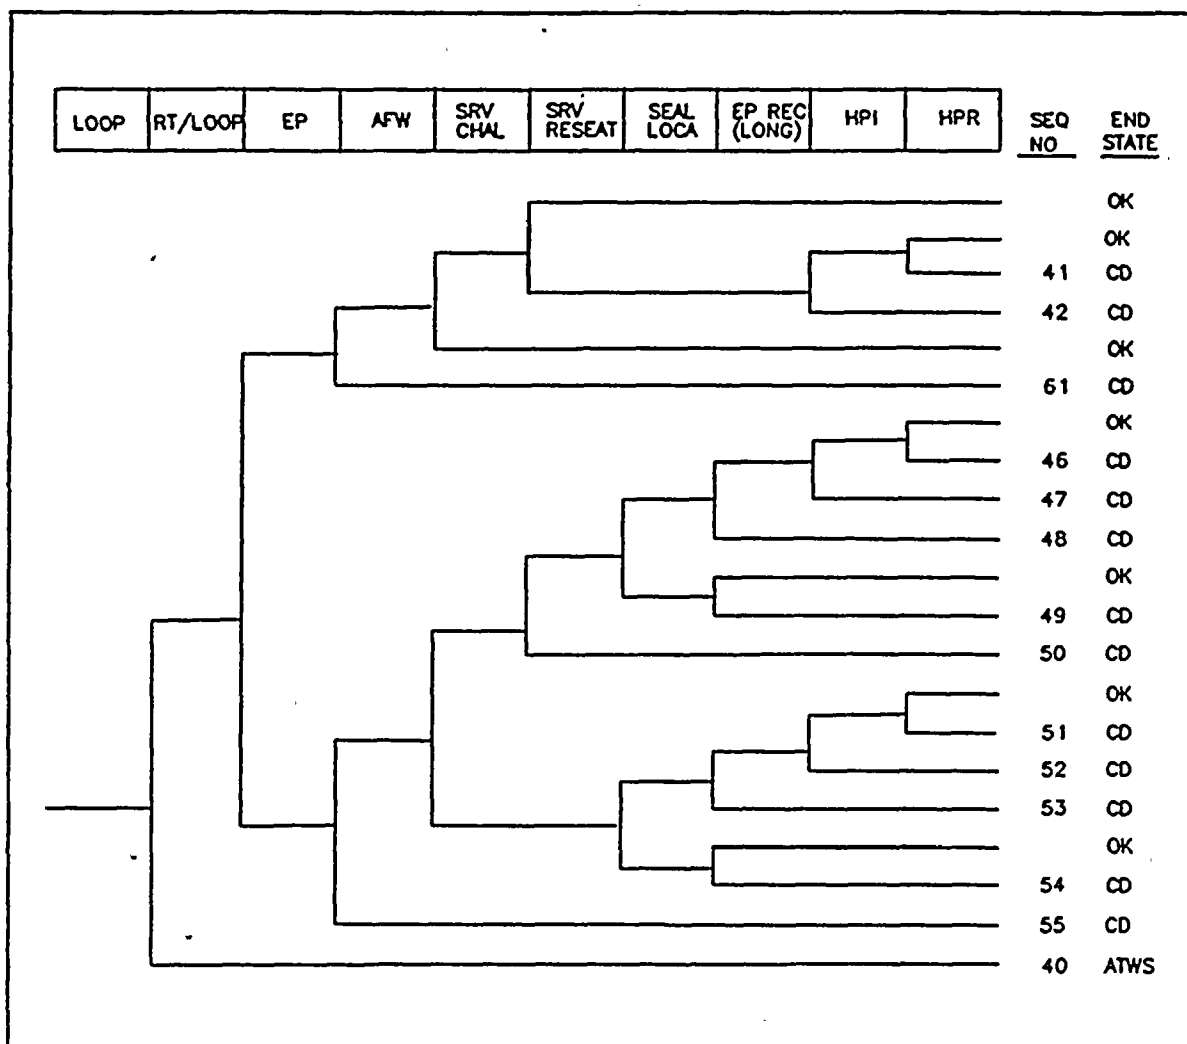


Fig. A.14. PWR class H loss of offsite power



Fig. A.15. PWR class H small-break loss-of-coolant accident

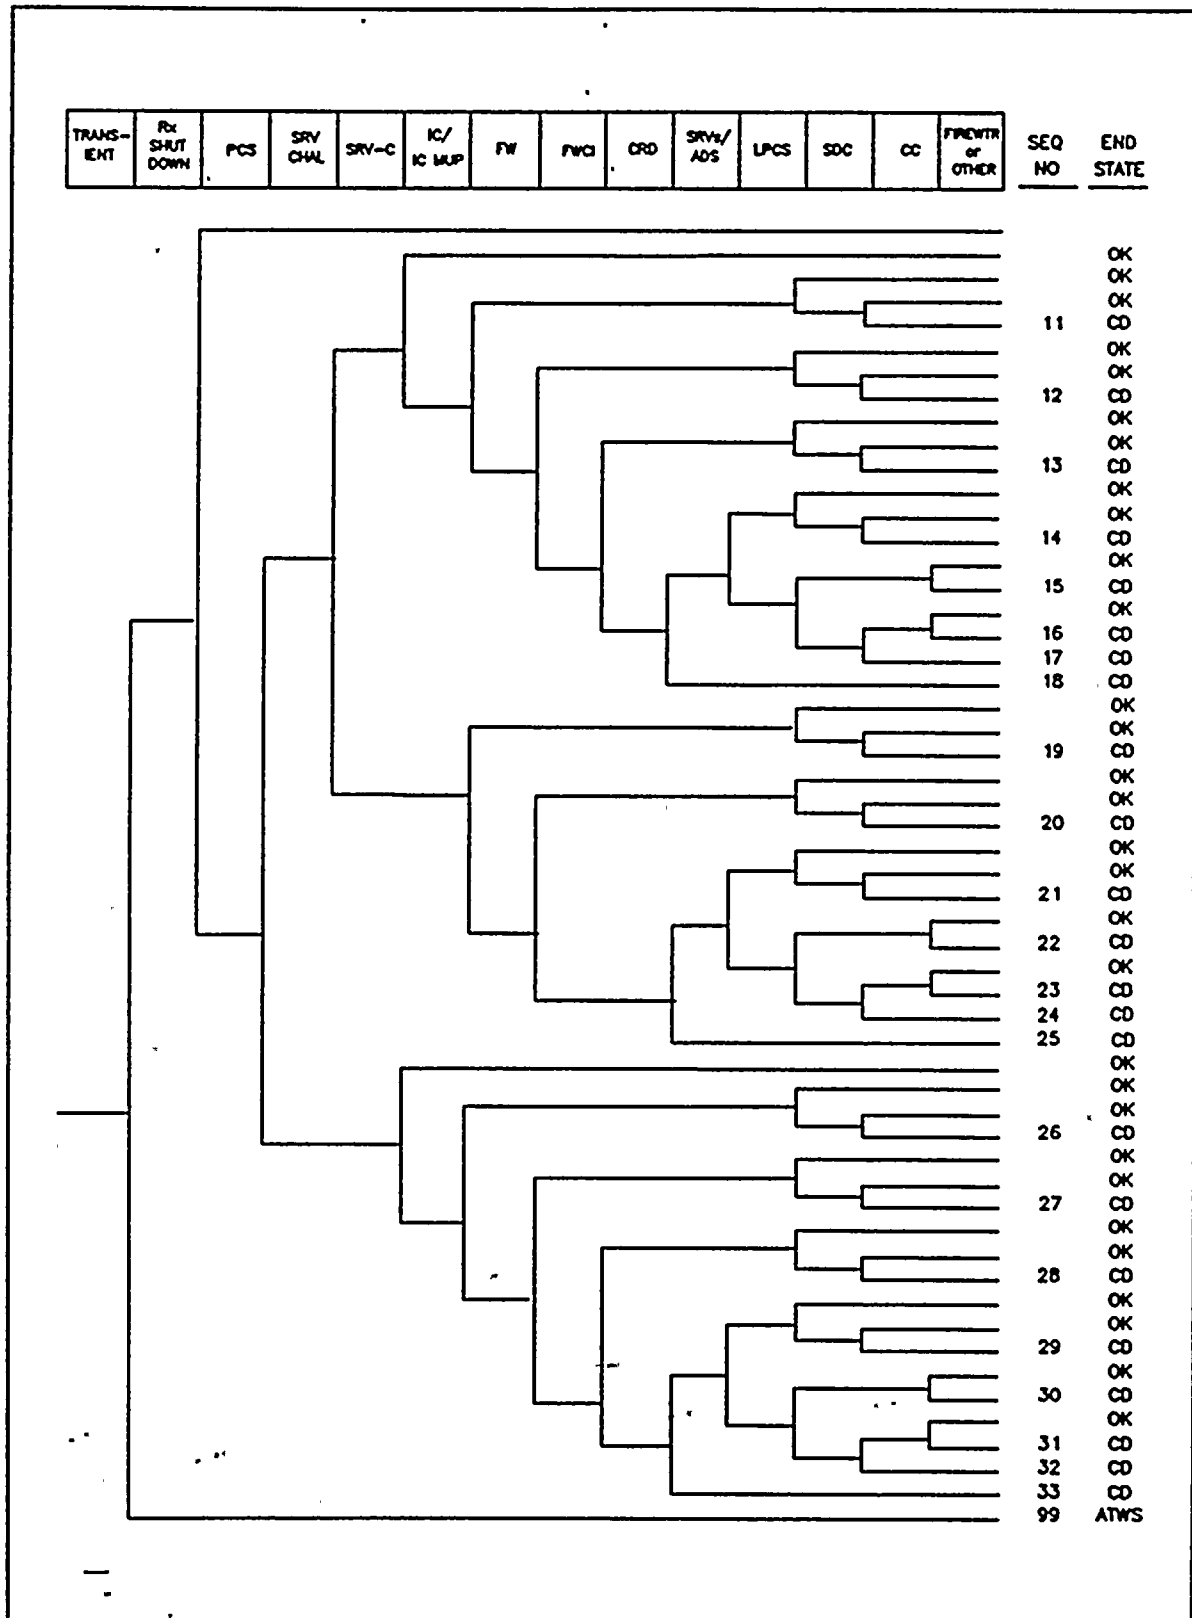


Fig. A.16. BWR class A nonspecific reactor trip

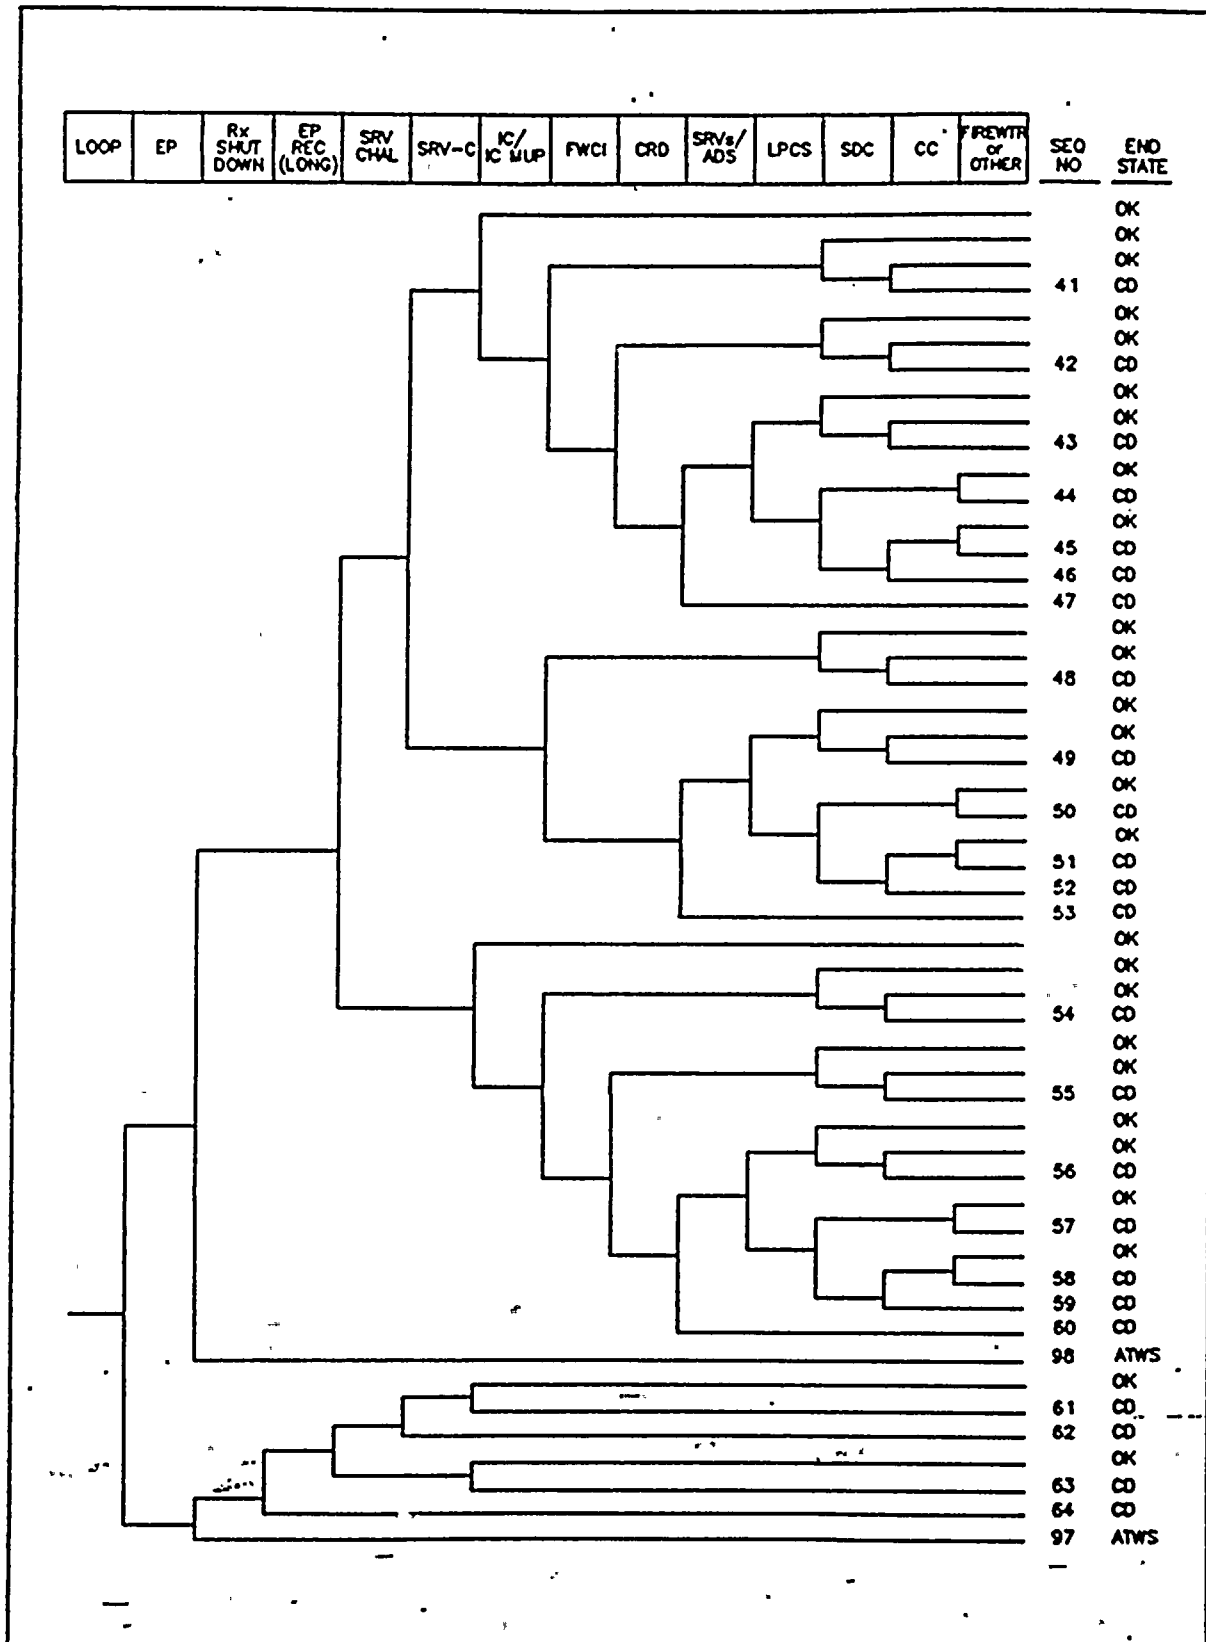


Fig. A.17. BWR class A loss of offsite power

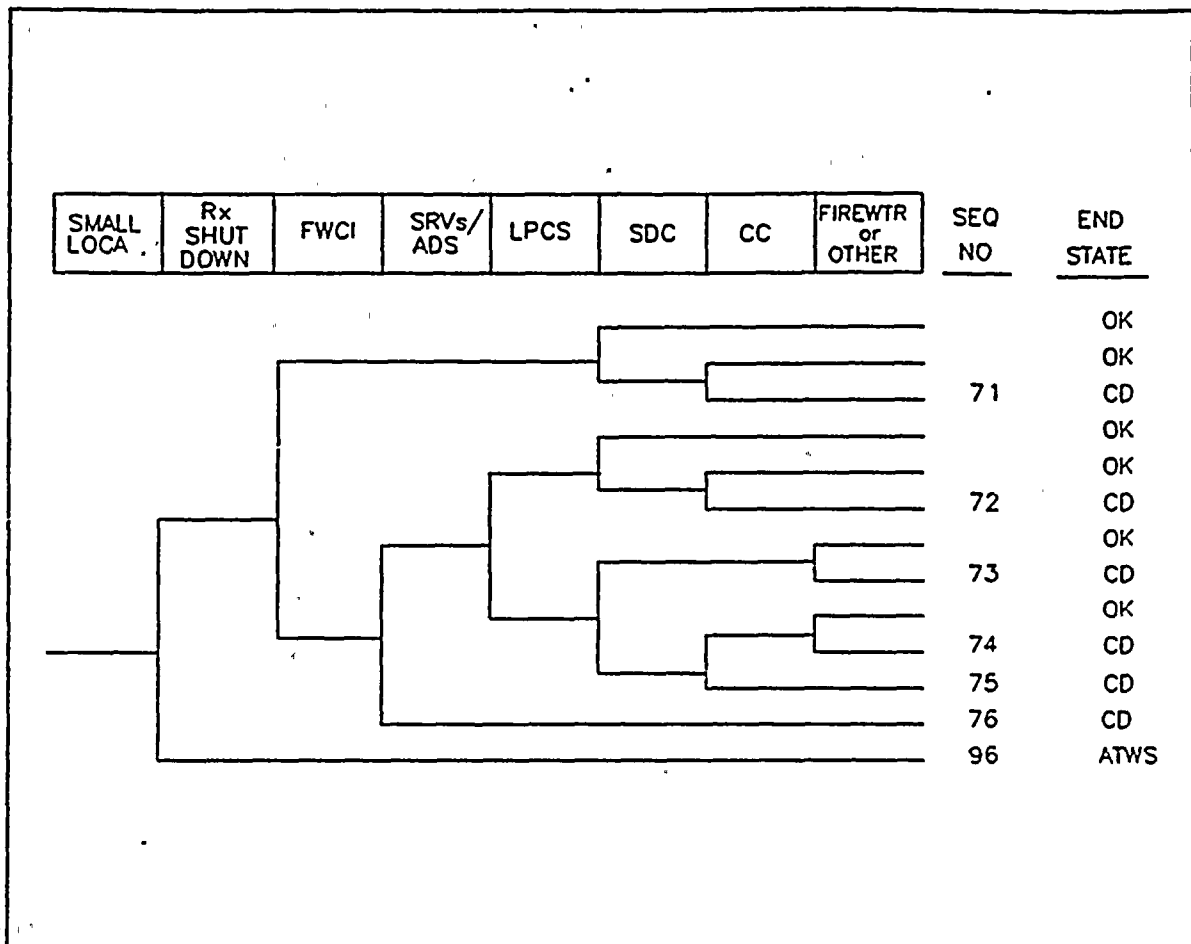


Fig. A.18. BWR class A small-break loss-of-coolant accident

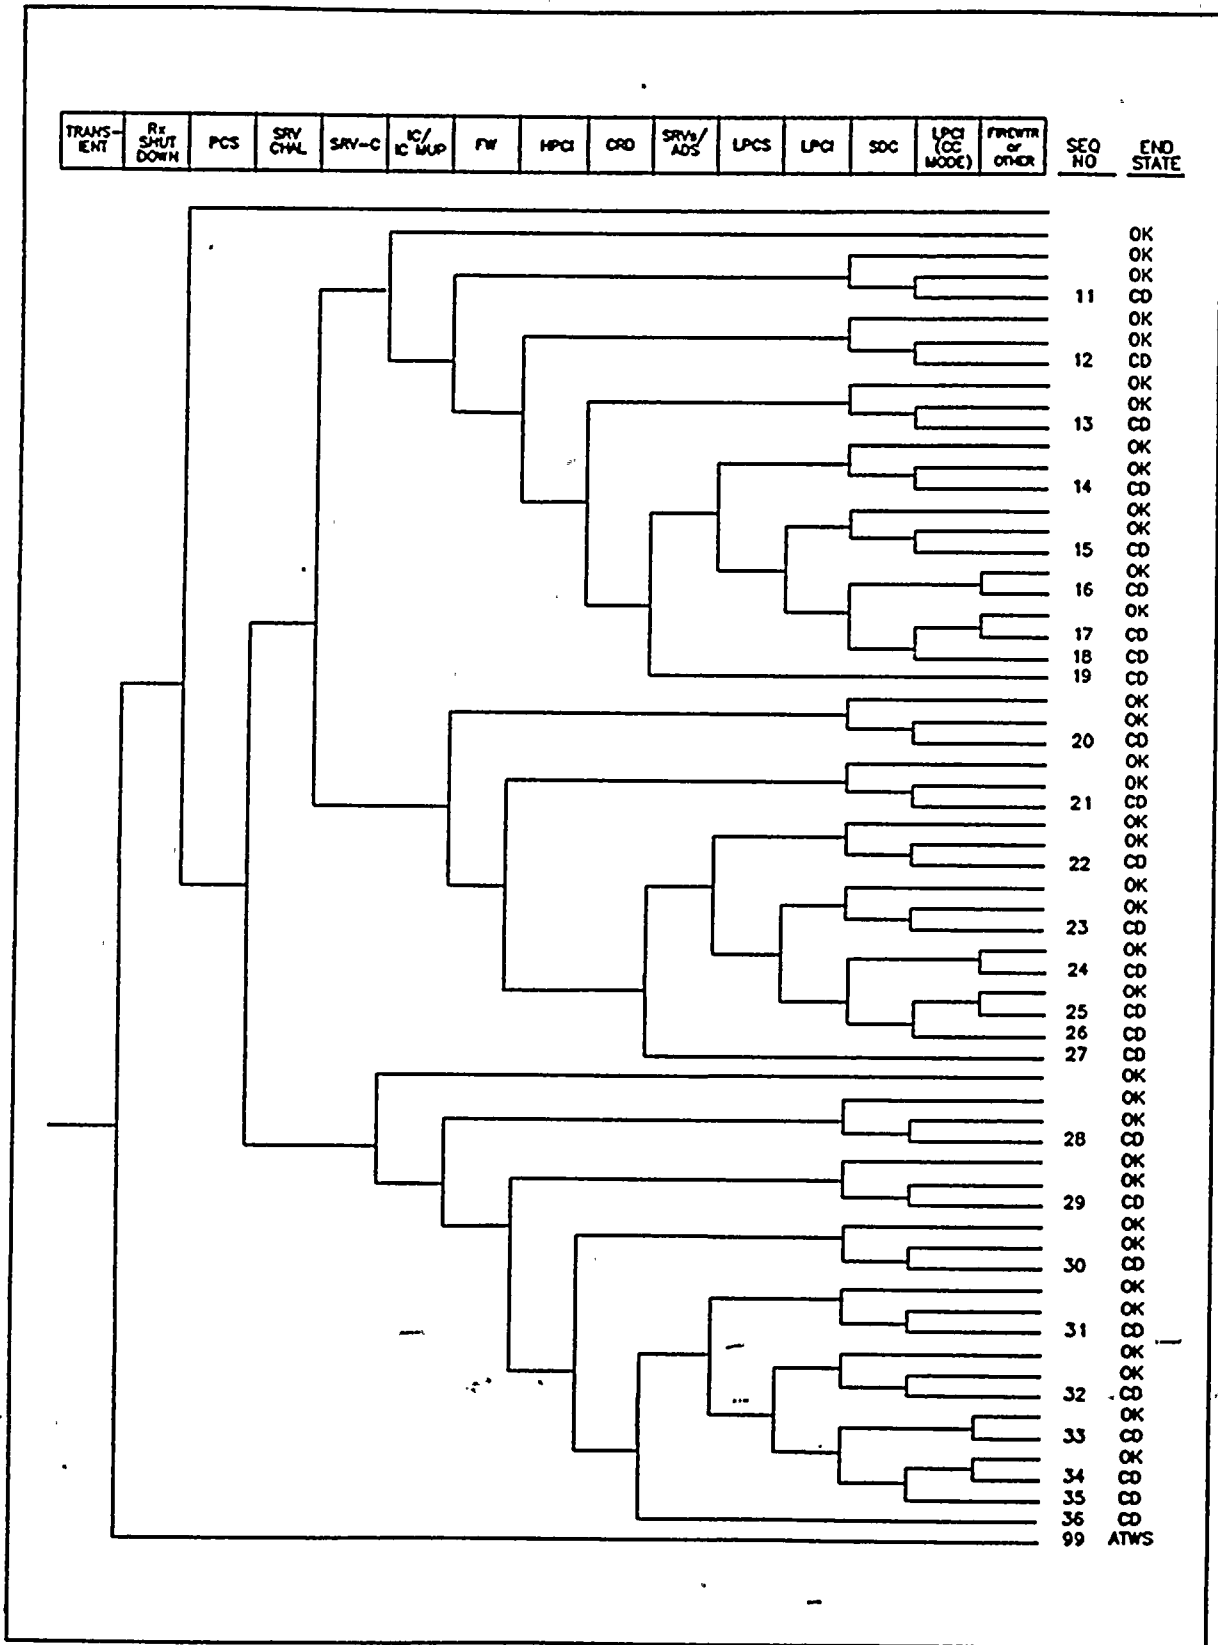


Fig. A.19. BWR class B nonspecific reactor trip

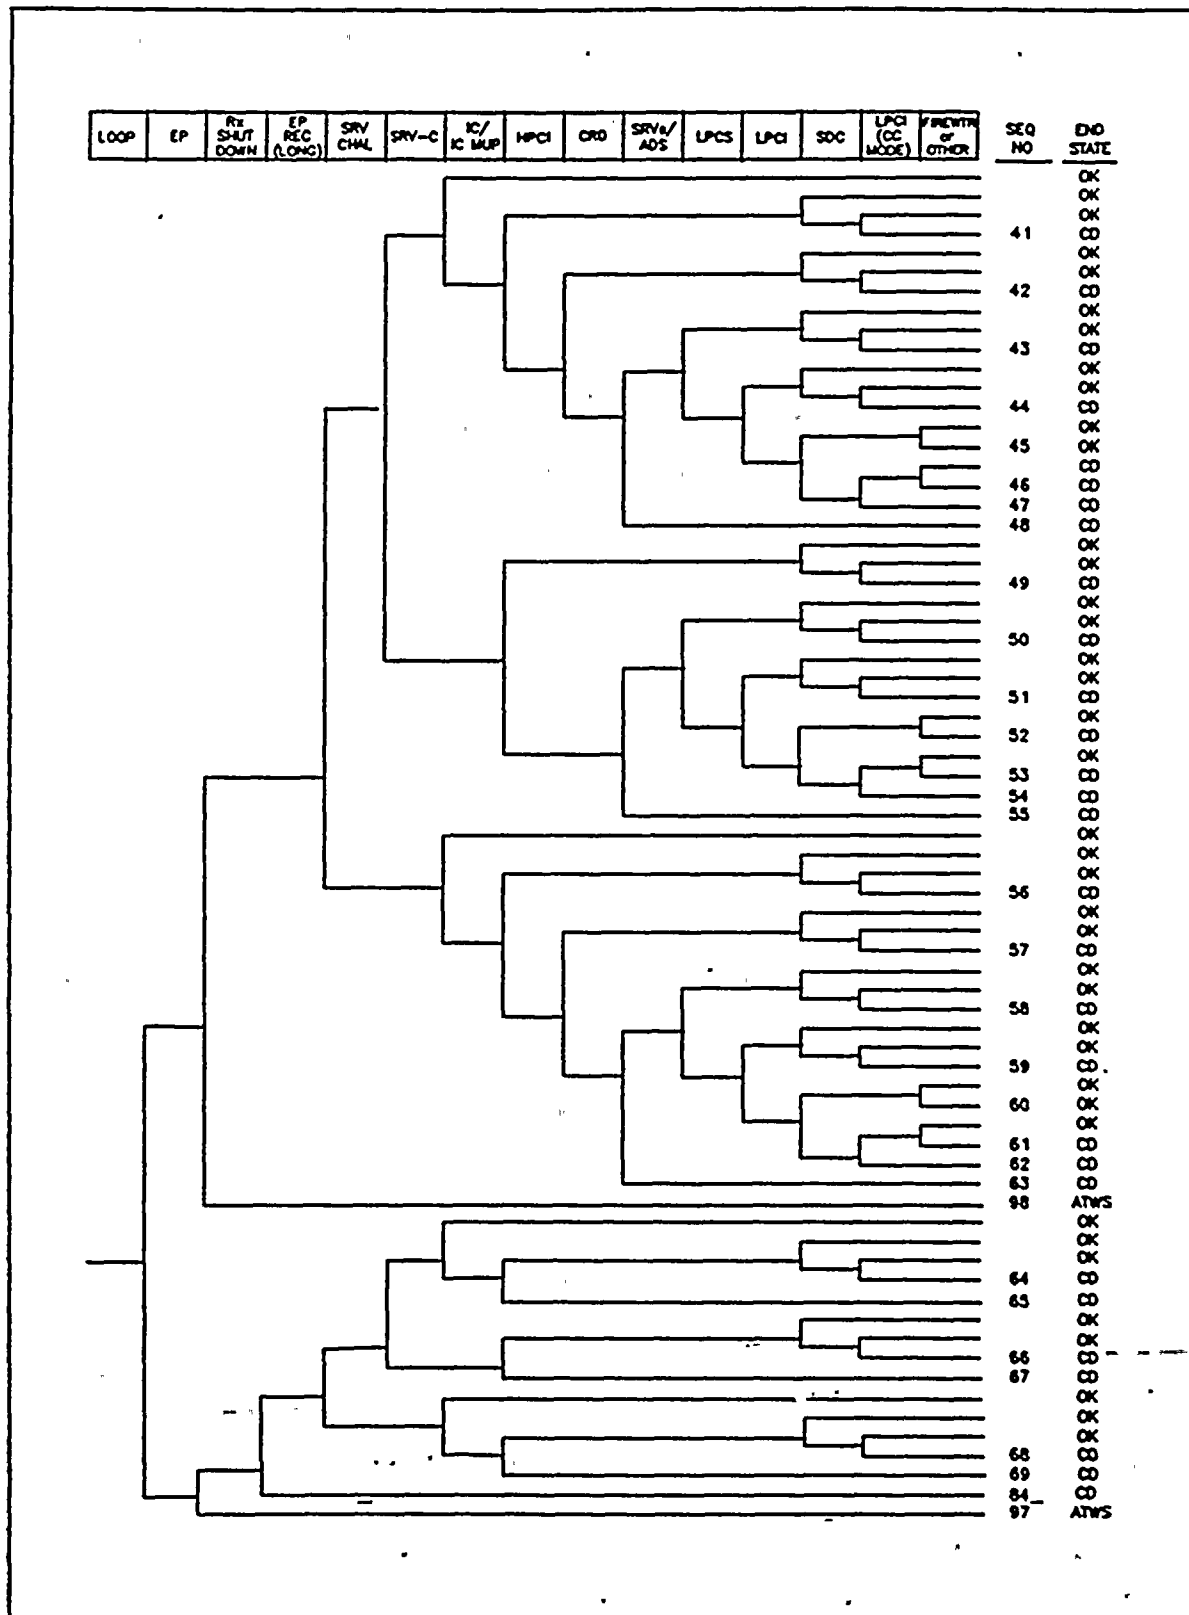


Fig. A.20. BWR class B loss of offsite power

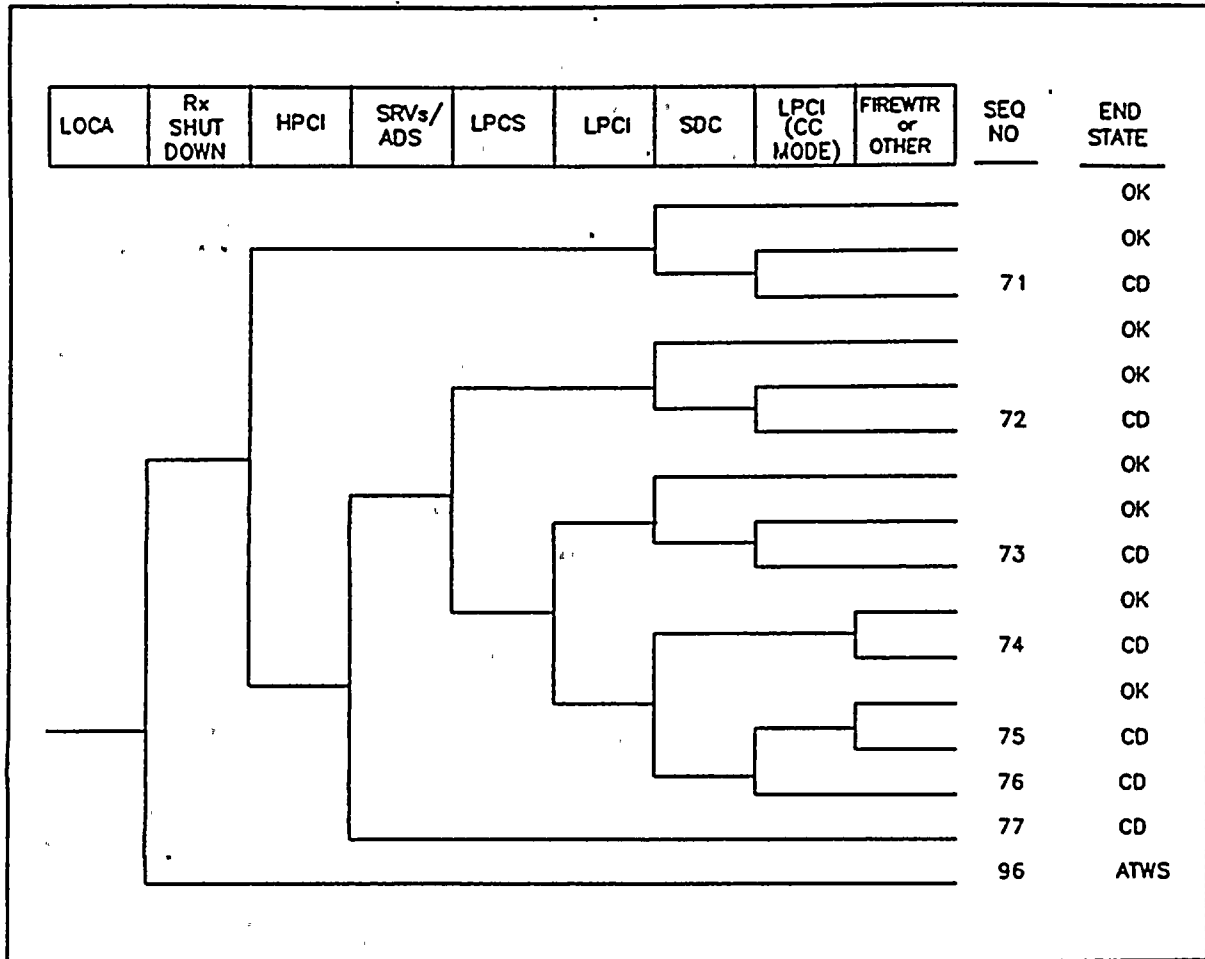


Fig. A.21. BWR class B small-break loss-of-coolant accident



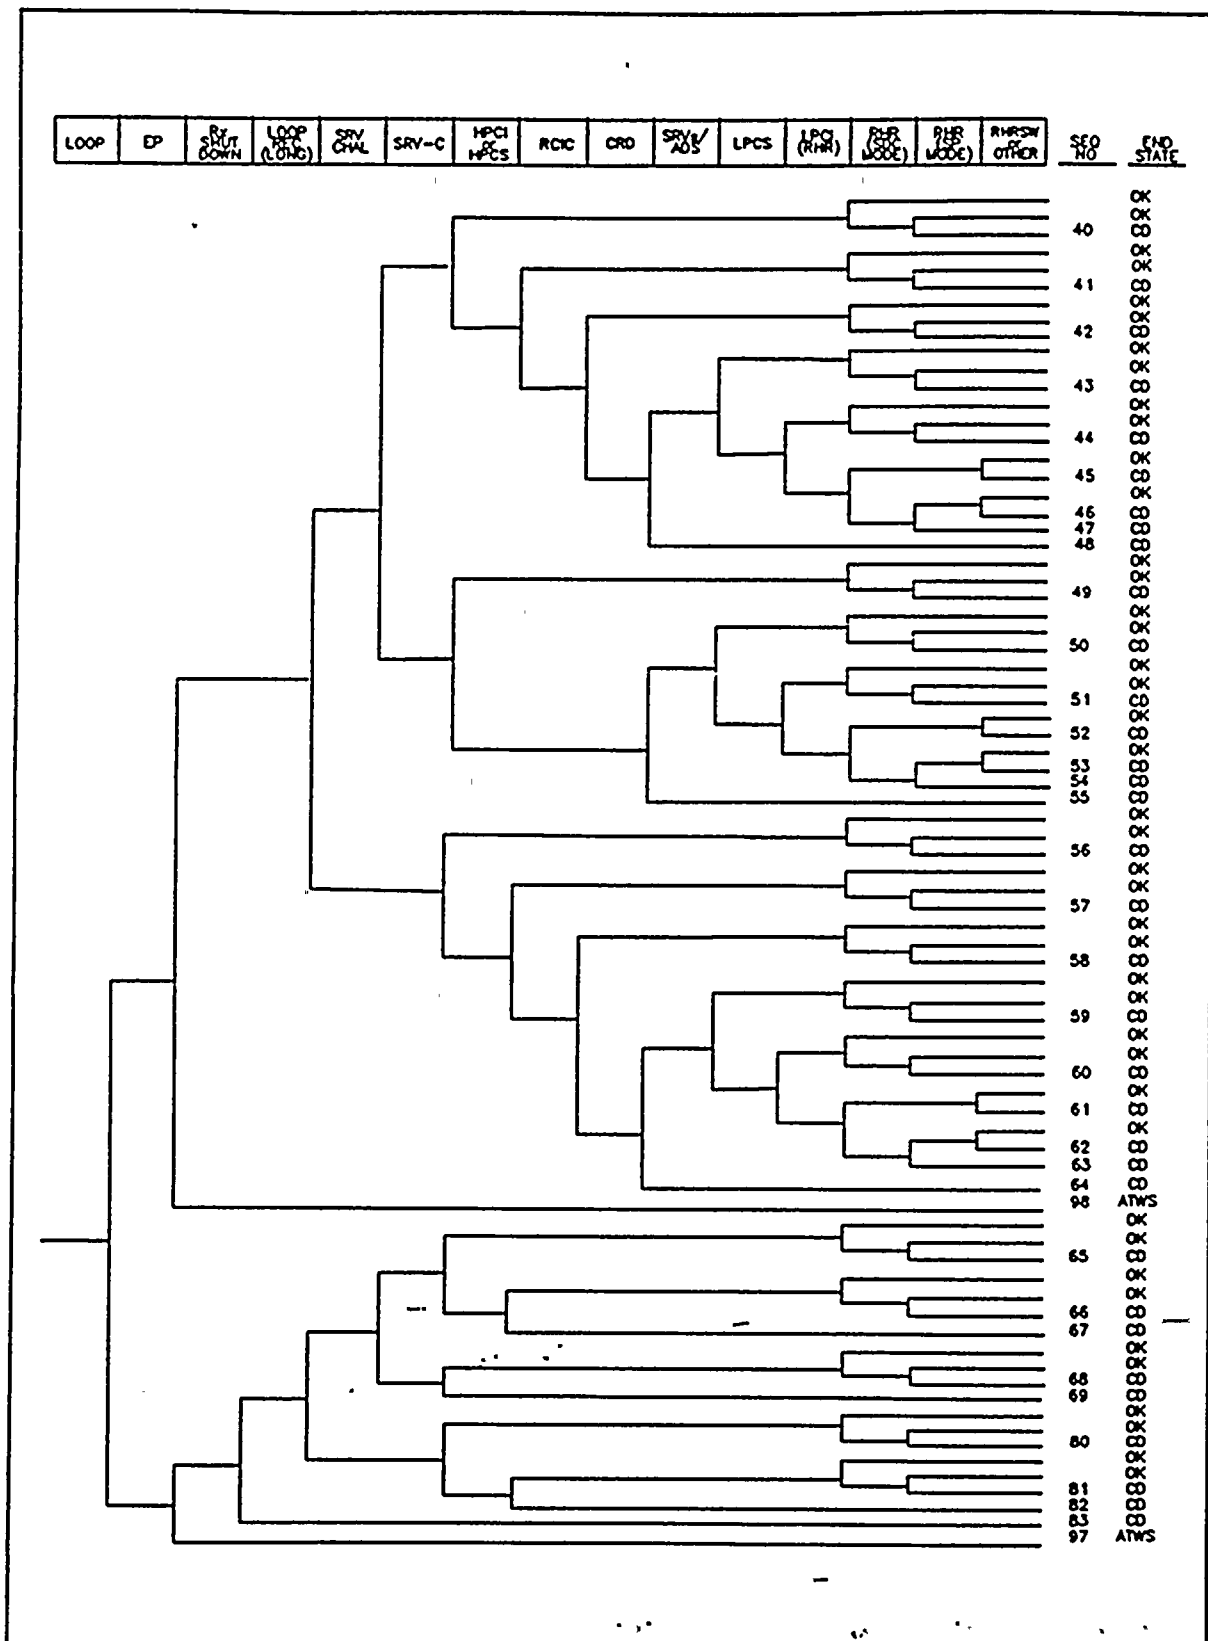


Fig. A.23. BWR class C loss of offsite power

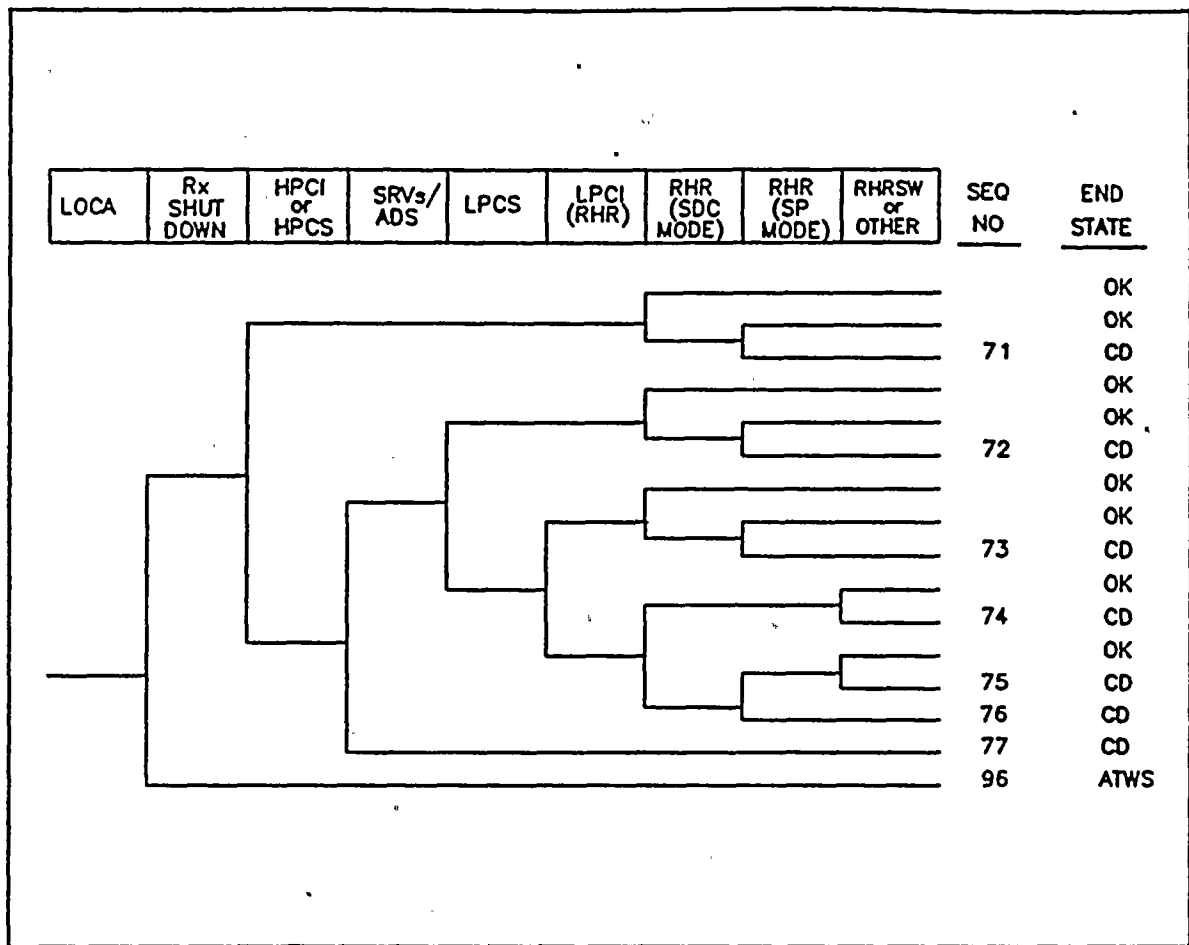


Fig. A.24. BWR class C small-break loss-of-coolant accident