

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8105210111 DUC DATE: 81/05/14 NOTARIZED: YES DOCKET #
 FACIL: 50-250 Turkey Point Plant, Unit 3, Florida Power and Light C 05000250
 50-251 Turkey Point Plant, Unit 4, Florida Power and Light C 05000251
 AUTH. NAME: UHRIG, R.E. AUTHOR AFFILIATION: Florida Power & Light Co.
 RECIP. NAME: EISENHUT, D.G. RECIPIENT AFFILIATION: Division of Licensing

SUBJECT: Application to amend App A of Licenses DPR-31 & DPR-41.

DISTRIBUTION CODE: PA01S COPIES RECEIVED: LTR 3 ENCL 40 SIZE: 2+25
 TITLE: Proprietary Review Distribution - OL Stage

NOTES:

ACTION:	RECIPIENT		COPIES		RECIPIENT	COPIES	
	ID CODE/NAME		LTTR	ENCL		ID CODE/NAME	LTTR
ACTION:	VARGA, S #3-9	02	7	7	GROTEHUIS, #2	1	1
INTERNAL:	I&E #10-11	09	2	2	NRC PDR	1	NP
	OELD		1	0	REG FILE #1	1	1
EXTERNAL:	ACRS #11-25	19	16	16	LPDR	1	NP
	NSIC		1	NP			

rec'd n/out check


MAY 22 1981

TOTAL NUMBER OF COPIES REQUIRED: LTTR 31 ENCL 27



May 14, 1981
L-81-198

Office of Nuclear Reactor Regulation
Attention: Mr. Darrell G. Eisenhut, Director
Division of Licensing
U.S. Nuclear Regulatory Commission
Washington, D. C. 20555

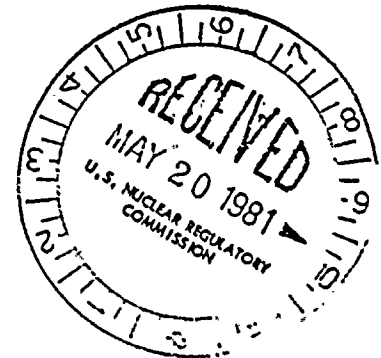

Dear Mr. Eisenhut:

Re: Turkey Point Units 3 & 4
Dockets Nos. 50-250 & 50-251
Proposed License Amendments
Base Load and Radial Burndown

In accordance with 10 CFR 50.30, Florida Power & Light Company submits herewith three (3) signed originals and forty (40) copies of a request to amend Appendix A of Facility Operating Licenses DPR-31 and DPR-41.

The proposed amendment is described below and shown on the accompanying pages bearing the date of this letter in the lower right hand corner.

Page 3.2-3

The specification on "hot channel factors" has been rewritten to incorporate a revised formula for determining F_Q .

Pages 3.2-3a & 3.2-3b

New pages are added to specify power distribution limits for Base Load operation and Radial Burndown operation.

Page 3.2-4

This section on flux map surveillance is deleted from the top of the page. The requirement for a monthly flux map is moved to Chapter 4, Surveillance Requirements (Table 4.1-1).

Figure 3.2-3

The variable F_Q is replaced with the $[F_Q]_L$ to be consistent with the revised hot channel factor specifications.

Table 4.1-1 (Sheet 1)

The requirement for monthly flux map is added to this table.

PA01
s

3/40

read w/out
check

change: L E
PDR 1 NP
LPDR 1 NP
NSIC 1 NP

8105210 ///

P

Office of Nuclear Regulation
Attention: Mr. Darrell G. Eisenhut, Director
Division of Licensing

Page Two

Table B3.2-3 through B3.2-8


The Bases have been revised to support both Base Load and Radial Burndown operation in addition to the changes in the nomenclature for F_Q.

Please note that our response contains information considered to be proprietary by the Westinghouse Electric Corporation. In conformance with 10 CFR 2.790, as amended, we are also forwarding an APPLICATION FOR WITHHOLDING INFORMATION FROM PUBLIC DISCLOSURE (Attachment 1) and an Affidavit (Attachment 2). The affidavit sets forth the basis on which the proprietary information contained in Attachment 3 may be withheld from public disclosure by the Commission.

Attachment 3 contains a Safety Evaluation supporting the proposed Technical Specification changes, both a proprietary and non-proprietary version.

The proposed amendment has been reviewed by the Turkey Point Plant Nuclear Safety Committee and the Florida Power & Light Company Nuclear Review Board. We have determined that since this request involves a single safety issue and duplicate amendment, the request should be classified as a Class I and III Amendment pursuant to 10 CFR 170. Accordingly, a check for \$4,400 is enclosed.

Very truly yours,



Robert E. Uhrig
Vice President
Advanced Systems and Technology

REU/JEM/ras

Attachment

cc: Mr. James P. O'Reilly, Region II
Harold F. Reis, Esquire