

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8106180256 DOC. DATE: 81/06/10 NOTARIZED: NO DOCKET #  
 FACIL: 50-250 Turkey Point Plant, Unit 3, Florida Power and Light Co. 05000250  
 50-251 Turkey Point Plant, Unit 4, Florida Power and Light Co. 05000251  
 AUTH. NAME: UHRIG, R.E. AUTHOR AFFILIATION: Florida Power & Light Co.  
 RECIP. NAME: VARGA, S.A. RECIPIENT AFFILIATION: Operating Reactors Branch 1

SUBJECT: Clarifies compliance w/Item 2.1.4 of TMI Lessons Learned, containment isolation, per NRC 810508 request. Emergency procedures have been revised. Procedures require dedicated person to close & lock isolation valves during emergency.


DISTRIBUTION CODE: A001S COPIES RECEIVED: LTR 3 ENCL 0 SIZE: 1.1  
 TITLE: General Distribution for after Issuance of Operating License


NOTES:

ACTION:	RECIPIENT ID CODE/NAME		COPIES		RECIPIENT ID CODE/NAME		COPIES	
			LTTR	ENCL			LTTR	ENCL
ACTION:	VARGA, S.	04	13	1				
INTERNAL:	D/DIR, HUM FAC08		1	1	DIR, DIV OF LIC		1	1
	I&E 06		2	2	NRC PDR 02		1	1
	OELD 11		1	0	OR ASSESS BR 10		1	0
	RAD ASMT BR		1	1	REG FILE 01		1	1
EXTERNAL:	ACRS 09		16	1	LPDR 03		1	1
	NSIC 05		1					

*P*

TOTAL NUMBER OF COPIES REQUIRED: LTTR 40 ENCL 0

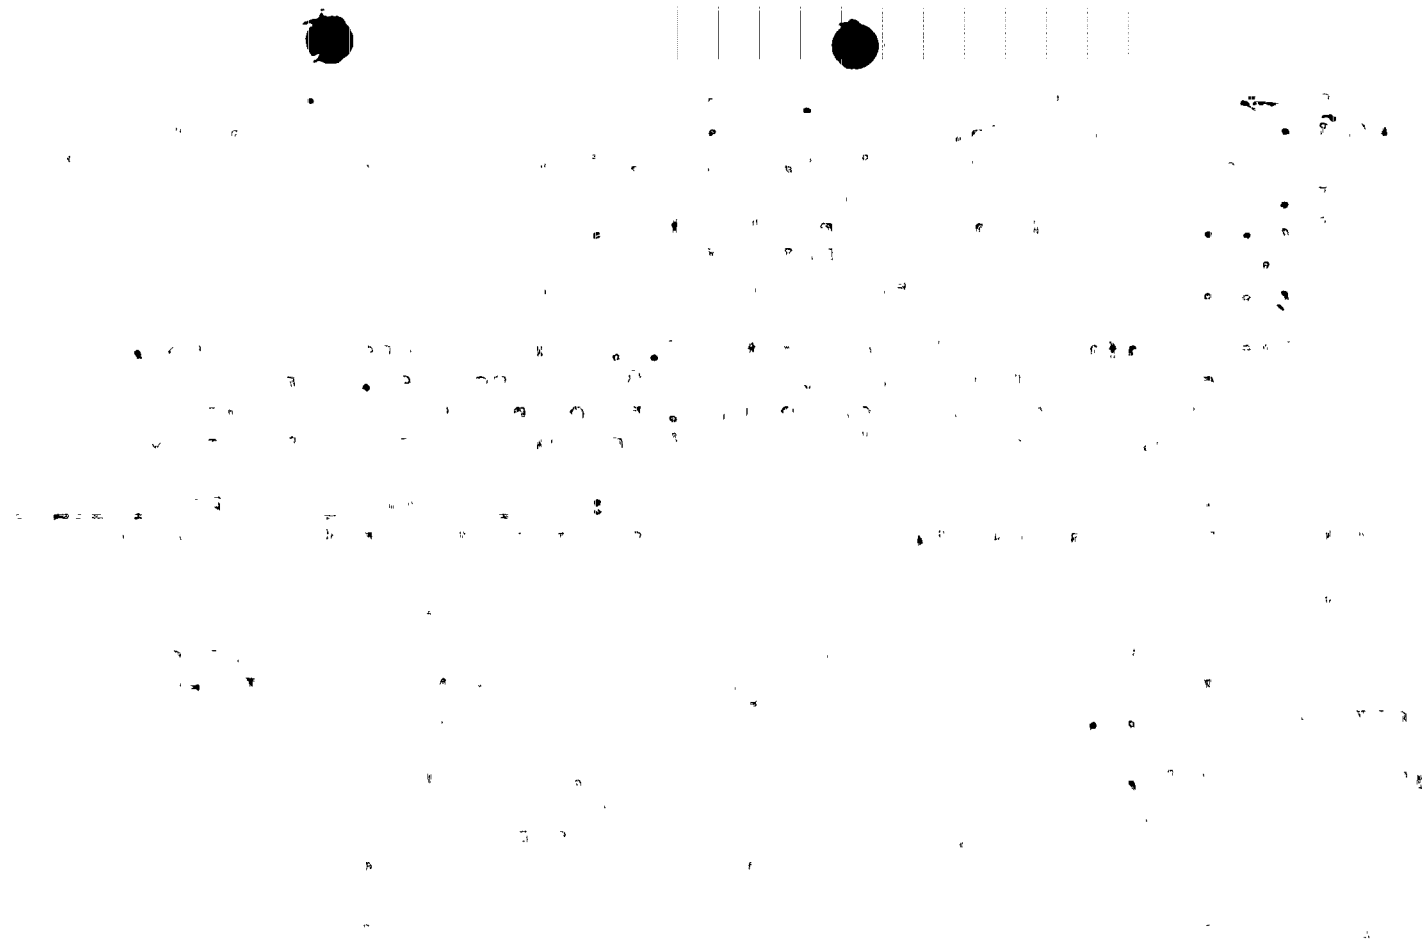

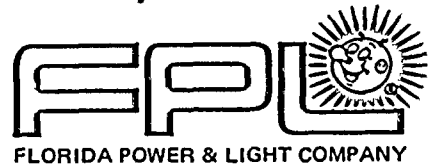

June 10, 1981  
L-81-242

Office of Nuclear Reactor Regulation  
Attention: Mr. Steven A. Varga, Chief  
Operating Reactor Branch #1  
Division of Licensing  
U. S. Nuclear Regulatory Commission  
Washington, D. C. 20555

Dear Mr. Varga:

Re: Turkey Point Units 3 & 4  
Docket Nos. 50-250 & 50-251  
TMI Lessons Learned-Containment Isolation

The purpose of this letter is to respond to your request for clarification regarding our compliance with item 2.1.4, Containment Isolation, of the TMI Lessons Learned. Your May 8, 1981 letter from Mr. Varga to Dr. Uhrig noted that our earlier response overlooked the portion of the item which required a dedicated person to close the isolation valves "when the operation is complete." In addition, the response failed to mention that the normally closed manual isolation valves would be locked closed.


We would like to advise you that in November 1980, we not only revised our Emergency Procedures, but also our Administrative and Operating Procedures to require that a "dedicated person" or persons would close and lock any normally closed manual isolation valve which might be open during plant operation in the event of an emergency, or when the operation is complete. We would also clarify our position regarding the dedicated person by stating that this person is not restricted to the Nuclear Control Center Operator, but could also be his designee or other assigned plant personnel.

Very truly yours,

Robert E. Uhrig  
Vice President  
Advanced Systems & Technology

REU/JEM/ras

cc: Mr. J. P. O'Reilly, Region II  
Harold F. Reis, Esquire

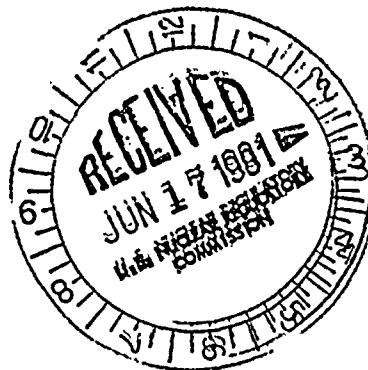

A001  
S  
3/6

8106180256  
P



— 428 —

