

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8107210331. DOC. DATE: 81/07/16. NOTARIZED: NO. DOCKET # 05000250
 FACIL: 50-250 Turkey Point Plant, Unit 3, Florida Power and Light Co. 05000250
 50-251 Turkey Point Plant, Unit 4, Florida Power and Light Co. 05000251
 AUTH. NAME: UHRIG, R.E. AUTHOR AFFILIATION: Florida Power & Light Co.
 RECIP. NAME: EISENHUT, D.G. RECIPIENT AFFILIATION: Division of Licensing

SUBJECT: Responds to Generic Ltr 81-14 re seismic qualification of auxiliary feedwater sys. Sys is seismically designed per FSAR & constructed & maintained in manner consistent w/other safety grade sys in plant. Addl info will be provided by 81091.

DISTRIBUTION CODE: A048S COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 11111111
 TITLE: Equipment Qualification (OR & PRE-OL)

NOTES:

ACTION:	RECIPIENT		COPIES		RECIPIENT	COPIES	
	ID CODE/NAME		LTTR	ENCL		ID CODE/NAME	LTTR
ACTION:	ORB #1 BC	10.	7	7			
INTERNAL:	DIR/DOL	17.	1.	1.	EQUIP QUAL BR05	5.	5.
	I&E	18.	3.	3.	NRC PDR	02.	1.
	DELD	20.	1.	1.	OGC	21.	1.
	REG FILE	01.	1.	1.	WILLIAMS, M.H.22	1.	1.
EXTERNAL:	ACRS	23.	16.	16.	LPDR	03.	1.
	NSIC	04.	1.	1.	NTIS		1.

TOTAL NUMBER OF COPIES REQUIRED: LTTR 40 ENCL 40

26

1. The first part of the report is a summary of the work done during the year. It is a brief statement of the facts and figures, and is intended to give a general impression of the work done.

2. The second part of the report is a detailed account of the work done during the year. It is a full and complete statement of the facts and figures, and is intended to give a detailed impression of the work done.

3. The third part of the report is a statement of the conclusions reached during the year. It is a brief statement of the facts and figures, and is intended to give a general impression of the work done.

4. The fourth part of the report is a statement of the conclusions reached during the year. It is a brief statement of the facts and figures, and is intended to give a general impression of the work done.

5. The fifth part of the report is a statement of the conclusions reached during the year. It is a brief statement of the facts and figures, and is intended to give a general impression of the work done.

6. The sixth part of the report is a statement of the conclusions reached during the year. It is a brief statement of the facts and figures, and is intended to give a general impression of the work done.

7. The seventh part of the report is a statement of the conclusions reached during the year. It is a brief statement of the facts and figures, and is intended to give a general impression of the work done.


8. The eighth part of the report is a statement of the conclusions reached during the year. It is a brief statement of the facts and figures, and is intended to give a general impression of the work done.

9. The ninth part of the report is a statement of the conclusions reached during the year. It is a brief statement of the facts and figures, and is intended to give a general impression of the work done.

10. The tenth part of the report is a statement of the conclusions reached during the year. It is a brief statement of the facts and figures, and is intended to give a general impression of the work done.

11. The eleventh part of the report is a statement of the conclusions reached during the year. It is a brief statement of the facts and figures, and is intended to give a general impression of the work done.

12. The twelfth part of the report is a statement of the conclusions reached during the year. It is a brief statement of the facts and figures, and is intended to give a general impression of the work done.

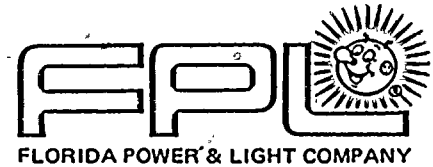


July 16, 1981
L-81-297

Office of Nuclear Reactor Regulation
Attention: Mr. Darrell G. Eisenhut, Director
Division of Licensing
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

Dear Mr. Eisenhut:

Re: Turkey Point Units 3 & 4
Docket No. 50-250 & 50-251
Generic Letter 81-14, Seismic Qualification
of Auxiliary Feedwater Systems

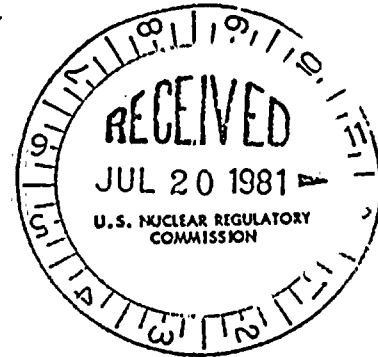

We are presently compiling the information concerning auxiliary feedwater seismic design that was requested in Generic Letter 81-14, dated February 10, 1981. The Turkey Point Units 3 & 4 Auxiliary Feedwater System (AFWS) is a seismically designed system as described in the FSAR and is designed, constructed, and maintained in a manner consistent with other safety grade systems in the plant. Our architect-engineer is in the process of verifying the seismic qualification of each of the AFWS components and supporting systems. A walkdown as requested in your letter will be performed for those portions of the AFWS where sufficient information is not retrievable to verify its seismic qualification. The final AFWS seismic qualification evaluation including the results of any required system walkdown is scheduled to be provided to you by September 15, 1981.

Very truly yours,


Robert E. Uhrig
Vice President
Advanced Systems & Technology

REU/JEM/ras

cc: Mr. J. P. O'Reilly, Region II
Harold F. Reis, Esquire

A048
3
1/0

8107210331 810716
PDR ADDCK 05000250
PDR



REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8107210331. DOC. DATE: 81/07/16 NOTARIZED: NO DOCKET #
 FACIL: 50-250 Turkey Point Plant, Unit 3, Florida Power and Light Co. 05000250
 50-251 Turkey Point Plant, Unit 4, Florida Power and Light Co. 05000251
 AUTH. NAME: UHRIG, R. E. AUTHOR AFFILIATION: Florida Power & Light Co.
 RECIP. NAME: EISENHUT, D. G. RECIPIENT AFFILIATION: Division of Licensing

SUBJECT: Responds to Generic Ltr 81-14 re seismic qualification of auxiliary feedwater sys. Sys is seismically designed per FSAR & constructed & maintained in manner consistent w/ other safety grade sys in plant. Addl info will be provided by 81091.

DISTRIBUTION CODE: A0489 COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1
 TITLE: Equipment Qualification (OR & PRE-OL)


NOTES:

ACTION:	RECIPIENT ID CODE/NAME		COPIES		RECIPIENT ID CODE/NAME		COPIES	
			LTTR	ENCL			LTTR	ENCL
ACTION:	ORB #1 BC	10.	7	7				
INTERNAL:	DIR/DOL	17	1	1	EQUIP QUAL BROS.	5	5	
	I&E	18	3	3	NRC PDR	02	1	1
	OELD	20.	1	1	OGC	21	1	1
	<u>REG. FILE</u>	01.	1	1	WILLIAMS, M. H.	22	1	1
EXTERNAL:	ACRS	23.	16	16	LPDR	03.	1	1
	NSIC	04	1	1	NTIS		1	1

JUL 24 1981

TOTAL NUMBER OF COPIES REQUIRED: LTTR 40 ENCL 0

26

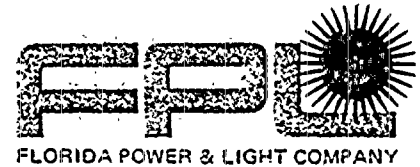


July 16, 1981
L-81-297

Office of Nuclear Reactor Regulation
Attention: Mr. Darrell G. Eisenhut, Director
Division of Licensing
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

Dear Mr. Eisenhut:

Re: Turkey Point Units 3 & 4
Docket No. 50-250 & 50-251
Generic Letter 81-14, Seismic Qualification
of Auxiliary Feedwater Systems

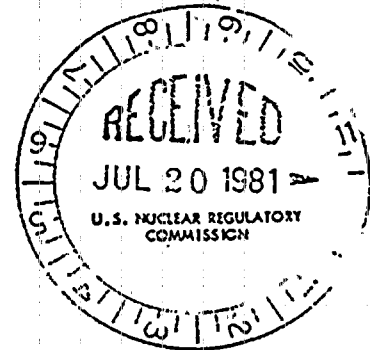

We are presently compiling the information concerning auxiliary feedwater seismic design that was requested in Generic Letter 81-14, dated February 10, 1981. The Turkey Point Units 3 & 4 Auxiliary Feedwater System (AFWS) is a seismically designed system as described in the FSAR and is designed, constructed, and maintained in a manner consistent with other safety grade systems in the plant. Our architect-engineer is in the process of verifying the seismic qualification of each of the AFWS components and supporting systems. A walkdown as requested in your letter will be performed for those portions of the AFWS where sufficient information is not retrievable to verify its seismic qualification. The final AFWS seismic qualification evaluation including the results of any required system walkdown is scheduled to be provided to you by September 15, 1981.

Very truly yours,

Robert E. Uhrig
Vice President
Advanced Systems & Technology

REU/JEM/ras

cc: Mr. J. P. O'Reilly, Region II
Harold F. Reis, Esquire

A048
s
1/0