

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8112160246 DOC. DATE: 81/12/10 NOTARIZED: YES DOCKET #
 FACIL: 50-250 Turkey Point Plant, Unit 3, Florida Power and Light C 05000250
 50-251 Turkey Point Plant, Unit 4, Florida Power and Light C 05000251
 AUTH. NAME AUTHOR AFFILIATION
 UHRIG, R. E. Florida Power & Light Co.
 RECIPIENT NAME RECIPIENT AFFILIATION
 EISENHUT, D. G. Division of Licensing

SUBJECT: Application to amend App A of Tech Specs for Licenses DPR-31
 & DPR-41, allowing operation w/positive moderator temp
 coefficient.


DISTRIBUTION CODE: A001S COPIES RECEIVED: LTR 3 ENCL 40 SIZE: 2+37
 TITLE: General Distribution for after Issuance of Operating License

NOTES: w/check \$4,400

ACTION:	RECIPIENT		COPIES		RECIPIENT	COPIES	
	ID CODE/NAME		LTTR	ENCL		ID CODE/NAME	LTTR
	ORB #1 BC	01	13	13			
INTERNAL:	ELD		1	0	IE	06	2 2
	NRR/DHFS DEPY08		1	1	NRR/DL DIR		1 1
	NRR/DI/ORAB		1	0	NRR/DSI/RAB		1 1
	REG FILE	04	1	1			
EXTERNAL:	ACRS	09	10	10	LPDR	03	1 1
	NRC PDR	02	1	1	NSIC	05	1 1
	NTIS		1	1			

DEC 18 1980

TOTAL NUMBER OF COPIES REQUIRED: LTTR 35 ENCL 33

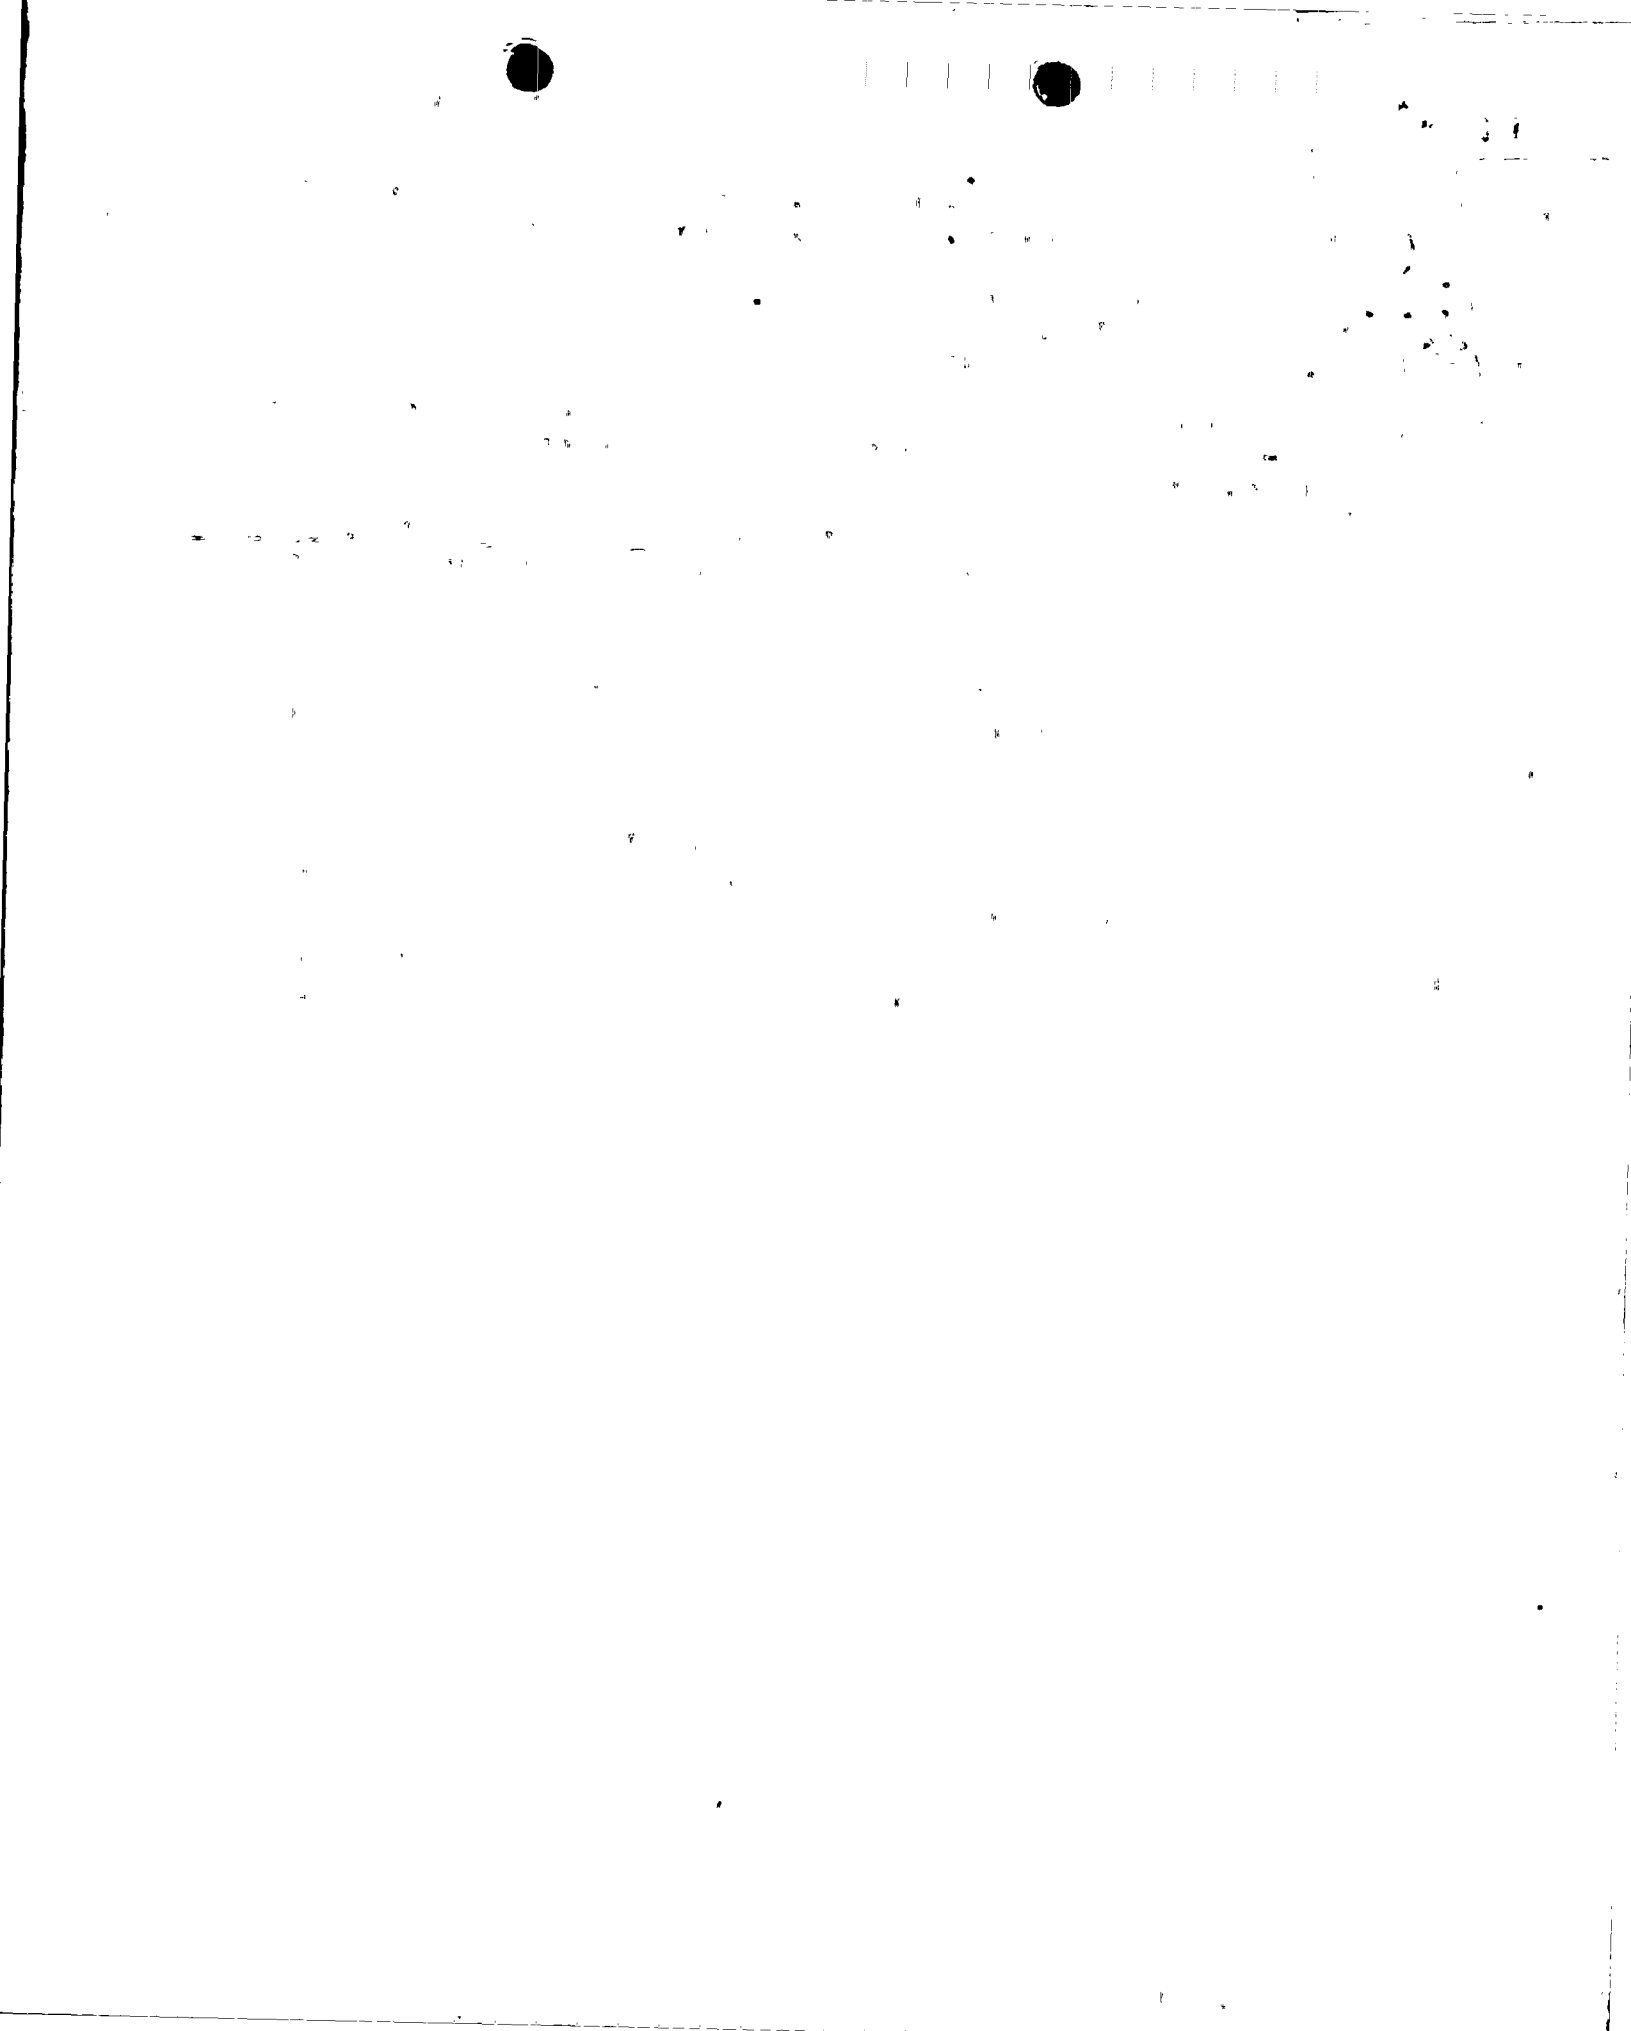



December 10, 1981
L-81-517

Office of Nuclear Reactor Regulation
Attention: Mr. Darrell G. Eisenhut, Director
Division of Licensing
U.S. Nuclear Regulatory Commission
Washington, D. C. 20555



Dear Mr. Eisenhut:

Re: Turkey Point Units 3 & 4
Docket Nos. 50-250 and 50-251
Proposed License Amendment
Moderator Temperature Coefficient

In accordance with 10 CFR 50.90, Florida Power & Light Company submits herewith three signed originals and forty copies of a request to amend Appendix A of Facility Operating Licenses DPR-31 and 41.

This amendment is submitted to allow operation with a positive moderator temperature coefficient. A safety evaluation is attached to support our request.

The proposed amendment is described below and shown on the accompanying Technical Specification pages bearing the date of this letter in the lower right hand corner.


Page 3.1-2

The requirement for the moderator temperature coefficient was changed for power operation less than 70%.

Enclosed please find a check for \$4,400 in accordance with 10 CFR 170.22. It has been determined that this represents a Class I and III amendment.

The proposed amendment has been reviewed and approved by the Turkey Point Plant Nuclear Safety Committee and the Florida Power & Light Company Nuclear Review Board.

Very truly yours,

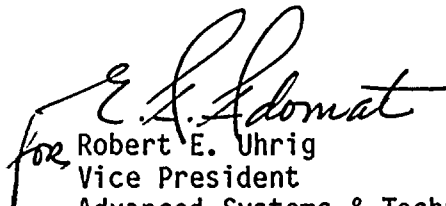for 
Robert E. Uhrig
Vice President
Advanced Systems & Technology

REU/JEM/ras

cc: Mr. J. P. O'Reilly, Region II
Harold F. Reis, Esquire

8112160246 811210
PDR ADDCK 05000250
PDR

Handwritten:
Aool
5/1/80
w/check
\$4,400

STATE OF FLORIDA)
COUNTY OF DADE)

E. A. Adomat , being first duly sworn, deposes and says:

That he is Executive Vice President of Florida Power &
Light Company, the herein;

That he has executed the foregoing document; that the statements made in this said document are true and correct to the best of his knowledge, information, and belief, and that he is authorized to execute the document on behalf of said

E. A. Adomat
E. A. Adomat

Subscribed and sworn to before me this .

10 day of December, 1981

Cheryl L. Fredrick
NOTARY PUBLIC, in and for the County of Dade,
State of Florida

My commission expires: Notary Public, State of Florida at Large
My Commission Expires October 30, 1983
Bonded thru Maynard Bonding Agency

