

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8202180126 DOC. DATE: 82/02/11 NOTARIZED: YES DOCKET #
 FACIL: 50-250 Turkey Point Plant, Unit 3, Florida Power and Light C 05000250
 50-251 Turkey Point Plant, Unit 4, Florida Power and Light C 05000251
 AUTH. NAME AUTHOR AFFILIATION
 UHRIG, R.E. Florida Power & Light Co.
 RECIP. NAME RECIPIENT AFFILIATION
 EISENHUT, D.G. Division of Licensing


SUBJECT: Application to amend Licenses DPR-31 & DPR-41, changing Tech
 Specs 3.14-2, 3.14-3.a & 4.15.3, a.4 re operability
 requirements of fire hose stations in vicinity of
 safety-related equipment.

DISTRIBUTION CODE: A006S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 3+3
 TITLE: Fire Protection Information (After Issuance of OP. Lic.)

NOTES:


ACTION:	RECIPIENT		COPIES		RECIPIENT	COPIES	
	ID CODE/NAME		LTTR	ENCL		ID CODE/NAME	LTTR
ACTION:	ORB #1 BC	01	7	7			
INTERNAL:	ELD		1	0	GC	1	1
	IE	06	2	2	NRR FIORAVANT07	2	2
	NRR WAMBACH	10	1	1	NRR/DE/CFB 08	3	3
	NRR/DL DIR		1	1	REG FILE 04	1	1
EXTERNAL:	ACRS	09	10	10	LPDR	03	1
	NRC PDR	02	1	1	NSIC	05	1
	NTIS		1	1			

TOTAL NUMBER OF COPIES REQUIRED: LTTR 33 ENCL 32

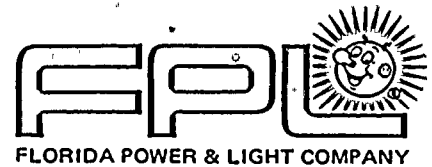

February 11, 1982
L-82-49

Office of Nuclear Reactor Regulation
Attention: Mr. Darrell G. Eisenhut, Director
Division of Licensing
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

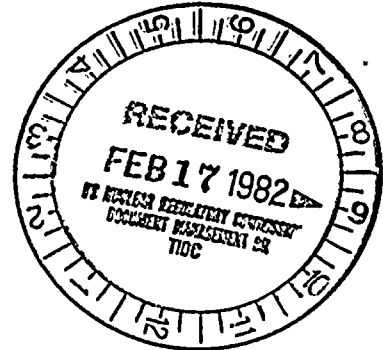

Dear Mr. Eisenhut:

Re: Turkey Point Units 3 & 4
Docket Nos. 50-250 and 50-251
Proposed License Amendment
Fire Hoses

In accordance with 10 CFR 50.30, Florida Power and Light Company submits herewith three signed originals and forty copies of a request to amend Appendix A of Facility Operating Licenses DPR-31 and DPR-41.

The purpose of this amendment is to address operability requirements of fire hose stations in the vicinity of safety related equipment as discussed in our letter to Mr. Varga (L-81-472) dated November 6, 1981. Our letter was in response to Mr. Varga's letter dated September 17, 1981.

The proposed amendment is described below and shown on the accompanying Technical Specification pages bearing the date of this letter in the lower right hand corner.

Page 3.14-2

Technical Specification 3.14.3.a is changed to require hose stations to be operable or for equivalent capacity hoses to be run to the inoperable location within 1 hour of finding an inoperable hose station.


Page 3.14-4

Table 3.14-2 is added to indicate the appropriate hose stations protecting safety related areas.

Page 4.15-2

Technical Specification 4.15.3.a.4 is changed to require testing fire hoses at 150 psi or 50 psi above system pressure (whichever is greater).


A006
S
11



Page 2
Turkey Point Units 3 & 4
Docket Nos. 50-250 and 50-251
Proposed License Amendment
Fire Hoses

The proposed amendment has been reviewed and approved by the Turkey Point Plant Nuclear Safety Committee and the Florida Power & Light Company Nuclear Review Board.


Very truly yours,


for Robert E. Uhrig
Vice President
Advanced Systems & Technology

REU/PLP/jmm

Attachment

cc: J.P. O'Reilly, Region II
Harold F. Reis, Esquire



STATE OF FLORIDA)
)
COUNTY OF DADE) SS.

E. A. Adomat, being first duly sworn, deposes and says:

That he is Executive Vice President of Florida Power & Light Company, the Licensee herein;

That he has executed the foregoing document; that the statements made in this said document are true and correct to the best of his knowledge, information, and belief, and that he is authorized to execute the document on behalf of said

E. A. Adomat
E. A. Adomat

Subscribed and sworn to before me this

11 day of February, 1982

Cheryl L. Fredrick
NOTARY PUBLIC, in and for the County of Dade,
State of Florida

My commission expires:

Notary Public, State of Florida at Large.
My Commission Expires October 30, 1983
Bonded thru Maynard Bonding Agency

