

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR:8205110369 DOC DATE: 82/05/06 NOTARIZED: YES DOCKET #
 FACIL:50-250 Turkey Point Plant, Unit 3, Florida Power and Light C ~~05000250~~
 50-251 Turkey Point Plant, Unit 4, Florida Power and Light C 05000251
 AUTH NAME AUTHOR AFFILIATION
 UHRIG, R.E. Florida Power & Light Co.
 RECIP NAME RECIPIENT AFFILIATION
 EISENHUT, D.G. Division of Licensing


SUBJECT: Application to amend Licenses DPR-31 & DPR-41, changing
 Tech Spec 4.10 requiring individual in communication w/
 control room be stationed at auxiliary feedwater area when
 valves are manually realigned.


DISTRIBUTION CODE: A001S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2+1
 TITLE: General Distribution for after Issuance of Operating License

NOTES:

	RECIPIENT ID CODE/NAME		COPIES		RECIPIENT ID CODE/NAME		COPIES	
			LTTR	ENCL			LTTR	ENCL
	ORB #1 BC	01	7	7				
INTERNAL:	ELD		1	0	NRR/DHFS DEPY08		1	1
	NRR/DL DIR		1	1	NRR/DL/ORAB		1	0
	NRR/DSI/RAB		1	1	REG FILE 04		1	1
	RGN2		1	1				
EXTERNAL:	ACRS	09	10	10	LPDR	03	1	1
	NRC PDR	02	1	1	NSIC	05	1	1
	NTIS		1	1				

TOTAL NUMBER OF COPIES REQUIRED: LTTR 28 ENCL 26

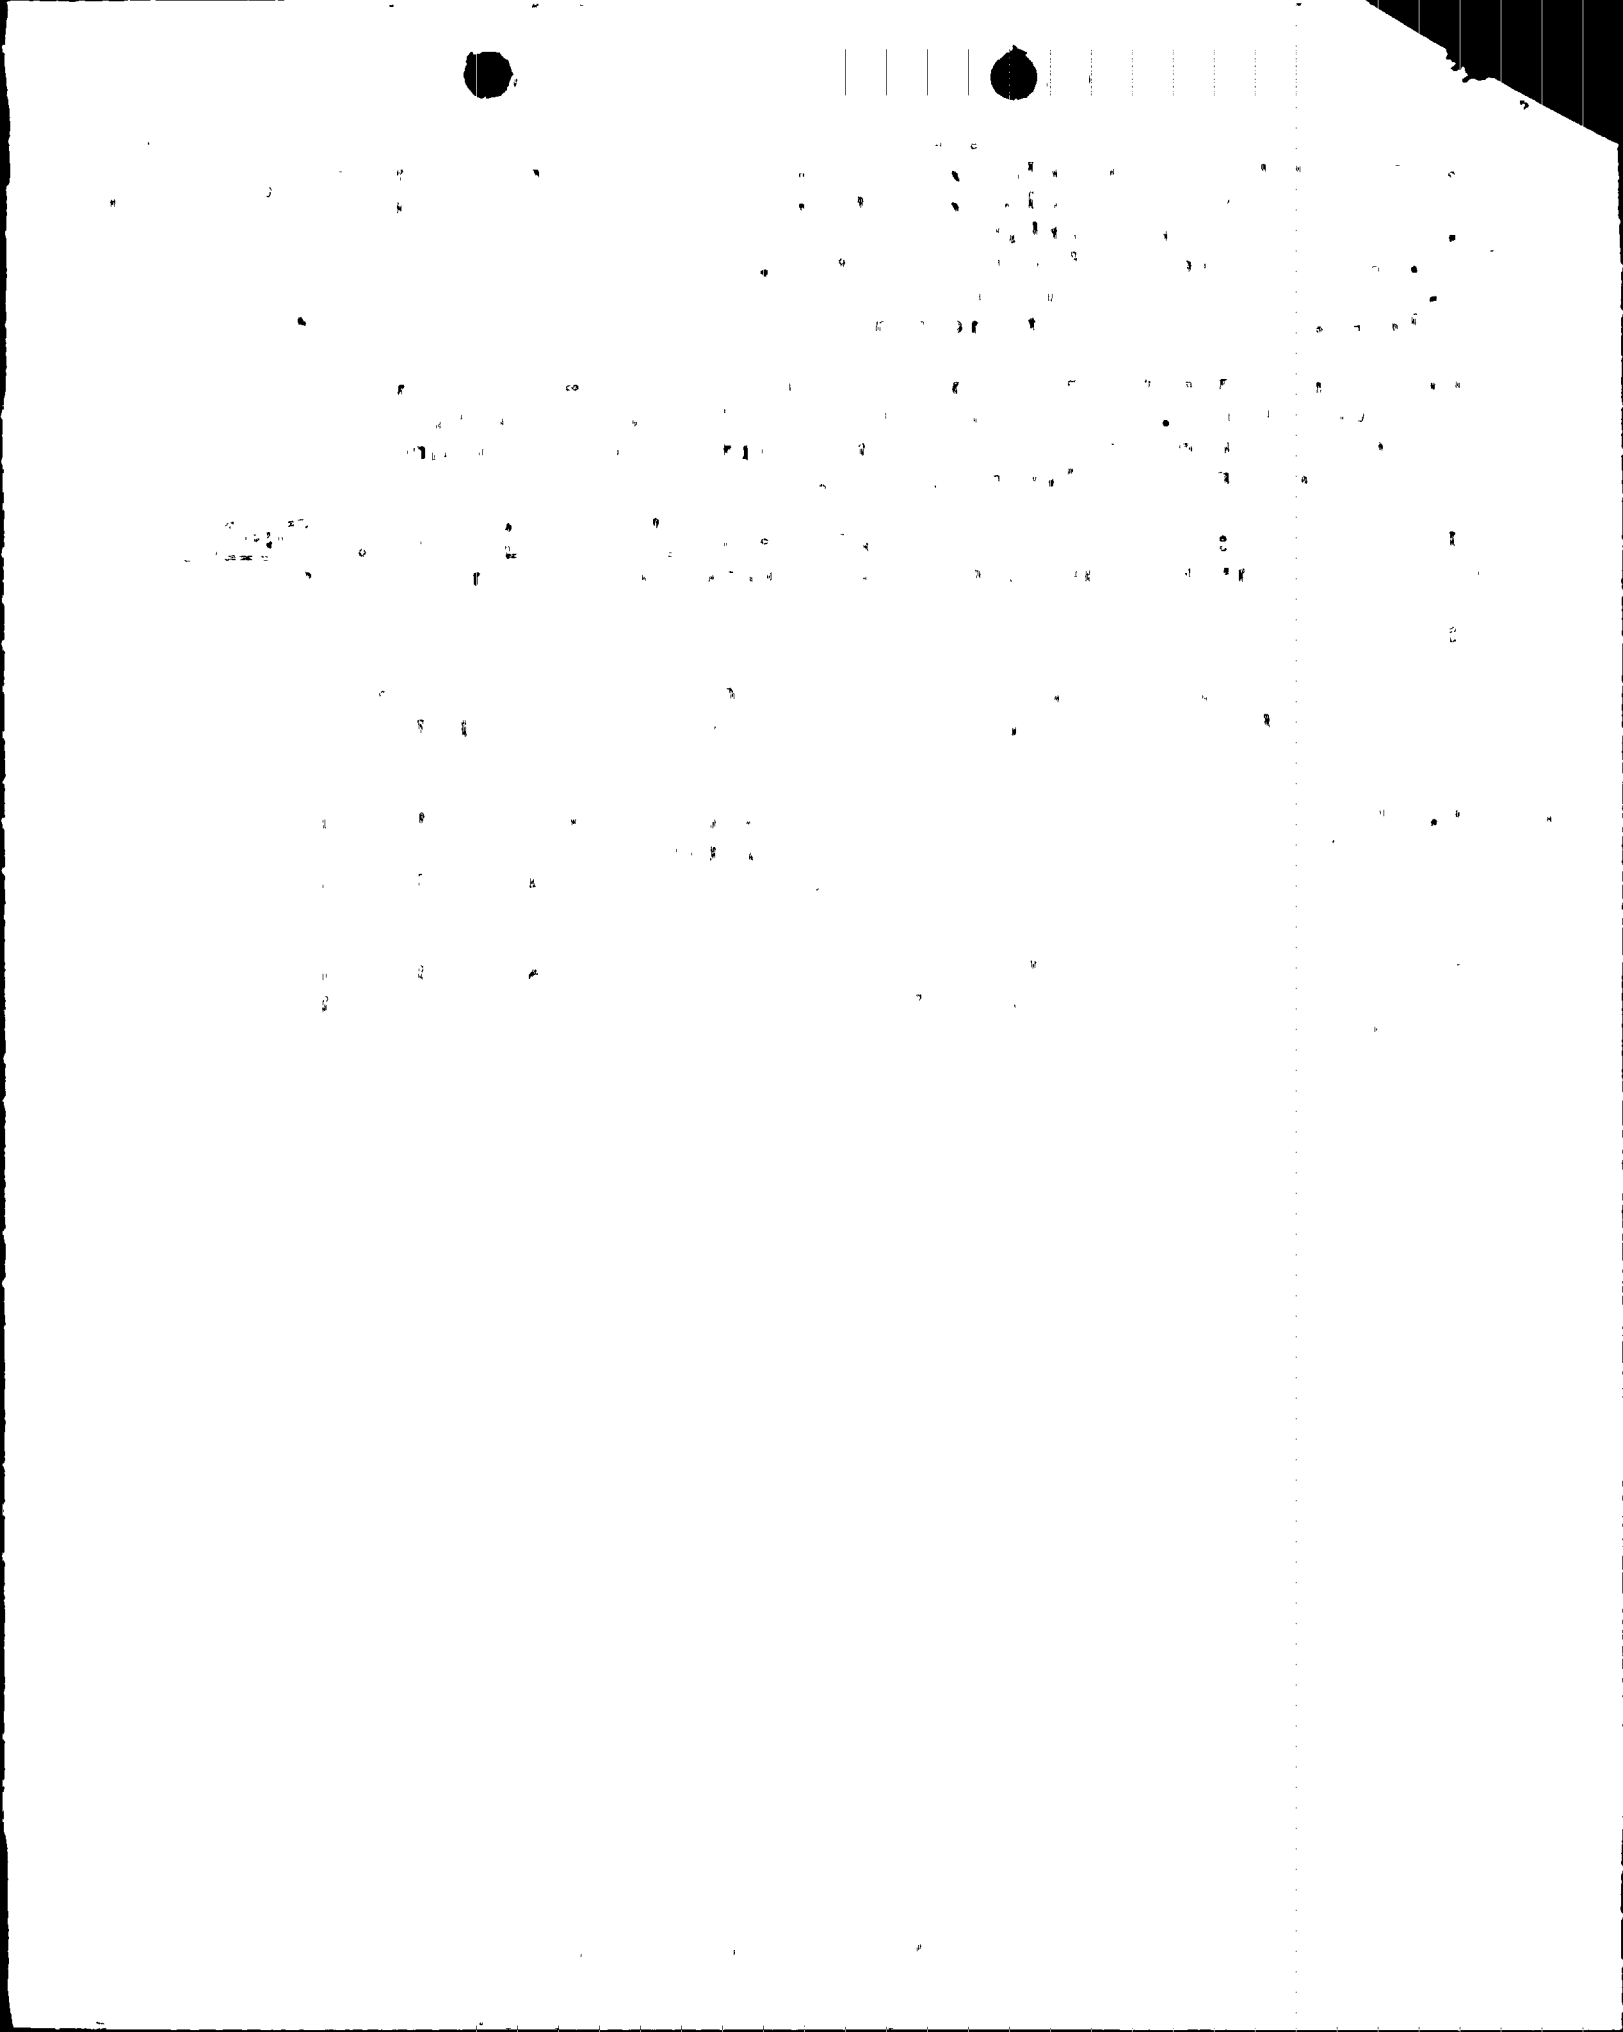

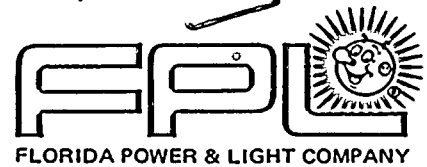


May 6, 1982
L-82-187

Office of Nuclear Reactor Regulation
Attention: Mr. Darrell G. Eisenhut, Director
Division of Licensing
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

Dear Mr. Eisenhut:

Re: Turkey Point Units 3 & 4
Docket No. 50-250 and 50-251
Proposed License Amendment
Auxiliary Feedwater System

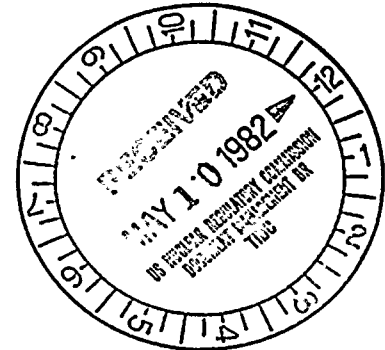

In accordance with 10 CFR 50.30, Florida Power & Light Company submits herewith three signed originals and forty copies of a request to amend Appendix A of Facility Operating Licenses DPR-31 and DPR-41.

This amendment is submitted in response to a NRC letter dated December 24, 1981 which requested that we propose a Technical Specification change to require that a dedicated individual in communication with the control room be stationed at the Auxiliary Feedwater area when valves are manually realigned.

The proposed amendment is described below and shown on the accompanying Technical Specification pages bearing the date of this letter in the lower right hand corner.

Technical Specification 4.10, Page 4.10-1

This specification is changed to add the requirement mentioned above.

The proposed amendment has been reviewed and approved by the Turkey Point Plant Nuclear Safety Committee and the Florida Power & Light Company Nuclear Review Board.

Very truly yours,

Robert E. Uhrig


Robert E. Uhrig
Vice President
Advanced Systems & Technology


*Aool
s
1/1*

REU/PLP/mbd

Attachment

cc: J.P. O'Reilly, Region II
Harold F. Reis, Esquire



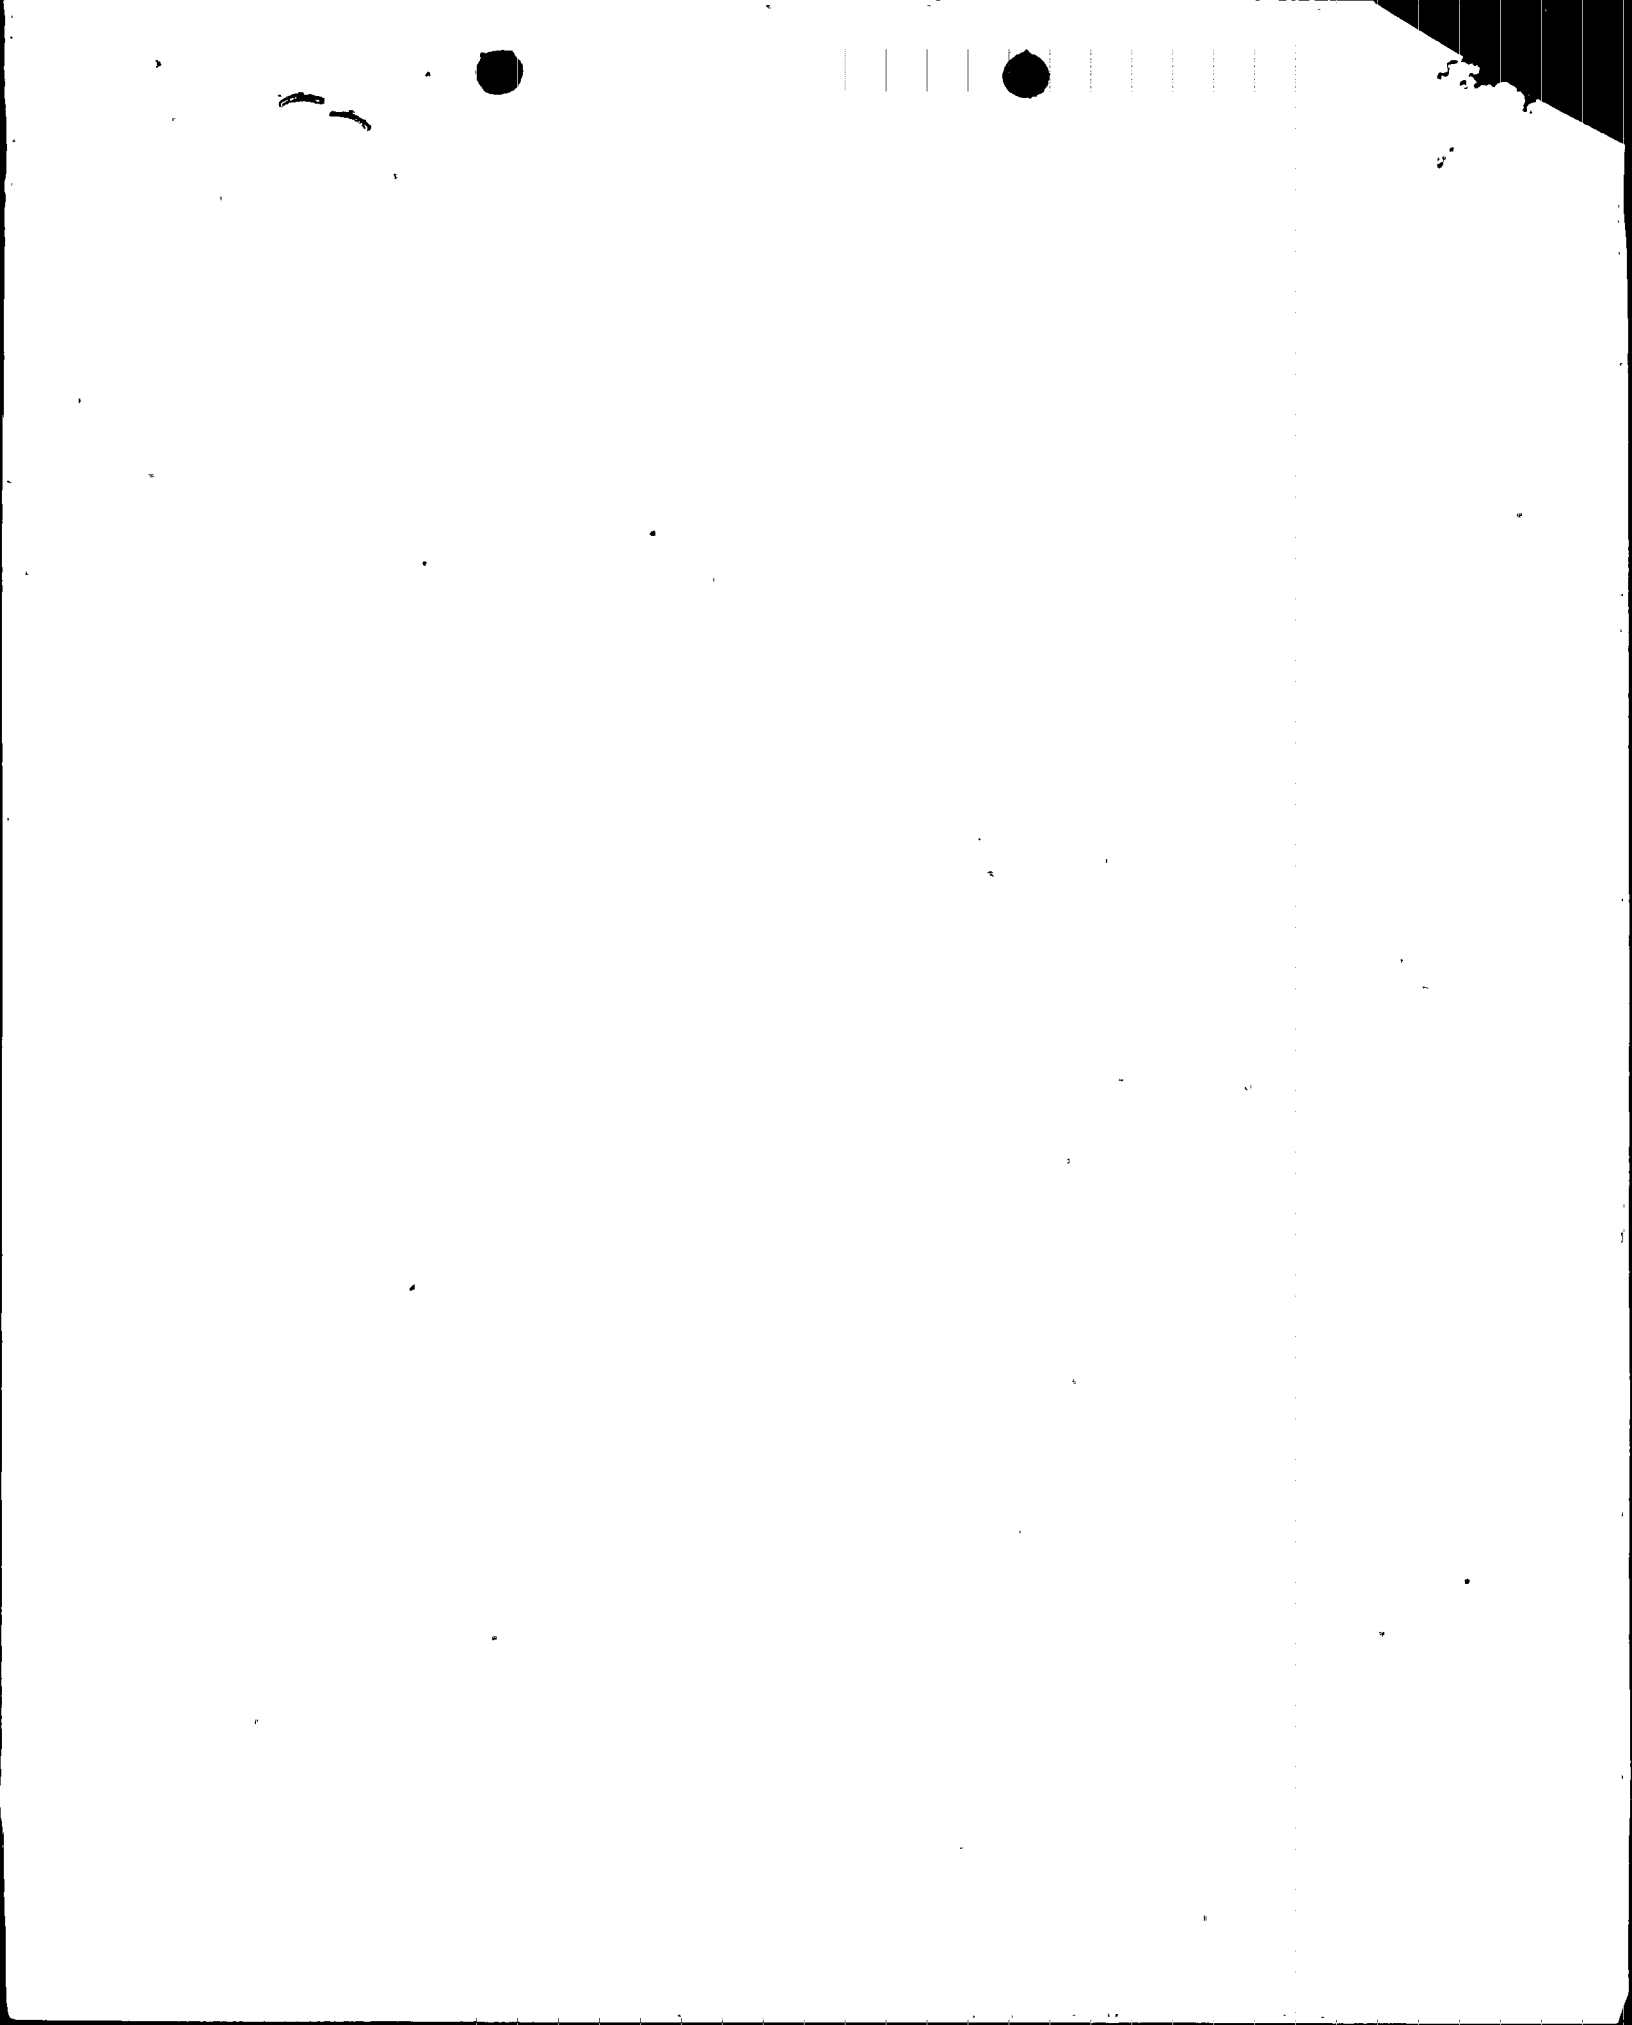


STATE OF FLORIDA)
)
COUNTY OF DADE) ss.

 J. W. Williams , being first duly sworn, deposes and says:


That he is Vice President of Florida Power &
Light Company, the herein;

That he has executed the foregoing document; that the state-
ments made in this said document are true and correct to the
best of his knowledge, information, and belief, and that he is
authorized to execute the document on behalf of said


J. W. Williams

Subscribed and sworn to before me this

 6 day of May , 1982


NOTARY PUBLIC, in and for the County of Dade,
State of Florida

My commission expires:
Notary Public, State of Florida at Large
My Commission Expires October 30, 1983
~~Bonded thru Meynard Bonding Agency~~

