

REGULATORY INFORMATION DISTRIBUTION SYSTEM (GRIDS)

ACCESSION NBR: 8207230237 DOC. DATE: 82/07/16 NOTARIZED: NO DOCKET #
 FACIL: 50-250 Turkey Point Plant, Unit 3, Florida Power and Light C 05000250
 50-251 Turkey Point Plant, Unit 4, Florida Power and Light C 05000251
 AUTH. NAME AUTHOR AFFILIATION
 UHRIG, R. E. Florida Power & Light Co.
 RECIPI. NAME RECIPIENT AFFILIATION
 VARGA, S. A. Operating Reactors Branch 1


SUBJECT: Responds to 820624 ltr requesting clarification of NUREG-0737, Item II.K.3.25, "Loss of AC power to Reactor Coolant Pump Seals." Component cooling water sys exchange is automatically restarted during event.

DISTRIBUTION CODE: A046S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 1
 TITLE: Response to NUREG -0737/NUREG-0660 TMI Action Plan Rgmts (OL's)

NOTES:

RECIPIENT ID CODE/NAME	COPIES LTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTR ENCL
ORB #1 BC 01	7 7		
INTERNAL: ELD/HDS4	1 0	IE/DEP DIR 33	1 1
IE/DEP EPDS	1 1	IE/DEP/EPLB	3 3
NRR/DE DIR 21	1 1	NRR/DE/ADCSE 22	1 1
NRR/DE/ADMGE 23	1 1	NRR/DHFS DIR 28	1 1
NRR/DHFS/DEPY29	1 1	NRR/DL DIR 14	1 1
NRR/DL/ADL 16	1 1	NRR/DL/ADOR 15	1 1
NRR/DL/ADSA 17	1 1	NRR/DL/ORAB 18	3 3
NRR/DSI DIR 24	1 1	NRR/DSI/ADDP25	1 1
NRR/DSI/ADRP 26	1 1	NRR/DSI/ADRS 27	1 1
NRR/DSI/AEB	1 1	NRR/DSI/ETSB	1 1
NRR/DSI/RAB	1 1	NRR/DST DIR 30	1 1
NRR/DST/ADGP 31	1 1	NRR/DST/ADT 32	1 1
REG FILE 04	1 1	RGN2	1 1
EXTERNAL: ACRS 34	10 10	FEMA-REP DIV	1 1
INPO, J. STARNES	1 1	LPDR 03	1 1
NRC PDR 02	1 1	NSIC 05	1 1
NTIS	1 1		

TOTAL NUMBER OF COPIES REQUIRED: LTR 53 ENCL 52

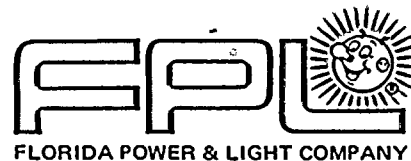

July 16, 1982
L-82-293


Office of Nuclear Reactor Regulation
Attention: Mr. Steven A. Varga, Chief
Operating Reactor Branch #1
Division of Licensing
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

Dear Mr. Varga:

Re: Turkey Point Units 3 & 4
Docket Nos. 50-250 & 50-251
Post-TMI Requirements
NUREG-0737 Item II.K.3.25
Loss of AC Power to Reactor Coolant
Pump Seals

This letter is our response to your letter dated June 24, 1982 which requested clarification of our response to NUREG-0737 Item II.K.3.25 contained in our letter dated January 7, 1982 (L-82-5). The answer to your question is that the component cooling water system which will supply water to the Reactor Coolant Pump thermal barrier heat exchanger is the system which is automatically restored during the loss-of-off-site-power event. We trust that this clarification will aid you in the completion of your review.

Very truly yours,

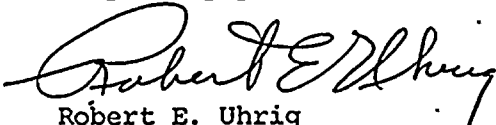
Robert E. Uhrig
Vice President
Advanced Systems & Technology

REU/PKG/pyc

cc: J.P. O'Reilly, Region II
Harold F. Reis, Esquire

A046

8207230237 820716
PDR ADDCK 05000250
P PDR