

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR:8211150134 DOC.DATE: 82/11/10 NOTARIZED: NO DOCKET #
 FACIL:50-250 Turkey Point Plant, Unit 3, Florida Power and Light C 05000250
 50-251 Turkey Point Plant, Unit 4, Florida Power and Light C 05000251
 AUTH.NAME AUTHOR AFFILIATION
 UHRIG,R.E. Florida Power & Light Co.
 RECIP.NAME RECIPIENT AFFILIATION
 VARGA,S.A. Operating Reactors Branch 1

SUBJECT: Responds to NRC 821015 ltr requesting addl info re 780809
 application to amend Tech Specs to add valves 863A & 863B to
 ECCS valve list. Change will facilitate surveillance & maint
 of valves.

DISTRIBUTION CODE: A001S COPIES RECEIVED:LTR __1 ENCL 1 SIZE:___2____
 TITLE: OR Submittal: General Distribution

NOTES:

	RECIPIENT ID CODE/NAME		COPIES LTTR ENCL		RECIPIENT ID CODE/NAME		COPIES LTTR ENCL
	NRR ORB1 BC 01		7 7				
INTERNAL:	ELD/HDS4		1 0		NRR/DL DIR		1 1
	NRR/DL/ORAB		1 0		NRR/DSI/RAB		1 1
	<u>REG FILE</u> 04		1 1		RGN2		1 1
EXTERNAL:	ACRS 09		6 6		LPDR 03		1 1
	NRC PDR 02		1 1		NSIC 05		1 1
	NTIS		1 1				


ACQUISITION: MONITORING SYSTEMS
 FACILITY: 20-200 JAMES H. HARRIS, JR. & SONS, INC.
 20-201 JAMES H. HARRIS, JR. & SONS, INC.
 20-202 JAMES H. HARRIS, JR. & SONS, INC.
 20-203 JAMES H. HARRIS, JR. & SONS, INC.
 20-204 JAMES H. HARRIS, JR. & SONS, INC.
 20-205 JAMES H. HARRIS, JR. & SONS, INC.
 20-206 JAMES H. HARRIS, JR. & SONS, INC.
 20-207 JAMES H. HARRIS, JR. & SONS, INC.
 20-208 JAMES H. HARRIS, JR. & SONS, INC.
 20-209 JAMES H. HARRIS, JR. & SONS, INC.
 20-210 JAMES H. HARRIS, JR. & SONS, INC.

SUBJECT: Response to the request for information and data re 20-200
 20-201 to 20-210. The information is being furnished to you for your information and for your use in the future.

DISTRIBUTION: 100% (100% of the information is being furnished to you for your information and for your use in the future.)

DATE:

EXTERNAL: 20-200	INTERNAL: 20-200	EXTERNAL: 20-201	INTERNAL: 20-201	EXTERNAL: 20-202	INTERNAL: 20-202	EXTERNAL: 20-203	INTERNAL: 20-203	EXTERNAL: 20-204	INTERNAL: 20-204	EXTERNAL: 20-205	INTERNAL: 20-205	EXTERNAL: 20-206	INTERNAL: 20-206	EXTERNAL: 20-207	INTERNAL: 20-207	EXTERNAL: 20-208	INTERNAL: 20-208	EXTERNAL: 20-209	INTERNAL: 20-209	EXTERNAL: 20-210	INTERNAL: 20-210
1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1



November 10, 1982
L-82-495

Office of Nuclear Reactor Regulation
Attention: Mr. S. A. Varga, Chief
Operating Reactors Branch #1
Division of Operating Reactors
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

Dear Mr. Varga:

Re: Turkey Point Units 3 & 4
Docket Nos. 50-250 and 50-251
ECCS Single Failure Review

Florida Power & Light has reviewed your letter dated October 13, 1982, which requested confirmation of information which had been provided in telephone conferences with your staff.


The subject of the conferences was our application dated August 9, 1978 to amend the Turkey Point Units 3 & 4 Technical Specifications. The change would add valves 863A and 863B to the list of ECCS valves which have power removed from their motor operators by locking open the circuit breakers at the motor control center. This change will facilitate surveillance and maintenance of these valves.

In response to your request, we confirm the following:

1. The relevant motor control centers (B&C) are two flights of stairs below the control room and inside the auxiliary building. The breakers are in an accessible location.
2. Transit from the control room to the motor control centers would require no more than two minutes. The operators are not likely to encounter any obstacles or any radiation environments.
3. Communication with the control room is possible through regular phones, a paging system, hand held transmitters, and a "PAX" phone system. The noise level is not an impediment to communication.
4. Battery powered emergency lighting is available in and on the way to the MCC's.

8211150134 821110
PDR ADDCK 05000250
PDR

Acc

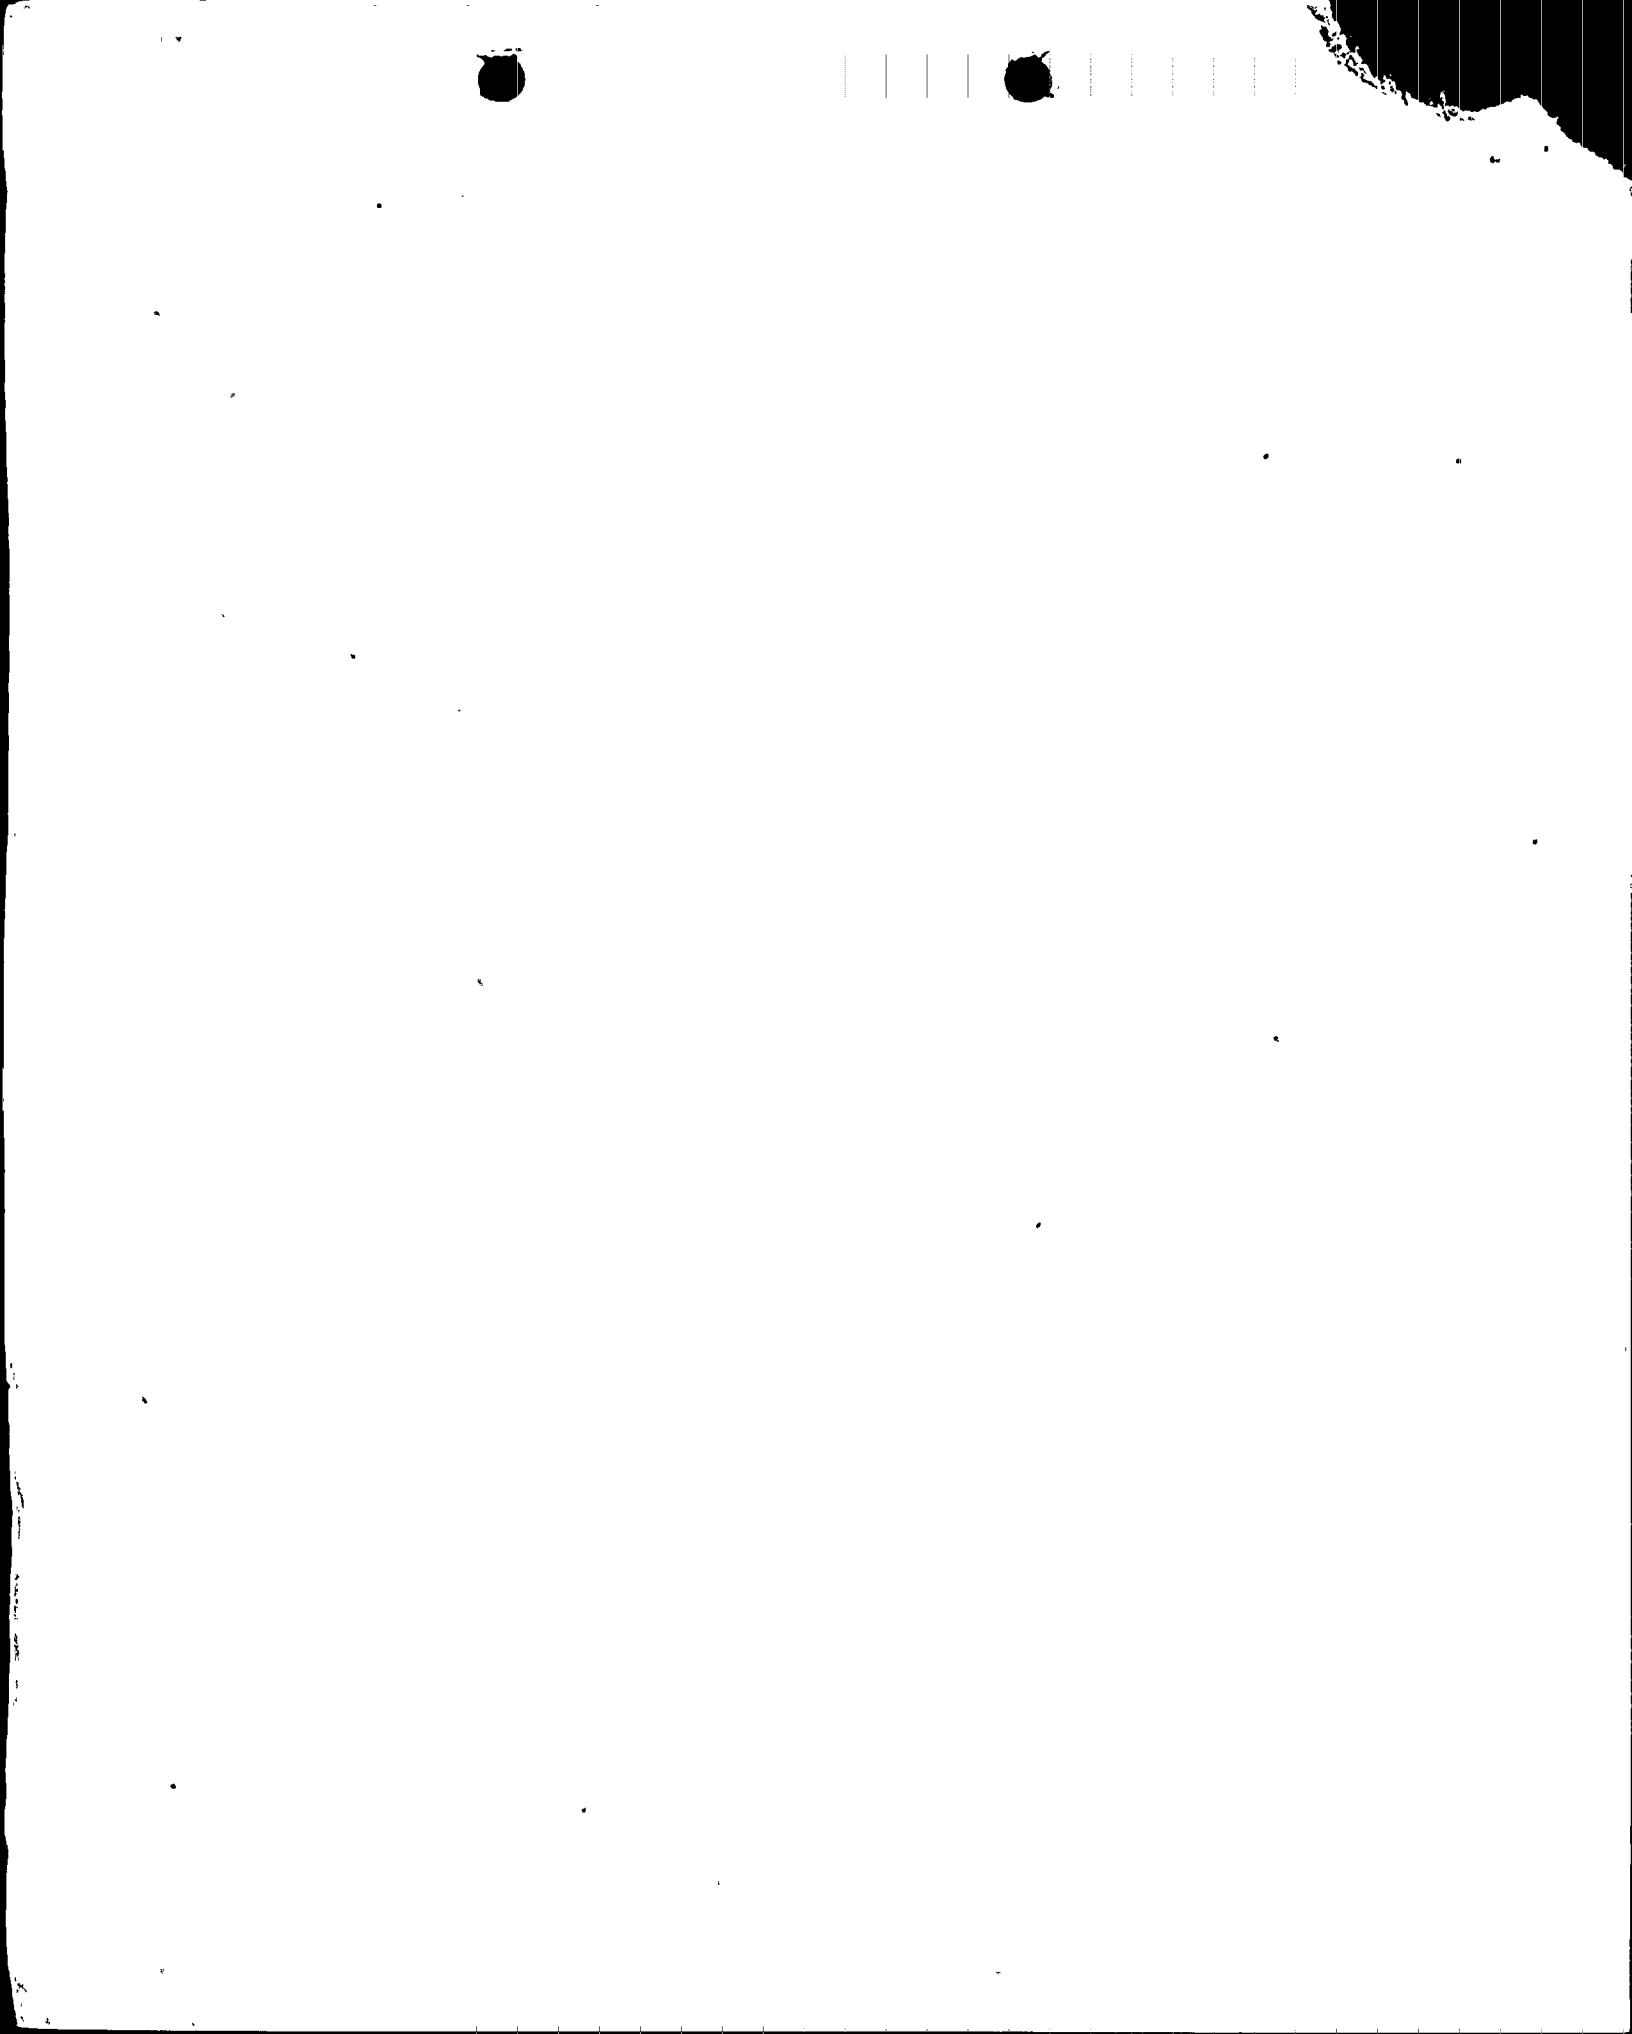

Office of Nuclear Reactor Regulation

Page 2

Should you or your staff have any additional questions on this subject, please contact us.

Very truly yours,

A handwritten signature in cursive script, appearing to read "R. E. Uhrig".

Robert E. Uhrig
Vice President
Advanced Systems & Technology

REU/PLP/js

cc: Mr. J. P. O'Reilly, Region II
Harold F. Reis, Esquire

