

# REGULATOR INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8510210046 DOC. DATE: 85/10/16 NOTARIZED: NO DOCKET #  
 FACIL: 50-250 Turkey Point Plant, Unit 3, Florida Power and Light C 05000250  
 AUTH. NAME: AUTHOR AFFILIATION  
 WILLIAMS, J.W. Florida Power & Light Co.  
 RECIP. NAME: RECIPIENT AFFILIATION  
 DENTON, H.R. Office of Nuclear Reactor Regulation, Director


SUBJECT: Forwards "1985 Inservice Insp Summary Rept for Turkey Point Nuclear Power Plant Unit 3," per ASME Code. Owner data rept of repairs or replacement & data rept for eddy current exam results included.


DISTRIBUTION CODE: A0470 COPIES RECEIVED: LTR 1 ENCL 3 ON SHEET 1+150  
 TITLE: OR Submittal: Inservice Inspection/Testing

NOTES: OL: 07/19/72 05000250

| RECIPIENT |             |    | COPIES |      | RECIPIENT    |           |      | COPIES |  |
|-----------|-------------|----|--------|------|--------------|-----------|------|--------|--|
| ID        | CODE/NAME   |    | LTTR   | ENCL | ID           | CODE/NAME | LTTR | ENCL   |  |
| NRR       | ORB1 BC     | 01 | 7      | 2    |              |           |      |        |  |
| INTERNAL: | ACRS        | 16 | 10     | 4    | ADM/LFMB     |           | 1    | 0      |  |
|           | ELD/HDS4    |    | 1      | 1    | NRR/DE/MEB   | 15        | 1    | 1      |  |
|           | NRR/DE/MTTB | 14 | 1      | 1    | NRR/DL/TAPMG |           | 1    | 1      |  |
|           | REG. FILE   | 04 | 1      | 1    | RGN2         |           | 1    | 1      |  |
| EXTERNAL: | 24X         |    | 1      | 1    | LPDR         | 03        | 1    | 1      |  |
|           | NRC PDR     | 02 | 1      | 1    | NSIC         | 05        | 1    | 1      |  |

TOTAL NUMBER OF COPIES REQUIRED: LTTR 28 ENCL 5

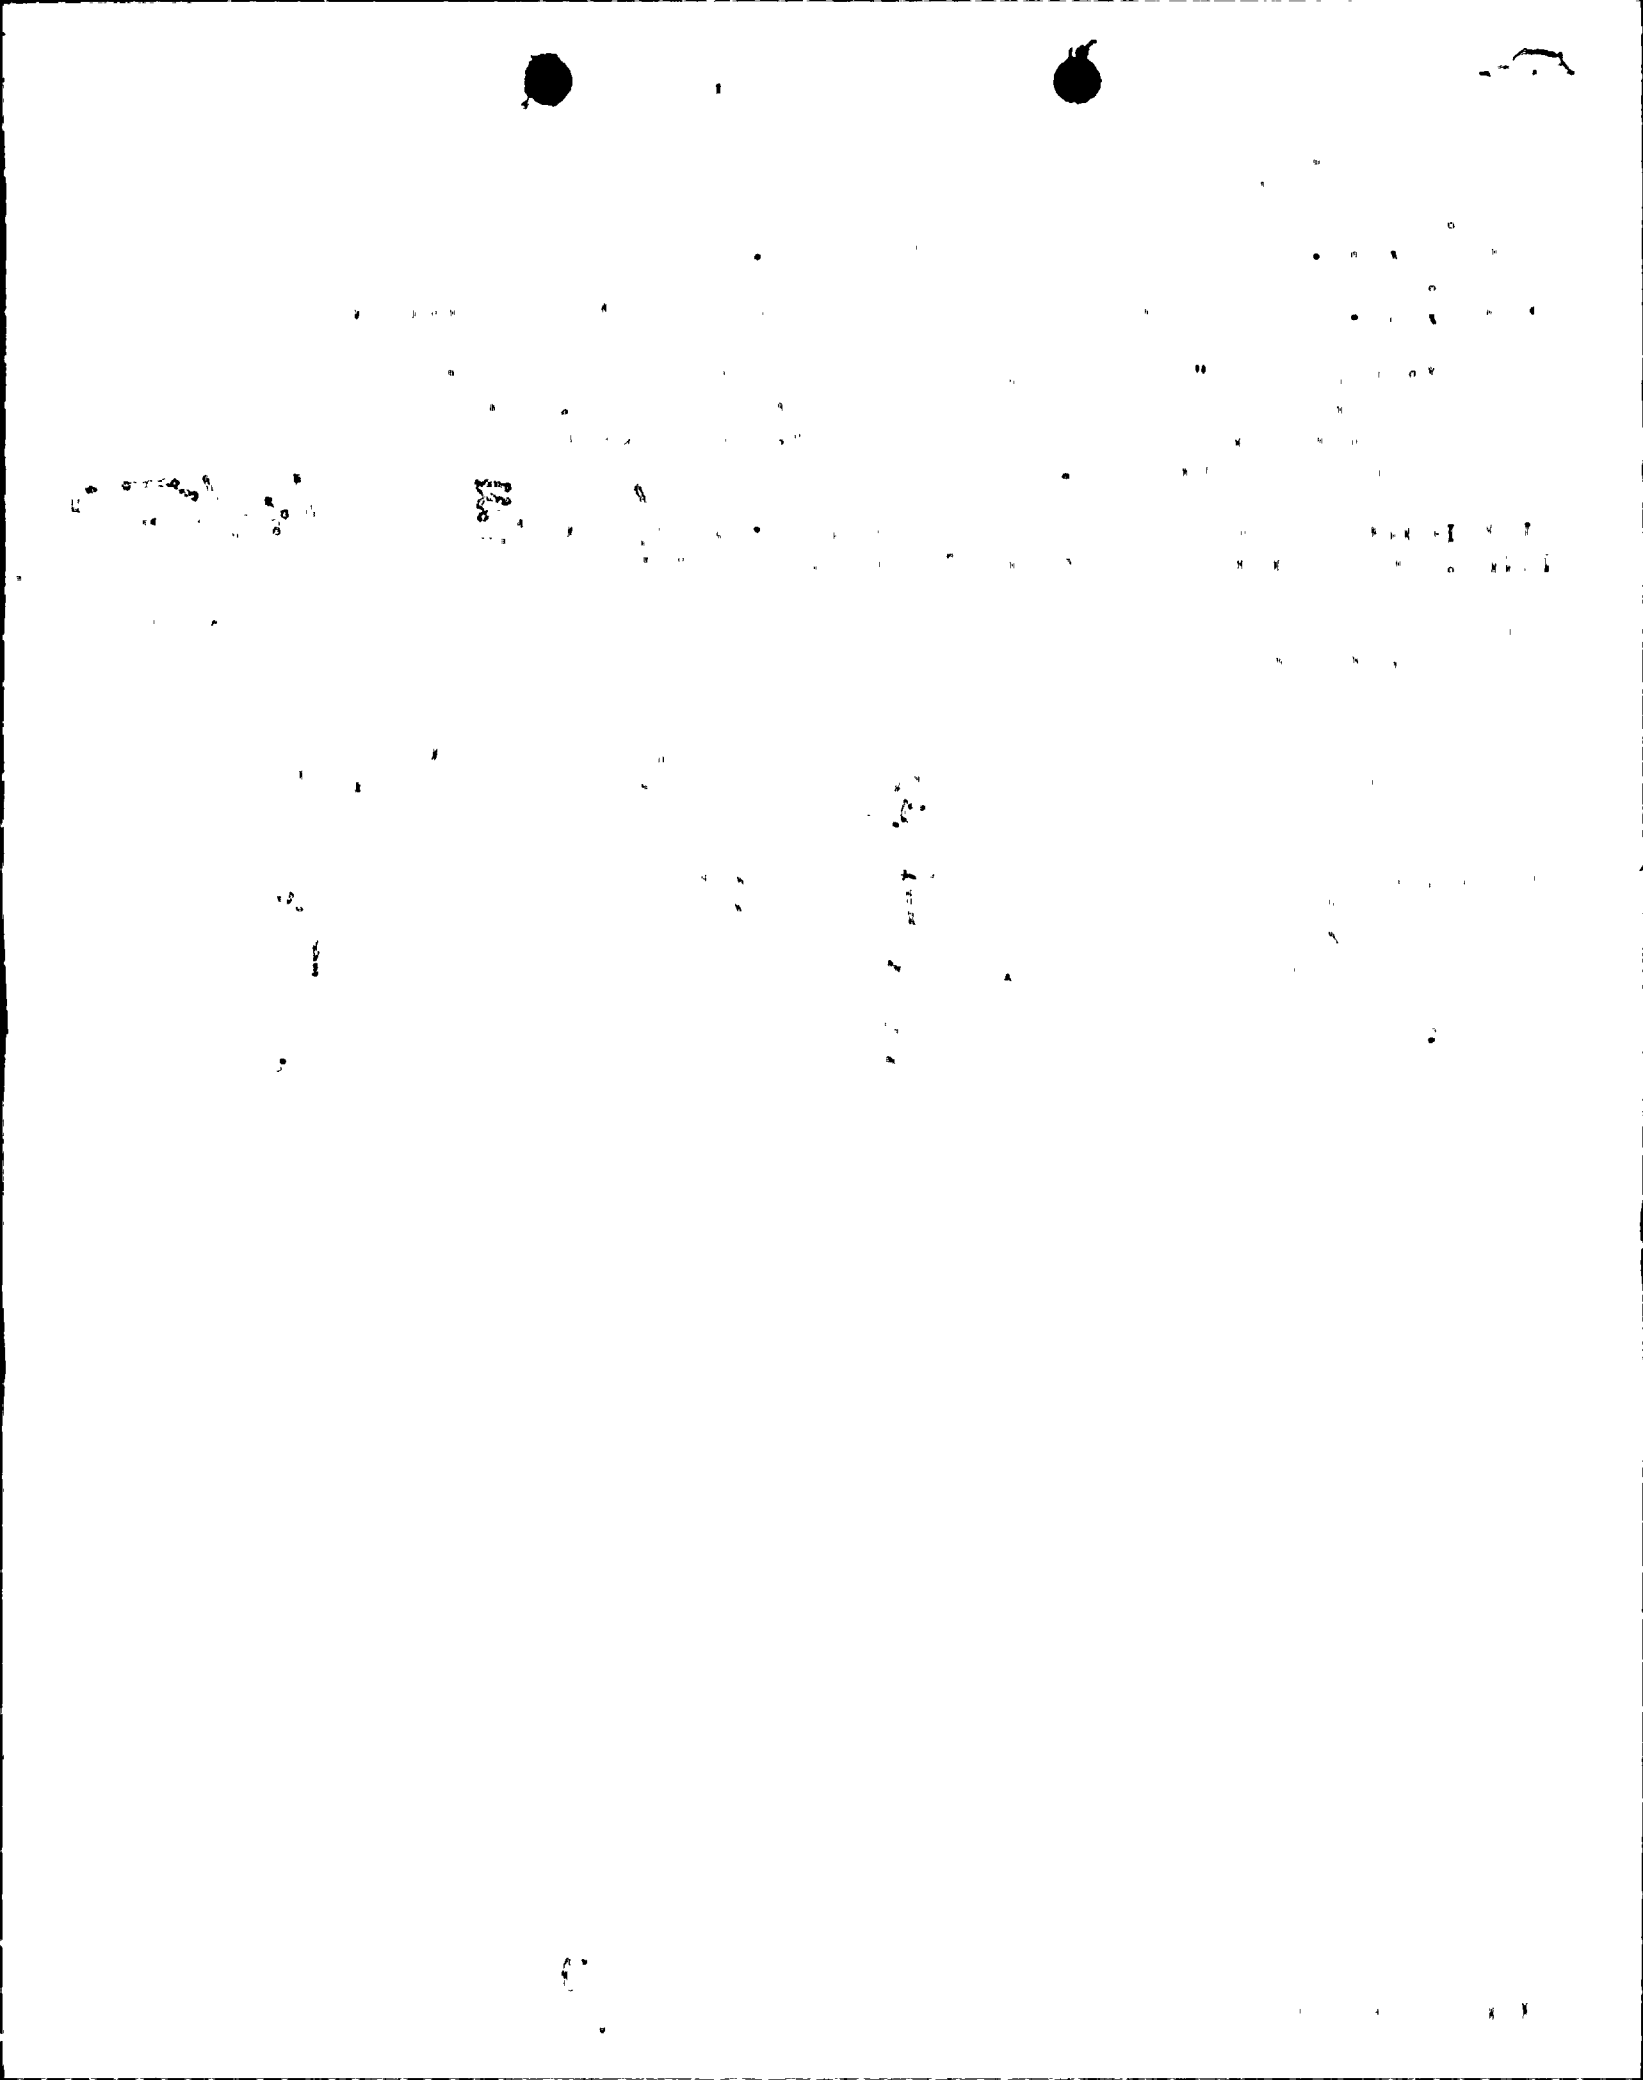

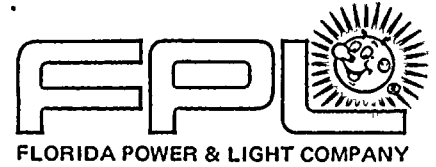

OCT 1 6 1985

L-85-389

Mr. Harold R. Denton, Director  
Office of Nuclear Reactor Regulation  
U.S. Nuclear Regulatory Commission  
Washington, D. C. 20555


Dear Mr. Denton:

Re: Turkey Point Unit 3  
Docket No. 50-250  
Inservice Inspection Report

Please find attached the Owner's Data Report for Inservice Inspection (Form NIS-1) which is submitted in accordance with the provisions of the ASME Code for Turkey Point Unit 3. Included as part of the report are the Owner's Data Report of Repairs or Replacement (Form NIS-2) and the Owner's Data Report for Eddy Current Examination Results (Form NIS-BB).

Should you or your staff have any questions concerning this report, please contact us.


Very truly yours,

  
J. W. Williams, Jr.  
Group Vice President  
Nuclear Energy

JWW/PLP:dh

Attachment

cc: Dr. J. Nelson Grace, Region II, USNRC  
Harold F. Reis, Esquire



A047  
1/3

