

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8602040335 DOC. DATE: 86/01/30 NOTARIZED: YES DOCKET #
 FACIL: 50-250 Turkey Point Plant, Unit 3, Florida Power and Light Co. 05000250
 50-251 Turkey Point Plant, Unit 4, Florida Power and Light Co. 05000251
 AUTH. NAME AUTHOR AFFILIATION
 WOODY, C. O. Florida Power & Light Co.
 RECIP. NAME RECIPIENT AFFILIATION
 THOMPSON, H. L. Division of Pressurized Water Reactor Licensing - A (post B)

SUBJECT: Application for amends to Licenses DPR-31 & DPR-41, changing
 Tech Specs to provide administrative control of
 nonsafety-grade standby feedwater sys to ensure availability
 during plant operation. Fee paid.


DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 3 ENCL 40 SIZE: 5+8
 TITLE: OR Submittal: General Distribution

NOTES: 05000250
 OL: 07/19/72
 05000251
 OL: 04/14/73

RECIPIENT ID CODE/NAME	COPIES		RECIPIENT ID CODE/NAME	COPIES	
	LTTR	ENCL		LTTR	ENCL
PWR-A ADTS	1	0	PWR-A PD2 PD 01	5	5
PWR-A EB	1	1	PWR-A EICSB	1	1
PWR-A FOB	1	1	McDONALD, D	1	1
PWR-A PSB	1	1	PWR-A RSB	1	1

INTERNAL: ACRS	09	6	6	ADM/LFMB	1	0
ELD/HDS4		1	0	NRR/DHFT/TSCB	1	1
NRR/DSRS/RRAB		1	1	NRR/ORAS	1	0
REG FILE	04	1	1	REN2	1	1
EXTERNAL: 24X		1	1	EG&G BRUSKE, S	1	1
LPDR	03	1	1	NRC PDR	02	1
NSIC	05	1	1			

REC'D w/ check \$ 150.00
 #0353

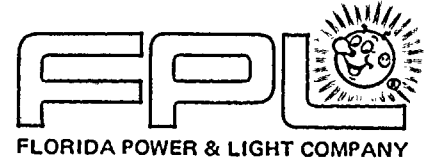

JAN 30 1986
L-86-43

Office of Nuclear Reactor Regulation
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

Attention: Mr. Hugh L. Thompson, Director
Division of Pressurized Water Reactor Licensing - A

Dear Mr. Thompson:

Reference: Turkey Point Units 3 and 4
Docket Nos. 50-250 and 50-251
Proposed License Amendment
STANDBY FEEDWATER SYSTEM

In accordance with 10 CFR 50.90, Florida Power and Light Company submits herewith three signed originals and forty copies of a request to amend Appendix A of Facility Operating License DPR-31 and 41.

The proposed Technical Specifications provide administrative control of the non-safety grade STANDBY FEEDWATER SYSTEM to ensure its availability during plant operation. This system is not relied upon to provide required plant protection to mitigate the consequences of a postulated design basis accident but is capable of supplying backup feedwater during certain non-design basis, low probability events.

The proposed amendment is described below and is shown on the accompanying Technical Specification pages:

Pages ii, iii, iv.

The Table of Contents is revised to include provisions for the STANDBY FEEDWATER SYSTEM.

Page 3.20-1

The Limiting Condition for Operation for the STANDBY FEEDWATER SYSTEM is added as Specification 3. 20. In addition to a SPECIAL REPORT, in a condition where both pumps are unavailable for longer than 24 hours, the NRC shall be notified. This notification will be included in our procedures as a VOLUNTARY 4 hour notification to be made via ENS to NRCOC.

Page 4.21-1

The surveillance requirements are added for the STANDBY FEEDWATER SYSTEM as Specification 4. 21.

Page 6.23

The special report requirements for limiting conditions of operation for Technical Specification 3.20.

Page B3.20-1

The Bases for the Limiting Condition for Operation of the STANDBY FEEDWATER SYSTEM are added.

8602040335 860130
PDR ADDCK 05000250
P PDR

Rec'd w/checked \$150.00
#0353

PEOPLE...SERVING PEOPLE

Acc'd
3/4/86

THE UNIVERSITY OF CHICAGO

PHYSICS DEPARTMENT

1962-1963

Mr. Hugh L. Thompson, Director
Page 2

Page B 4.21 - 1

The Bases for Surveillance Requirements of the STANDBY FEEDWATER SYSTEM are added.

A safety evaluation of this proposed change is provided as Attachment 1.


In accordance with 10 CFR 50.91(a)(1), we have determined that this amendment does not involve any significant hazards considerations pursuant to 10 CFR 50.91(c). A discussion of our evaluation is provided in Attachment 2.

In accordance with 10 CFR 50.91(b)(1), a copy of the proposed amendment is being forwarded to the State Designee for the State of Florida.

In accordance with 10 CFR 170.12(c), a check for \$150.00 is attached.

The proposed amendment has been reviewed by the Turkey Point Plant Nuclear Safety Committee and the Florida Power and Light Company Nuclear Review Board.

Very truly yours,



C. O. Woody
Group Vice President
Nuclear Energy

COW/JA/dh

Attachment

cc: Dr. J. Nelson Grace, USNRC, Region II
Harold R. Reis, Esquire

Mr. Allan Schubert, Manager
Public Health Physicist and Rehabilitative Services
Department of Health and Rehabilitative Services
1323 Winewood Boulevard
Tallahassee, FL 32301

STATE OF FLORIDA)
)
COUNTY OF DADE) ss.

J. W. Williams, Jr. being first duly sworn, deposes and says:


That he is a Group Vice President of Florida Power & Light Company, the Licensee herein;

That he has executed the foregoing document; that the statements made in this document are true and correct to the best of his knowledge, information, and belief, and that he is authorized to execute the document on behalf of said Licensee.



J. W. Williams, Jr.


Subscribed and sworn to before me this
31 day of January, 1986.



NOTARY PUBLIC, in and for the County
of Dade, State of Florida

My Commission expires: Notary Public, State of Florida
My Commission Expires April 26, 1986
Bonded Thru Troy Fain - Insurance, Inc.



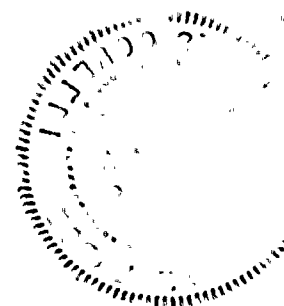

ATTACHMENT I

Re: Turkey Point Units 3 and 4
Docket Nos. 50-250, 50-251
Proposed License Amendment
Standby Feedwater System Evaluation

The proposed Technical Specification provides administrative control of the standby feedwater system to ensure its availability during plant operation. This system is not relied upon to provide required plant protection to mitigate the consequences of a postulated design basis accident but is capable of supplying backup feedwater during certain non-design basis, low probability events.

There is no automatic actuation of this system. All control (pump start and stop and flow path alignment) is accomplished via manual operator action.

The proposed Technical Specification adds administrative controls and reporting requirements based on availability of STANDBY FEEDWATER SYSTEM main components.

This change does not increase the probability of or the consequences of a previously analyzed accident. It does not involve the possibility of a new accident nor does it decrease the margin of safety.

ATTACHMENT 2

Re: Turkey Point Units 3 and 4
Docket Nos. 50-250, 50-251
Proposed License Amendment
Standby Feedwater System

No Significant Hazards Determination.

The proposed changes to the Technical Specifications provide limiting conditions for operation and surveillance requirements for the standby feedwater system. The addition of these requirements would be a change that constitutes an additional limitation, restriction or control not presently included in the technical specifications. For this reason this change would be similar to example ii of the examples of amendments that are considered not likely to involve significant hazards considerations.

