

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)


ACCESSION NBR: 8303240357 DOC. DATE: 83/03/18 NOTARIZED: NO DOCKET #
 FACIL: 50-250 Turkey Point Plant, Unit 3, Florida Power and Light C 05000250
 50-251 Turkey Point Plant, Unit 4, Florida Power and Light C 05000251
 AUTH. NAME AUTHOR AFFILIATION
 UHRIG, R.E. Florida Power & Light Co.
 RECIP. NAME RECIPIENT AFFILIATION
 VARGA, S.H. Operating Reactors Branch 1

SUBJECT: Forwards corrected P3 to 830315 submittal re "Control of Heavy Loads," technical evaluation rept.

DISTRIBUTION CODE: A033S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2
 TITLE: OR Submittal: USI A-36 Control of Heavy Load Near Spent Fuel-NUREG-06

NOTES:

	RECIPIENT ID CODE/NAME		COPIES		RECIPIENT ID CODE/NAME		COPIES	
			LTTR	ENCL			LTTR	ENCL
	NRR ORB1 BC		7	7	NRR CLEMENSON01		4	4
INTERNAL:	NRR REQUA, G 09		1	1	NRR/DL/ORAB 12		1	1
	NRR/DSI/AEB		1	1	<u>REG FILE</u> 04		1	1
	RGN2		1	1				
EXTERNAL:	ACRS 13		6	6	LPDR 03		1	1
	NRC PDR 02		1	1	NSIC 06		1	1
	NTIS		1	1				

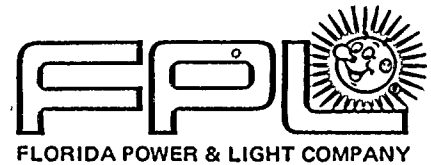

March 18, 1983
L-83-155

Office of Nuclear Reactor Regulation
Attention: Mr. Steven A. Varga, Chief
Operating Reactors Branch #1
Division of Licensing
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

Dear Mr. Varga:

Re: Turkey Point Units 3 & 4
Docket Nos. 50-250 & 50-251
Control of Heavy Loads
Technical Evaluation Report

Attached is a corrected copy of page 3 to our March 15, 1983 (L-83-146)
Heavy Loads submittal. Please replace that corrected page.

Very truly yours,

A handwritten signature in cursive script, appearing to read "Jack E. Versly for".

Robert E. Uhrig
Vice President
Advanced Systems & Technology


REU/SAV/cab

Attachment

cc: J. P. O'Reilly, Region II
Harold F. Reis, Esquire

A033

8303240357 830318
PDR ADUCK 05000250
P PDR

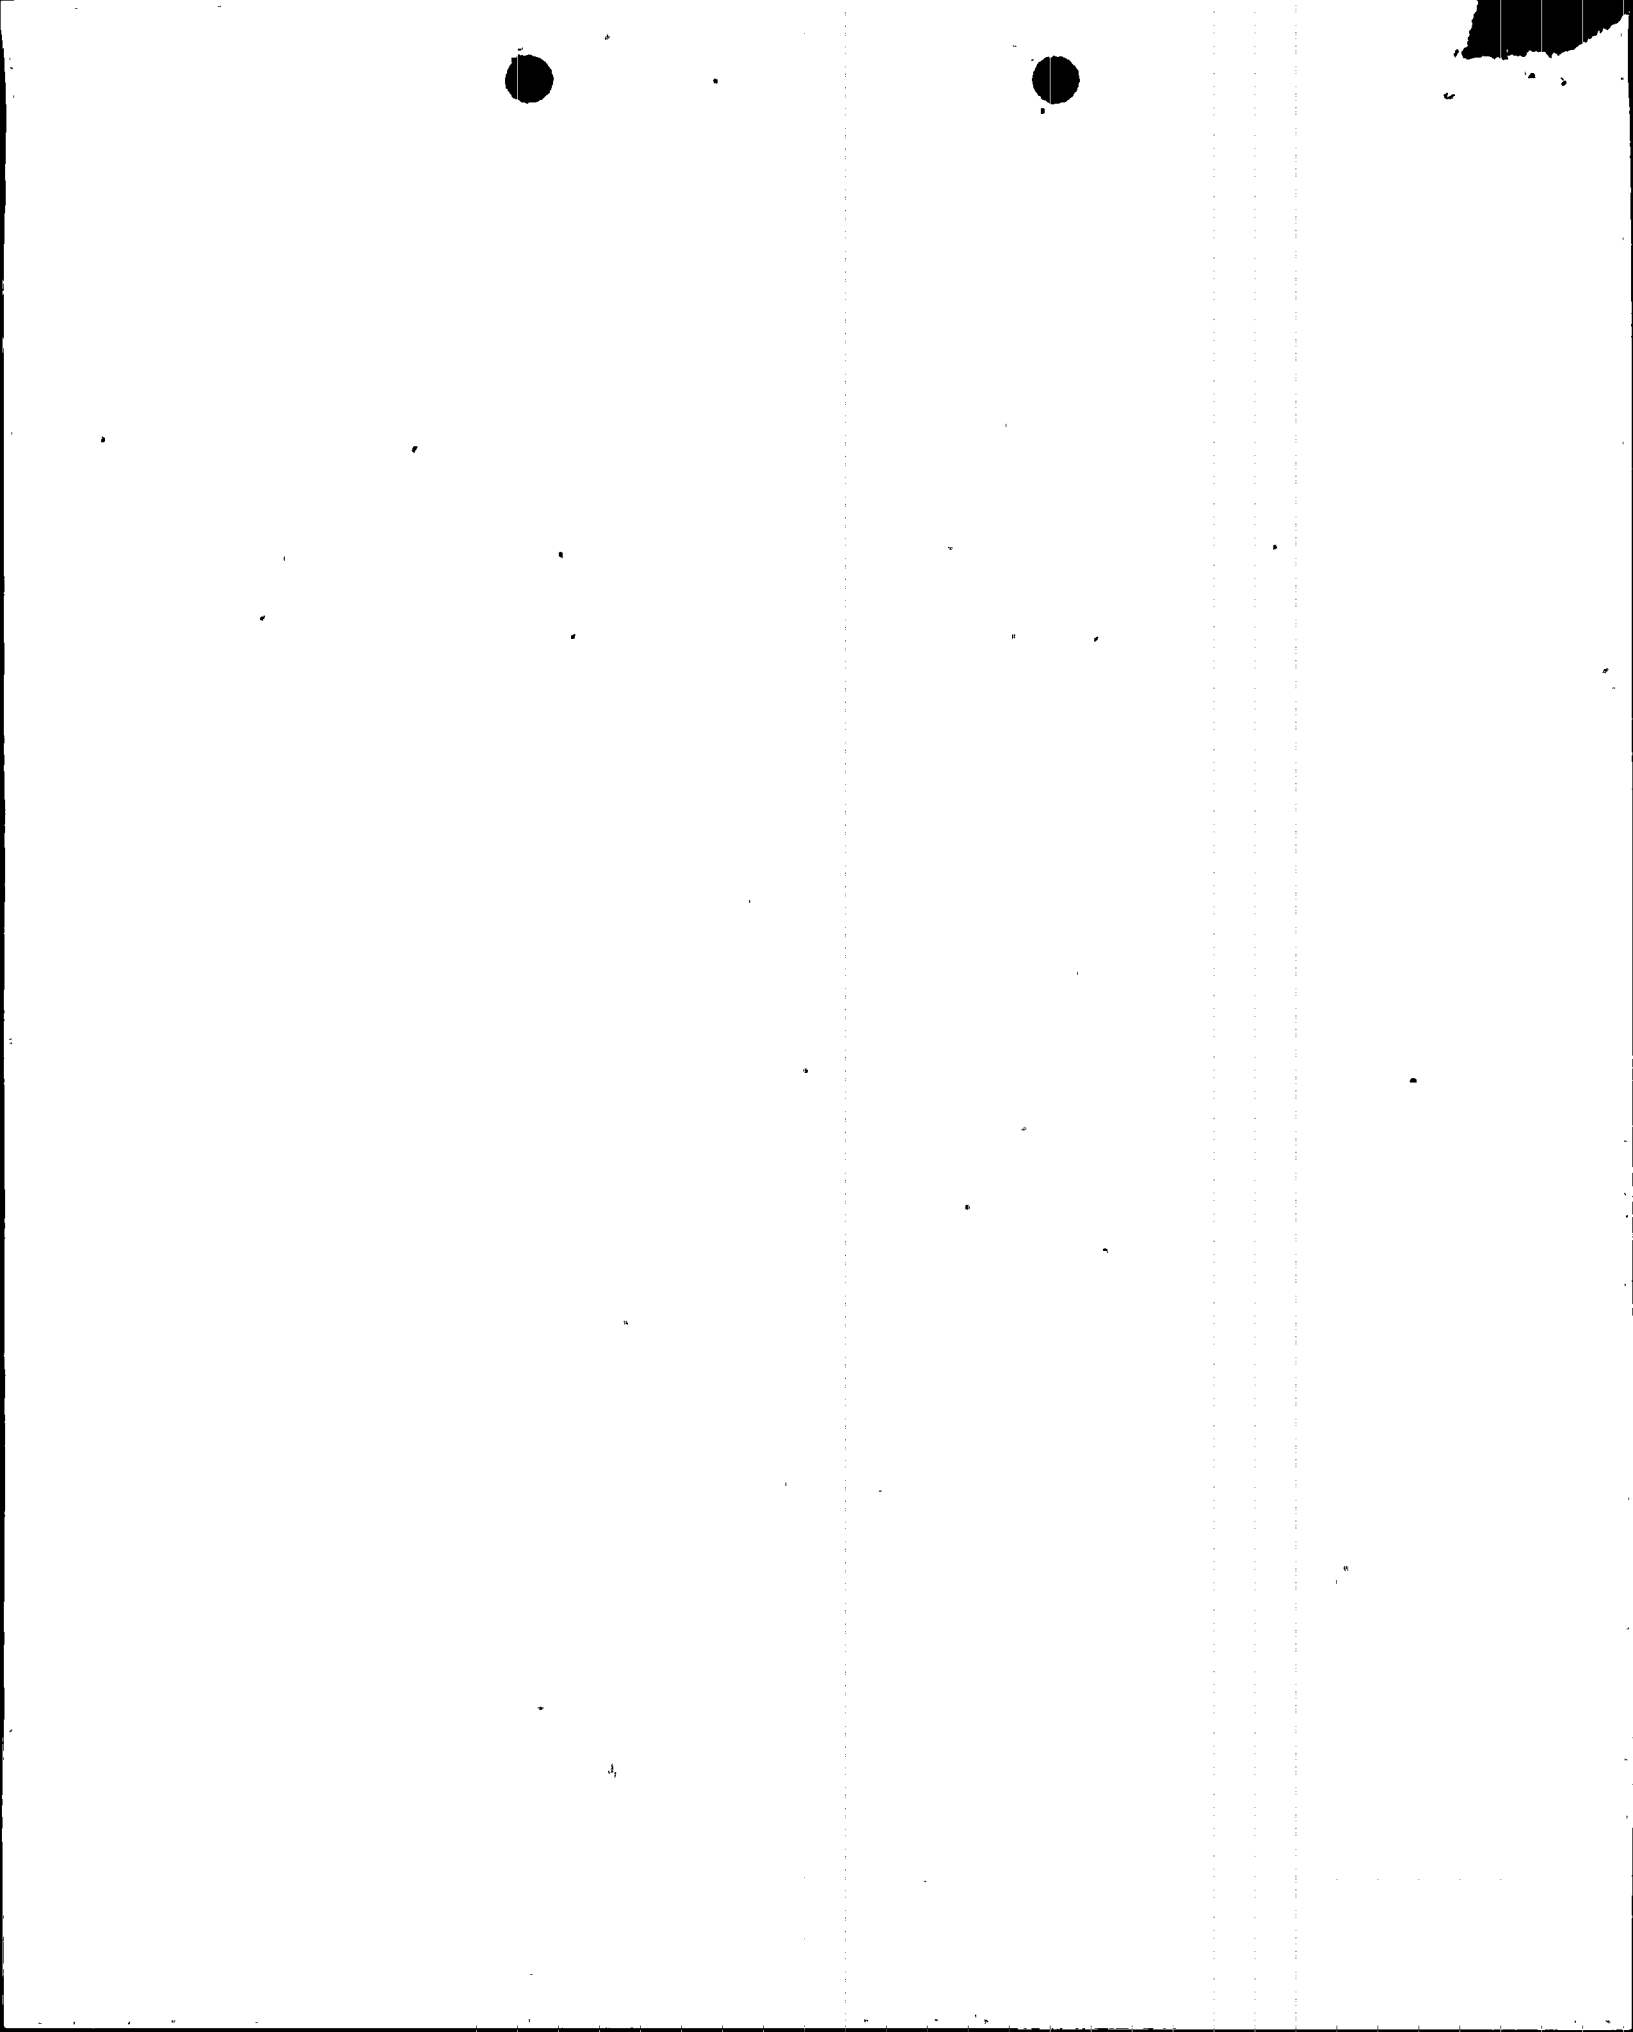

6. RECOMMENDATION/OPEN ITEM

FPL should implement new, or revise existing, technical specifications to prohibit movement of any heavy loads over irradiated fuel in the spent fuel pool.

RESPONSE

FPL will submit a technical specification to prohibit movement of heavy loads, inside the spent fuel building, over irradiated fuel in the spent fuel pool.

Attachment

