

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8305170520 DOC DATE: 83/05/13 NOTARIZED: YES DOCKET #:
 FACIL: 50-250 Turkey Point Plant, Unit 3, Florida Power and Light Co 05000250
 50-251, Turkey Point Plant, Unit 4, Florida Power and Light Co 05000251
 AUTH. NAME: AUTHOR AFFILIATION:
 UHRIG, R. E. Florida Power & Light Co.
 RECIPIENT NAME: RECIPIENT AFFILIATION:
 EISENHUT, D. G. Division of Licensing

SUBJECT: Application for amend to Licenses DPR-31, & 41 providing
 requirements for monthly walkdown of all accessible safety-
 related flow paths to verify correct valve position.

DISTRIBUTION CODE: A001S COPIES RECEIVED: LITR: 1 ENCL: 1 SIZE: 4x4
 TITLE: DR. Submittals General Distribution

NOTES:

	RECIPIENT ID CODE/NAME	COPIES LITR. ENCL	RECIPIENT ID CODE/NAME	COPIES LITR. ENCL
	NRR ORB1 BCI 01	7 7		
INTERNAL:	ELD/H264	1 0	NRR/DE/MTEB	1 1
	NRR/DL DIR	1 1	NRR/DL/ORAB	1 0
	NRR/DSI/METB	1 1	NRR/DSI/RAB	1 1
	<u>REG FIDEN</u> 04	1 1	RGN2	1 1
EXTERNAL:	ACRS 09	6 6	LPOR 03	1 1
	NRCI POR 02	1 1	NSIC 05	1 1
	NTIS	1 1		



May 13, 1983
L-83-302

Office of Nuclear Reactor Regulation
Attention: Mr. Darrell G. Eisenhut, Director
Division of Licensing
U. S. Nuclear Regulatory Commission
Washington, D.C. 20555

Dear Mr. Eisenhut:

Re: Turkey Point Units 3 & 4
Docket Nos. 50-250 & 50-251
Proposed License Amendment
Monthly System Walkdowns

In accordance with 10 CFR 50.90, Florida Power & Light Company submits herewith three signed originals and forty copies of a request to amend Appendix A of Facility Operating License DPR-31 and 41.

This amendment is submitted to provide a requirement for a monthly walkdown of all accessible safety related flowpaths to verify correct valve position.

The proposed amendment is described below and shown on the accompany Technical Specification pages.

Page 4.18-1, Table 4.18-1, and B4.18-1, -2 & -3


The requirement and bases for a monthly walkdown is added.

In accordance with 10 CFR 50.91(a)(1), we have determined that this amendment poses no significant hazard. The amendment provides a technical specification requiring a procedure to ensure correct valve position and continued safe operation. Therefore, the amendment does not:

- 1) Involve a significant increase in the probability or consequences of an accident previously evaluated; or
- 2) Create the possibility of a new or different kind of accident from any accident previously evaluated; or
- 3) Involve a significant reduction in a margin of safety.

A001

8305170520 830513
PDR ADDCK 05000250
P PDR

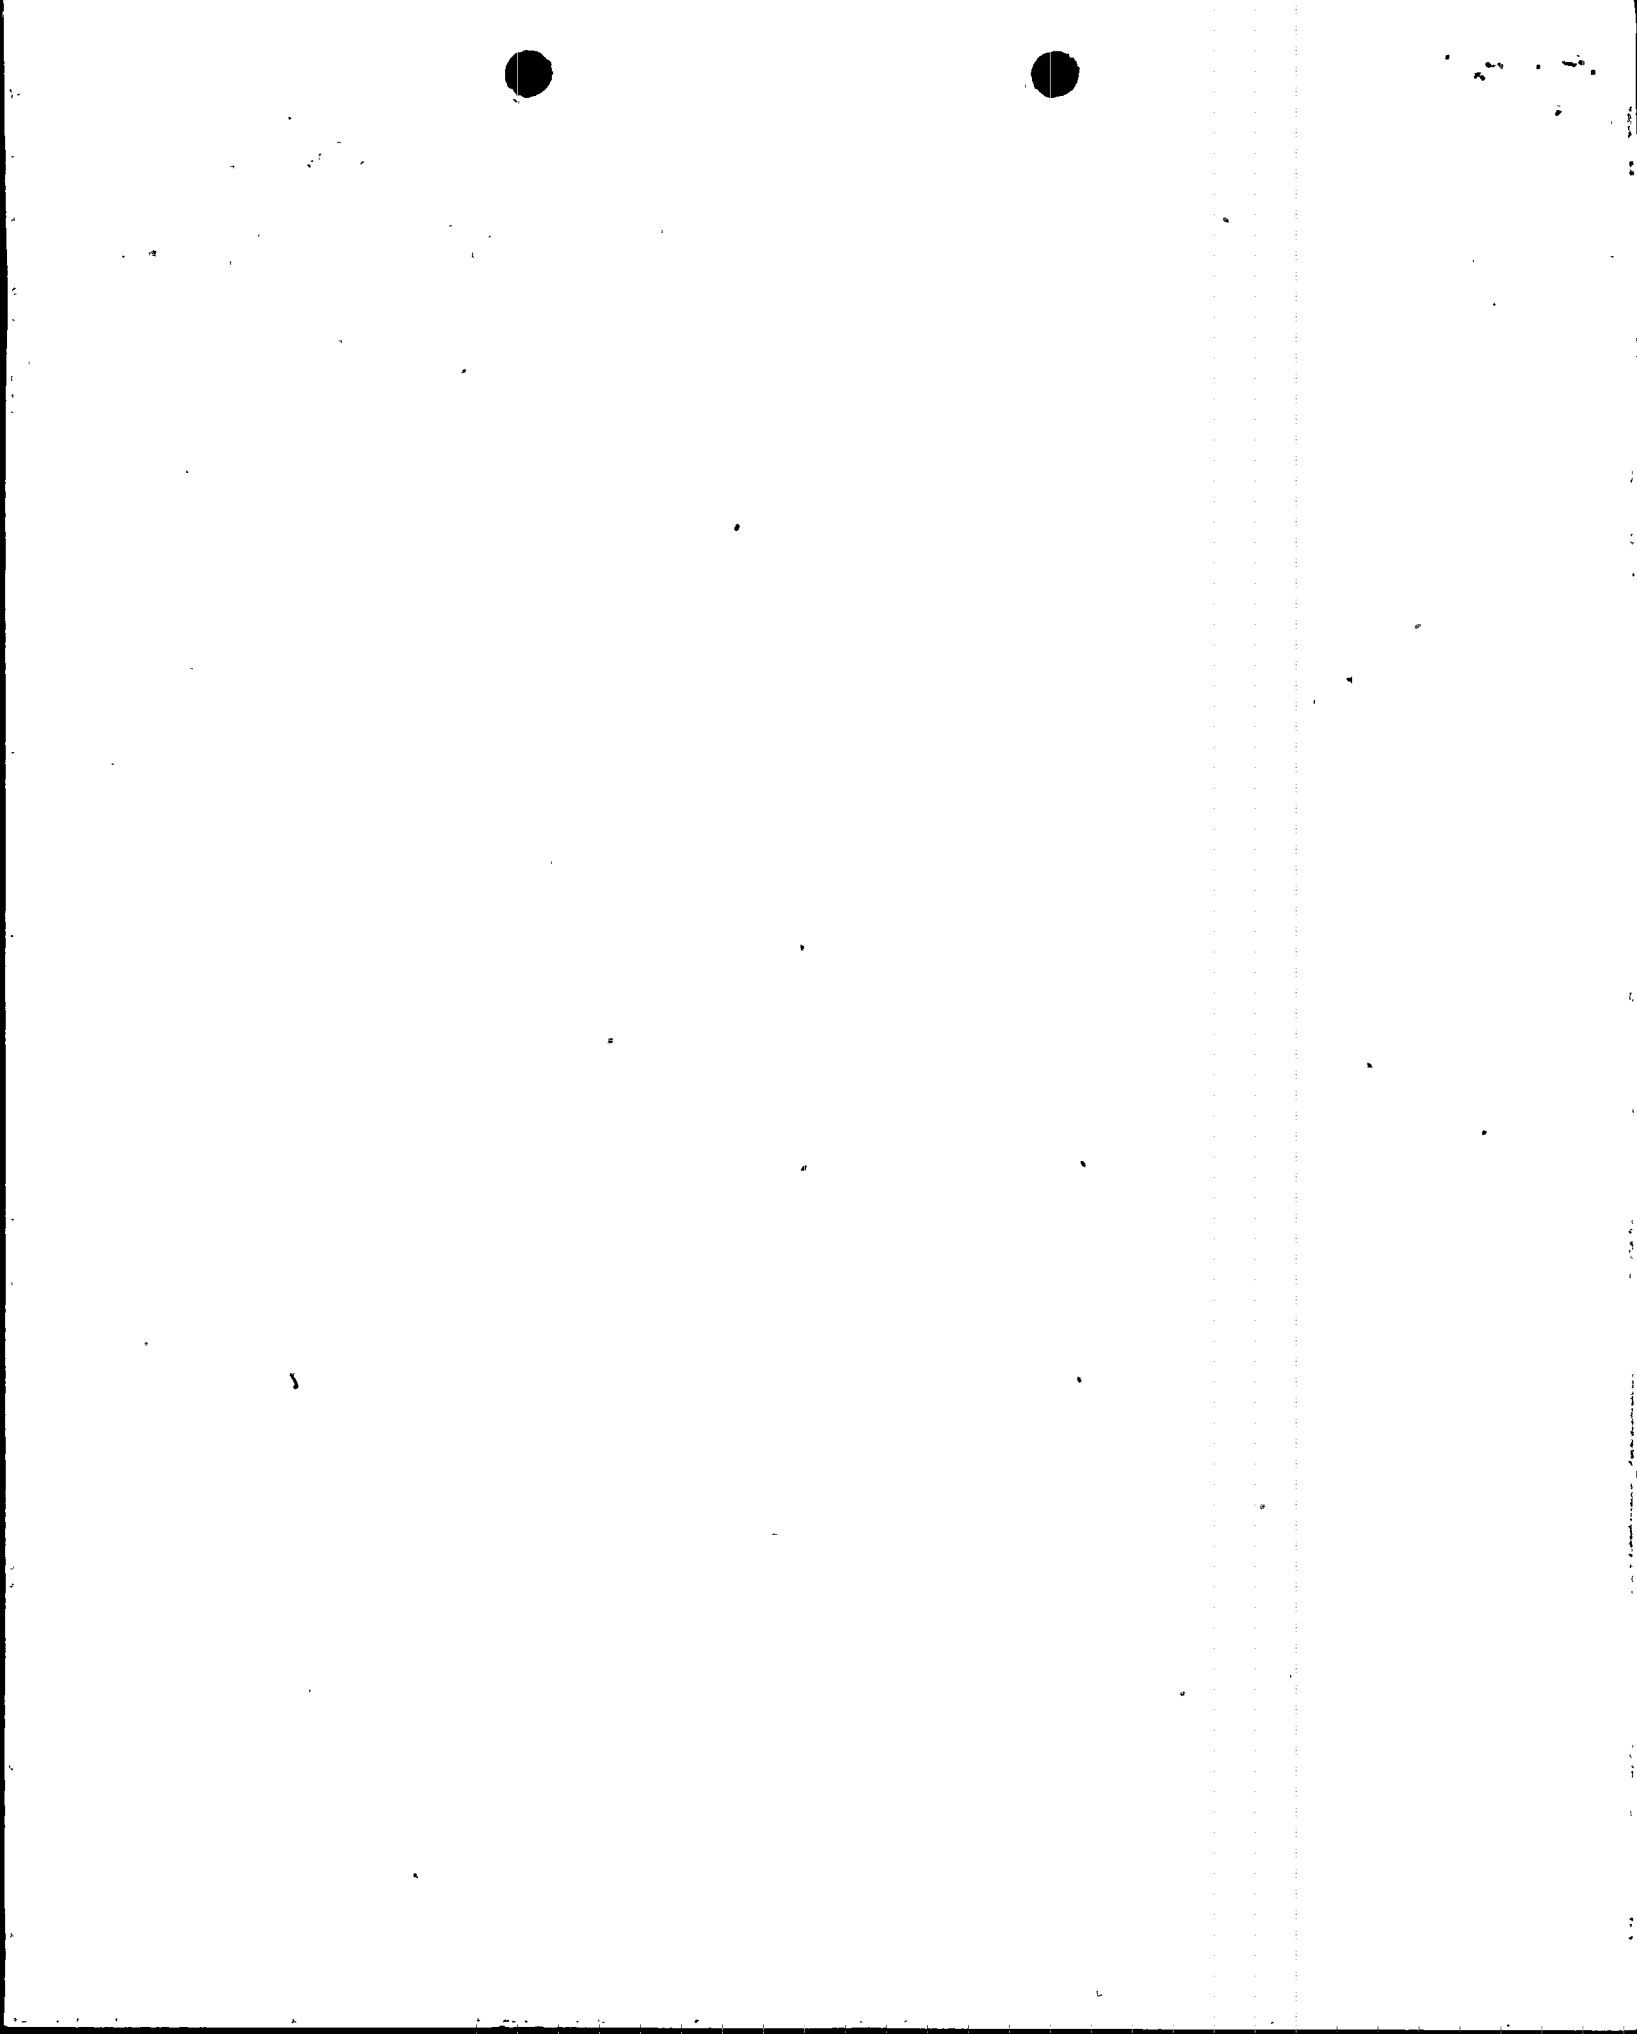

Office of Nuclear Reactor Regulation
Attention: Mr. Darrell G. Eisenhut
Page 2

The proposed amendment has been reviewed by the Turkey Point Plant Nuclear Safety Committee and the Florida Power & Light Company Nuclear Review Board.


Very truly yours,

In 
Robert E. Uhrig
Vice President
Advanced Systems & Technology

REU/PLP/cab

Attachment

cc: Mr. James P. O'Reilly, Region II
Mr. Harold F. Reis, Esquire

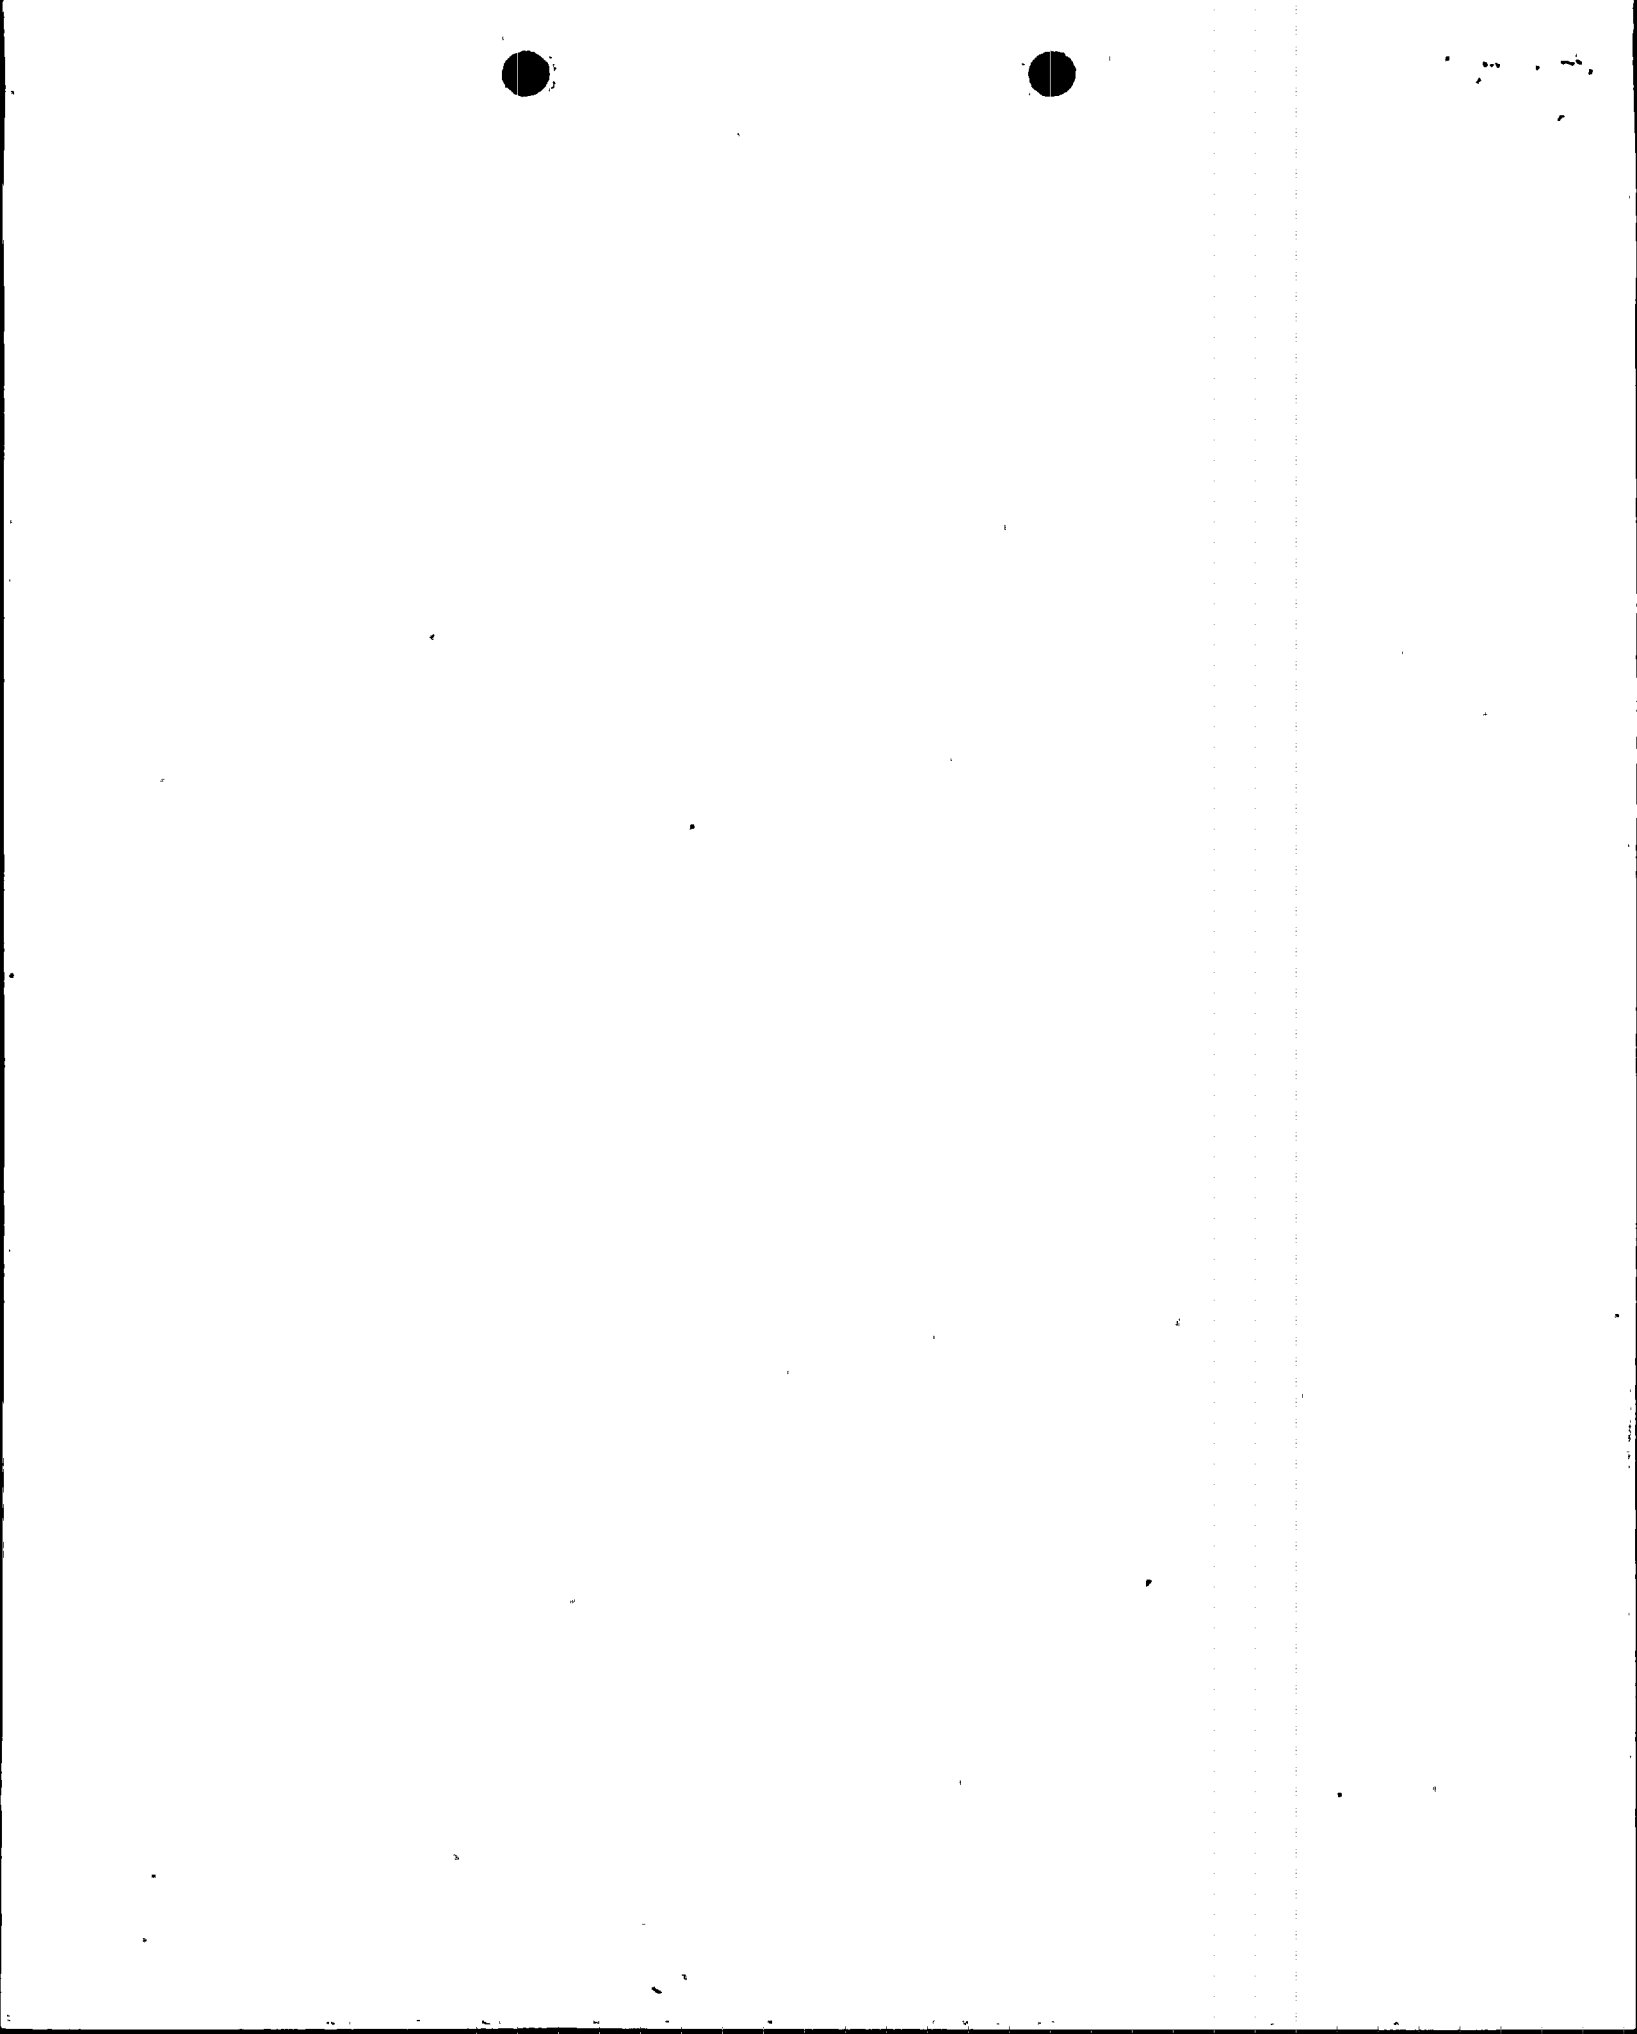

ATTACHMENT I

Re: Turkey Points Units 3 & 4
Docket Nos. 50-250 & 50-251
Proposed License Amendment

SAFETY EVALUATION

I. INTRODUCTION

This evaluation supports the addition of T.S. 4.18 and T.S. B4.18 covering safety systems flowpath verifications to be performed at least once per month.

The proposed changes consist of:

1. T.S. 4.18 requires the flow path verifications to be performed. Table 4.18-1 lists the frequencies and applicability modes for the verifications.
2. T.S. B4.18 describes the need and purpose of the flowpath verifications.

II. EVALUATION


The proposed revisions are evaluated as follows:

1. T.S. 4.18 including Table 4.18-1 - This proposed change will support a recent commitment made to the NRC by which all safety systems as shown on Table 4.18-1 will be verified to ensure proper line-ups and availability of flowpaths at monthly intervals.
 - a. T.S. B4.18 - This section describes the needs and purpose for the availability of safety systems flowpath which will ensure the performance of the systems as designed.

III. CONCLUSION

We have concluded, based on the considerations discussed above, that:

1. The proposed amendment does not involve a significant increase in the probability or consequences of accidents previously considered, and does not involve a significant decrease in a safety margin.
2. There is reasonable assurance that the health and safety of the public will not be endangered by operation in such a manner.
3. Such activities will be conducted in compliance with the Commissions regulations and the issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public.

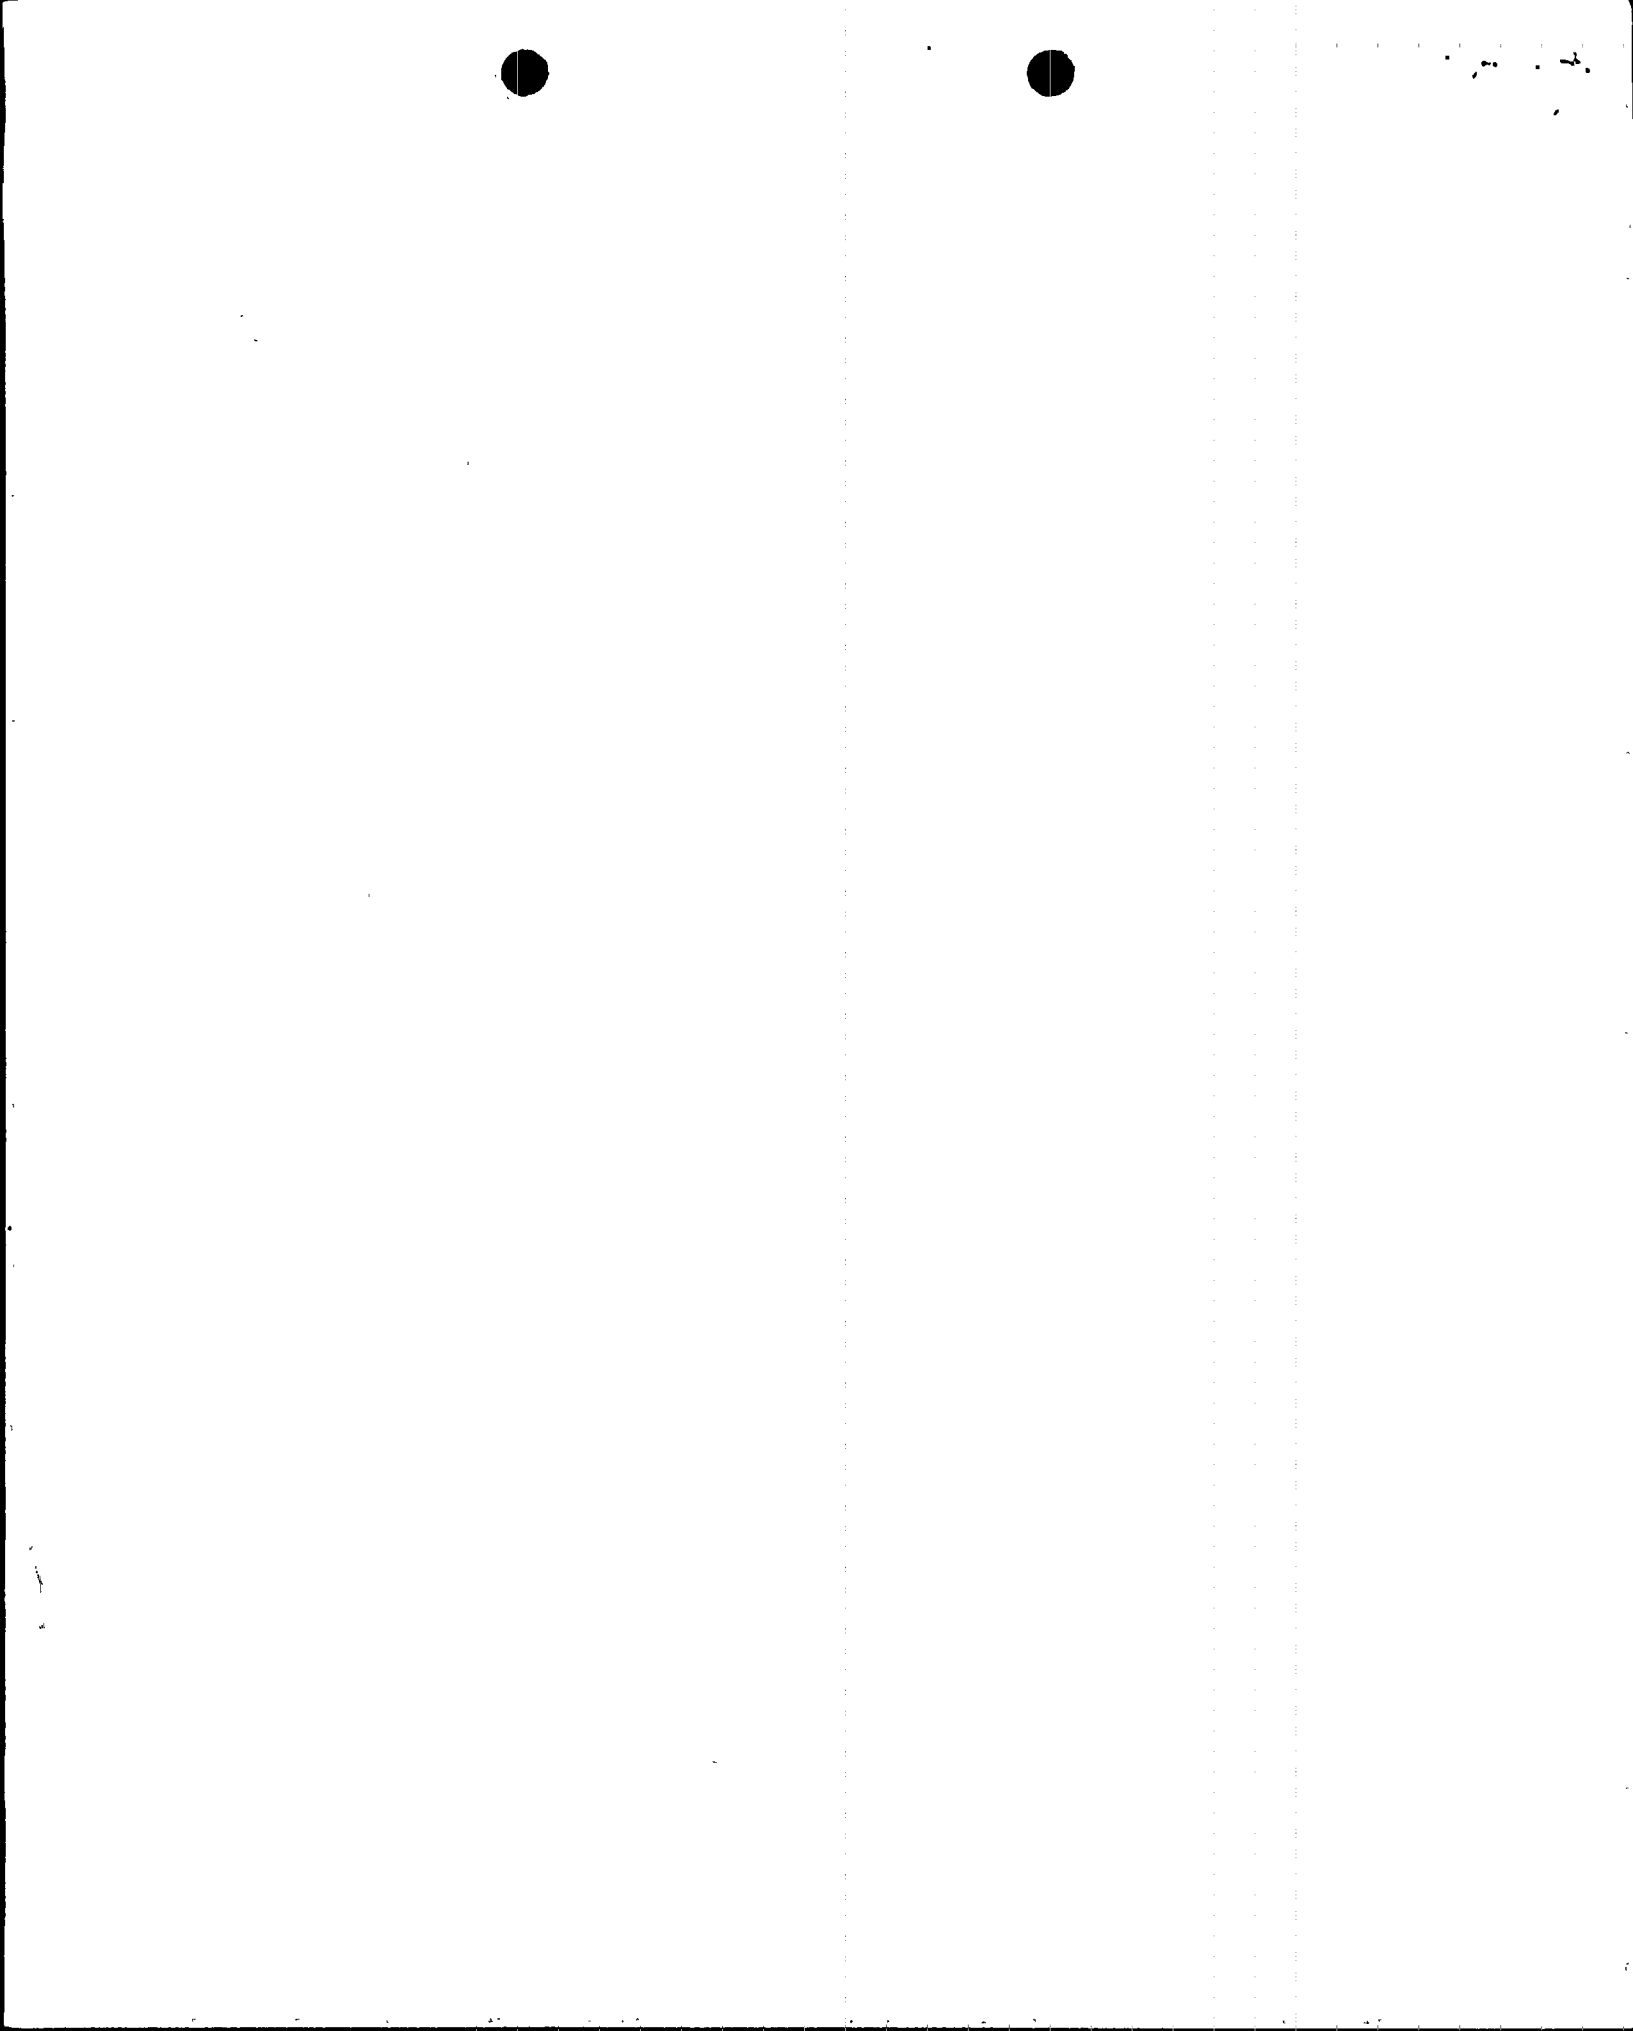


STATE OF FLORIDA)
) ss.
COUNTY OF PALM BEACH)

H. J. Dager, being first duly sworn, deposes and says:

That he is Vice President of Florida Power & Light Company, the Licensee herein;


That he has executed the foregoing document; that the statements made in this document are true and correct to the best of his knowledge, information, and belief, and that he is authorized to execute the document on behalf of said Licensee.

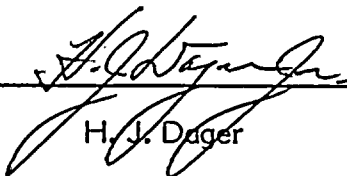

H. J. Dager

Subscribed and sworn to before me this

13 day of May, 1983.



Cheryl L. Fredrick

NOTARY PUBLIC, in and for the County
of Palm Beach, State of Florida.

My commission expires: Notary Public, State of Florida at Large
My Commission Expires October 30, 1983
Bonded thru Maynard Bonding Agency

1950