

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8405290158 DOC. DATE: 84/05/21 NOTARIZED: YES DOCKET #
 FACIL: 50-250 Turkey Point Plant, Unit 3, Florida Power and Light C 05000250
 50-251 Turkey Point Plant, Unit 4, Florida Power and Light C 05000251
 AUTH. NAME: AUTHOR AFFILIATION
 WILLIAMS, J.W. Florida Power & Light Co.
 WOODS, C.O. Florida Power & Light Co.
 RECIP. NAME: RECIPIENT AFFILIATION
 EISENHUT, D.G. Division of Licensing


SUBJECT: Application for amend to Licenses DPR-31 & 41, changing Tech
 Specs to revise & expand Table 2.13-1 re safety-related
 snubbers for Unit 3.


DISTRIBUTION CODE: A001S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 3+4
 TITLE: OR Submittal: General Distribution

NOTES:

	RECIPIENT ID CODE/NAME		COPIES LTTR ENCL		RECIPIENT ID CODE/NAME		COPIES LTTR ENCL
	NRR ORB1 BC 01		7 7				
INTERNAL:	ELD/HDS4		1 0		NRR/DE/MTEB		1 1
	NRR/DL DIR		1 1		NRR/DL/ORAB		1 0
	NRR/DSI/MTEB		1 1		NRR/DSI/RAB		1 1
	REG FILE 04		1 1		RGN2		1 1
EXTERNAL:	ACRS 09		6 6		LPDR 03		1 1
	NRC PDR 02		1 1		NSIC 05		1 1
	NTIS		1 1				

TOTAL NUMBER OF COPIES REQUIRED: LTTR 25 ENCL 23

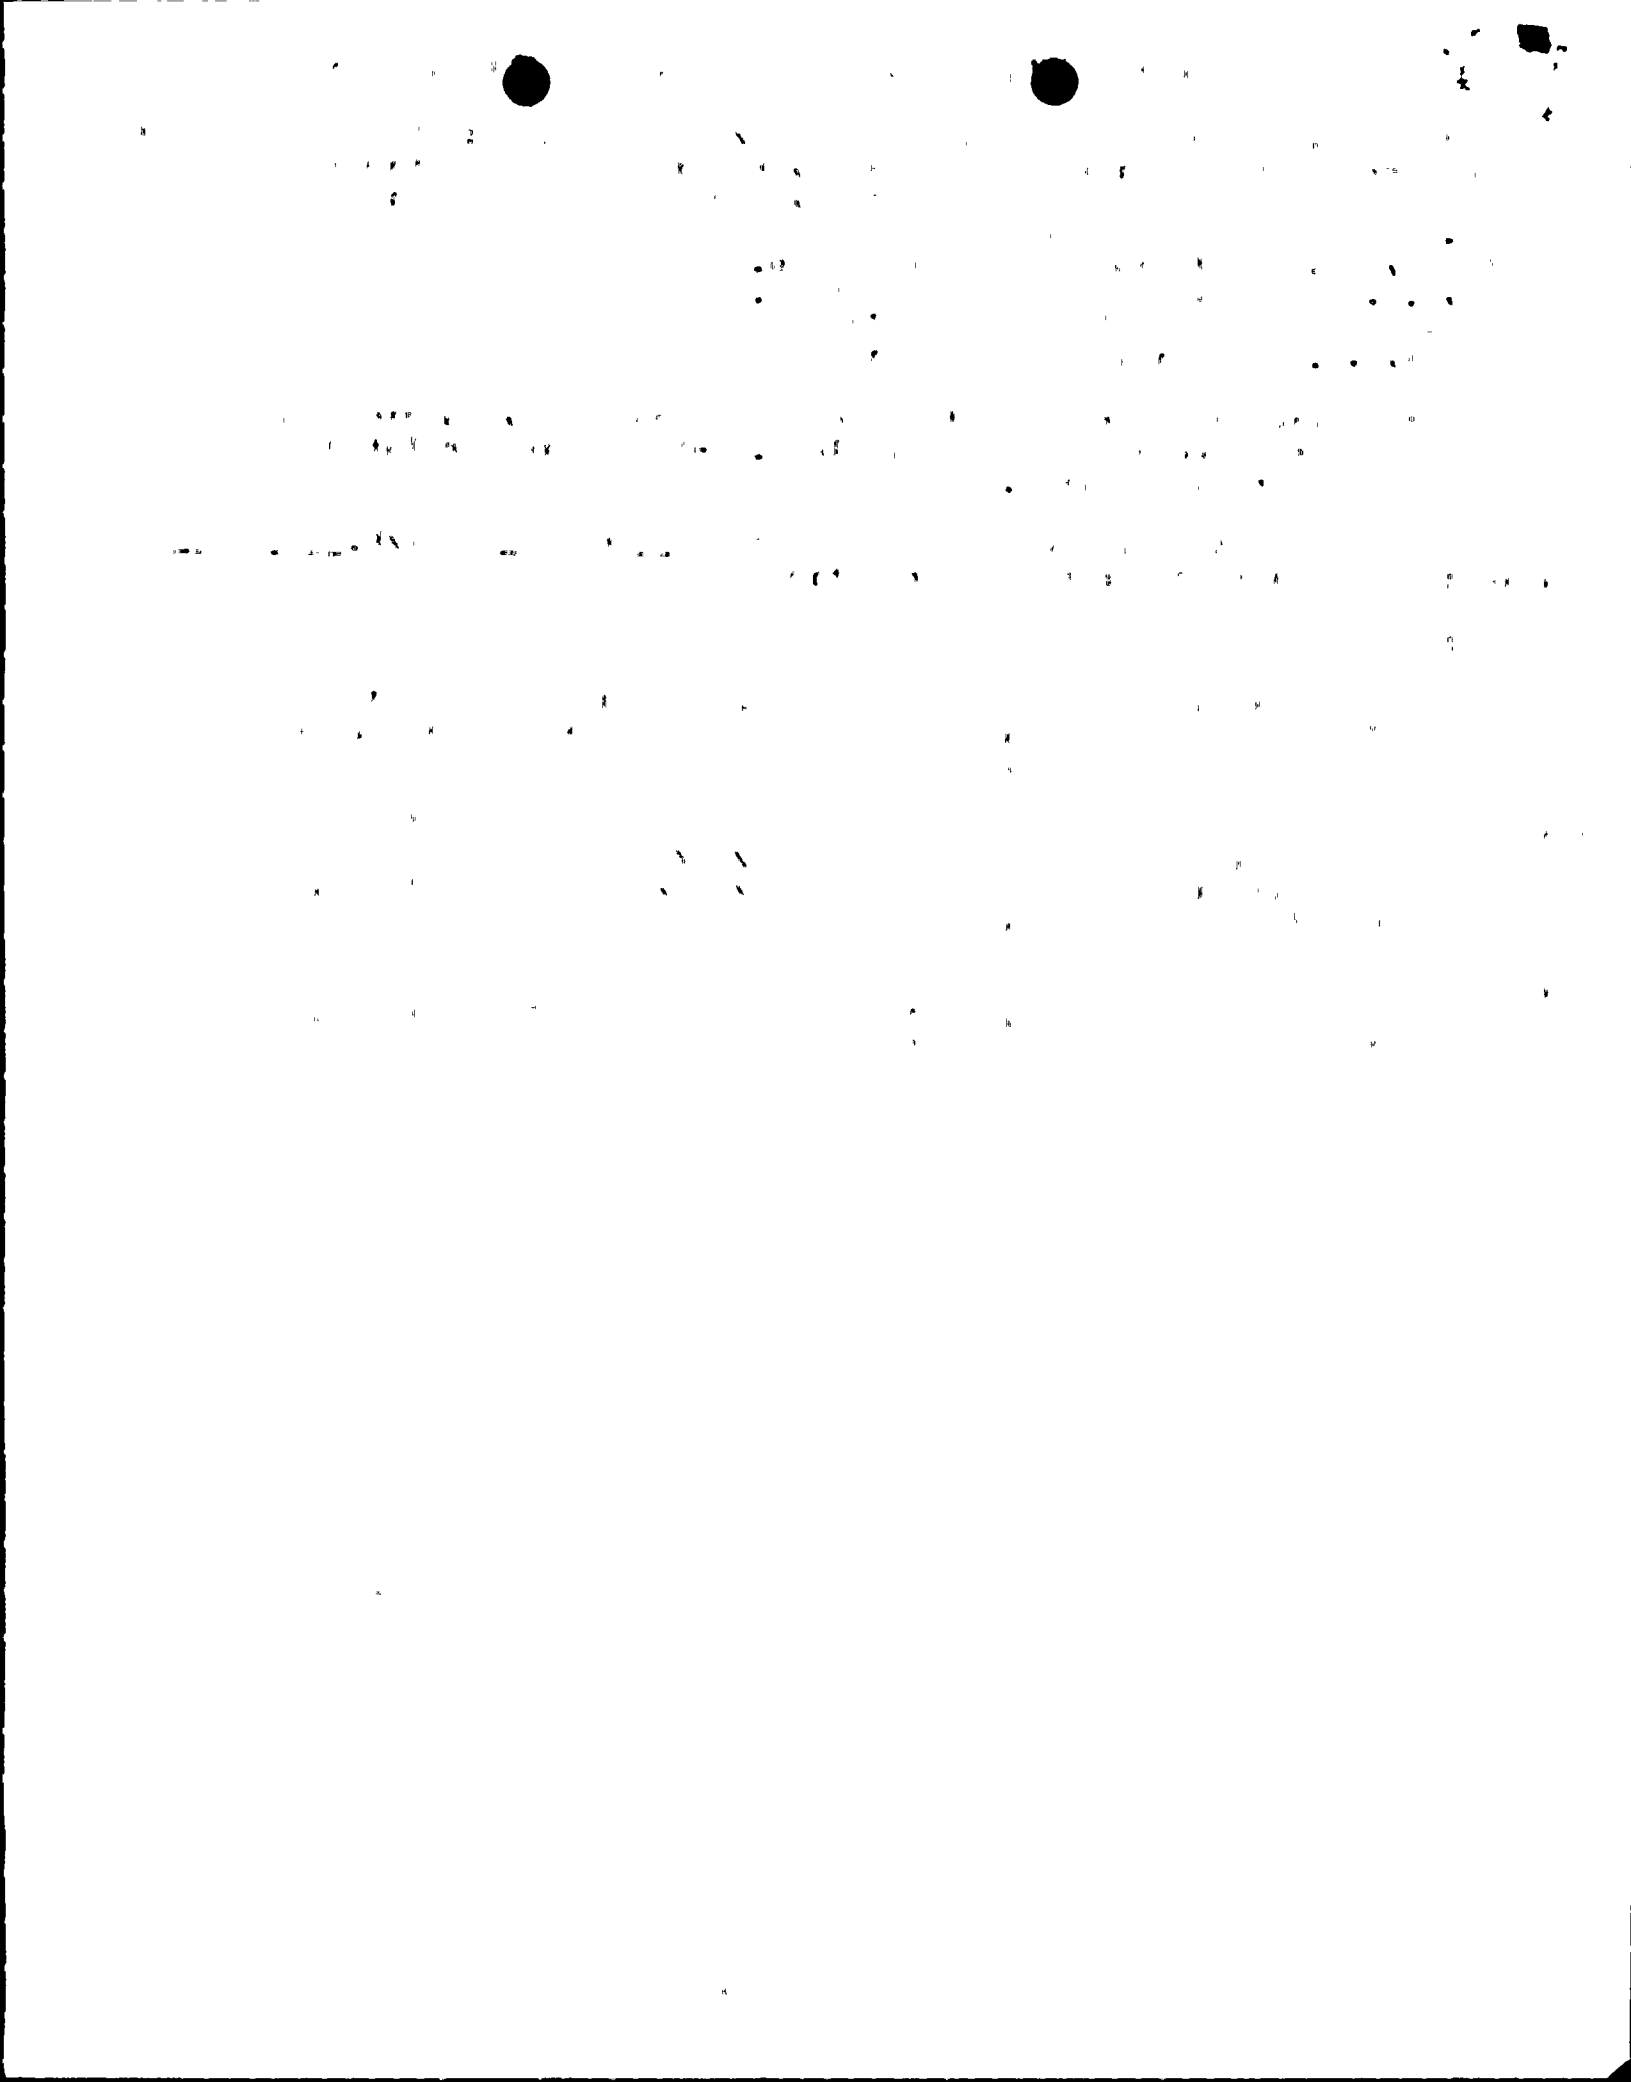

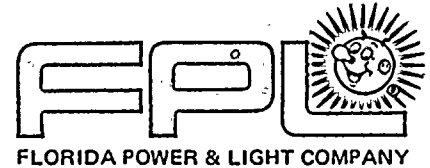

May 21, 1984
L-84-132

Office of Nuclear Reactor Regulation
Attention: Mr. D. G. Eisenhut, Director
Division of Licensing
U. S. Nuclear Regulatory Commission
Washington, D.C. 20555

Dear Mr. Eisenhut:

Re: Turkey Point Units 3 & 4
Docket Nos. 50-250 and 50-251
Proposed Amendment to Facility
Operating Licenses DPR-31 and 41
Safety-Related Snubbers

In accordance with 10 CFR 50.90, Florida Power & Light Company (FPL) submits herewith three signed originals and forty copies of a request to amend Facility Operating Licenses DPR-31 and 41.

FPL proposes to revise and expand the Table of Safety-Related Snubbers. This revision includes all snubbers installed during the recent Unit 3 refueling outage.

The proposed modification will involve Technical Specification changes as described below and as shown on the accompanying Technical Specification pages. (Attachment 1).

Table 3.13-1

The Unit 3 Table has been revised and updated to reflect recent snubber changes.

The proposed facility modification has been reviewed by the Turkey Point Plant Nuclear Safety Committee and the FPL Company Nuclear Review Board. FPL has concluded that operation of the Turkey Point Plants under the proposed license amendments would not.

1. Involve a significant increase in the probability or consequences of an accident previously evaluated; or
2. Create the possibility of a new or different kind of accident from any accident previously evaluated; or
3. Involve a significant reduction in a margin of safety.

Aool
11

840529015B 840521
PDR ADDCK 05000250
P PDR

100



100

May 21, 1984

Page 2


Office of Nuclear Reactor Regulation
Mr. Darrell G. Eisenhut, Director

Attachment 2 provides an evaluation of the proposed action in light of three standards contained in 10 CFR 50.92 (listed above, regarding the issue of no significant hazards consideration.

In summary, FPL submits that the activities associated with the proposed amendments do not constitute a significant hazard to the public health and safety or to the environment and, therefore, that these amendments do not involve a significant hazards consideration. FPL respectfully requests, therefore, that this application be processed pursuant to 10 CFR 50.91 and 50.92, as involving no significant hazards consideration.

In accordance with 10 CFR 170.22, this proposed license amendment has been determined to represent a Class I and III amendment. Accordingly, a check for \$4,400.00 will be forwarded under separate cover.

Very truly yours,


J. W. Williams, Jr.
Group Vice President
Nuclear Energy

JWW/SAV/cab

Attachment

cc: Mr. J. P. O'Reilly
Mr. Harold F. Reis, Esquire

Lyle E. Jerrett, Administrator
Radiological Health & Rehabilitative Services
1323 Winewood Boulevard
Tallahassee, FL 32301

ATTACHMENT

Re: Turkey Point Units 3 and 4
Docket Nos. 50-250 and 50-251
Reactor Coolant System Inservice Inspection

Safety and Significant Hazards Evaluation

The Turkey Point Technical Specifications include a table listing all safety-related snubbers. Technical Specification 3.13.4 allows for the addition or removal of snubbers without prior License Amendment provided that a revision to Table 3.13-1 follows. This proposed Amendment provides the required revision.

This proposed change is administrative in nature in that it replaces outdated specifications with revised and updated information. This is similar to example (i) of the Examples of Amendments That Are Considered Not Likely to Involve Significant Hazards Considerations as presented in the Federal Register notice of Interim Final Rule dated April 6, 1983 in that it is:

"A purely administrative change to technical specifications: for example, a change to achieve consistency through the technical specifications, correction of an error, are a change in nomenclature."

In that this change merely revises and updates existing Technical Specifications, we have determined that operation of Turkey Point Units 3 and 4, in accordance with the proposed amendment, would not:

- 1) Involve a significant increase in the probability or consequences of an accident previously evaluated; or
- 2) Create the possibility of a new or different kind of accident from any accident previously evaluated; or
- 3) Involve a significant reduction in a margin of safety.

TABLE 3.13-1 SHEET 2

SAFETY RELATED SNUBBERS - UNIT 3

FPL Tag No.	System	Approximate Elevation (Feet)	Snubbers in High Radiation Areas During Shutdown*	Snubbers Especially Difficult to Remove	Snubbers Inaccessible During Normal Operation	Snubbers Accessible During Normal Operation
25	Pressurizer Relief	73	X		X	
26	Pressurizer Spray	73	X		X	
27	Pressurizer Spray	73	X		X	
28	Pressurizer Spray	73	X		X	
29	Pressurizer Spray	73	X		X	
30	Pressurizer Relief	73	X		X	
31	Pressurizer Relief	73	X		X	
32	3A S/G Blowdown in Cubicle	32			X	
33	3A S/G Blowdown in Cubicle	32			X	
34	3A S/G Blowdown in Cubicle	32			X	
35	3C S/G Blowdown in Cubicle	33			X	
36	3C S/G Blowdown in Cubicle	33			X	
37	3C S/G Blowdown in Cubicle	21			X	
38	Residual Heat Removal	2	X			X
39	Residual Heat Removal	2	X			X
40	Residual Heat Removal	2	X			X
41	Residual Heat Removal	2	X			X
42	Safety Injection	12	X			X
43						
44						
45						
46	Steam to Aux. Feedwater	26				X
47	Steam to Aux. Feedwater	26				X
48	Steam to Aux. Feedwater	26				X

TABLE 3.13-1 SHEET 3a

SAFETY RELATED SNUBBERS - UNIT 3

FPL Tag No.	System	Approximate Elevation (Feet)	Snubbers in High Radiation Areas During Shutdown*	Snubbers Especially Difficult to Remove	Snubbers Inaccessible During Normal Operation	Snubbers Accessible During Normal Operation
95	"A" RTD Loop	22	X		X	
96	"A" RTD Loop	22	X		X	
97	"A" RTD Loop	19	X		X	
98	Excess Letdown Line	15			X	
99	"A" RCP CCW Line	23	X		X	
100	"A" RCP CCW Line	23	X		X	
101	"A" RCP CCW Line	23	X		X	
102	"A" RTD Loop	27	X		X	
103	"A" RTD Loop	23	X		X	
104						
105	Excess Letdown Line	15			X	
106	"C" RCP Seal Return	37	X		X	
107	CCW to C RCP Cooler	30	X		X	
108	CCW to C RCP Cooler	32	X		X	
109	CCW to C RCP Cooler	22	X		X	
110	"B" RTD Loop	26	X		X	
111	"B" RTD Loop	27	X		X	
112	Cont. Spray Pump Room	19				X
113	RWST Line	19				X
114	RWST Line	19				X
115	Charging Pump Room	26				X
116	14" RWST Line in Pipeway	12	X			X
117	14" RWST Line in Pipeway	12	X			X
118	14" RWST Line in Pipeway	12	X			X

TABLE 3.13-1 SHEET 3b

SAFETY RELATED SNUBBERS - UNIT 3

FPL Tag No.	System	Approximate Elevation (Feet)	Snubbers in High Radiation Areas During Shutdown*	Snubbers Especially Difficult to Remove	Snubbers Inaccessible During Normal Operation	Snubbers Accessible During Normal Operation
119	12" RWST Line in Pipeway	12	X			X
120	RHR Heat Exchanger Room	28	X			X
121	RHR Heat Exchanger Room	24	X			X
122	RHR Heat Exchanger Room	7	X			X
123	RHR Heat Exchanger Room	5	X			X
124	RHR Heat Exchanger Room	5	X			X

STATE OF FLORIDA)
)
COUNTY OF DADE) ss.

C. O. Woody, being first duly sworn, deposes and says:

That he is Vice President Nuclear Operations of Florida Power & Light Company,
the licensee herein;

That he has executed the foregoing document; that the statements made in this
document are true and correct to the best of his knowledge, information, and
belief, and that he is authorized to execute the document on behalf of said
Licensee.

C. O. Woody
C. O. Woody

Subscribed and sworn to before me this

1st day of May, 1984.

Lawrence Jordan
NOTARY PUBLIC, in and for the County of
Dade, State of Florida.

My commission expires: _____

NOTARY PUBLIC STATE OF FLORIDA AT LARGE
MY COMMISSION EXPIRES DEC 8 1984
BONDED THRU GENERAL INS. UNDERWRITERS

10

10