

July 26, 1984
L-84-190

Office of Nuclear Reactor Regulation
Attention: Mr. Darrell G. Eisenhut, Director
Division of Licensing
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

Dear Mr. Eisenhut:

Re: Turkey Point Units 3 and 4
Docket Nos. 50-250 and 50-251
Revisions to Inservice Test
Program for Pumps and Valves

In the Abstracts for the Turkey Point Units 3 and 4 Valve Test Program and Pump Test Program submitted with our letter, L-84-84, dated March 30, 1984, we inadvertently identified the effective date of the revised programs as August 1, 1984. It had been our intention to make the program effective six months after the submittal date as we did with the submittal for St. Lucie Unit 1. Our draft of the report had set the 6 month date as August 1, 1984 and this date was not corrected in our final letter.

To correct the effective date discussed above, we have attached revised abstract pages for the IST program which set the effective date as six months after the submittal of the program. For the current submittal, the effective date will therefore be September 30, 1984.

We have also attached page 119 of the submittal. This page may have been inadvertently omitted from some copies of the program.

Should you or your staff have any questions on this information, please contact us.

Very truly yours,

A handwritten signature in cursive script, appearing to read "J.W. Williams, Jr.", is written over the typed name.

J.W. Williams, Jr.
Group Vice President
Nuclear Energy

JWW/PLP/djc

Attachment

cc: Mr. James P. O'Reilly, Region II
Harold F. Reis, Esquire
PNS-LI-84-259

8407310122 840726
PDR ADOCK 05000250
Q PDR

TURKEY POINT UNIT 3

ABSTRACT


The planned inservice inspection and testing programs were developed employing the R.G. 1.26, Revision 2, criteria for quality group classifications and standards (Quality Group A is the same as ASME Class 1, etc.).

Section I. Valve Test Program Outline

The valve test program shall be conducted in accordance with Subsection IWV of Section XI of the 1980 Edition of the ASME Boiler and Pressure Vessel Code thru Winter 1981 Addenda, except for specific relief requested in accordance with 10 CFR 50.55a (g) (5) (iii) which is identified in Subsections I.G. The period for this valve test program starts December 14, 1982, and ends December 14, 1992. The effective date of this revised valve test program shall be six (6) months after the submittal date.

Section II. Pump Test Program Outline

The pump test program shall be conducted in accordance with Subsection IWP of Section XI of the 1980 Edition of the ASME Boiler and Pressure Vessel Code thru Winter 1981 Addenda, except for specific relief requested in accordance with 10 CFR 50.55a (g) (5) (iii) which is identified in Subsection II.A. The period for the pump test program starts December 14, 1982, and ends December 14, 1992. The effective date of this revised pump test program shall be six (6) months after the submittal date.

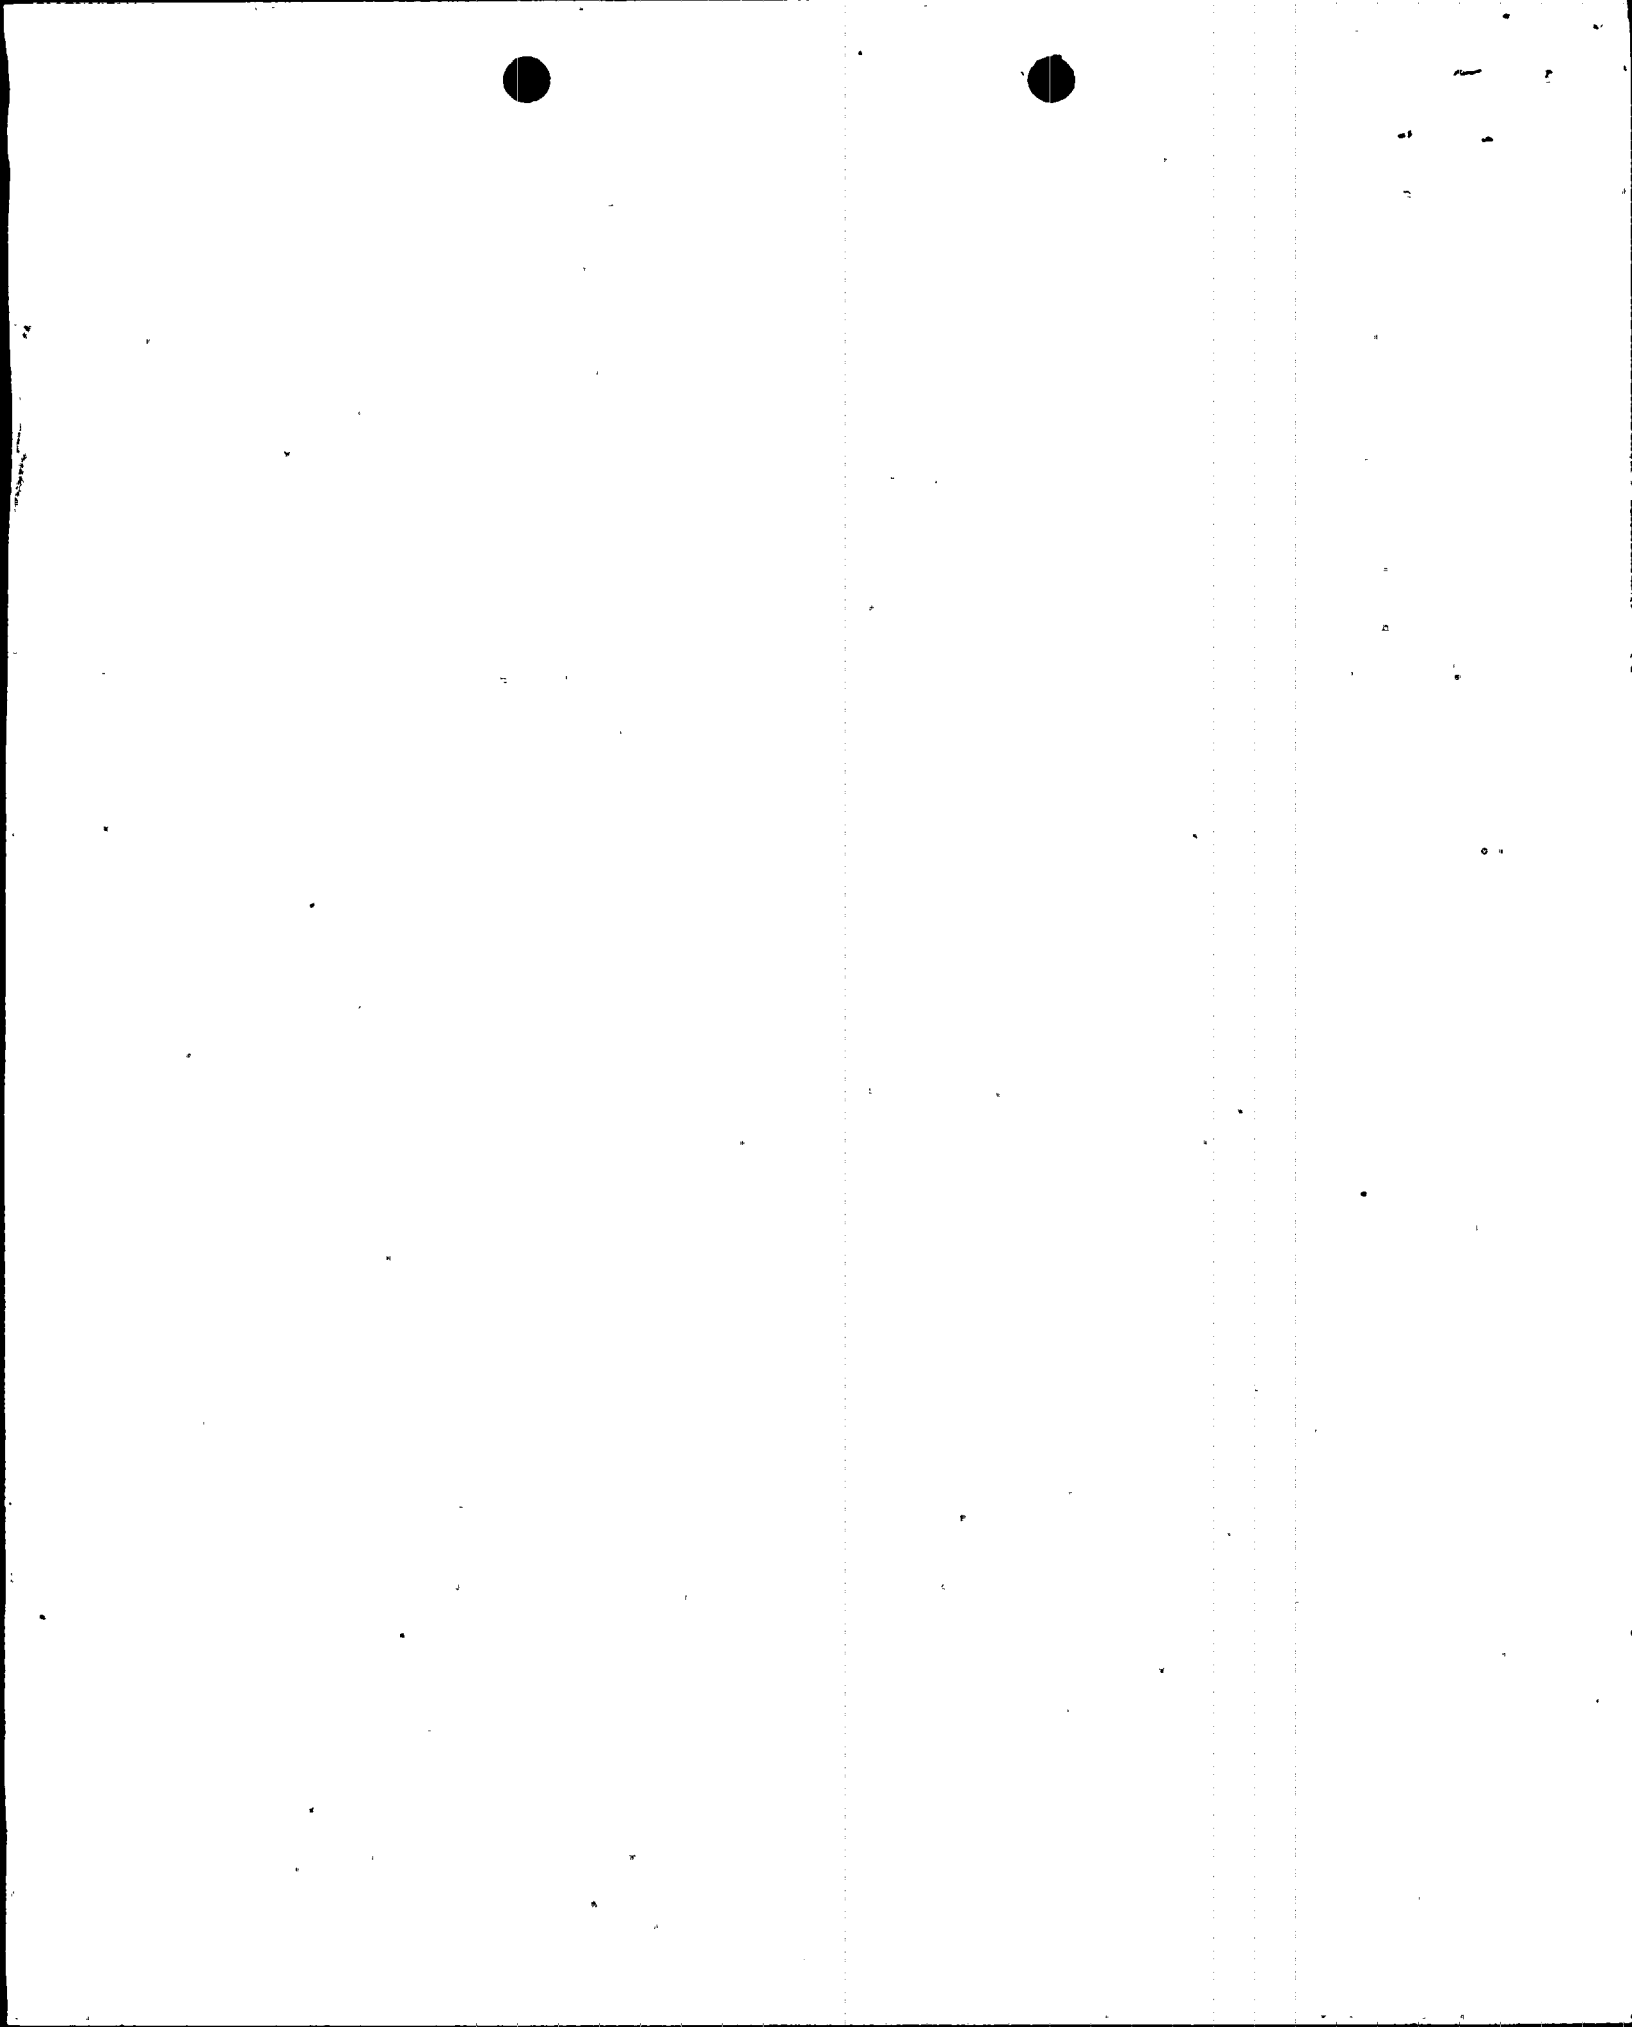

TURKEY POINT UNIT 4

ABSTRACT

The planned inservice inspection and testing programs were developed employing the R.G. 1.26, Revision 2, criteria for quality group classifications and standards. (Quality Group A is the same as ASME Class 1, etc.).

Section I. Valve Test Program Outline

The valve test program shall be conducted in accordance with Subsection IWV of Section XI of the 1980 Edition of the ASME Boiler and Pressure Vessel Code thru Winter 1981 Addenda, except for specific relief requested in accordance with 10 CFR 50.55a (g) (5) (iii) which is identified in Subsections I.G. The period for this valve test program starts September 7, 1983, and ends September 7, 1993. The effective date of this revised valve test program shall be six (6) months after the submittal date.

Section II. Pump Test Program Outline

The pump test program shall be conducted in accordance with Subsection IWP of Section XI of the 1980 Edition of the ASME Boiler and Pressure Vessel Code thru Winter 1981 Addenda, except for specific relief requested in accordance with 10 CFR 50.55a (g) (5) (iii) which is identified in Subsection II.A. The period for the pump test program starts September 7, 1983, and ends September 7, 1993. The effective date of this revised pump test program shall be six (6) months after the submittal date.

FLORIDA POWER & LIGHT COMPANY
TABLE IV
PUMP TEST PROGRAM

PUMP	PUMP NO.	TEST PARAMETERS						
		Speed, H	Inlet Pressure P_1	Differential Pressure DELTA P	Flow Rate Q	Vibration Amplitude, V	Bearing Temperature T_b (1)	RRB NO.
Auxiliary Feed	P2A	Yes	Yes	Yes	Yes (3)	Yes	Yes	---
	P2B	Yes	Yes	Yes	Yes (3)	Yes	Yes	---
	P2C	Yes	Yes	Yes	Yes (3)	Yes	Yes	---
Intake Cooling Water	*-P9A	No	Yes	Yes	Yes (3)	Yes	No	2
	*-P9B	No	Yes	Yes	Yes (3)	Yes	No	2
	*-P9C	No	Yes	Yes	Yes (3)	Yes	No	2
Residual Heat Removal	*-P210A	No	Yes	Yes	No (2)	Yes	No	1&3
	*-P210B	No	Yes	Yes	No (2)	Yes	No	1&3
Component Cooling	*-P211A	No	Yes	Yes	Yes (3)	Yes	Yes	---
	*-P211B	No	Yes	Yes	Yes (3)	Yes	Yes	---
	*-P211C	No	Yes	Yes	Yes (3)	Yes	Yes	---
Containment Spray	*-P214A	No	Yes	Yes	No (2)	Yes	Yes	1
	*-P214B	No	Yes	Yes	No (2)	Yes	Yes	1

