

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8706260344 DDC. DATE: 87/06/23 NOTARIZED: NO DOCKET #
 FACIL: 50-250 Turkey Point Plant, Unit 3, Florida Power and Light C 05000250
 AUTH. NAME AUTHOR AFFILIATION
 WOODY, C. O. Florida Power & Light Co.
 RECIP. NAME RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk)


SUBJECT: Lists results of 870608-13 insp of steam generators
 following steam generator tube plugging.


DISTRIBUTION CODE: A047D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1
 TITLE: DR Submittal: Inservice Inspection/Testing

NOTES:

	RECIPIENT ID CODE/NAME	COPIES			RECIPIENT ID CODE/NAME	COPIES	
		LTTR	ENCL			LTTR	ENCL
	PD2-2 LA	1	0		PD2-2 PD	5	5
	McDONALD, D	1					
INTERNAL:	AEOD/DOA	1	1		AEOD/DSP/TPAB	1	1
	ARM/DAF/LFMB	1	0		NRR/DEST/ADE	1	0
	NRR/DEST/MEB	1	1		NRR/DEST/MTB	1	1
	NRR/PMAS/ILRB	1	1		OGC/HDS2	1	0
	REG FILE 01	1	1				
EXTERNAL:	LPDR	1	1		NRC PDR	1	1
	NSIC	1	1				

TOTAL NUMBER OF COPIES REQUIRED: LTTR 19 ENCL 15

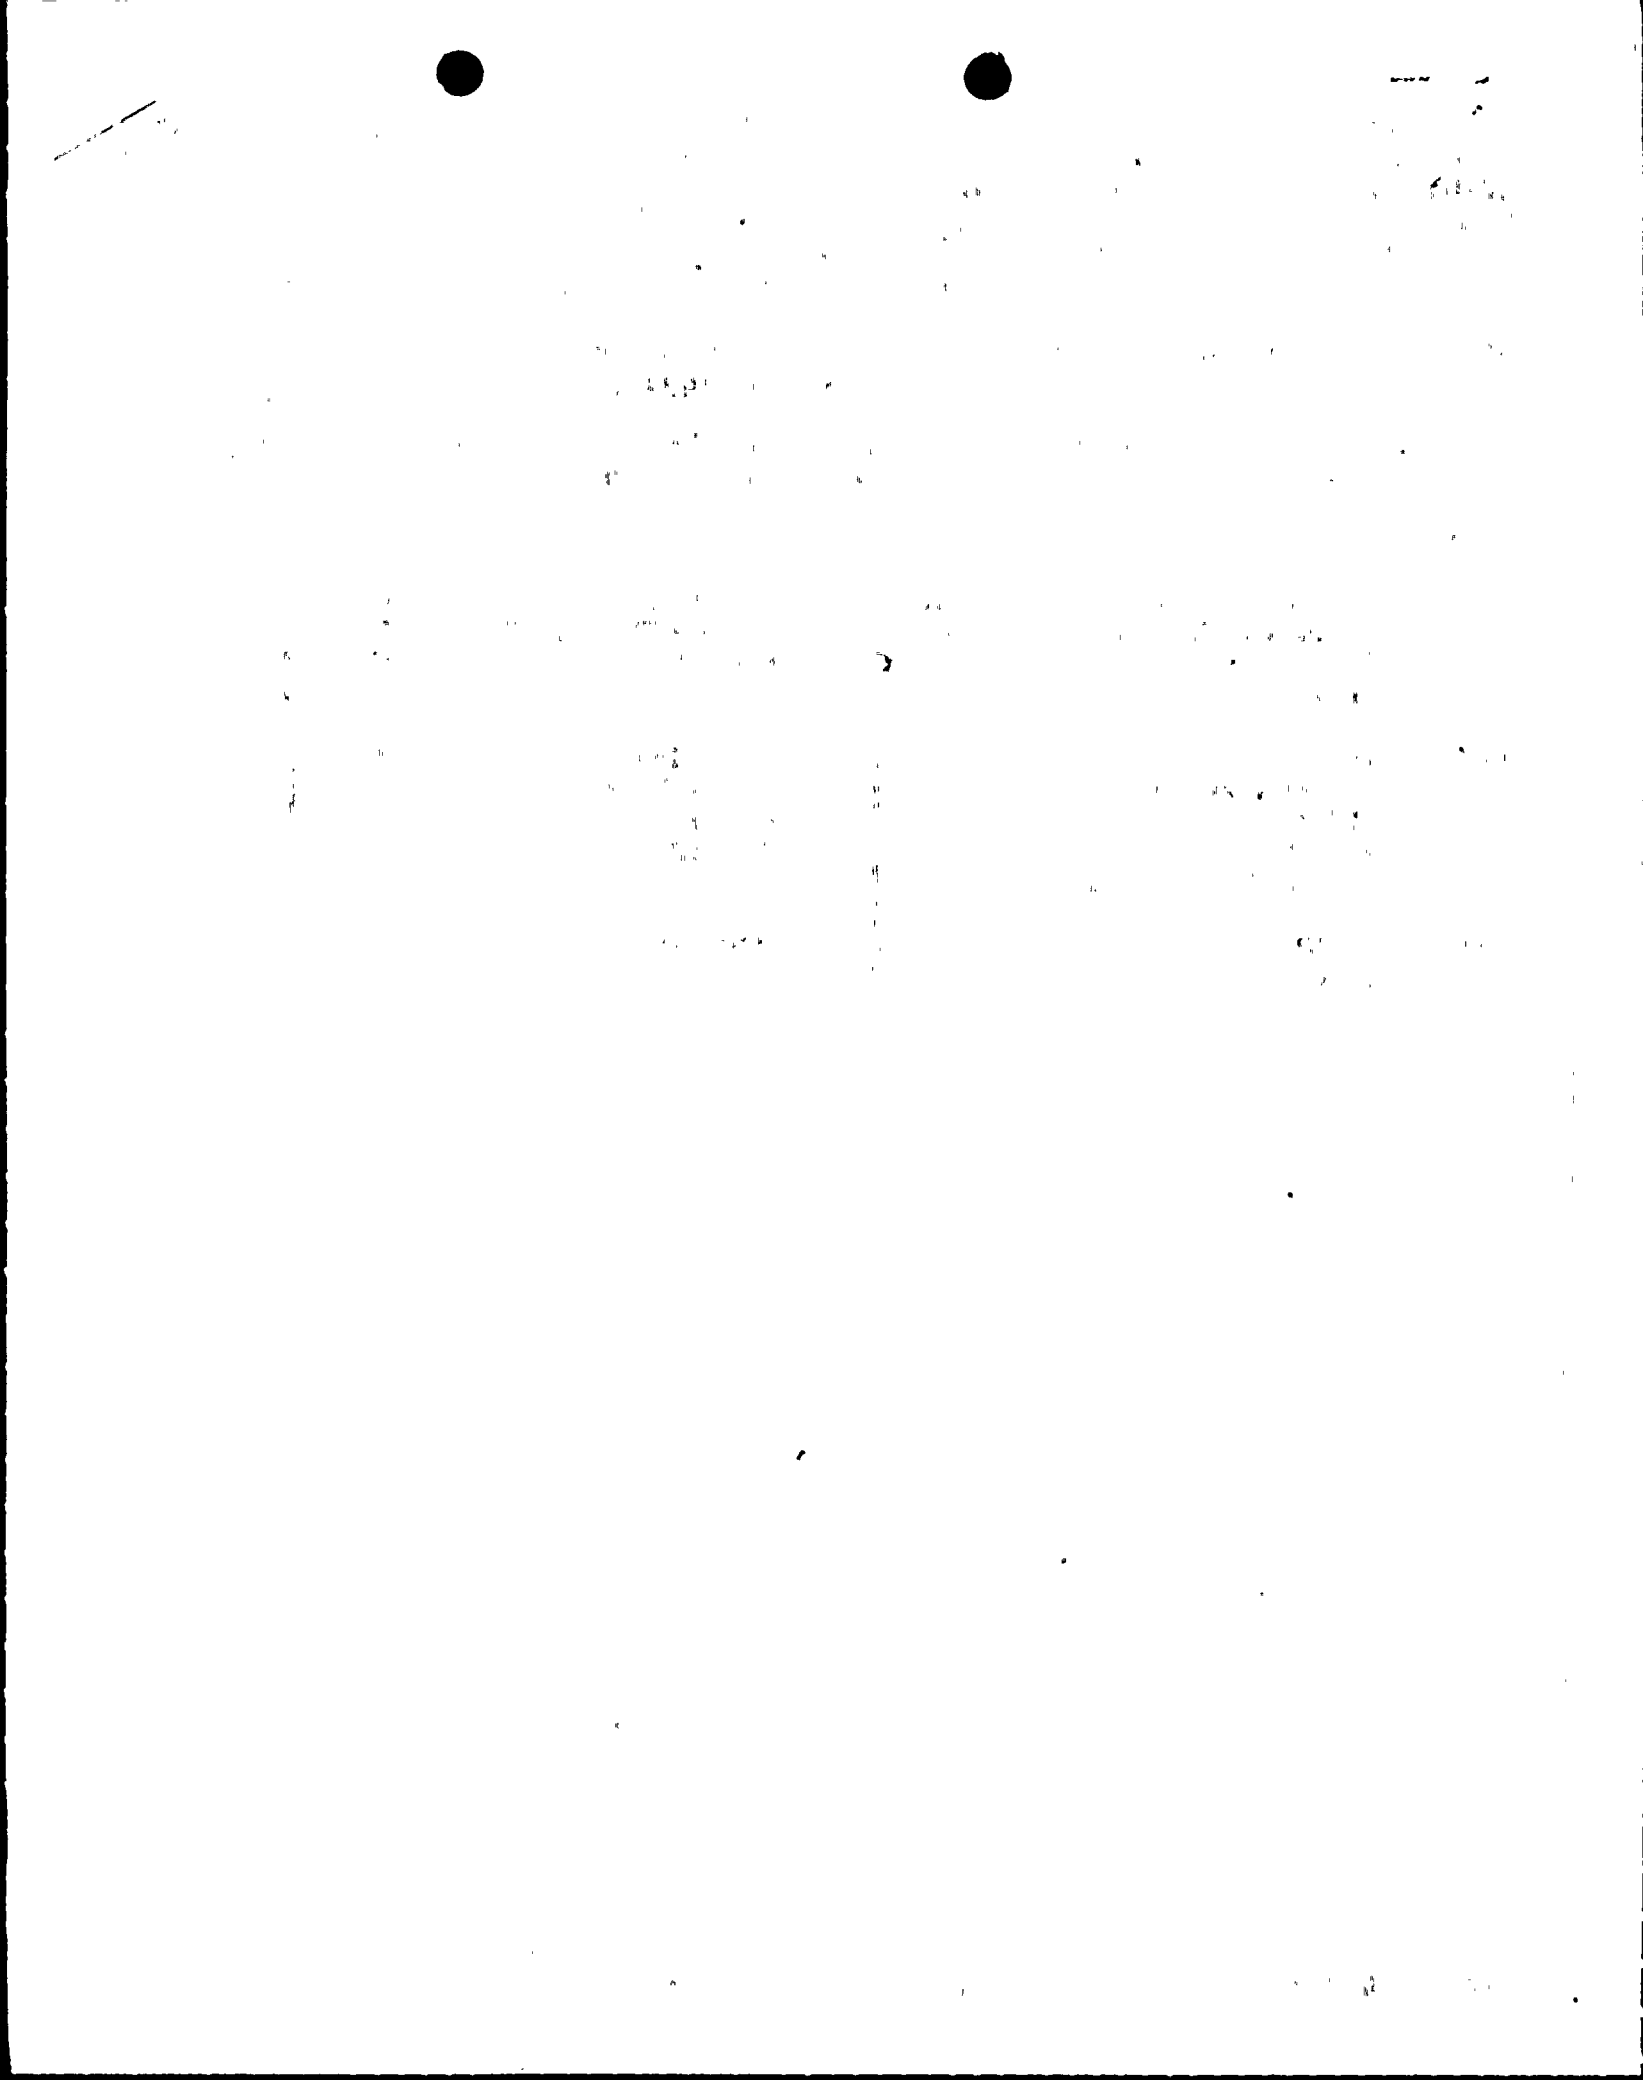

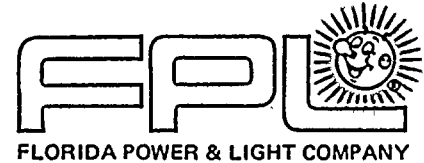

JUNE 23 1987

L-87-254

U. S. Nuclear Regulatory Commission
 Attn: Document Control Desk
 Washington, D. C. 20555

Gentlemen:


Re: Turkey Point Unit 3
 Docket No. 50-250
Technical Specification 4.2.5.5.a. Report

The Turkey Point Unit 3 steam generators were inspected June 8 through 13, 1987. As a result of the inspection the following steam generator tubes were plugged. (The asterisk (*) denotes tubes that were plugged electively as they were non-full length tubes).

	<u>Row</u>	<u>Column</u>
Steam Generator A:	0	
Steam Generator B:	0	
Steam Generator C:	7	5*
	7	13*
	14	89


Should there be any questions, please contact us.

Very truly yours,


 C. O. Woody
 Group Vice President
 Nuclear Energy

COW/SDF/gp

cc: Dr. J. Nelson Grace, Regional Administrator, Region II, USNRC
 Senior Resident Inspector, USNRC, Turkey Point Plant



A047
 1/0

... ..

...

...

...

... ..

... ..

... ..

... ..

...

...

...

...

... ..