

# PRIORITY 1

(ACCELERATED RIDS PROCESSING)

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9510110118      DOC. DATE: 95/10/06      NOTARIZED: NO      DOCKET #  
FACIL: 50-251 Turkey Point Plant, Unit 4, Florida Power and Light C      05000251 P  
AUTH. NAME      AUTHOR AFFILIATION  
PLUNKETT, T.F.      Florida Power & Light Co.  
RECIP. NAME      RECIPIENT AFFILIATION  
EBNETER, S.D.      Region 2 (Post 820201)

SUBJECT: Forwards ISI of four SGs conducted on 941014-17. Informs of  
no SG tubes plugged as result of insp.

DISTRIBUTION CODE: A047D      COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2+7  
TITLE: OR Submittal: Inservice/Testing/Relief from ASME Code - GL-89-04

### NOTES:


	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
	PD2-1 LA	1 1	PD2-1 PD	1 1
	CROTEAU, R	1 1		
INTERNAL:	AEOD/SPD/RAB	1 1	<u>FILE CENTER</u> 01	1 1
	NRR/DE/EMCB	1 1	NRR/DE/EMEB	1 1
	NUDOCS-ABSTRACT	1 1	OGC/HDS3	1 0
	RES/DSIR/EIB	1 1		
EXTERNAL:	LITCO ANDERSON	1 1	NOAC	1 1
	NRC PDR	1 1		

### NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL  
DESK, ROOM OWFN 5D8 (415-2083) TO ELIMINATE YOUR NAME FROM  
DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 13 ENCL 12

may

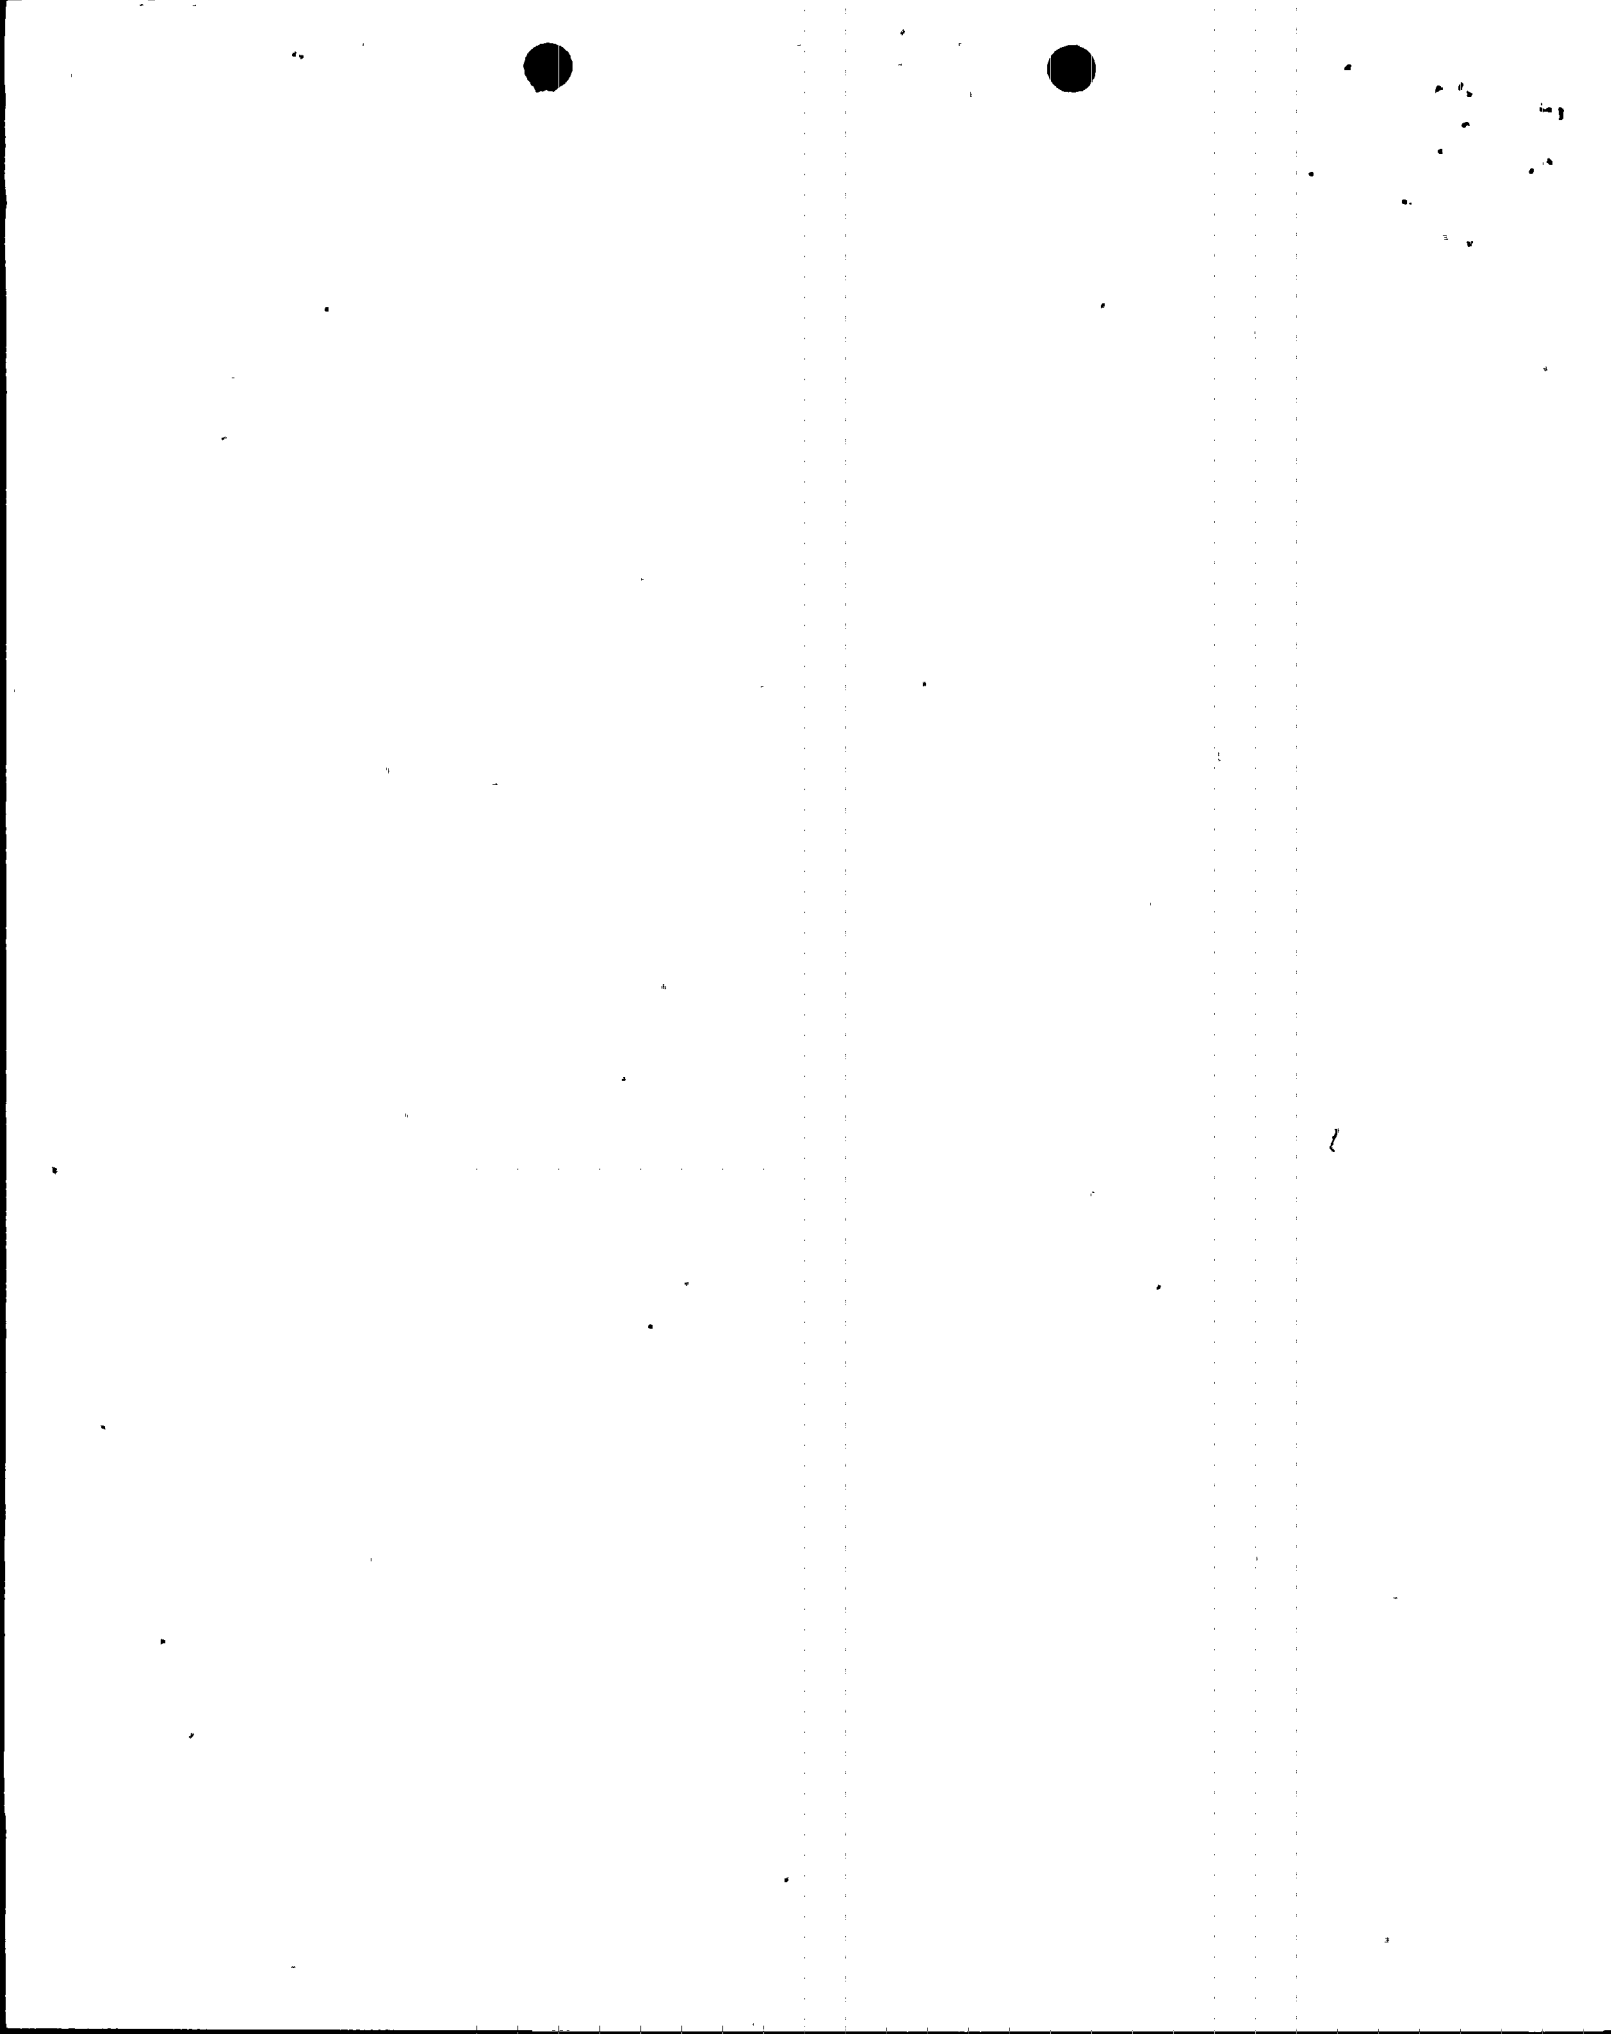



FPL

OCT 06 1995

L-95-268  
10 CFR 50.36

Stewart D. Ebnetter  
Regional Administrator  
U. S. Nuclear Regulatory Commission  
101 Marietta Street, N.W., Suite 2900  
Atlanta, Georgia 30323

Dear Mr. Ebnetter:

Re: Turkey Point Unit 4  
Docket No. 50-251  
Steam Generator Tube Plugging  
Inservice Inspection Report

The Turkey Point Unit 4 steam generators were inspected from October 14, 1994 through October 17, 1994. There were no steam generator tubes plugged as a result of this inspection. In accordance with Technical Specification 4.4.5.5, the attached report summarizes the results of the steam generator tube inservice inspection.

Should there be any questions, please contact us.

Very truly yours,

T. F. Plunkett  
Vice President  
Turkey Point Plant

OIH

cc: USNRC, Document Control Desk, Washington, D.C.  
T. P. Johnson, Senior Resident Inspector, USNRC, Turkey  
Point Plant

100060

A047  
11

