

CATEGORY 1

REGULATOR INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9710100290 DOC. DATE: 97/10/01 NOTARIZED: NO DOCKET #
 FACIL: 50-251 Turkey Point Plant, Unit 4, Florida Power and Light C 05000251
 AUTH. NAME AUTHOR AFFILIATION
 HOVEY, R. J. Florida Power & Light Co.
 RECIP. NAME RECIPIENT AFFILIATION
 REYES, L. A. Region 2 (Post 820201)

SUBJECT: Informs that Unit 4 SG inspected from 970918 through 22 & no
 SG tubes plugged as result of insp.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1
 TITLE: OR Submittal: General Distribution

NOTES:

	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID CODE/NAME		LTTR	ENCL		ID CODE/NAME		LTTR	ENCL
	PD2-3 LA		1	1		PD2-3 PD		1	1
	CROTEAU, R		1	1					
INTERNAL:	<u>FILE CENTER</u>	01	1	1		NRR/DE/ECGB/A		1	1
	NRR/DE/EMCB		1	1		NRR/DRCH/HICB		1	1
	NRR/DSSA/SPLB		1	1		NRR/DSSA/SRXB		1	1
	NUDOCS-ABSTRACT		1	1		OGC/HDS3		1	0
EXTERNAL:	NOAC		1	1		NRC PDR		1	1

REG. II

NOTE TO ALL "RIDS" RECIPIENTS:


PLEASE HELP US TO REDUCE WASTE. TO HAVE YOUR NAME OR ORGANIZATION REMOVED FROM DISTRIBUTION LISTS OR REDUCE THE NUMBER OF COPIES RECEIVED BY YOU OR YOUR ORGANIZATION, CONTACT THE DOCUMENT CONTROL DESK (DCD) ON EXTENSION 415-2083

TOTAL NUMBER OF COPIES REQUIRED: LTTR 14 ENCL 2

C
A
T
E
G
O
R
Y

1

D
O
C
U
M
E
N
T

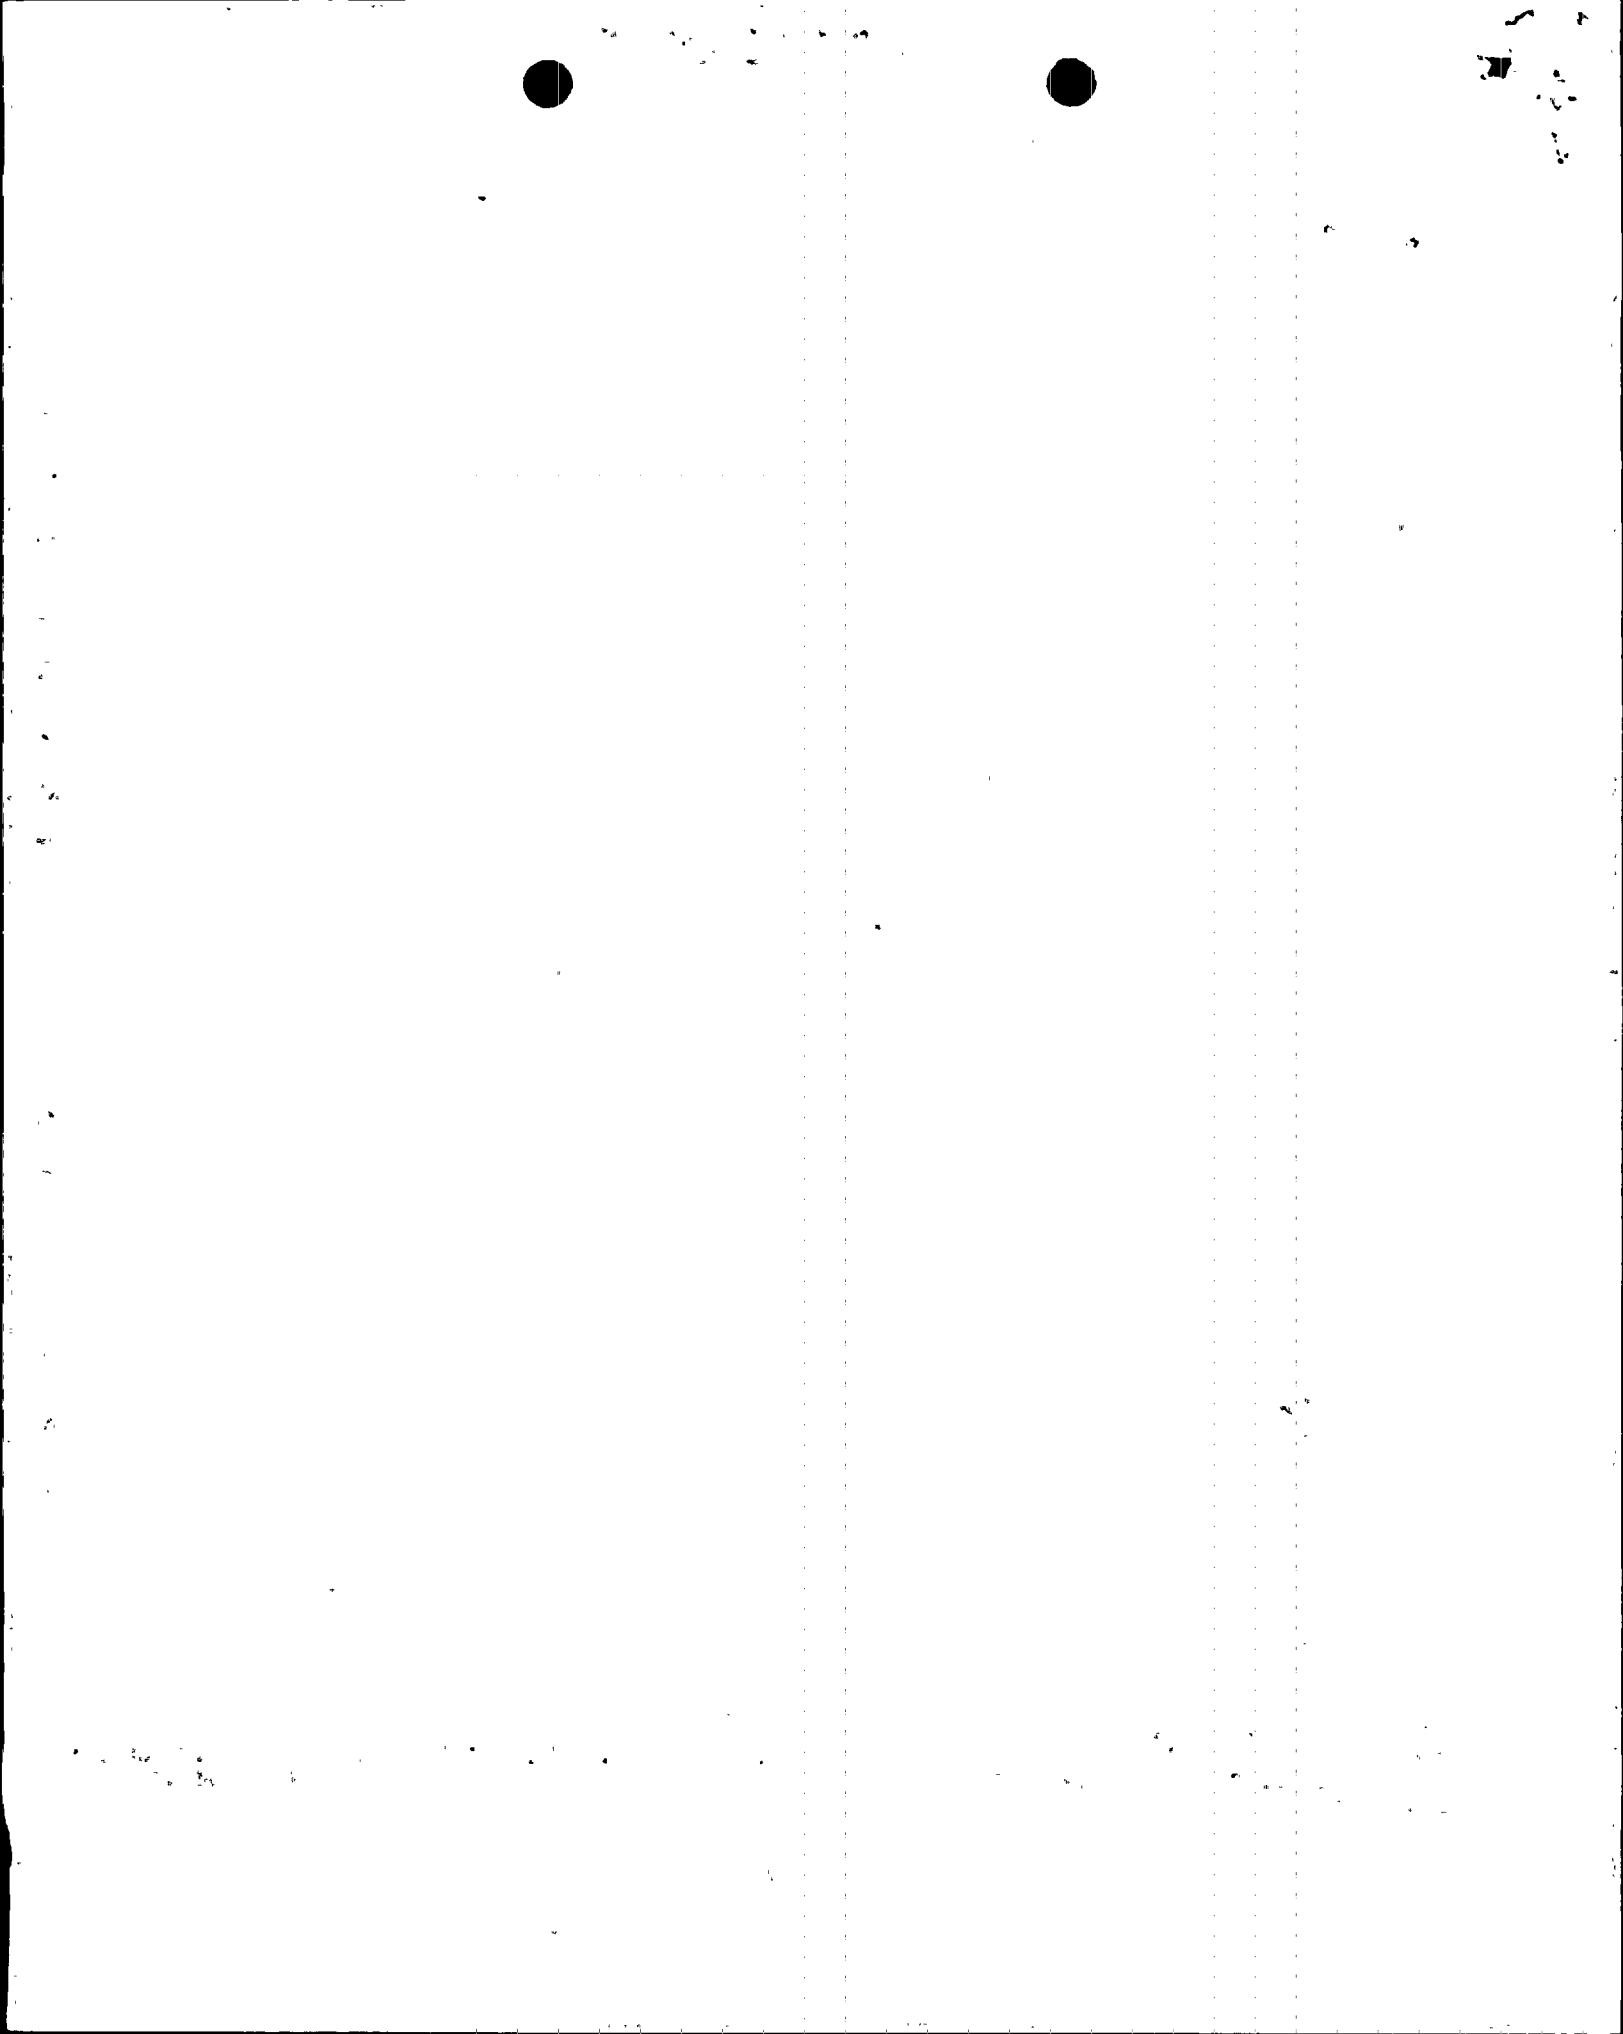



OCT 01 1997

L-97-249
10 CFR 50.36

Luis A. Reyes
Regional Administrator
U. S. Nuclear Regulatory Commission
Atlanta Federal Center
61 Forsyth Street, S. W., Suite 23T85
Atlanta, GA 30303


Dear Mr. Reyes:

Re: Turkey Point Unit 4
Docket No. 50-251
Steam Generator Tube Plugging

The Turkey Point Unit 4 steam generators were inspected from September 18, 1997, through September 22, 1997. There were no steam generator tubes plugged as a result of this inspection. This letter meets the requirements of notification in accordance with Technical Specification 4.4.5.5.a.

Should there be any questions, please contact us.

Very truly yours,


R. J. Hovey
Vice President
Turkey Point Plant

OIH

cc: Document Control Desk, USNRC, Washington, D.C.
T. P. Johnson, Senior Resident Inspector, USNRC, Turkey
Point Plant

9710100290 971001
PDR ADDCK 05000251
Q PDR

100007



10