

# CATEGORY 1

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR:9801060277 DOC.DATE: 97/12/30 NOTARIZED: NO DOCKET #  
 FACIL:50-251 Turkey Point Plant, Unit 4, Florida Power and Light C 05000251  
 AUTH.NAME AUTHOR AFFILIATION  
 HOVEY,R.J. Florida Power & Light Co.  
 RECIP.NAME RECIPIENT AFFILIATION  
 REYES,L.A. Region 2 (Post 820201)

SUBJECT: Forwards "Turkey Point Unit 4 SG Insp Rept," conducted from  
 970918-22.No SG tubes plugged as result of insp.

DISTRIBUTION CODE: A047D COPIES RECEIVED:LTR 1 ENCL 1 SIZE: 1+7  
 TITLE: OR Submittal: Inservice/Testing/Relief from ASME Code - GL-89-04

### NOTES:


	RECIPIENT ID CODE/NAME	COPIES		RECIPIENT ID CODE/NAME	COPIES	
		LTTR	ENCL		LTTR	ENCL
	PD2-3 LA	1	1	PD2-3 PD	1	1
	CROTEAU, R	1	1			
INTERNAL:	AEOD/SPD/RAB	1	1	<b>FILE CENTER 01</b>	1	1
	NRR/DE/EMEB	1	1	NUDOCS-ABSTRACT	1	1
	OGC/HDS3	1	0	RES/DET/EIB	1	1
	RES/DET/EMMEB	1	1			
EXTERNAL:	LITCO ANDERSON	1	1	NOAC	1	1
	NRC PDR	1	1			

### NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE. TO HAVE YOUR NAME OR ORGANIZATION REMOVED FROM DISTRIBUTION LISTS  
 OR REDUCE THE NUMBER OF COPIES RECEIVED BY YOU OR YOUR ORGANIZATION, CONTACT THE DOCUMENT CONTROL  
 DESK (DCD) ON EXTENSION 415-2083

TOTAL NUMBER OF COPIES REQUIRED: LTTR 13 ENCL 12

C  
A  
T  
E  
G  
O  
R  
Y  
  
1  
  
D  
O  
C  
U  
M  
E  
N  
T

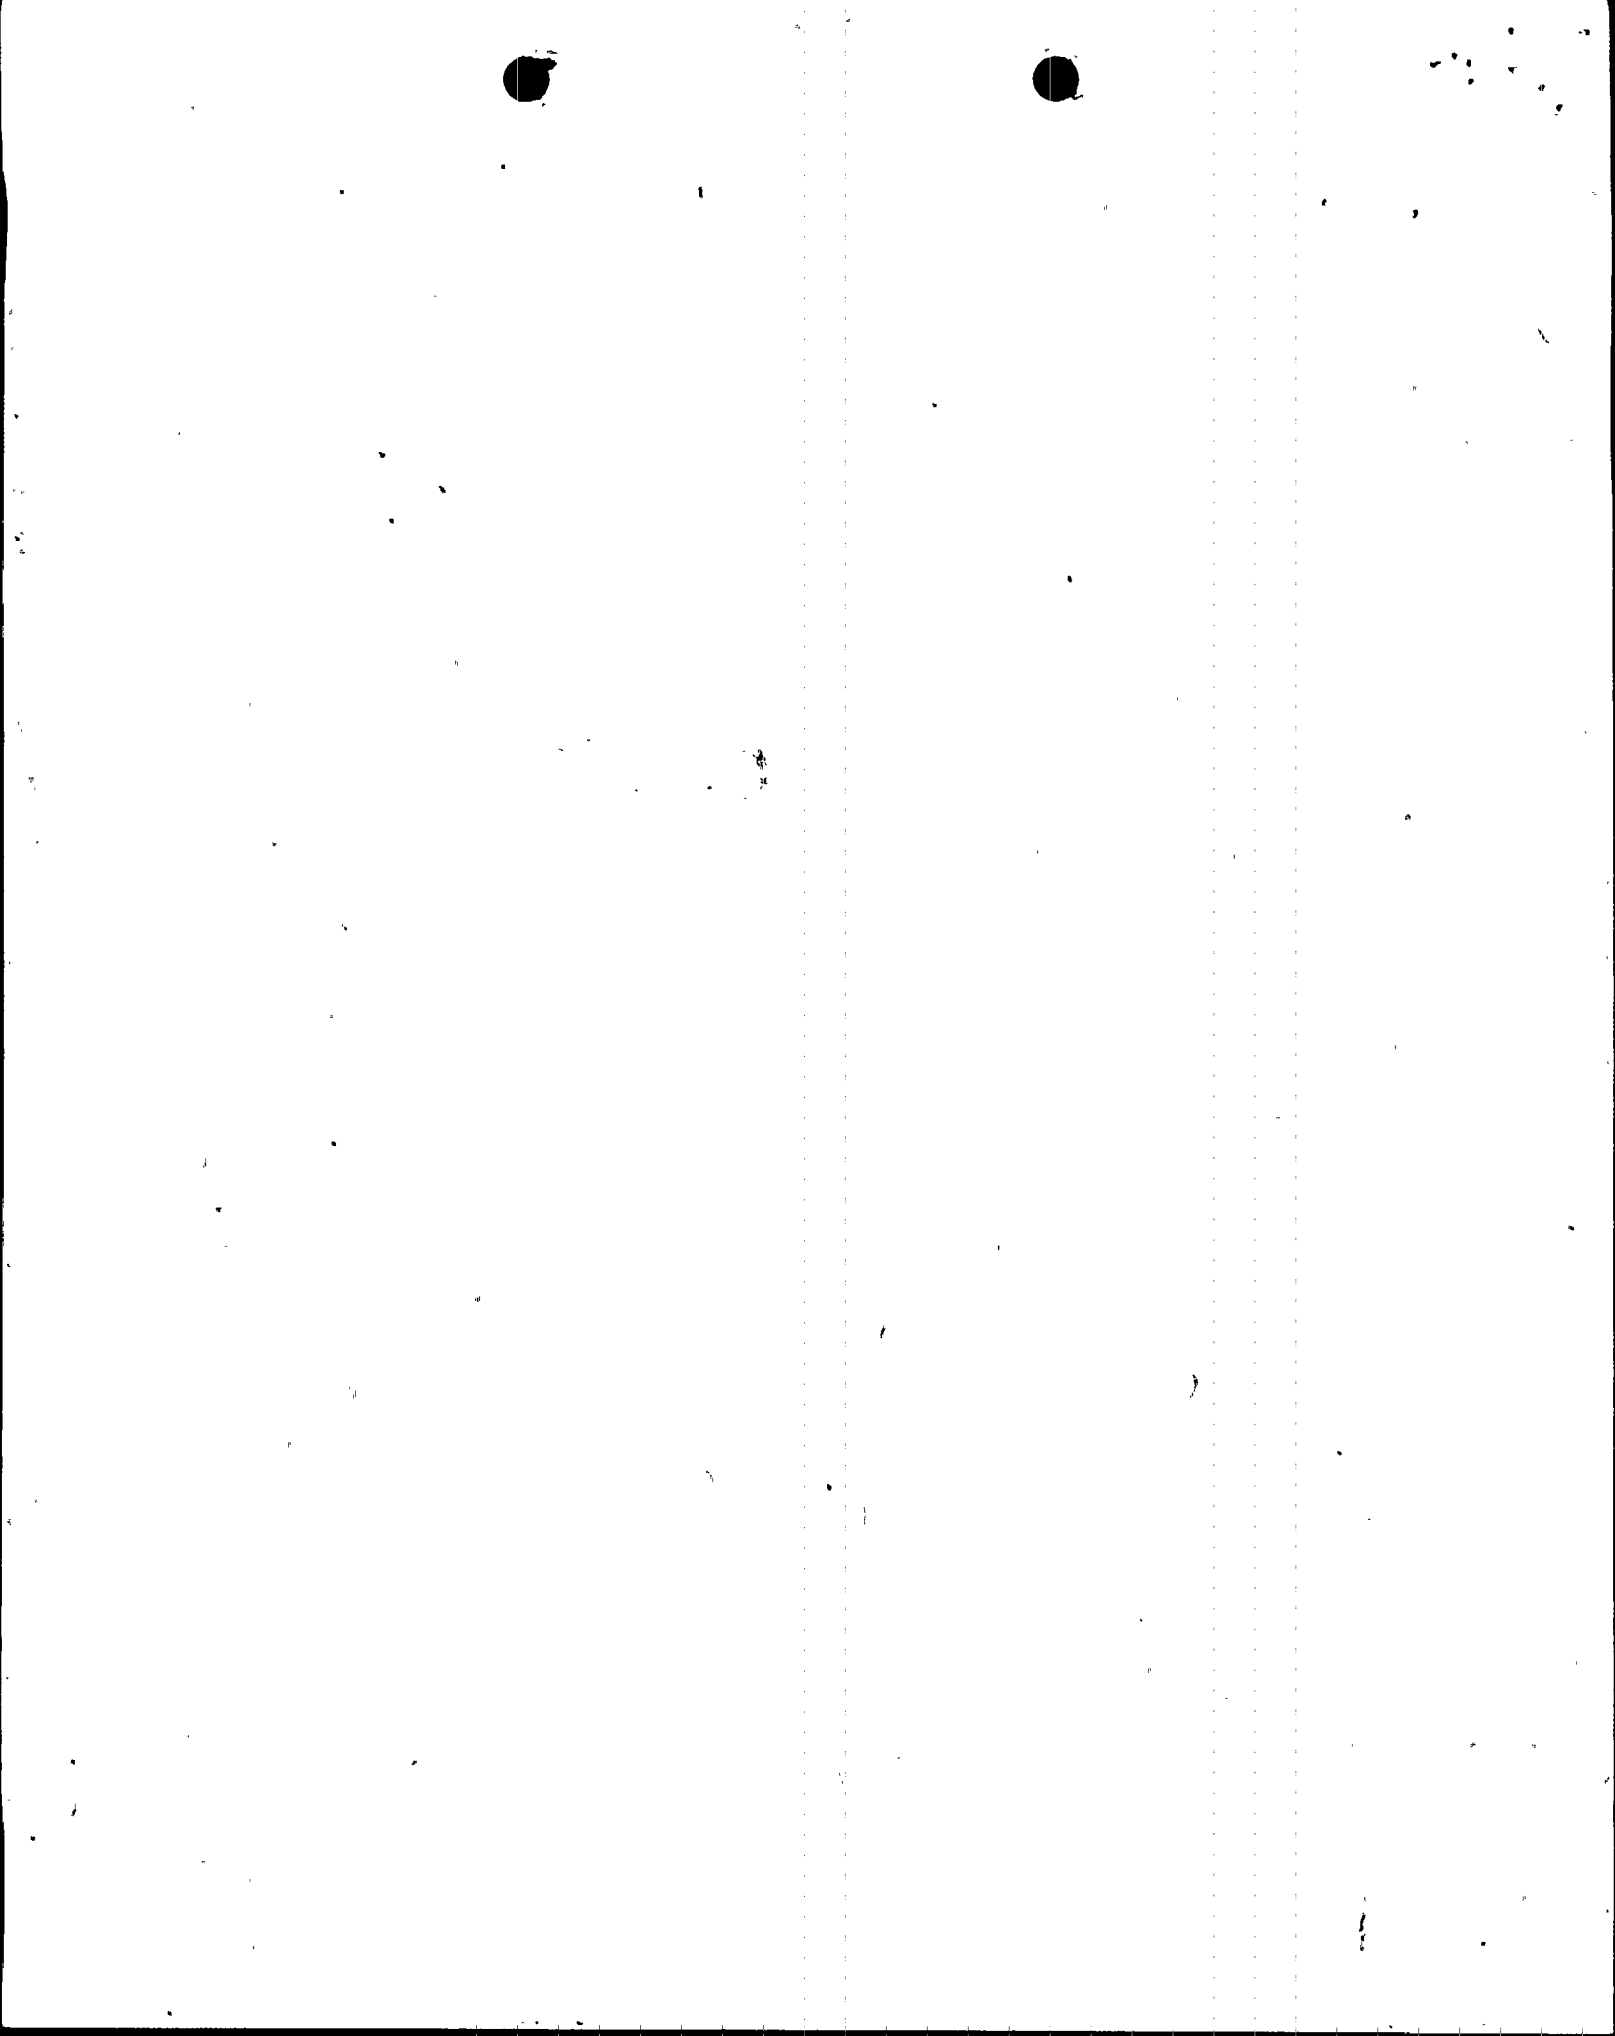



FPL

DEC 30 1997

L-97-307  
10 CFR 50.36

Luis A. Reyes  
Regional Administrator  
U. S. Nuclear Regulatory Commission  
Atlanta Federal Center  
61 Forsyth Street, S. W., Suite 23T85  
Atlanta, GA 30303

Dear Mr. Reyes:

Re: Turkey Point Unit 4  
Docket No. 50-251  
Steam Generator Tube Plugging  
Inservice Inspection Report

The Turkey Point Unit 4 steam generators were inspected from September 18, 1997 through September 22, 1997. There were no steam generator tubes plugged as a result of the inspection. In accordance with Technical Specification 4.4.5.5.b, the attached report summarizes the results of the steam generator tube inservice inspection.

Should there be any questions, please contact us.

Very truly yours,

*MIL*

R. J. Hovey  
Vice President  
Turkey Point Plant

Attachment

OIH

cc: USNRC, Document Control Desk, Washington, D.C.  
T. P. Johnson, Senior Resident Inspector, USNRC, Turkey  
Point Plant

9801060277 971230  
PDR ADDCK 05000251  
Q PDR

060026



