DWG. NO. SK-98002 19-M-2005

Completion of Construction - 41 of 41

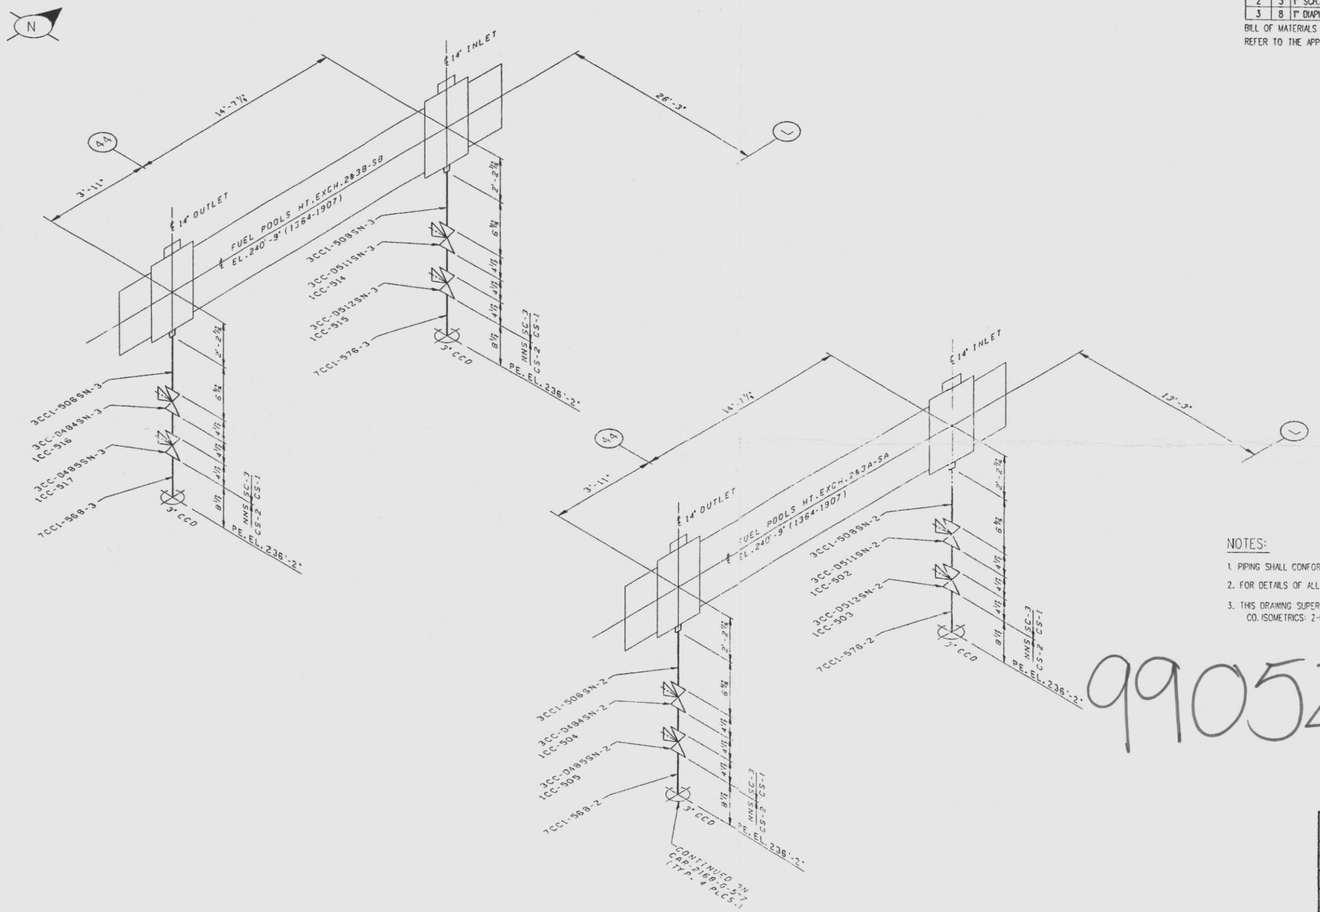

BILL OF MATERIAL					
PC.NO.	QTY.	DESCRIPTION	ASTM NO.	GRADE	COMMENTS
1	4'	1" SCH.80 SMLS. PIPE	SA-106	B	SPEC. CS-1
2	3'	1" SCH.80 SMLS. PIPE	A-53	B	SPEC. CS-2
3	8	1" DIAPHRAGM VALVE			1364-5210

BILL OF MATERIALS QUANTITIES ARE FOR NEW CONSTRUCTION ONLY.
REFER TO THE APPLICABLE PIPE CODE FOR ACCEPTABLE MATERIAL SUBSTITUTION.

NOTES:

1. PIPING SHALL CONFORM TO GENERAL POWER PIPING SPECIFICATION CAR-SH-M-30.
2. FOR DETAILS OF ALL VALVES REFER TO 1364-5210.
3. THIS DRAWING SUPERCEDES THE FOLLOWING SOUTHWEST FABRICATING & WELDING CO. ISOMETRICS: 2-CC-5, 2-CC-6, 3-CC-13, & 3-CC-14.

990520002 3

ESR No. 98-00219
Revision No. 0
Page No. 10.8

REV	DATE	DESCRIPTION	DWN	CHK	APPR'D
A	3/4/99	ISSUED FOR CONSTRUCTION ESR 98-00219	TCC	DHL	DWP

PROFESSIONAL ENGINEER:
QUALITY LEVEL: SAFETY RELATED IN PART
CAROLINA POWER & LIGHT COMPANY
NUCLEAR ENGINEERING DEPARTMENT
CP&L
PLANT: SHEARON HARRIS UNIT 1
SCALE: NONE
TITLE: FUEL HANDLING BUILDING PIPING
COMPONENT COOLING WATER SYSTEM
FUEL POOLS HT. EXCHGR. DRAINS
PLANT DWG NO.: 2-CC-005
REV:
SHT:
FOR SHEET NO.: SK-98002 19-M-2005
SHT:

file: 219m005.dgn

990520002-01
04/24/99

APERTURE CARD

D

990520002 3