

50-220

NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL

FILE NUMBER
INCIDENT REPORT

TO:

Mr. James P. O'Reilly

FROM:

Niagara Mohawk Pwr. Corp.
Syracuse, New York
R. R. Schneider

DATE OF DOCUMENT

6/2/77

DATE RECEIVED

6/13/77

☒ LETTER☐ NOTORIZED

PROP

INPUT FORM

NUMBER OF COPIES RECEIVED

☒ ORIGINAL☒ UNCLASSIFIED☐ COPY

151620

DESCRIPTION

ACKNOWLEDGED

DO NOT REMOVE

PLANT NAME:

Nine Mile Point Unit No. 1

(1-P)

RJL

ENCLOSURE

Licensee Event Report (RO 50-220/77-27) on
5/19/77 concerning an unacceptable linear
PT indication being found in the pipe at the
safe end to pipe weld joint.....NOTE: IF PERSONNEL EXPOSURE IS INVOLVED
SEND DIRECTLY TO KREGER/J. COLLINS

FOR ACTION/INFORMATION

BRANCH CHIEF:

LEARN

W/3 CYS FOR ACTION

LIC. ASST.:

PARRISH

W/1 CYS

ACRS 16 CYS HOLDING/SENT AS CFTB

INTERNAL DISTRIBUTION

REG FILE

NRC PDR

I.-E (2)

MIPC

SCHROEDER/IPPOLITO

HOUSTON

NOVAK/CHECK

GRIMES

BUTLER

HANAUER

TEDESCO/MACCARY

EISENHUT

BAER

SHAO

VOLLMER/BUNCH

KREGER/J. COLLINS

EXTERNAL DISTRIBUTION


LPDR: OSWEGO NY

TIC:

NSIC:

CONTROL NUMBER


771660036

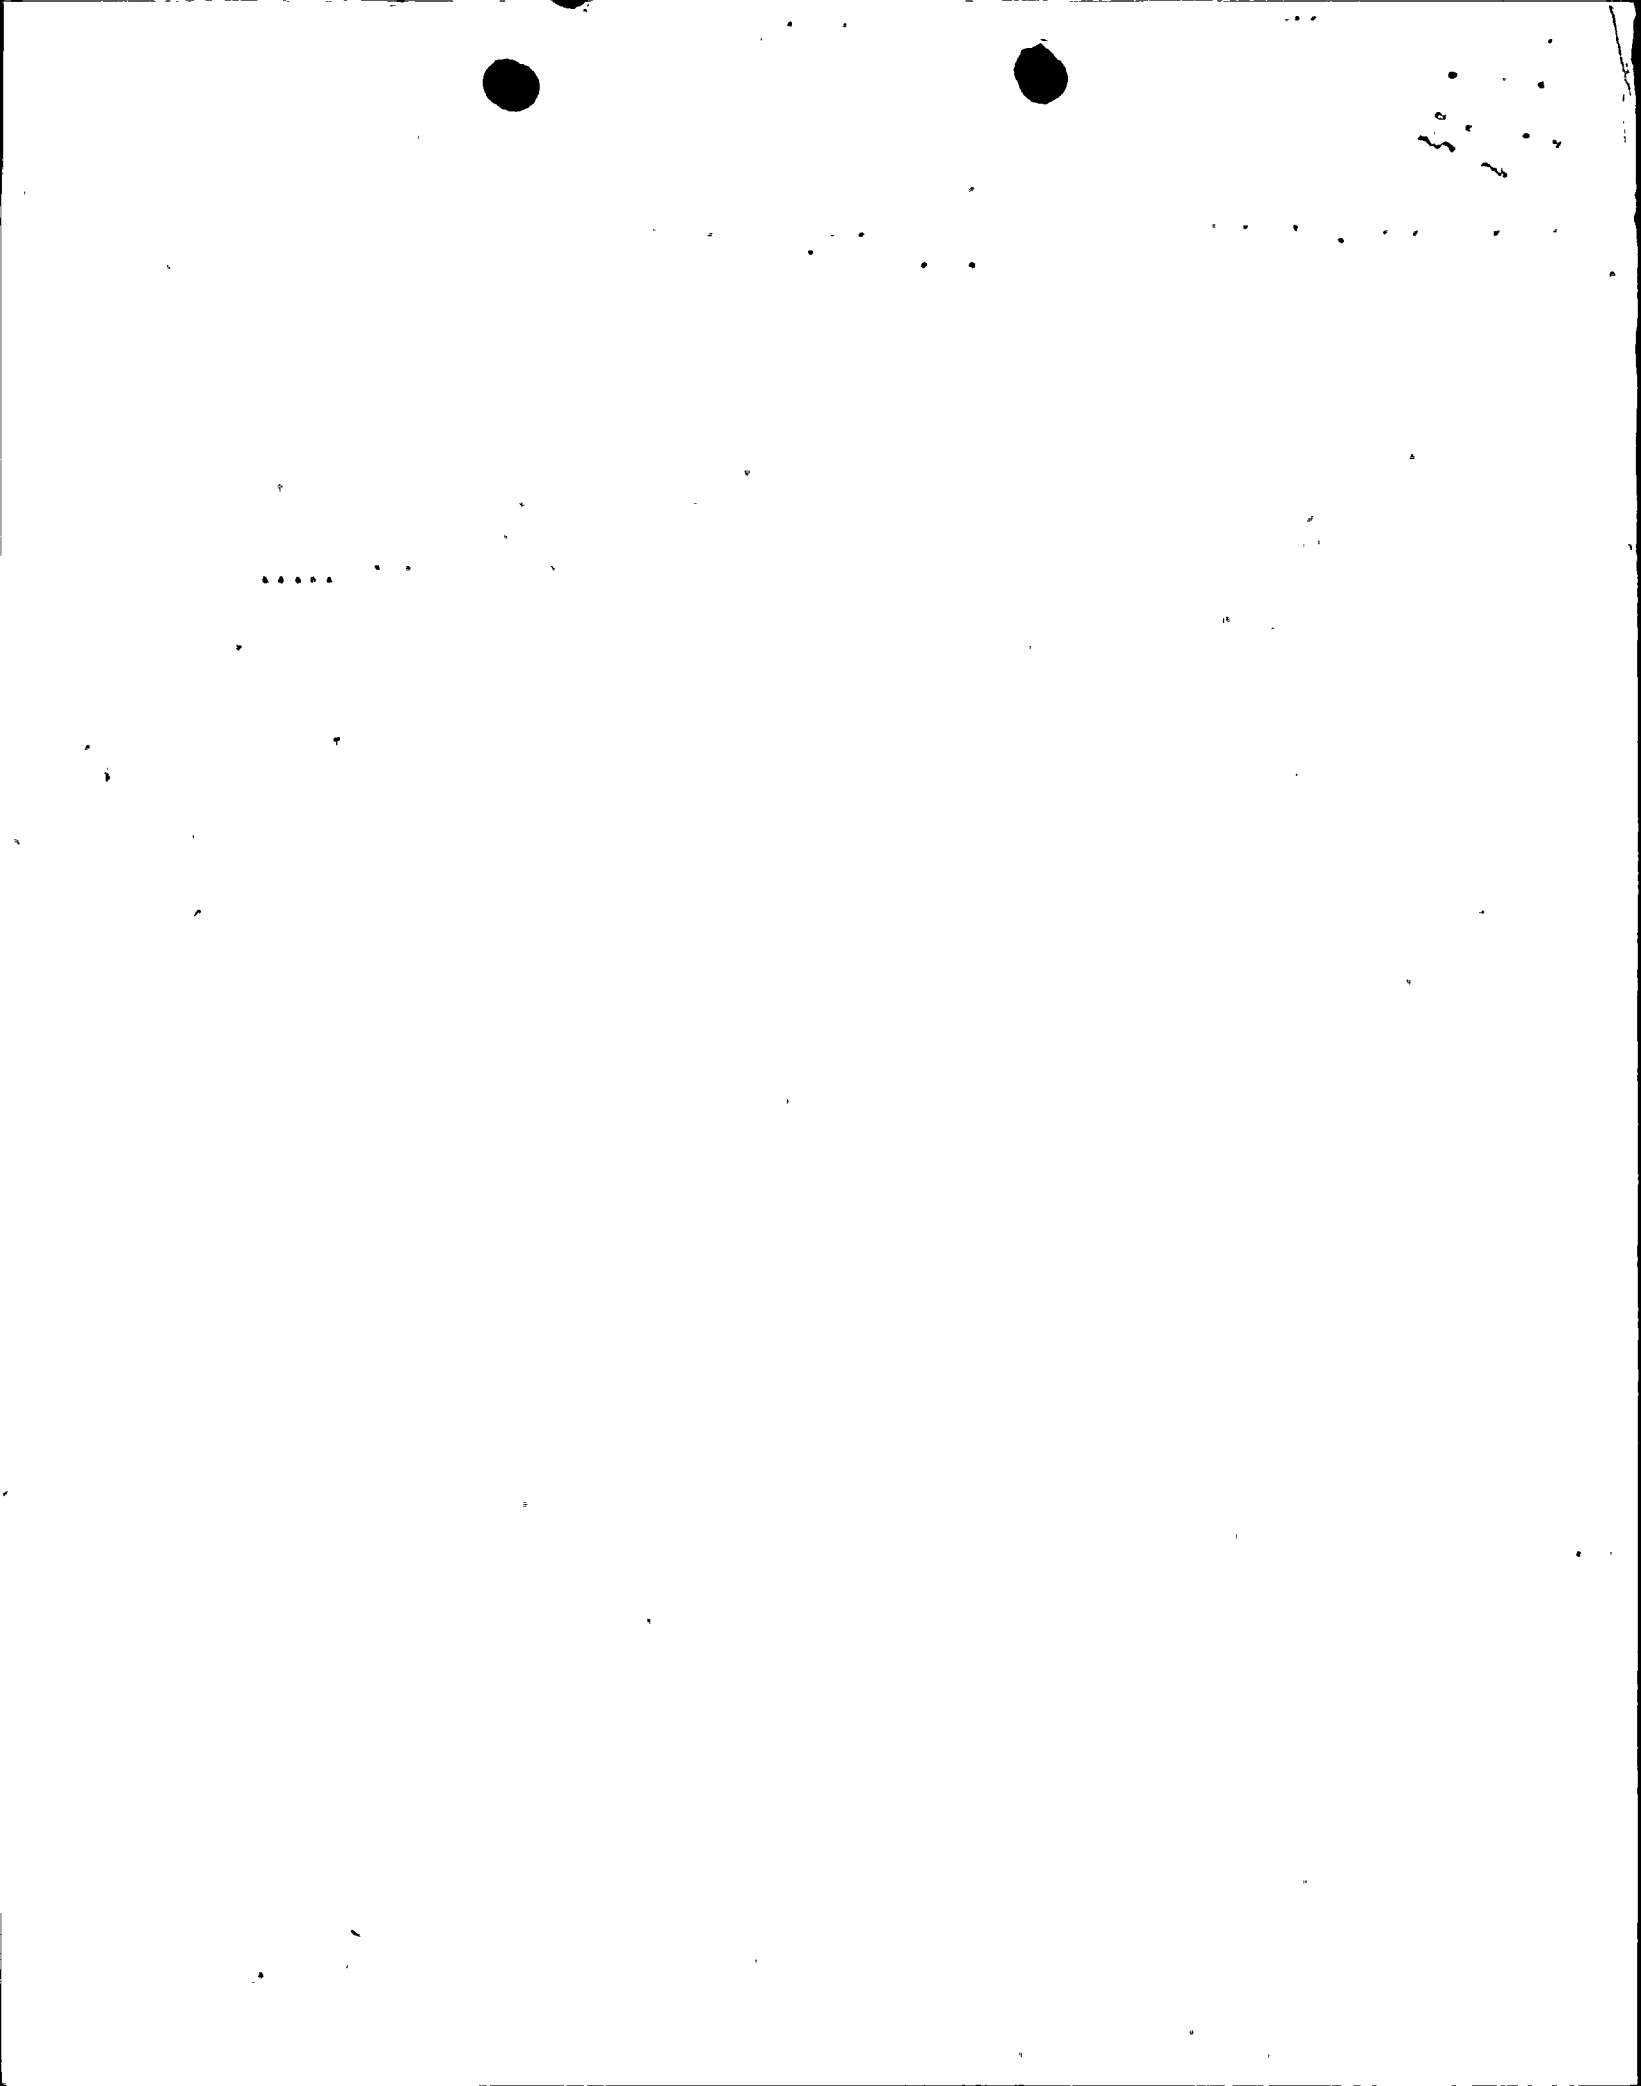

NIAGARA MOHAWK POWER CORPORATION

NIAGARA  MOHAWK300 ERIE BOULEVARD, WEST
SYRACUSE, N. Y. 13202

June 2, 1977

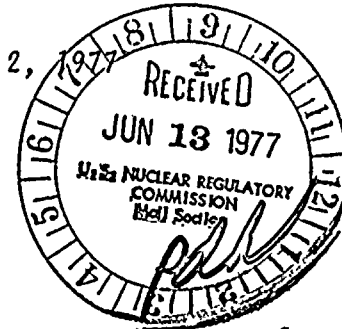

Mr. James P. O'Reilly
Director
United States Nuclear Regulatory Commission
Region I
631 Park Avenue
King of Prussia, PA. 19406

RE: Docket No. 50-220


REGULATORY DOCKET FILE COPY.

Dear Mr. O'Reilly:

In accordance with Nine Mile Point Nuclear Station Unit #1
Technical Specifications, we hereby submit Licensee Event Report
LER 77-27.

This report was completed in the format designated in the
Licensee Event Report Instruction Booklet 00E-SS-001, dated
October 1974, revised December 8, 1975.

Very truly yours,



R.R. Schneider
Vice President -
Electric Production

TWR/mtm

Attachment

771660036

LICENSEE EVENT REPORT

CONTROL BLOCK: 1 2 3 4 5 6

(PLEASE PRINT ALL REQUIRED INFORMATION)

LICENSEE NAME														LICENSE NUMBER										LICENSE TYPE					EVENT TYPE	
01	N	Y	N	M	P	1									4	1	1	1	1	0	1									
7	8	9				14	15								25	26	27	28	29	30	31	32								
<div style="display: flex; justify-content: space-between;"> CS 0 0 0 0 0 0 1 </div>																														
CATEGORY		REPORT TYPE		REPORT SOURCE		DOCKET NUMBER										EVENT DATE					REPORT DATE									
01		CONT		7		L		0 5 0 0 2 2 0										0 5 1 9 7 7					0 6 0 2 7 7							
7	8	57	58	59	60	61									68	69					74	75					80			

EVENT DESCRIPTION

02	During preplanned inservice inspection of reactor vessel emergency condenser steam																							80
03	outlet nozzle, an unacceptable linear PT indication was found in the pipe at the																							80
04	safe end to pipe weld joint. In grinding out this indication, it was necessary to																							80
05	grind through the entire pipe wall. The 90° pipe elbow was removed and replaced																							80
06	in kind. LER 77-27																							80

SYSTEM CODE		CAUSE CODE		COMPONENT CODE					PRIME COMPONENT SUPPLIER		COMPONENT MANUFACTURER				VIOLATION		
07	C	E	F	Z	Z	Z	Z	Z	Z	Z	Z	Z	Z	Z	Z	Z	
7	8	9	10	11	12						43	44				47	48

CAUSE DESCRIPTION

08	Unknown																							80
09																								80
10																								80

FACILITY STATUS		% POWER		OTHER STATUS					METHOD OF DISCOVERY		DISCOVERY DESCRIPTION															
11	H	0	0	0	NA					b	Inservice Inspection															
7	8	9	10	11	12	13				44	45	46														80
FORM OF ACTIVITY RELEASED		CONTENT OF RELEASE		AMOUNT OF ACTIVITY					LOCATION OF RELEASE																	
12	Z	Z	NA					NA																		
7	8	9	10	11						44	45														80	

PERSONNEL EXPOSURES

NUMBER		TYPE		DESCRIPTION																					
13	0	0	0	Z	NA																				
7	8	9	11	12	13																				80

PERSONNEL INJURIES

NUMBER		DESCRIPTION																							
14	0	0	0	NA																					
7	8	9	11	12																					80

OFFSITE CONSEQUENCES

15	NA																							80
----	----	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	----

LOSS OR DAMAGE TO FACILITY

TYPE		DESCRIPTION																							
16	Z	NA																							
7	8	9	10																						80

PUBLICITY

17	NA																							80
----	----	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	----

ADDITIONAL FACTORS

18	NA																							80
19																								80

NAME: _____ PHONE: _____

RECEIVED DOCUMENT
PROCESSING UNIT

1977 JUN 13 AM 10 28

6 JUN 77 12: 03

USNRC-REG. 1-