


BFN-16

Figure 7.12-1

Deleted by Amendment 7.

[illegible]

AMENDMENT 27


POWERHOUSE
UNITS 2 & 0


BROWNS FERRY NUCLEAR PLANT
FINAL SAFETY ANALYSIS REPORT


RADIATION MONITORING SYSTEM
MECHANICAL CONTROL DIAGRAM


FIGURE 7.12-2a SH 2


7738 9-08-0193(P-C) IV 1/9

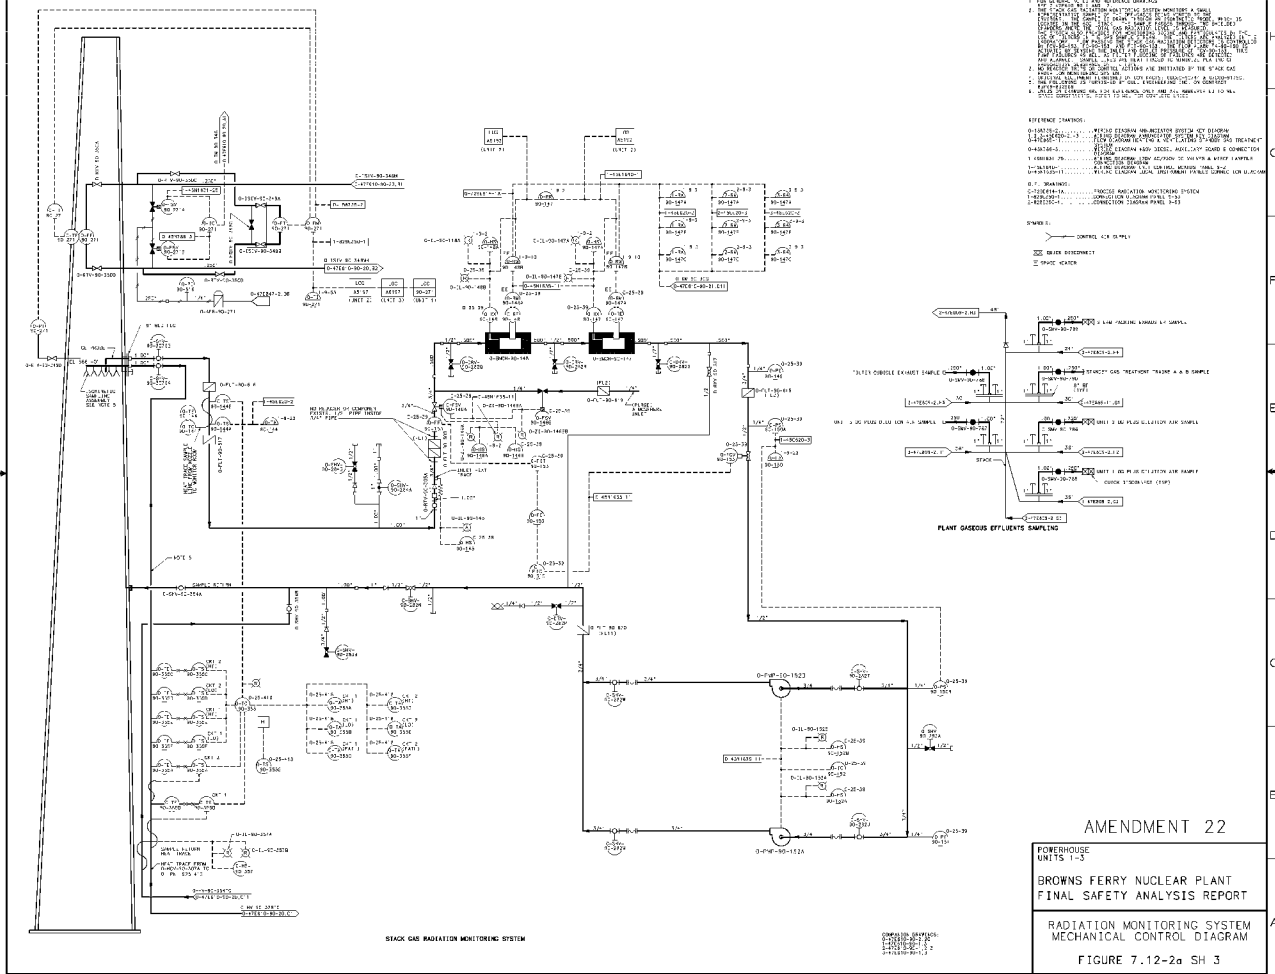

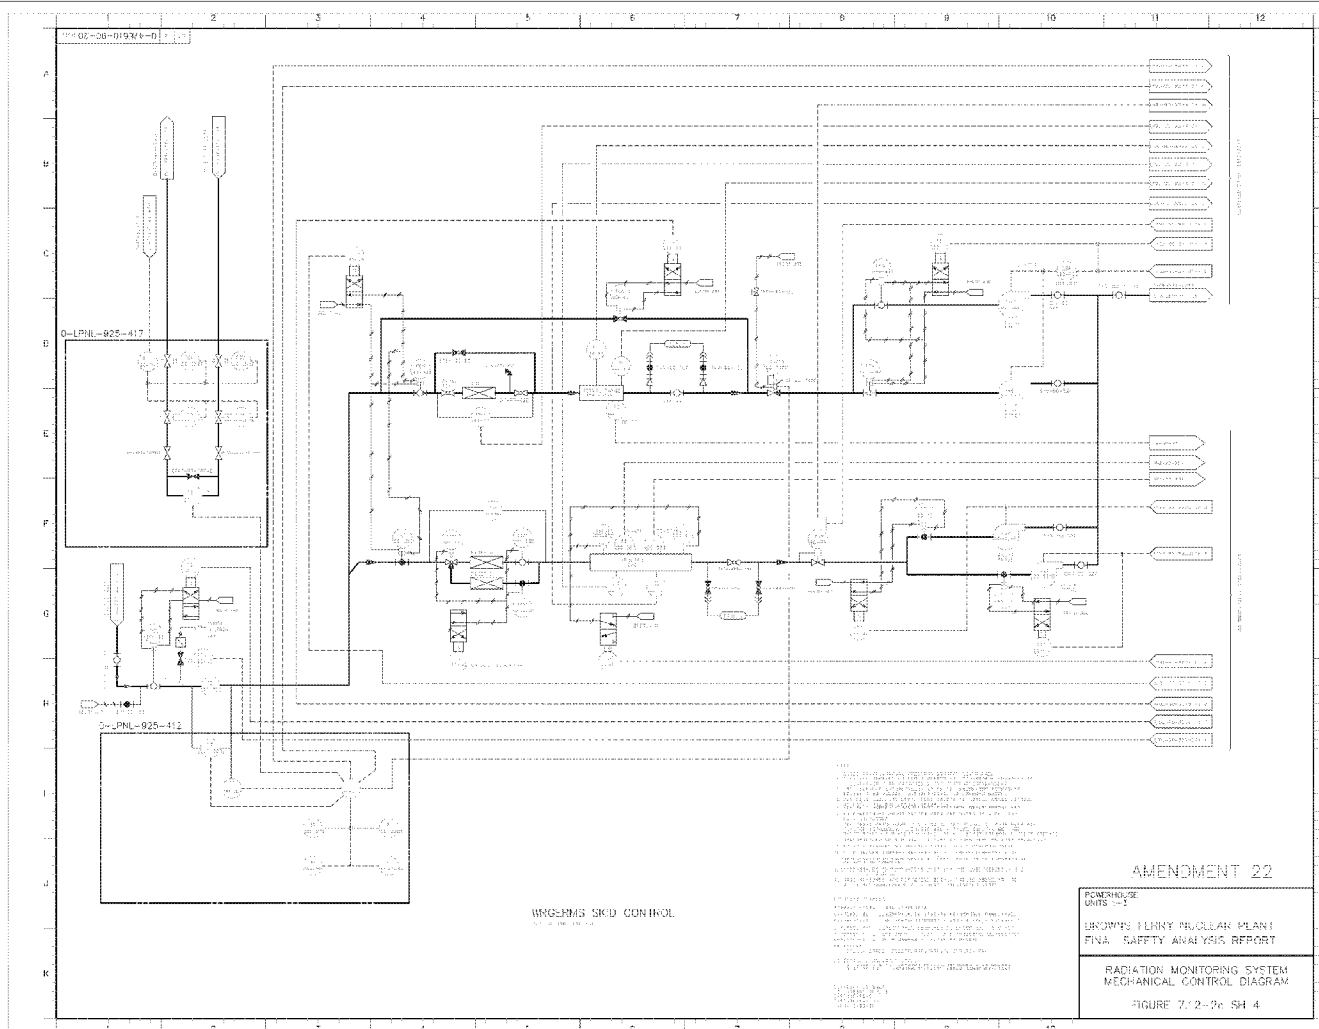

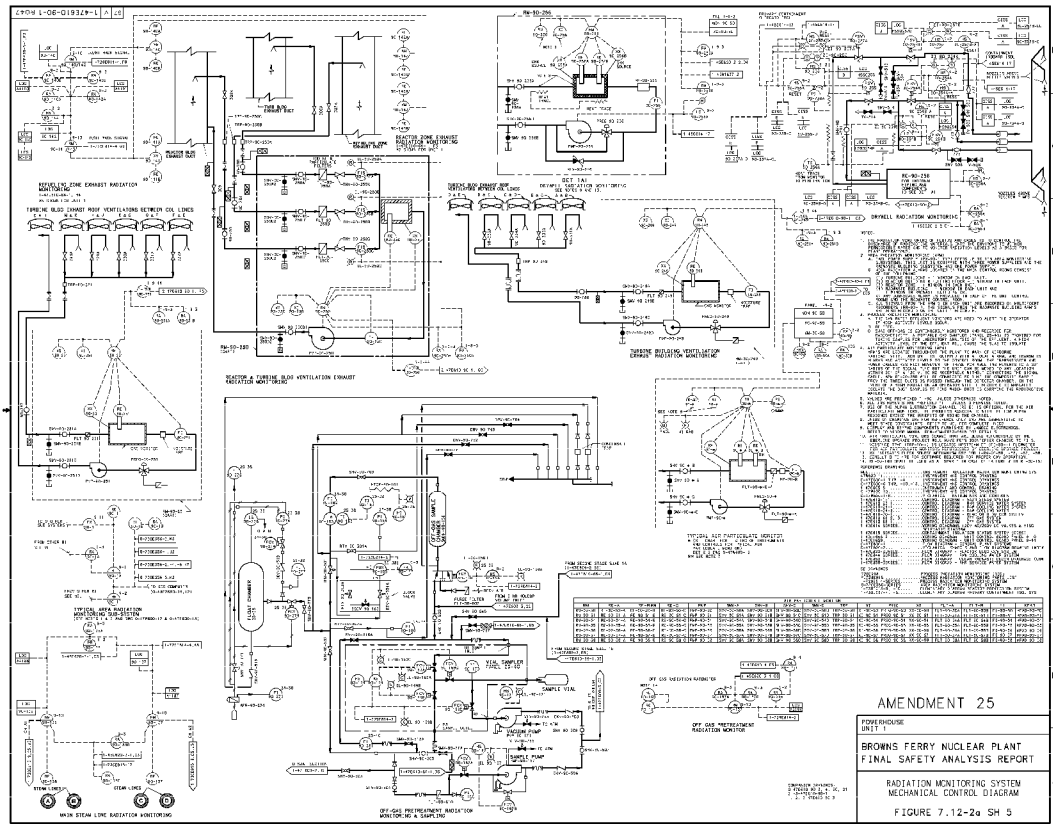

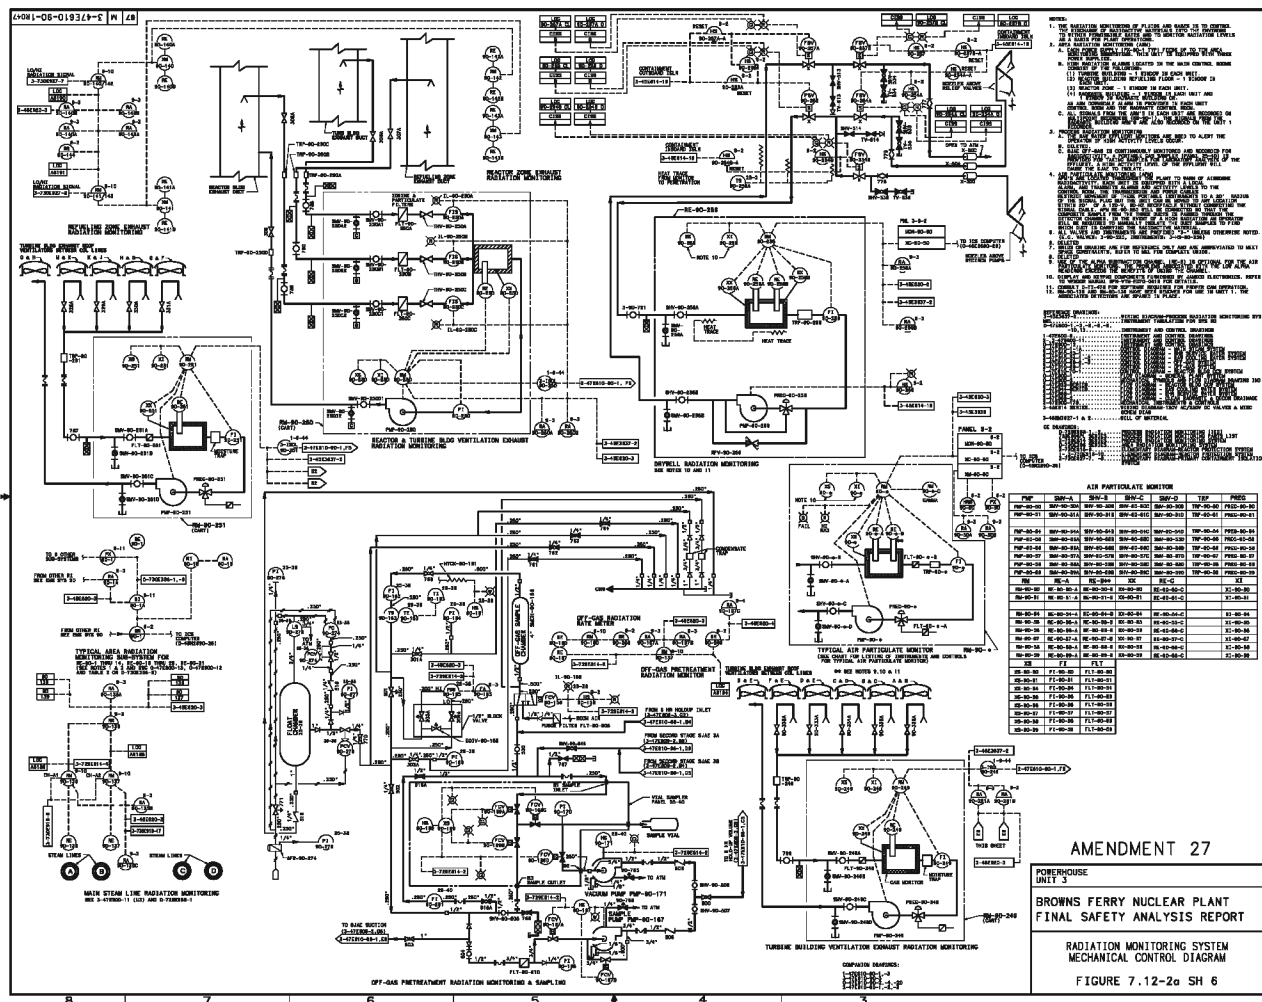


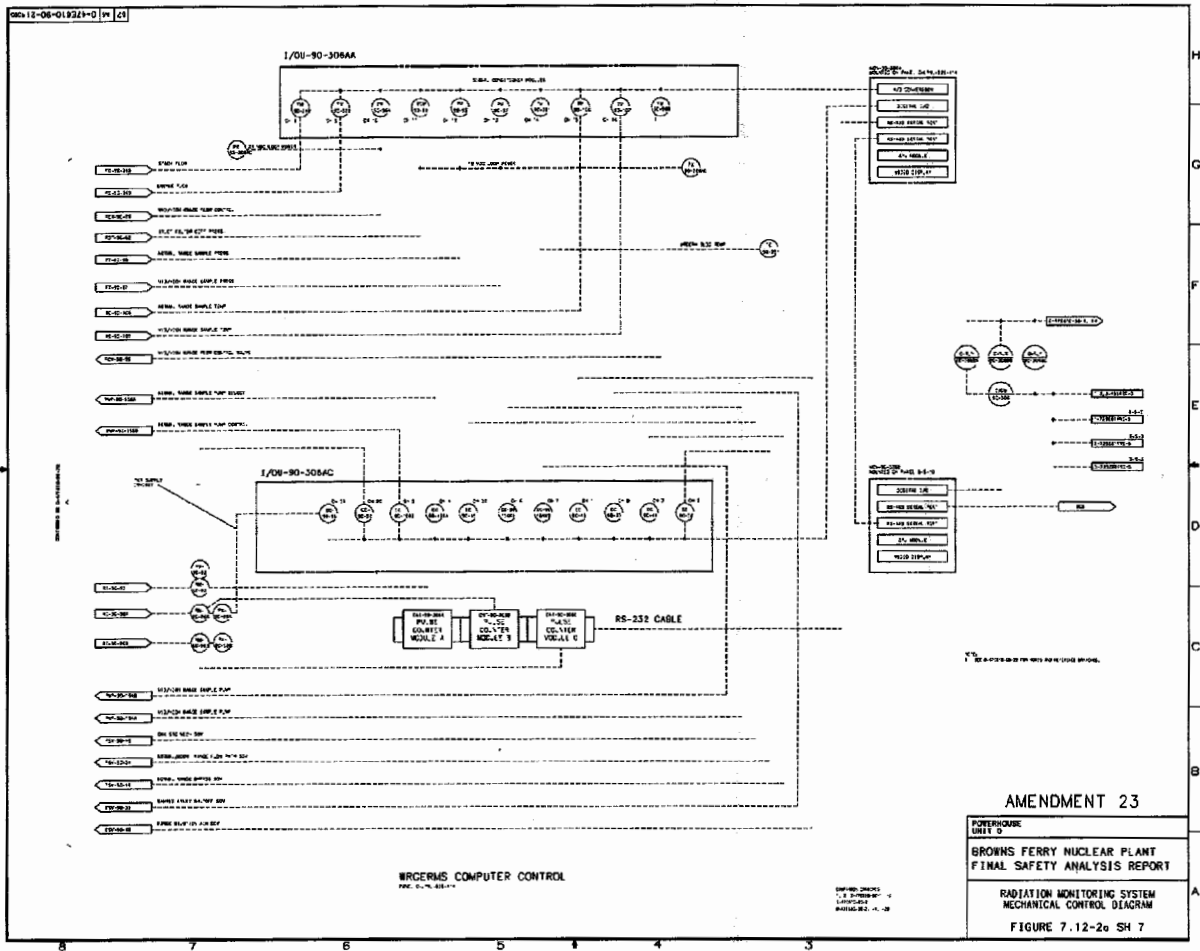

BFN-19

Figure 7.12-2b Sheet 1


(Deleted by Amendment 17)

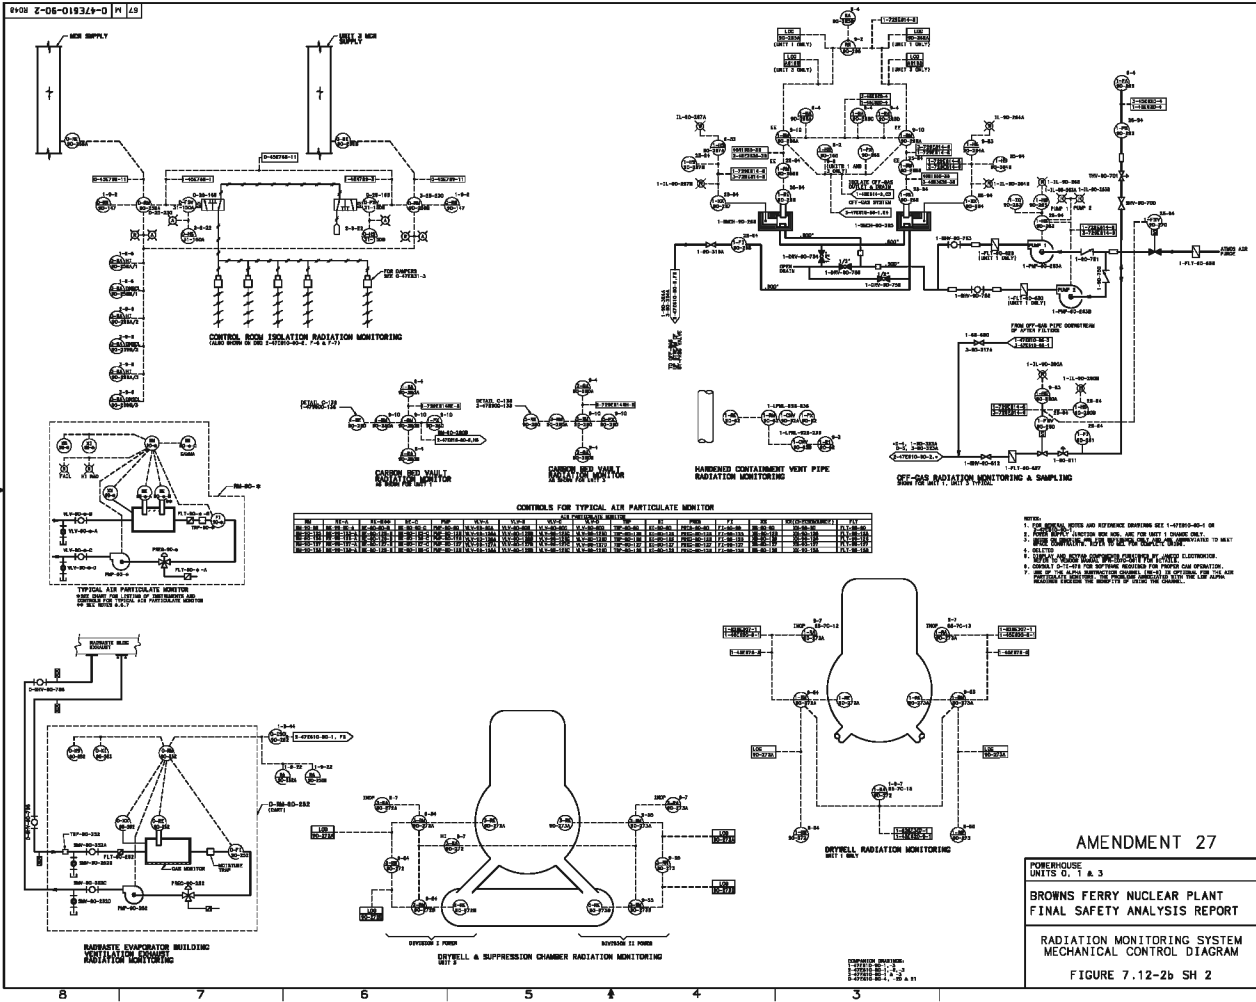

BFN-19

Figure 7.12-2b Sheet 3

(Deleted by Amendment 17)

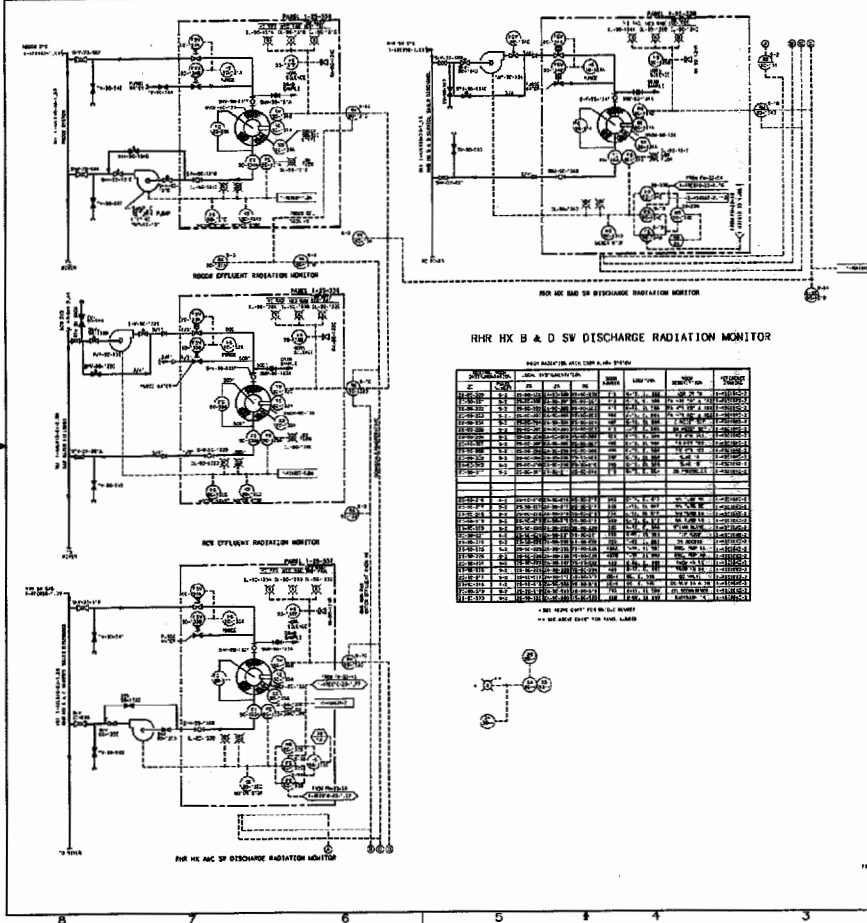

RHR HX B & D SW DISCHARGE RADIATION MONITOR

NO.	DESCRIPTION	UNIT	QTY	REMARKS
1	RELAY	12VDC	1	
2	RELAY	12VDC	1	
3	RELAY	12VDC	1	
4	RELAY	12VDC	1	
5	RELAY	12VDC	1	
6	RELAY	12VDC	1	
7	RELAY	12VDC	1	
8	RELAY	12VDC	1	
9	RELAY	12VDC	1	
10	RELAY	12VDC	1	
11	RELAY	12VDC	1	
12	RELAY	12VDC	1	
13	RELAY	12VDC	1	
14	RELAY	12VDC	1	
15	RELAY	12VDC	1	
16	RELAY	12VDC	1	
17	RELAY	12VDC	1	
18	RELAY	12VDC	1	
19	RELAY	12VDC	1	
20	RELAY	12VDC	1	
21	RELAY	12VDC	1	
22	RELAY	12VDC	1	
23	RELAY	12VDC	1	
24	RELAY	12VDC	1	
25	RELAY	12VDC	1	
26	RELAY	12VDC	1	
27	RELAY	12VDC	1	
28	RELAY	12VDC	1	
29	RELAY	12VDC	1	
30	RELAY	12VDC	1	
31	RELAY	12VDC	1	
32	RELAY	12VDC	1	
33	RELAY	12VDC	1	
34	RELAY	12VDC	1	
35	RELAY	12VDC	1	
36	RELAY	12VDC	1	
37	RELAY	12VDC	1	
38	RELAY	12VDC	1	
39	RELAY	12VDC	1	
40	RELAY	12VDC	1	
41	RELAY	12VDC	1	
42	RELAY	12VDC	1	
43	RELAY	12VDC	1	
44	RELAY	12VDC	1	
45	RELAY	12VDC	1	
46	RELAY	12VDC	1	
47	RELAY	12VDC	1	
48	RELAY	12VDC	1	
49	RELAY	12VDC	1	
50	RELAY	12VDC	1	

AMENDMENT 23

POWERHOUSE
UNIT 1
BROWNS FERRY NUCLEAR PLANT
FINAL SAFETY ANALYSIS REPORT
RADIATION MONITORING SYSTEM
MECHANICAL CONTROL DIAGRAM
FIGURE 7.12-26 SH 5

