

AMENDMENT 27


POWERHOUSE  
UNIT 2

BROWNS FERRY NUCLEAR PLANT  
FINAL SAFETY ANALYSIS REPORT


SAMPLING & WATER QUALITY SYSTEMS  
MECHANICAL CONTROL DIAGRAM

FIGURE 10.17-1c SH 2



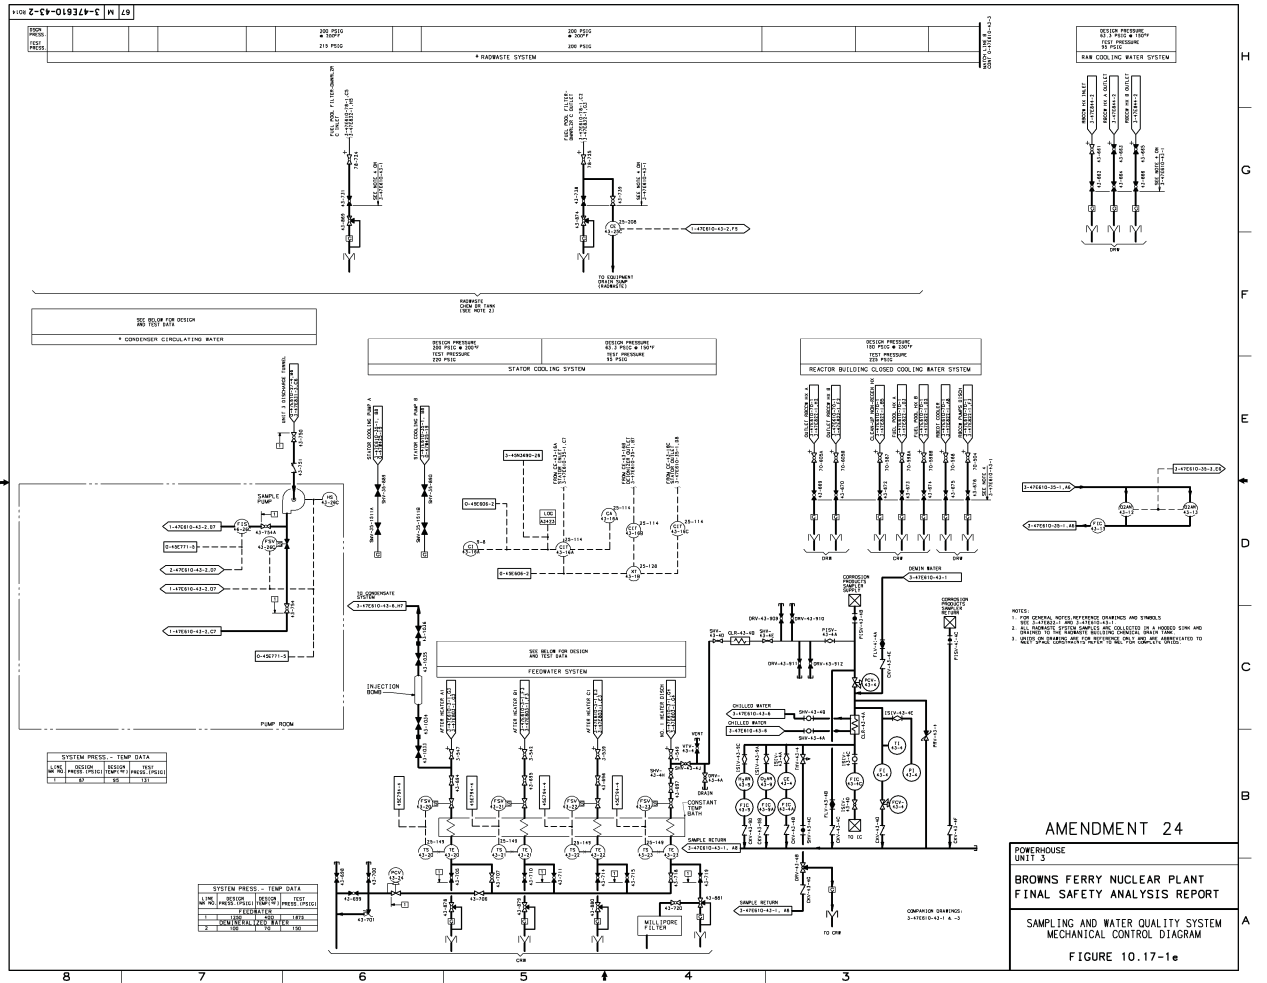



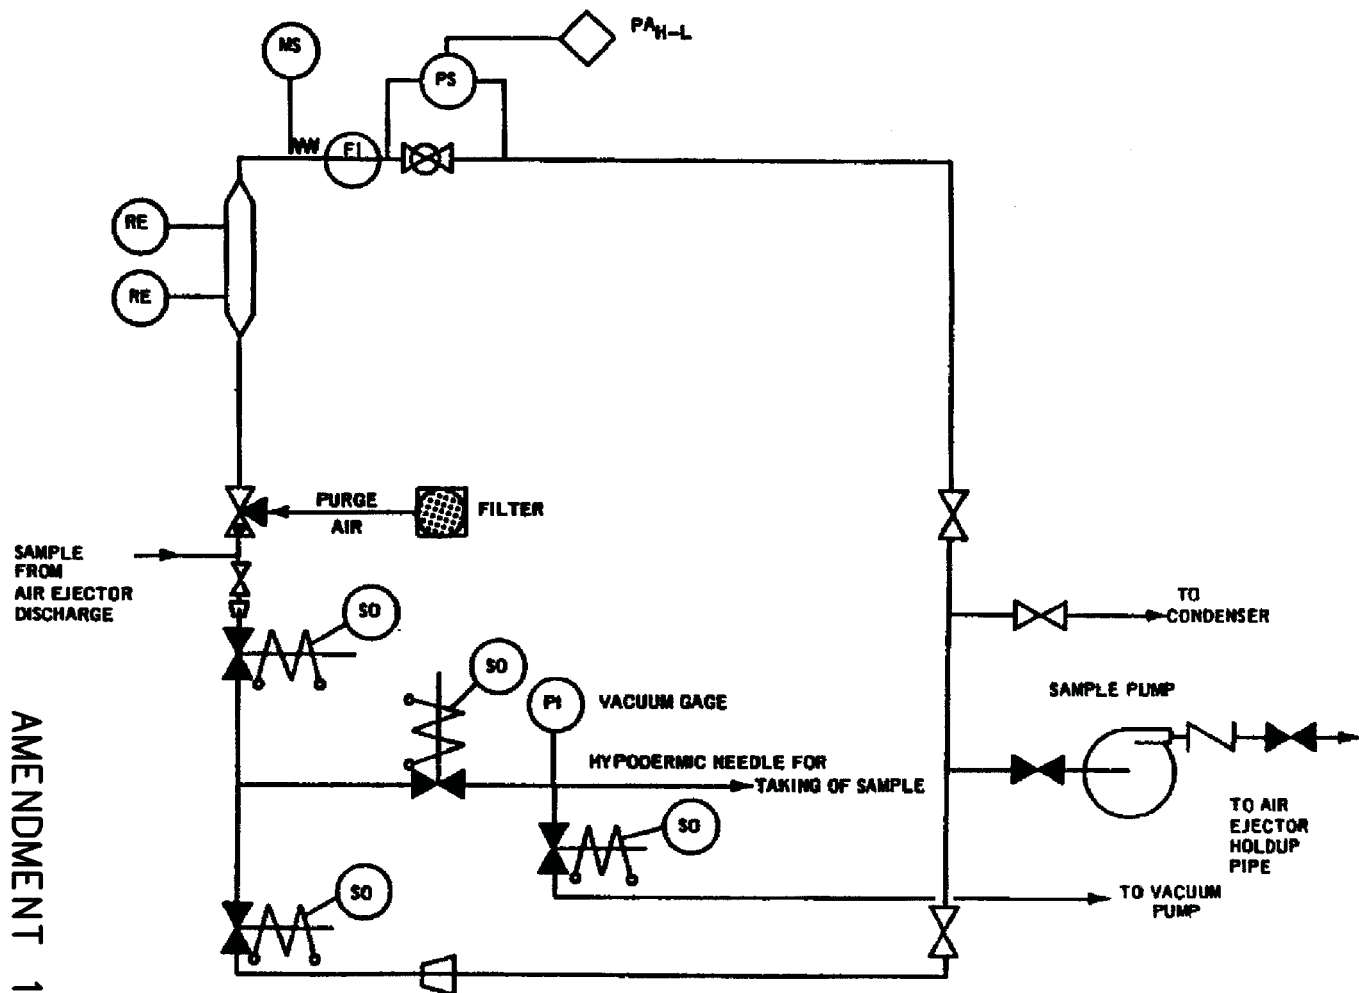

AMENDMENT 16

BROWNS FERRY NUCLEAR PLANT  
FINAL SAFETY ANALYSIS REPORT

Air Ejector Offgas Sampler  
FIGURE 10.17-2