

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 7901050124 DOC. DATE: 78/12/28 NOTARIZED: NO
 FACIL: 50-220 NINE MILE POINT #1, NIAGARA MOHAWK POWER CORP.
 AUTH. NAME: HEDRICK, M.C. AUTHOR AFFILIATION: NIAGARA MOHAWK PWR
 RECIP. NAME: RECIPIENT AFFILIATION

DOCKET #
 05000220

SUBJECT: LER 78-041/04T-0 on 781220: during impingement sampling only
 23 samples (22 hourly samples & one 2-hour sample) were
 collected instead of 24 samples required, caused by one-time
 personnel scheduling change.

DISTRIBUTION CODE: A002S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 1+1
 TITLE: INCIDENT REPORTS


NOTES:

ACTION:	RECIPIENT	COPIES		RECIPIENT	COPIES	
	ID CODE/NAME	LTTR	ENCL		ID CODE/NAME	LTTR
	05 BC <u>ORB#3</u>	4	4			
INTERNAL:	01 REG FILE	1	1	02 NRC PDR	1	1
	09 I&E	2	2	11 MPA	3	3
	14 HANAUER	1	1	15 NOVAK/KNIEL	1	1
	16 EEB	1	1	17 AD FOR ENGR	1	1
	18 PLANT SYS BR	1	1	19 I&C SYS BR	1	1
	20 AD PLANT SYS	1	1	21 AD SYS/PROJ	1	1
	22 REAC SAFT BR	1	1	23 ENGR BR	1	1
	24 COLLINS	0	0	24 KREGER	1	1
	25 PWR SYS BR	1	1	26 HOUSTON	0	0
	26 VOLLMER	1	1	E JORDAN/IE	1	1
EXTERNAL:	03 LPDR	1	1	04 NSIC	1	1
	27 ACRS	16	16			

JAN 8 1979

TOTAL NUMBER OF COPIES REQUIRED: LTTR 43 ENCL 43

A012-4

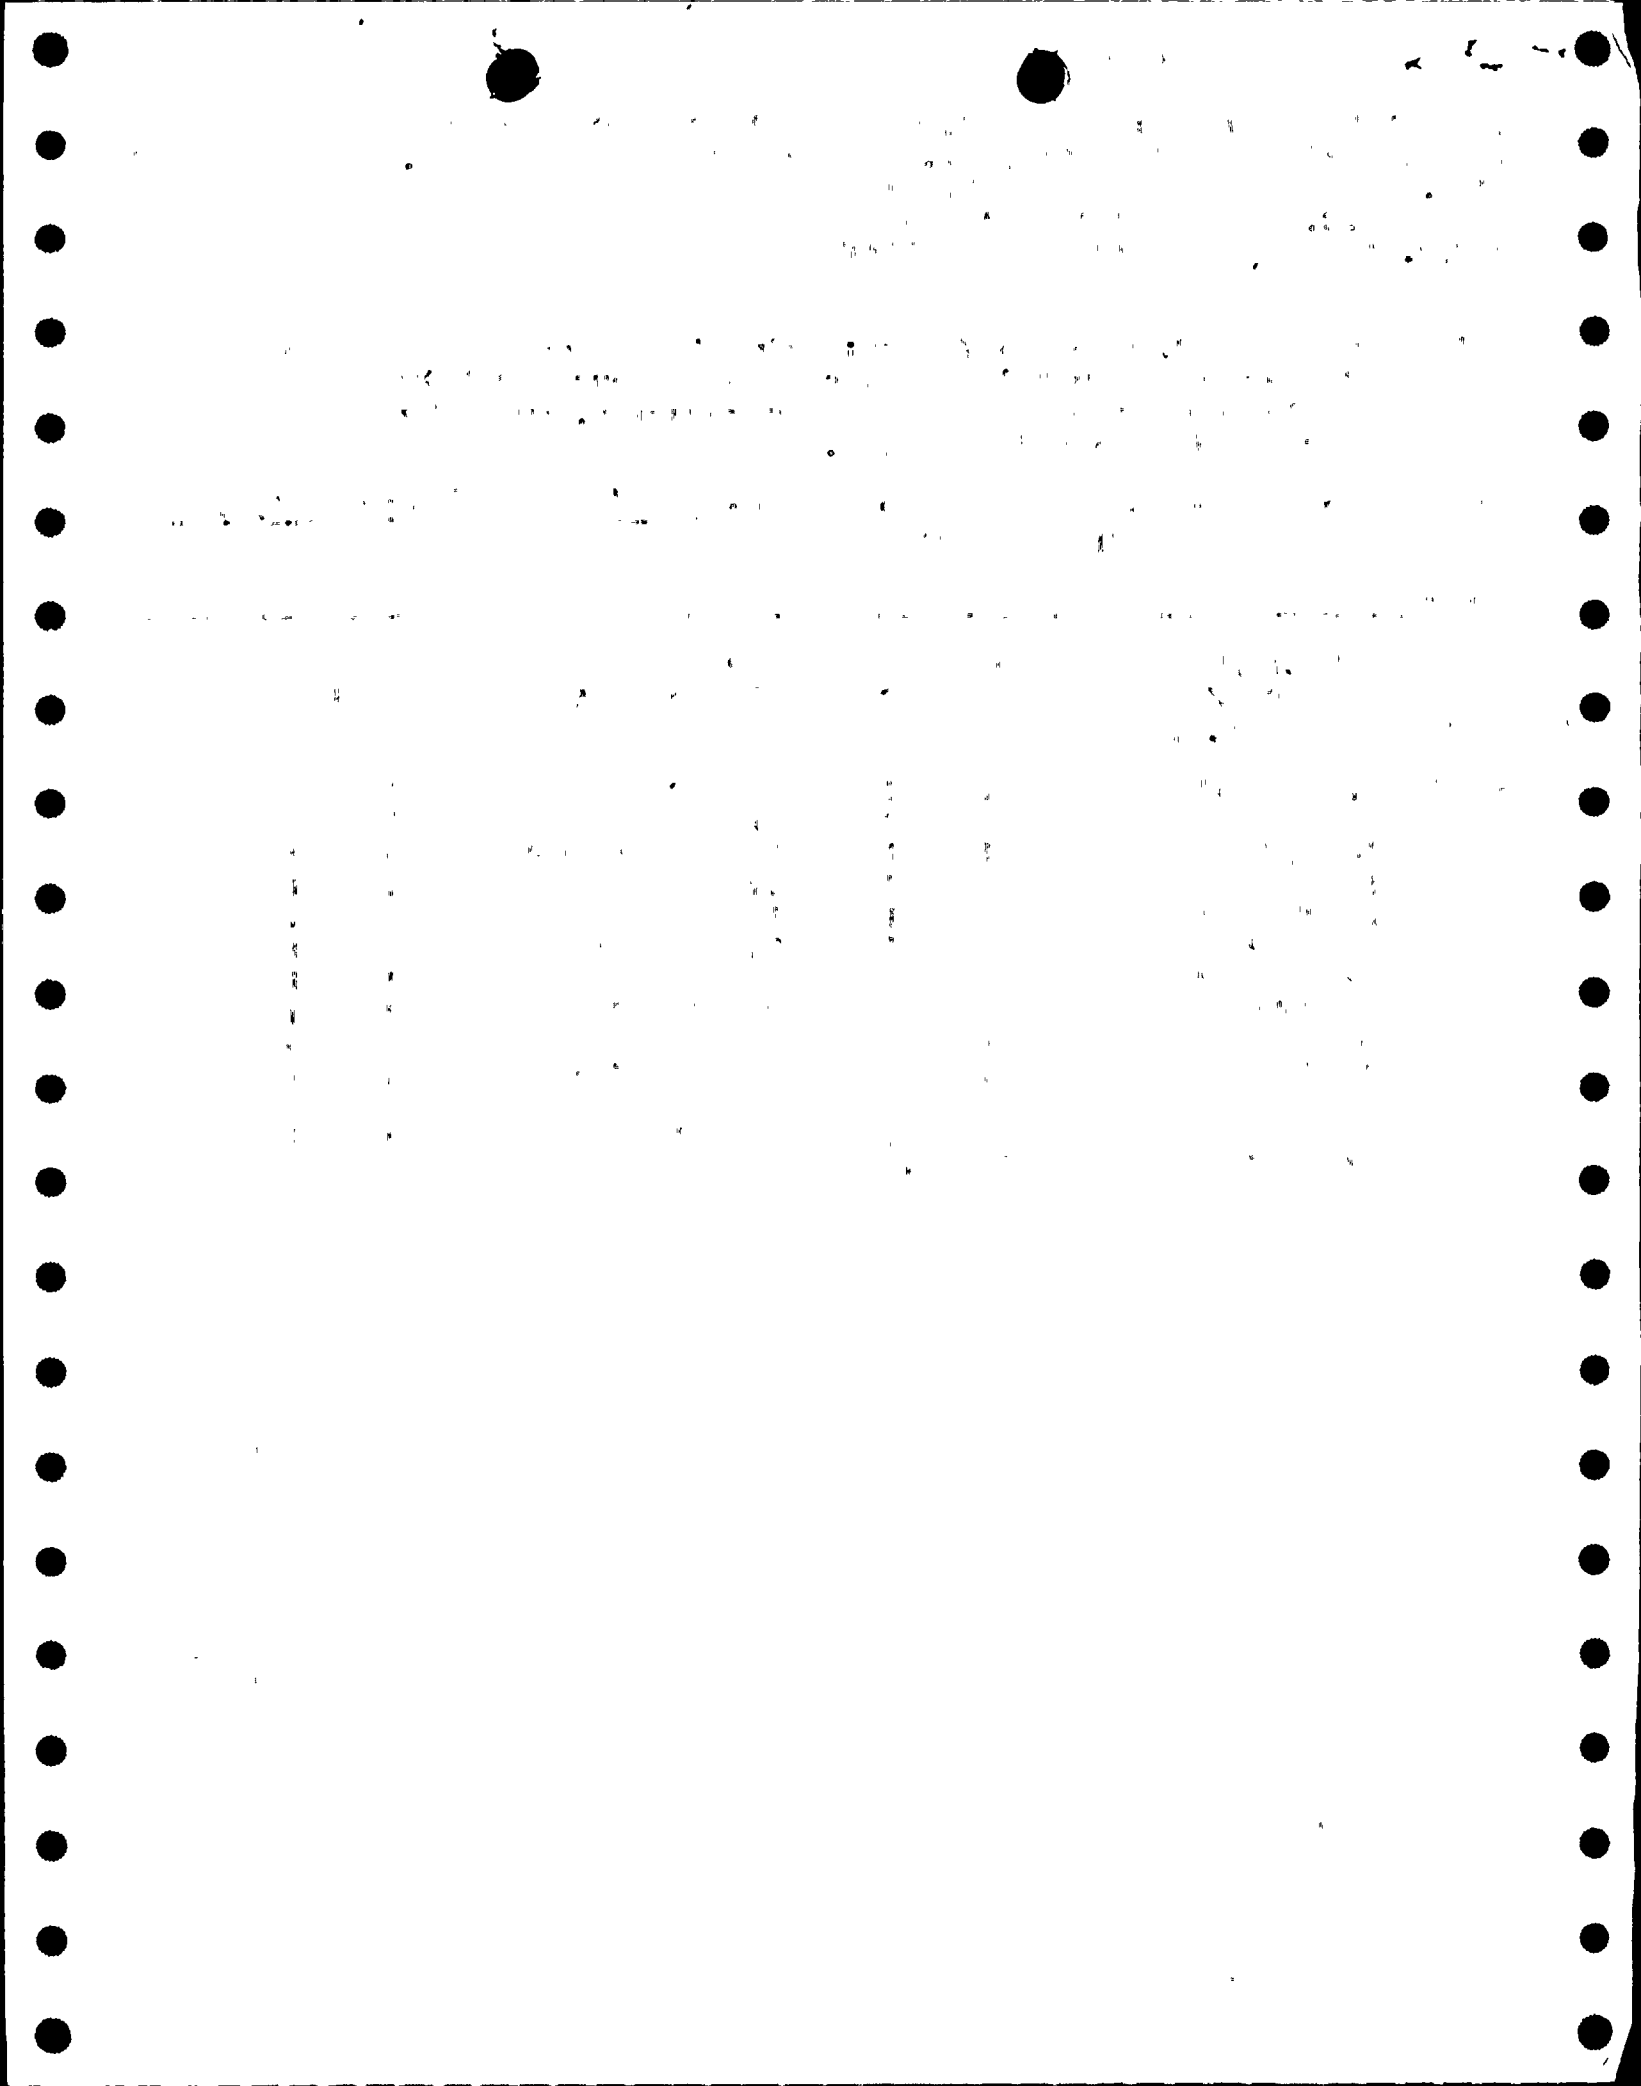

LICENSEE EVENT REPORT

CONTROL BLOCK:

(PLEASE PRINT OR TYPE ALL REQUIRED INFORMATION)

0	1	N	Y	N	M	P	1	2	0	0	-	0	0	0	0	0	-	0	0	3	4	1	1	1	1	4			5	
7	8	LICENSEE CODE						14	15	LICENSE NUMBER										25	26	LICENSE TYPE					30	57	CAT	58

CON'T

REPORT SOURCE: 01 60 05 00 02 20 71 22 07 88 12 28 78 9

EVENT DESCRIPTION AND PROBABLE CONSEQUENCES (10)

0 2 | During impingement sampling only 23 samples (22 hourly samples and one
0 3 | 2-hour sample) were collected instead of the 24 hourly samples required
0 4 | by Section 3.1.2.a of the Environmental Technical Specifications. This
0 5 | condition resulted in minimal safety implications.
0 6 |
0 7 |
0 8 |

SYSTEM CODE Z Z		CAUSE CODE A		CAUSE SUBCODE F		COMPONENT CODE Z Z Z Z Z				COMP. SUBCODE Z		VALVE SUBCODE Z	
9 10		11		12 13		14 15 16 17 18				19 20		21	
LER/RO REPORT NUMBER 7 8		EVENT YEAR 7 8		SEQUENTIAL REPORT NO. 0 4 1		OCCURRENCE CODE 0 4		REPORT TYPE T		REVISION NO. 0			
17 18 19		20 21 22		23 24 25 26		27 28 29		30 31 32		33 34 35		36 37 38 39 40	
ACTION TAKEN H		FUTURE ACTION Z		EFFECT ON PLANT Z		SHUTDOWN METHOD Z		HOURS 0 0 0 0		ATTACHMENT SUBMITTED Y		NP&D-4 FORM SUB. N	
18 19		20		21		22		23		24		25	
PRIME COMP. SUPPLIER Z		COMPONENT MANUFACTURER Z 9 9 9											
43		44 45 46 47											

CAUSE DESCRIPTION AND CORRECTIVE ACTIONS (27)

1 0 Contractor technician was detained by the Security Force for an investi-
1 1 gation for compliance with ANSI 18.17 Sect. 4.3(2). In conjunction,
1 2 contractor tech already onsite collecting samples left prior to his
1 3 relief's arrival. Contractor supervision instructed technical staff not
1 4 to leave site until relieved.

7		8		9		FACILITY STATUS		% POWER		OTHER STATUS		METHOD OF DISCOVERY		DISCOVERY DESCRIPTION	
1		5		E		(28)		0		8		29		NA	
7		8		9		10		11		12		13		44	
45		46		47		48		49		50		51		52	
A		(31)		Management Review											
7		8		9		10		11		12		13		44	
45		46		47		48		49		50		51		52	

ACTIVITY CONTENT
RELEASED OF RELEASE AMOUNT OF ACTIVITY (35) LOCATION OF RELEASE (36)

1 6 Z (33) NA (34) NA

PERSONNEL EXPOSURES									
NUMBER			TYPE	DESCRIPTION					
1	7	0	0	0	(37) Z	(38) NA	(39)		

PERSONNEL INJURIES			DESCRIPTION	
1	2	3	4	5
0	0	0	40	NA

7	8	9	11	12	
LOSS OF OR DAMAGE TO FACILITY (43)					
TYPE		DESCRIPTION			
1	9	Z (42)	NA		

7	8	9	10												
PUBLICITY				NRC USE ONLY											
ISSUED				DESCRIPTION											
2	0	IN	(44)	NA	(45)										

NRC USE ONLY

M.C. Hedrick

PHONE:

NAME OF PREPARER

7901050124

315-343-2110 X1310

December 28, 1978

Mr. Boyce H. Grier
Director
United States Nuclear Regulatory Commission
Region I
631 Park Avenue
King of Prussia, PA. 19406

RE: Docket No. 50-220
LER 78-41/04T-0
Nine Mile Point Nuclear Station #1

Dear Mr. Grier:

Section 3.1.2.a of the Environmental Technical Specifications requires that on Wednesday of each week hourly impingement samples will be collected. Contrary to this requirement, on December 20, 1978, only 23 samples were collected. The 23 samples consisted of 22 one hour samples and 1 two hour sample.

The contractor technician who had been on site collecting the impingement samples left prior to his relief's arrival. When the relief technician did arrive, she was detained by the security force while an investigation for compliance with ANSI 18.17 Section 4.3(2) was conducted. A combination of these two circumstances resulted in one hourly traveling screen wash not being sampled. All fish during this period were collected, but in one 2-hour sample instead of 2 hourly samples.

Contractor supervision instructed the technicians not to leave the site until relieved.

This incident is considered to have minimal impact.

Very truly yours,

Original Signed by R.R. Schneider

R.R. Schneider
Vice President -
Electric Production

mtm