

E 07/07/78

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)
DISTRIBUTION FOR INCOMING MATERIAL

50-335

REC: REID R W
NRC

ORG: UHRIG R E
FL PWR & LIGHT

DOCDATE: 06/28/78
DATE RCVD: 07/07/78

DOCTYPE: LETTER NOTARIZED: NO

COPIES RECEIVED

SUBJECT:

LTR 3 ENCL 3

FURNISHING CORRECTION TO MINOR ERROR IN TECH SPEC FIGURE 3.1-2 ("CEA
INSERTION LIMITS VS. THERMAL PWR WITH 4 REACTOR COOLANT PUMPS OPERATING"),
AND INFO RE SEQUENCE OF EVENTS LEADING TO ERROR... W/ATT.

PLANT NAME: ST LUCIE #1

REVIEWER INITIAL: XJM
DISTRIBUTOR INITIAL: *m*

***** DISTRIBUTION OF THIS MATERIAL IS AS FOLLOWS *****

GENERAL DISTRIBUTION FOR AFTER ISSUANCE OF OPERATING LICENSE.
(DISTRIBUTION CODE A001)

FOR ACTION: BR CHIEF ~~ORR#4~~ BC**W/7 ENCL

INTERNAL:

REG FILE**W/ENCL

I & E**W/2 ENCL

HANAUER**W/ENCL

AD FOR SYS & PROJ**W/ENCL

REACTOR SAFETY BR**W/ENCL

EEB**W/ENCL

J. MCGOUGH**W/ENCL

NRC PDR**W/ENCL

OELD**LTR ONLY

CORE PERFORMANCE BR**W/ENCL

ENGINEERING BR**W/ENCL

PLANT SYSTEMS BR**W/ENCL

EFFLUENT TREAT SYS**W/ENCL

EXTERNAL:

LPDR'S

FT PIERCE, FL**W/ENCL

TIC**W/ENCL

NSIC**W/ENCL

ACRS CAT B**W/16 ENCL

App 2 -


DISTRIBUTION: LTR 40 ENCL 39
SIZE: 1P+1P+1P

CONTROL NBR: 781880108

***** THE END ***** *GD*



11

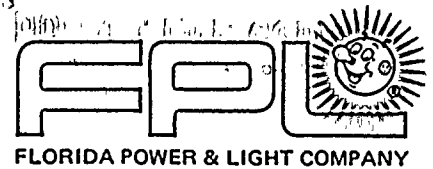

Office of Nuclear Reactor Regulation
 Attention: Mr. R. W. Reid, Chief
 Operating Reactors Branch #2
 Division of Operating Reactors
 U. S. Nuclear Regulatory Commission
 Washington, D. C. 20555

June 28, 1978
 L-78-222

Dear Mr. Reid:

Re: St. Lucie Unit 1
 Docket No. 50-335

Power Dependent Insertion Limit Curve

The purpose of this letter is to correct a minor error in Technical Specification Figure 3.1-2 ("CEA Insertion Limits vs. Thermal Power with 4 Reactor Coolant Pumps Operating"). The sequence of events leading to the error were as follows:


In March of 1978, Florida Power & Light Company (FPL) received a draft Reload Safety Evaluation (RSE) from Combustion Engineering (C-E) for St. Lucie Unit 1, Cycle 2. A revised Figure 3.1-2 was part of the draft RSE. The C-E revised figure gave CEA insertion limits in per cent as a function of thermal power. At 100% rated thermal power, the Power Dependent Insertion Limit (PDIL) was 25%.

In order to make the curve consistent with the existing Technical Specifications and easier to use, the "CEA Insertion" scale was changed from per cent to inches. The coordinates in the upper left corner of the figure should have been changed from (25,1.0) to (34,1.0), but this was overlooked. The actual position of the PDIL curve was correct; that is, the full power insertion limit corresponded to 34 inches (25% of 137 inches) on the "CEA Insertion" scale, but the abscissa was not changed as it should have been.

The RSE was submitted on March 22, 1978, and the NRC approved numerous Cycle 2 Technical Specification changes by issuing Amendment 27 to Operating License DPR-67 on May 26, 1978. Figure 3.1-2 was issued with the (25,1.0) coordinates intact, but the PDIL curve had been positioned such that, at full power, it corresponded to 25 inches on the "CEA Insertion" scale. The correct curve, as supported by the RSE, should have been positioned such that the full power limit corresponded to 34 inches and the coordinates in the upper left corner read (34,1.0). A corrected Figure 3.1-2 is attached.

781880108

A001
 3/3

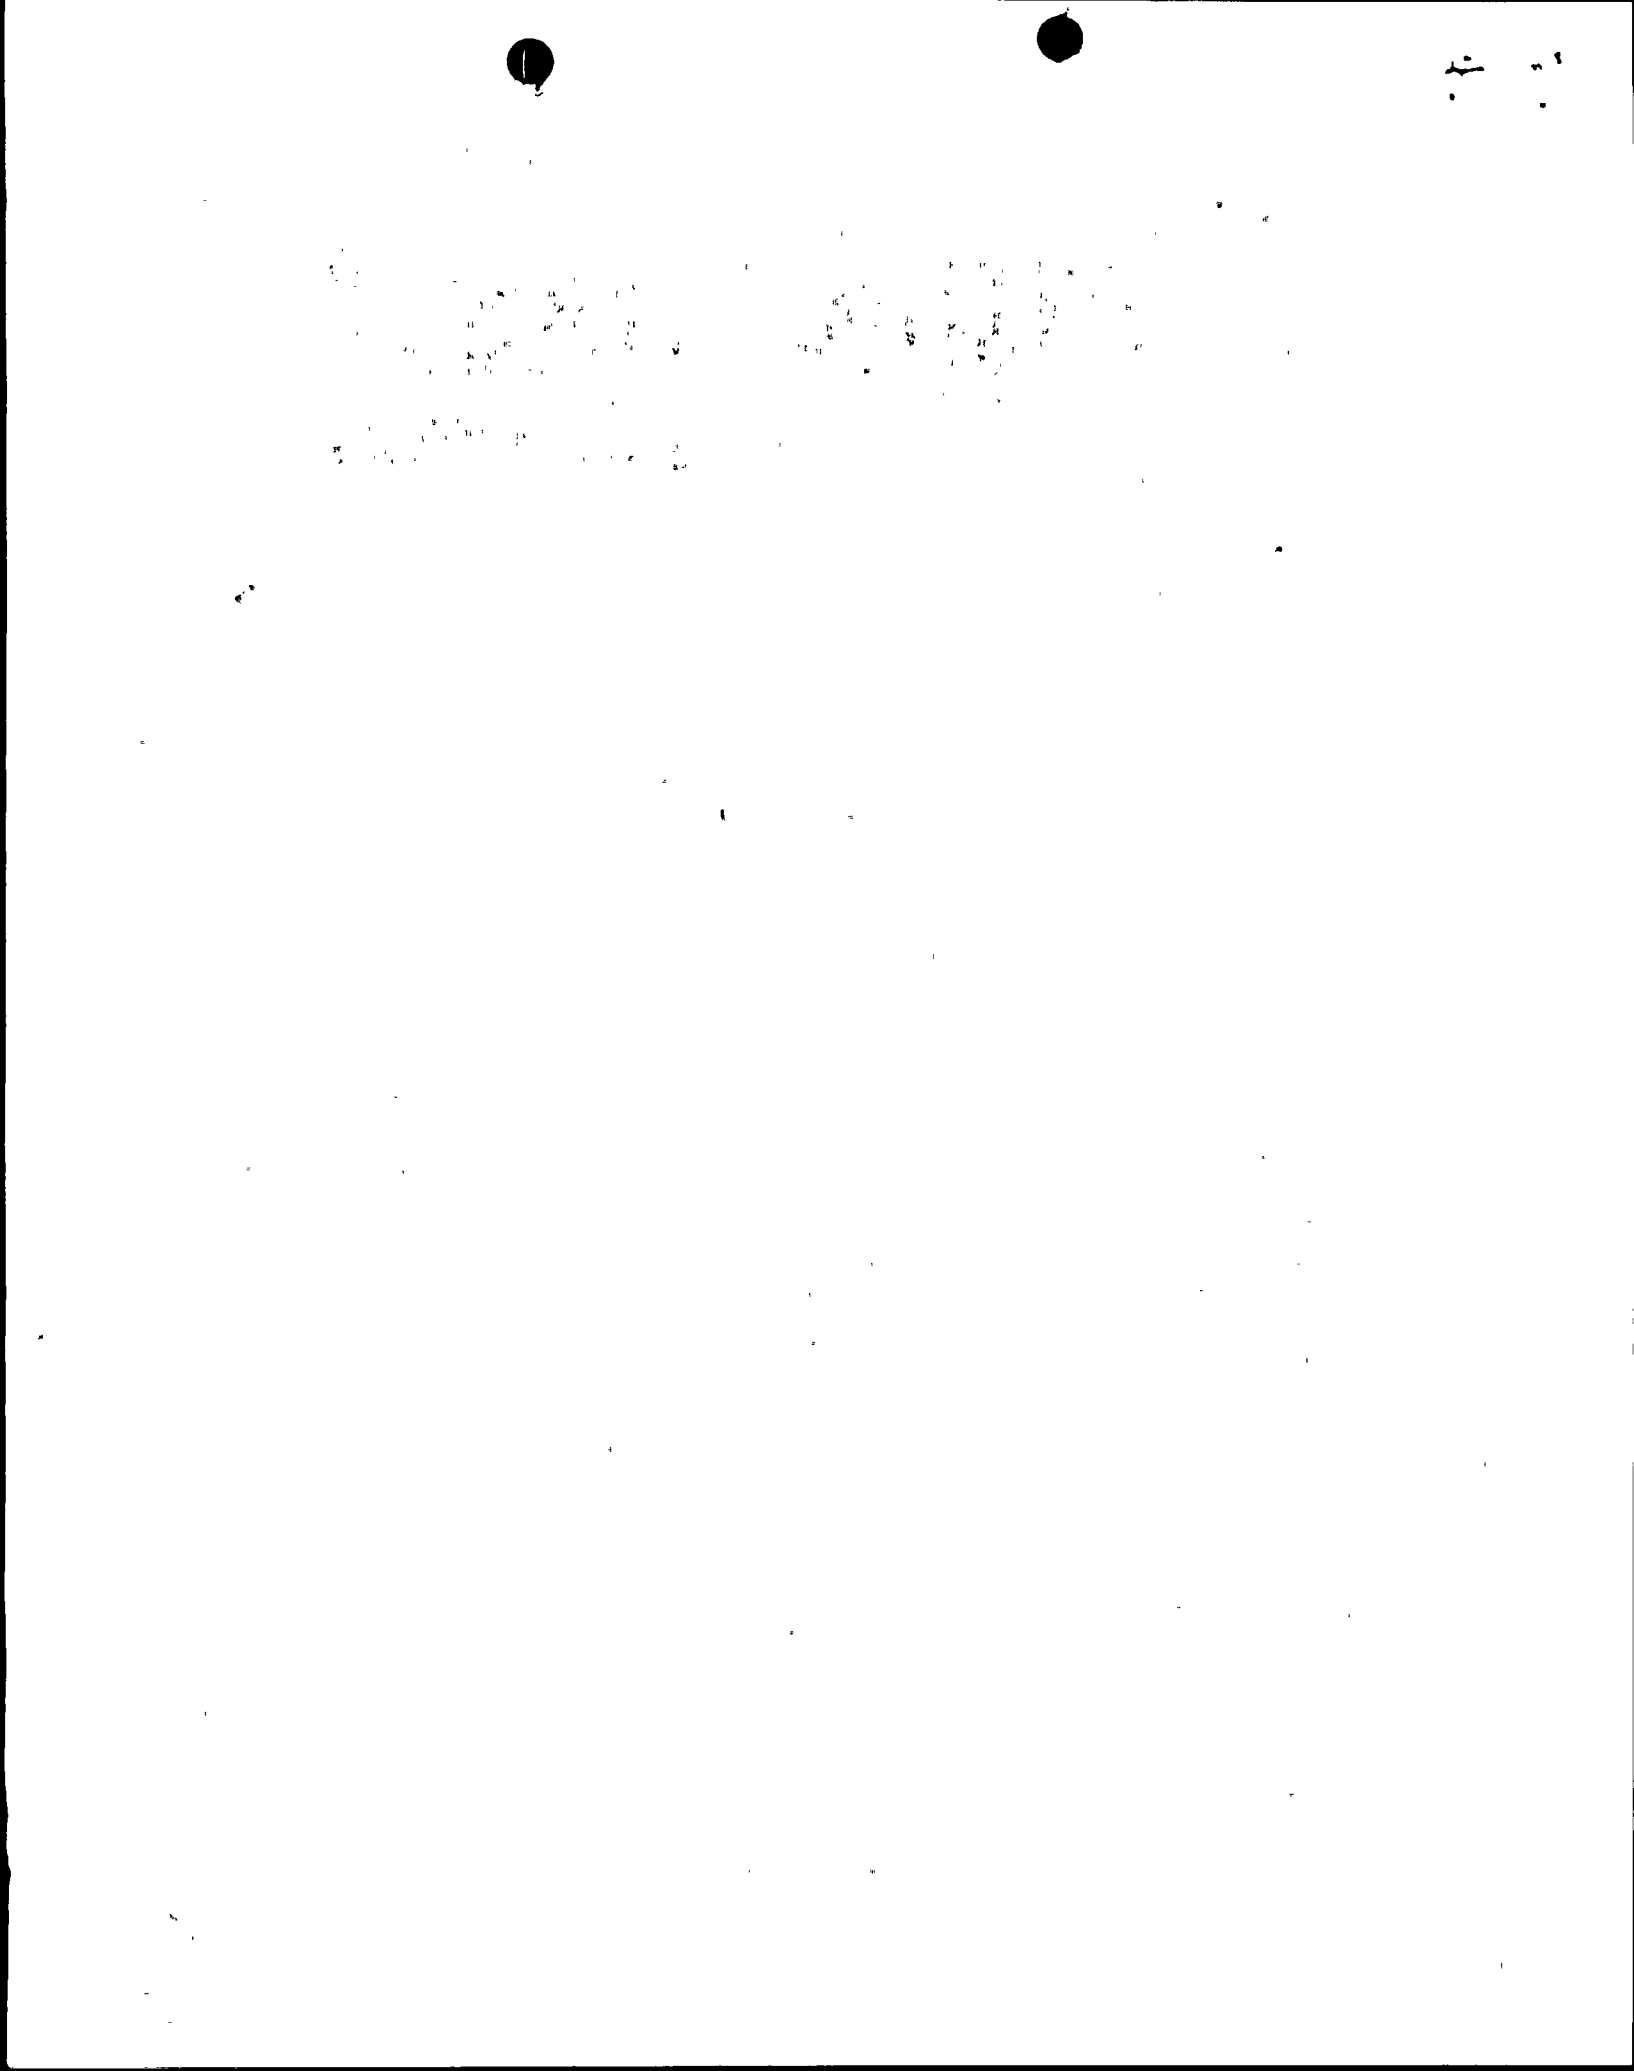


Mr. R. W. Reid, Chief
U. S. Nuclear Regulatory Commission
Page Two

June 28, 1978
L-78-222

Figure 3.1-2 as issued by Amendment 27 is conservative in that it limits Group 7 insertion at full power to 25 inches rather than 34 inches. Since Group 7 is used to dampen Xenon oscillations, the conservative PDIL limit decreases operating flexibility. Limiting Group 7 insertion to 25 inches could permit a situation where power would be limited during a Xenon oscillation because compensating rod insertion past 25 inches would be prohibited. In order to correct our error, and to gain operating flexibility, we request that Figure 3.1-2 be reissued to conform with the attached corrected figure. Your assistance will be appreciated.

Very truly yours,

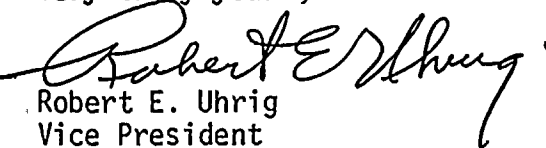
Robert E. Uhrig
Vice President

REU/MAS/pa

Attachment

cc: Mr. James P. O'Reilly, Region II
Harold F. Reis, Esquire

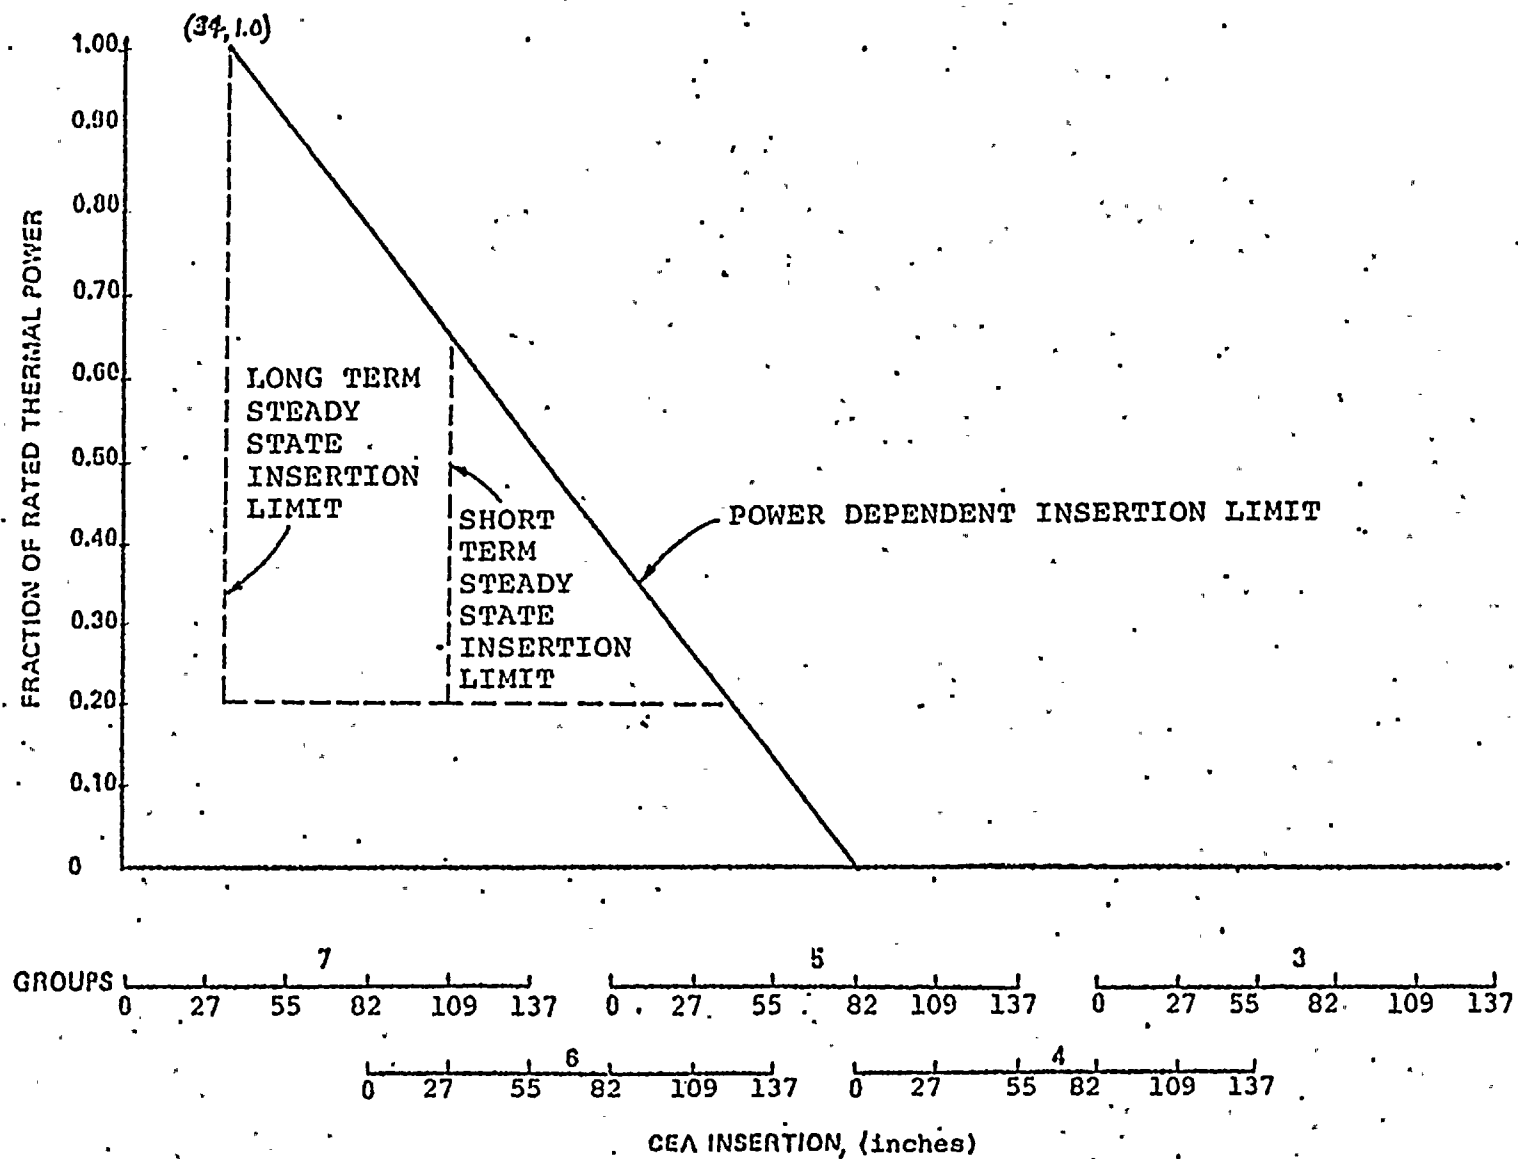


Figure 3.1-2 CEA Insertion Limits vs THERMAL POWER with 4 Reactor Coolant.
Pumps Operating

