

50-335

NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL

FILE NUMBER

INCIDENT REPORT

TO: Mr Moseley

FROM: Florida Pwr & Light Co
Miami, Fla
A D Schmidt

DATE OF DOCUMENT

4-26-76

DATE RECEIVED 5-5-76

☒ LETTER☐ NOTORIZED

PROP

INPUT FORM

NUMBER OF COPIES RECEIVED

☐ ORIGINAL☒ UNCLASSIFIED☒ COPY

none signed

DESCRIPTION

Ltr trans the following:

ENCLOSURE

License Event Rpt (RO#76-6) on 3-26-76 concerning technical specifications time limit where exceeded during transition from shutdown cooling pumps to reactor coolant pumps.....

(1 cy encl rec'd)

PLANT NAME: St Lucie #1

NOTE: IF PERSONNEL EXPOSURE IS INVOLVED
SEND DIRECTLY TO KREGER/J. COLLINS

SAFETY

FOR ACTION/INFORMATION

ENVIRO

5-10-76

ent

BRANCH CHIEF:

Ziemann

W/3 CYS FOR ACTION

LIC. ASST:

Diggs

W/1 CYS

ACRS 16 CYS HOLDING/SENT TO LA

INTERNAL DISTRIBUTION

REG FILE

NRC PDR

I & E (2)

MIPC (3)

SCHROEDER/IPPOLITO

HOUSTON

NOVAK/CHECK

GRIMES/SCHWENCER

CASE

E. WILLIAMS

HANAUER

TEDESCO/MACCARY

EISENHUT

BAER

SHAO

VOLLMER/BUNCH

KREGER/J. COLLINS

EXTERNAL DISTRIBUTION

LPDR: Ft Pierce, Fla

TIC

NSIC

CONTROL NUMBER

4468

27




April 26, 1976

PRN-LI-76-98

~~50-335~~
50-335

REGULATORY DOCKET FILE COPY

Mr. Norman C. Moseley, Director, Region II
Office of Inspection and Enforcement
U. S. Nuclear Regulatory Commission
230 Peachtree Street, N. W., Suite 818
Atlanta, Georgia 30303

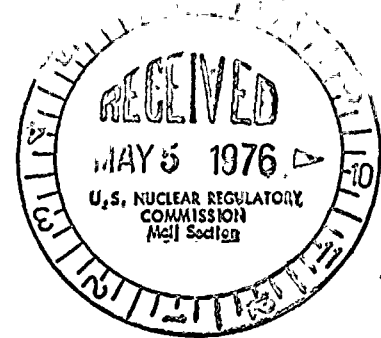

Dear Mr. Moseley:


REPORTABLE OCCURRENCE 335-76-6
ST. LUCIE UNIT 1
DATE OF OCCURRENCE: MARCH 26, 1976

TECHNICAL SPECIFICATION TIME LIMIT EXCEEDED
DURING TRANSITION FROM SHUTDOWN COOLING
PUMPS TO REACTOR COOLANT PUMPS

The attached Licensee Event Report is being submitted in accordance with Technical Specification 6.9 to provide 30-day notification of the subject occurrence.

Very truly yours,

A. D. Schmidt
A. D. Schmidt
Vice President
Power Resources

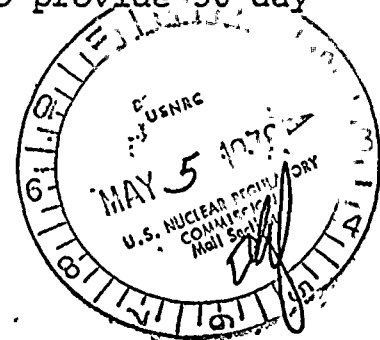

MAS/cpc

Attachment

cc: Jack R. Newman, Esquire
Director, Office of Inspection and Enforcement (30)
Director, Office of Management Information and
Program Control (3)

4468

PLEASE PRINT ALL REQUIRED INFORMATION)

EVENT DESCRIPTION

(cont.d')

CAUSE DESCRIPTION

DISCOVERY DESCRIPTION

LOCATION OF RELEASE

PERSONNEL EXPOSURES

PERSONNEL INJURIES

PROBABLE CONSEQUENCES

LOSS OR DAMAGE TO FACILITY

PUBLICITY

ADDITIONAL FACTORS:

GPO 881-667

Event Description (continued)

3.4.1 permits operation in Modes 3, 4, and 5 for a maximum of 15 minutes with no shutdown cooling (LPSI) pump or RCP in operation. This was the first occurrence of this type. (335-76-6).

Cause Description (continued)

to perform the transition from SDC operation to RCP operation. Followup action will be to submit a request to amend the Technical Specifications to extend the time limit for transition from SDC operation to RCP operation in Modes 3, 4, and 5.