


SH 29 RWO

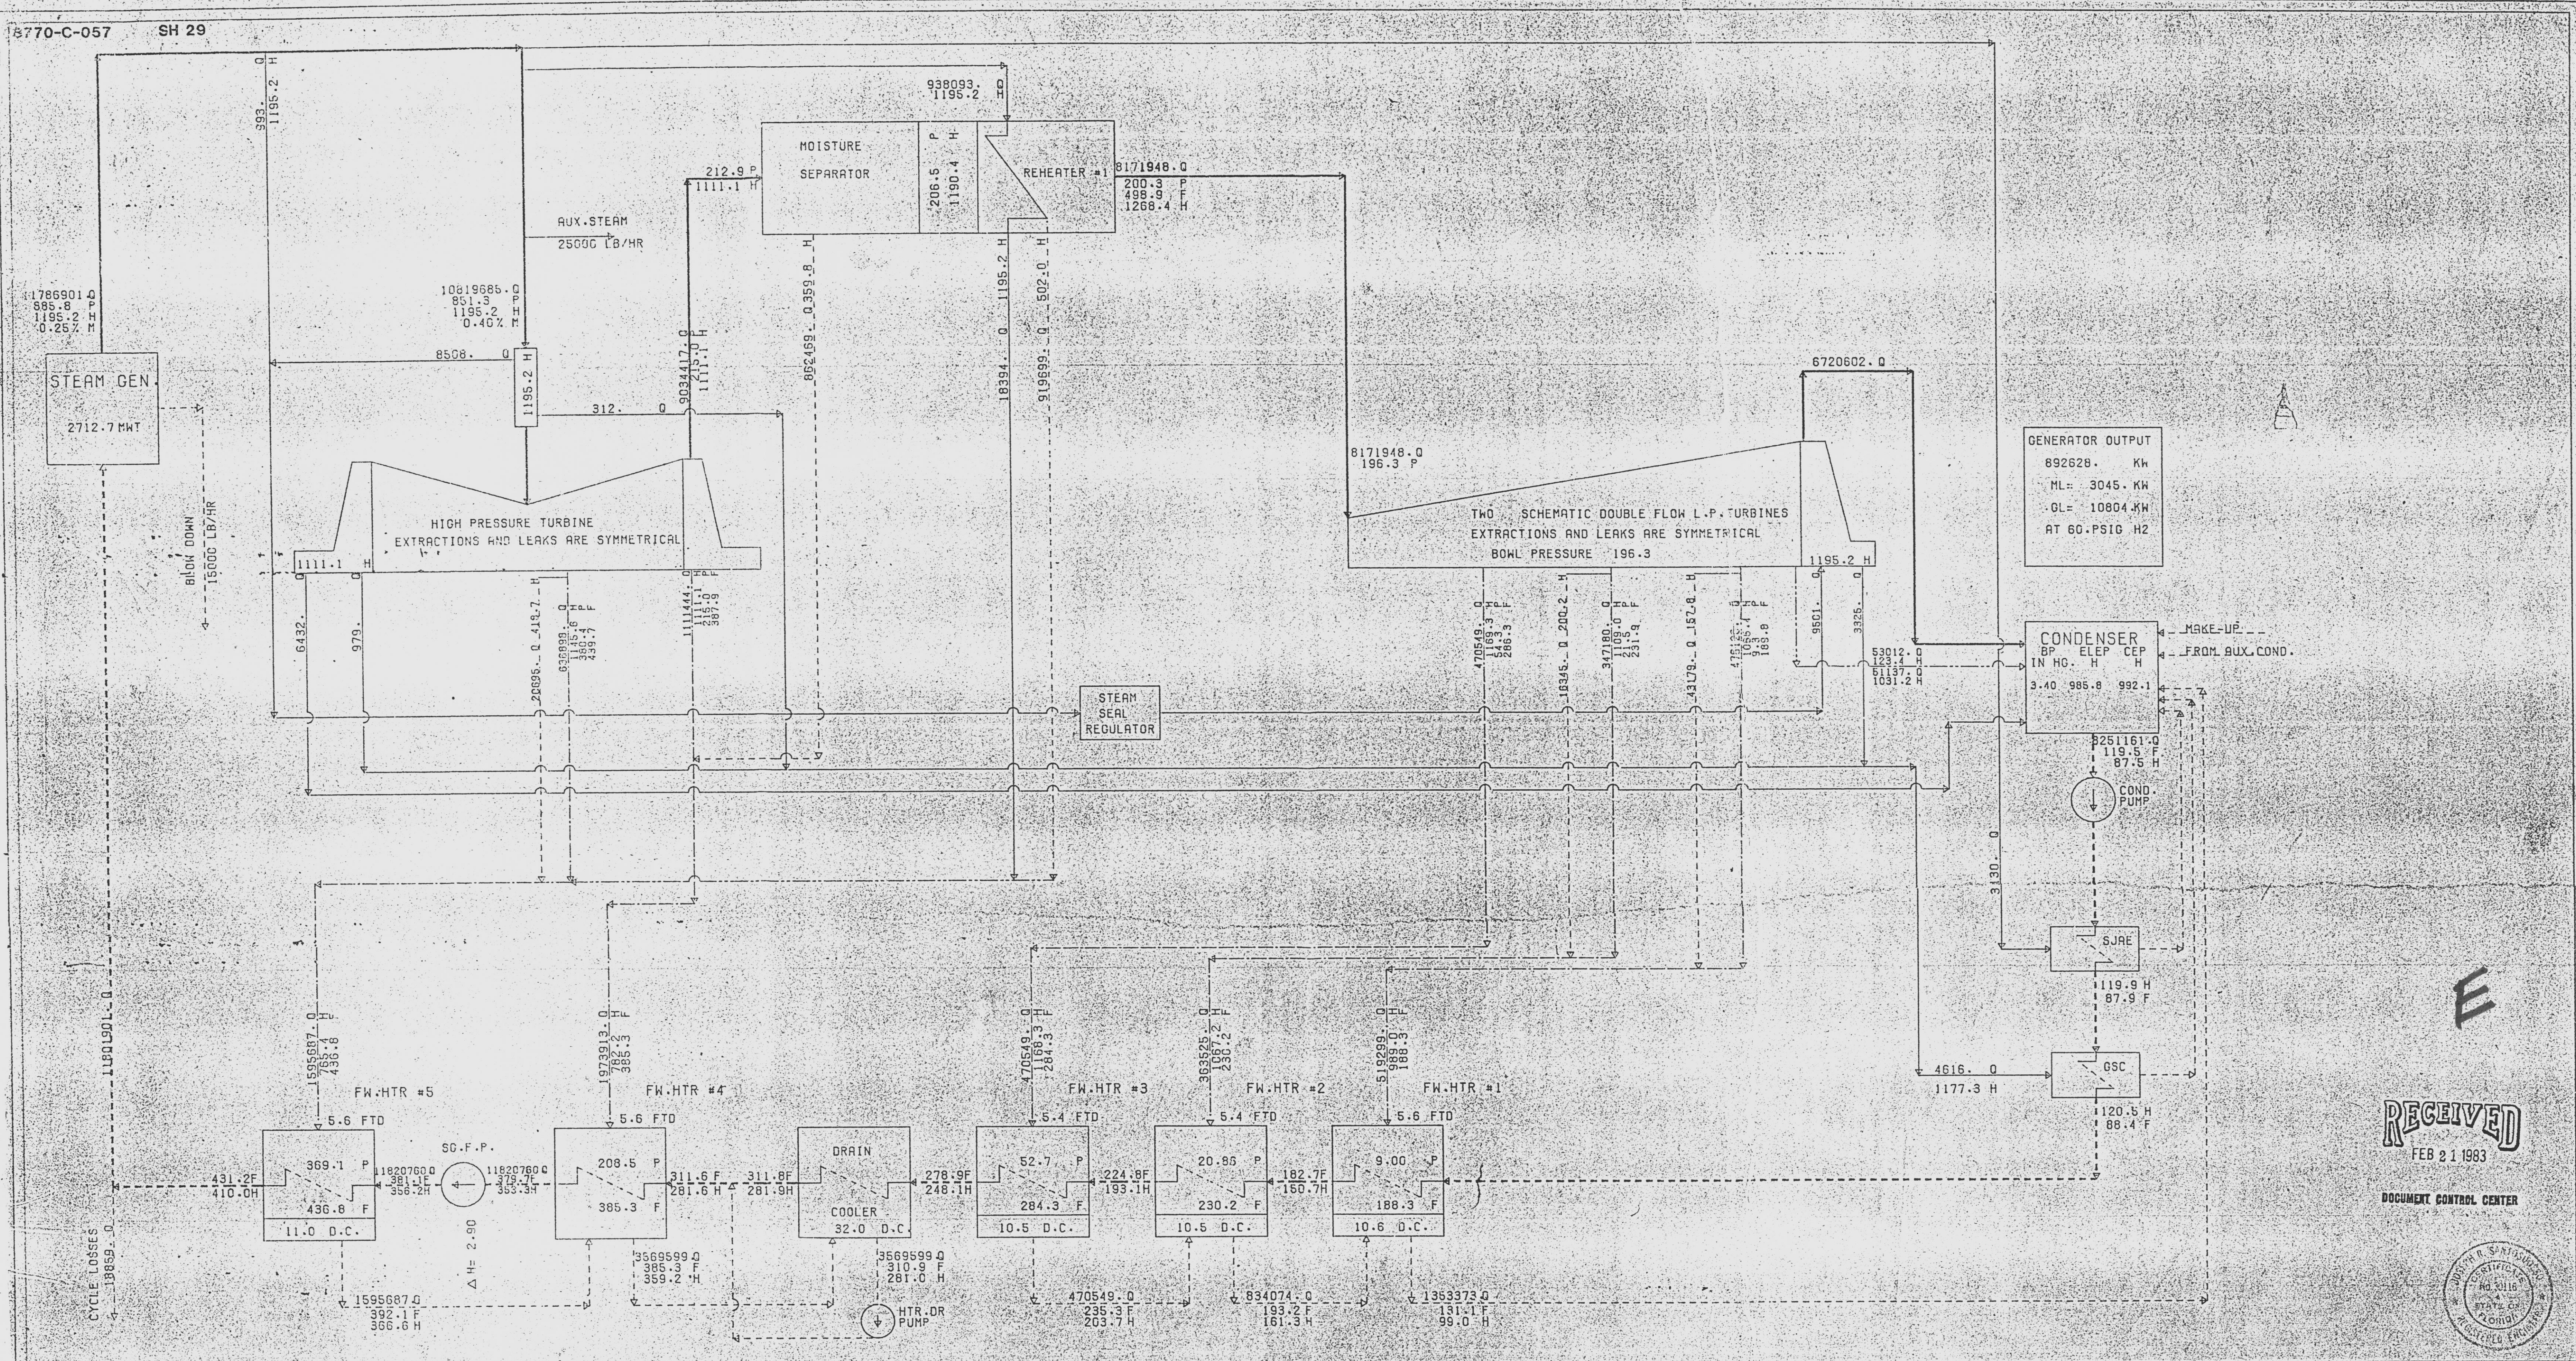

PERFORMANCE

LEGEND

GROSS GENERATION KW.	TURBINE HEAT RATE BTU/KW-HR
892628.	10367.8

SHEET NO.	THROTTLE FLOW LBS/HR	THROTTLE PRESSURE PSIA	BACK PRESSURE IN. HG ABS	CYCLE LOSSES LBS/HR	BLOW-DOWN LBS/HR
22.	10819703.	851	2.00	18859.	15000.
23.	10819700.	851	2.20	18859.	15000.
24.	10819697.	851	2.40	18859.	15000.
25.	10819695.	851	2.60	18859.	15000.
26.	10819695.	851	2.80	18859.	15000.
27.	10819692.	851	3.00	18859.	15000.
28.	10819688.	851	3.20	18859.	15000.
29.	10819685.	851	3.40	18859.	15000.

THIS DOCUMENT IS THE PROPERTY OF EBASCO SERVICES INCORPORATED. ITS USE IS EXPRESSLY RESTRICTED BY THE TERMS OF THE CONTRACT. DATED AS OF AUGUST 10, 1988 BETWEEN EBASCO SERVICES INCORPORATED AND FLORIDA POWER & LIGHT COMPANY.

FLORIDA POWER & LIGHT COMPANY
ST. LUCIE PLANT
1976 - 890,000 KW INSTALLATION UNIT NO. 1
HEAT BALANCE
2710 MWT VARIABLE BACK PRESSURE
3.40 INCHES HG. ABSOLUTE

EBASCO SERVICES INCORPORATED NEW YORK

SCALE-NONE	APPROVED	DATE 2-2-82
NO.	DATE	REVISION
BY	CH.	APPROVED

_____	_____	DRAWING ORIGINALLY APPROVED AS BCS-125-61.302 SH 8 OF 8	_____	_____	_____
NO.	DATE	REVISION	BY	CH.	APPROVED

8770-C-057
SH 29