


8770-G-063

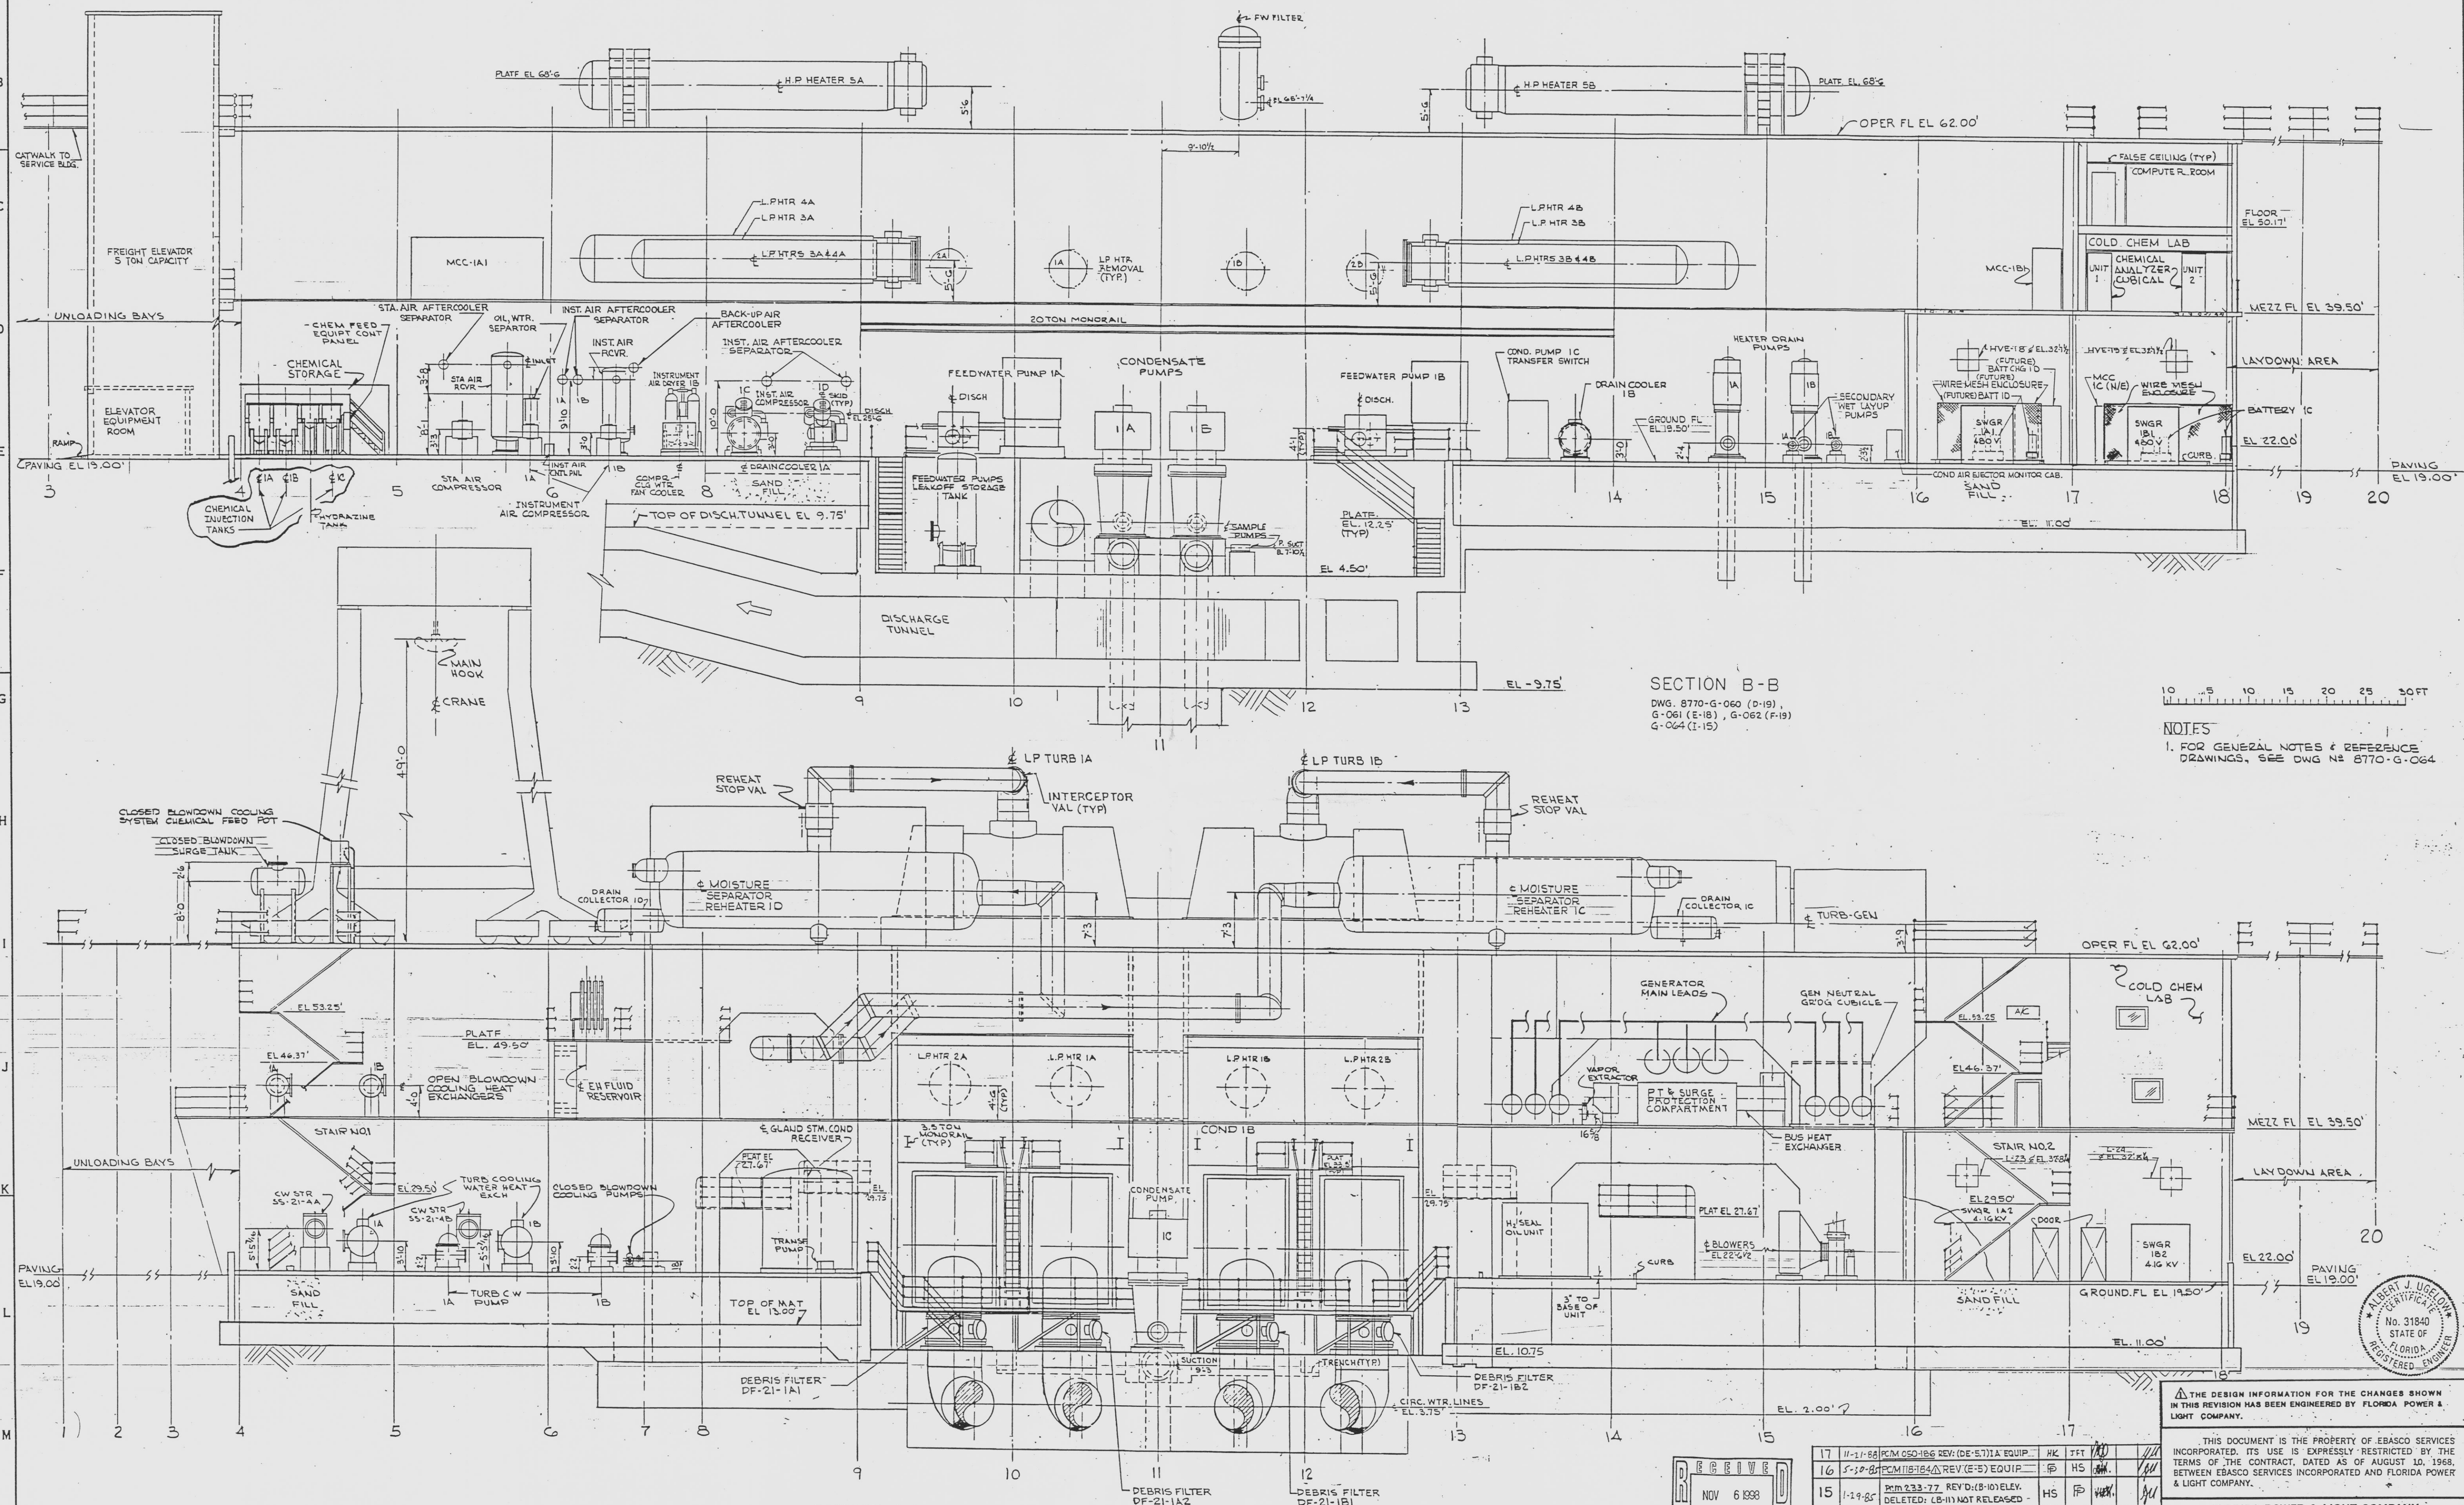

SECTION B-B

DWG. 8770-G-060 (D-19)
G-061 (E-18), G-062 (F-19)
G-064 (I-15)

NOTES

1. FOR GENERAL NOTES & REFERENCE
DRAWINGS, SEE DWG. 8770-G-064

SECTION A-A

DWG. 8770-G-060 (I-19)
G-061 (J-19)
G-061 (K-19)RECEIVED
NOV 6 1993
DOCUMENT CONTROL CENTER

NO.	DATE	REVISION	BY	CH	APPROVED	NO.	DATE	REVISION	BY	CH	APPROVED
21	10/1/83	DER. 18010 REVISED (E-13) TANK NAMES & TAG NOS.	H5	GM	SHM	17	11-17-88	PCIM 050-186 REV. (E-57) 1A EQUIP.	HK	FT	SHM
20	4/27/89	PCIM 050-186 REV. (E-57) 1A EQUIP.	H5	GM	SHM	16	5-3-88	PCIM 181-84 REV. (E-5) EQUIP.	HS	HS	SHM
19	8/22/83	PCIM 233-77 REV. (D-10) ELEV. DELETED (B-11) NOT RELEASED	AMB	FB	SHM	15	1-19-85	PCIM 233-77 REV. (D-10) ELEV. DELETED (B-11) NOT RELEASED	HS	FB	SHM
18	2/15/81	PCIM 233-77 REV. (D-10) ELEV. DELETED (B-11) NOT RELEASED	AMB	FB	SHM	14	4-13-84	PCIM 233-77 REV. (D-10) ELEV. DELETED (B-11) NOT RELEASED	HS	FB	SHM
		PCIM 233-77 REV. (D-10) ELEV. DELETED (B-11) NOT RELEASED	AMB	FB	SHM	13	8-13-83	PCIM 233-77 REV. (D-10) ELEV. DELETED (B-11) NOT RELEASED	HS	FB	SHM
		PCIM 233-77 REV. (D-10) ELEV. DELETED (B-11) NOT RELEASED	AMB	FB	SHM	12	2-23-83	PCIM 233-77 REV. (D-10) ELEV. DELETED (B-11) NOT RELEASED	HS	FB	SHM

THE DESIGN INFORMATION FOR THE CHANGES SHOWN
IN THIS REVISION HAS BEEN ENGINEERED BY FLORIDA POWER &
LIGHT COMPANY.THIS DOCUMENT IS THE PROPERTY OF EBASCO SERVICES
INCORPORATED. ITS USE IS EXPRESSLY RESTRICTED BY THE
TERMS OF THE CONTRACT, DATED AS OF AUGUST 10, 1968,
BETWEEN EBASCO SERVICES INCORPORATED AND FLORIDA POWER &
LIGHT COMPANY.FLORIDA POWER & LIGHT COMPANY
ST. LUCIE PLANT
1976 - 890,000 KW INSTALLATION - UNIT NO. 1GENERAL ARRANGEMENT
TURBINE BUILDING - SECTIONS - SHEET 1

EBASCO SERVICES INCORPORATED - NEW YORK

SCALE 1/8" = 1'-0"
APPROVED
DATE 2-23-83
DIV. MECH.
DR. ANDERSON
CH. P. P. GAN

8770-G-063