8770-G-068

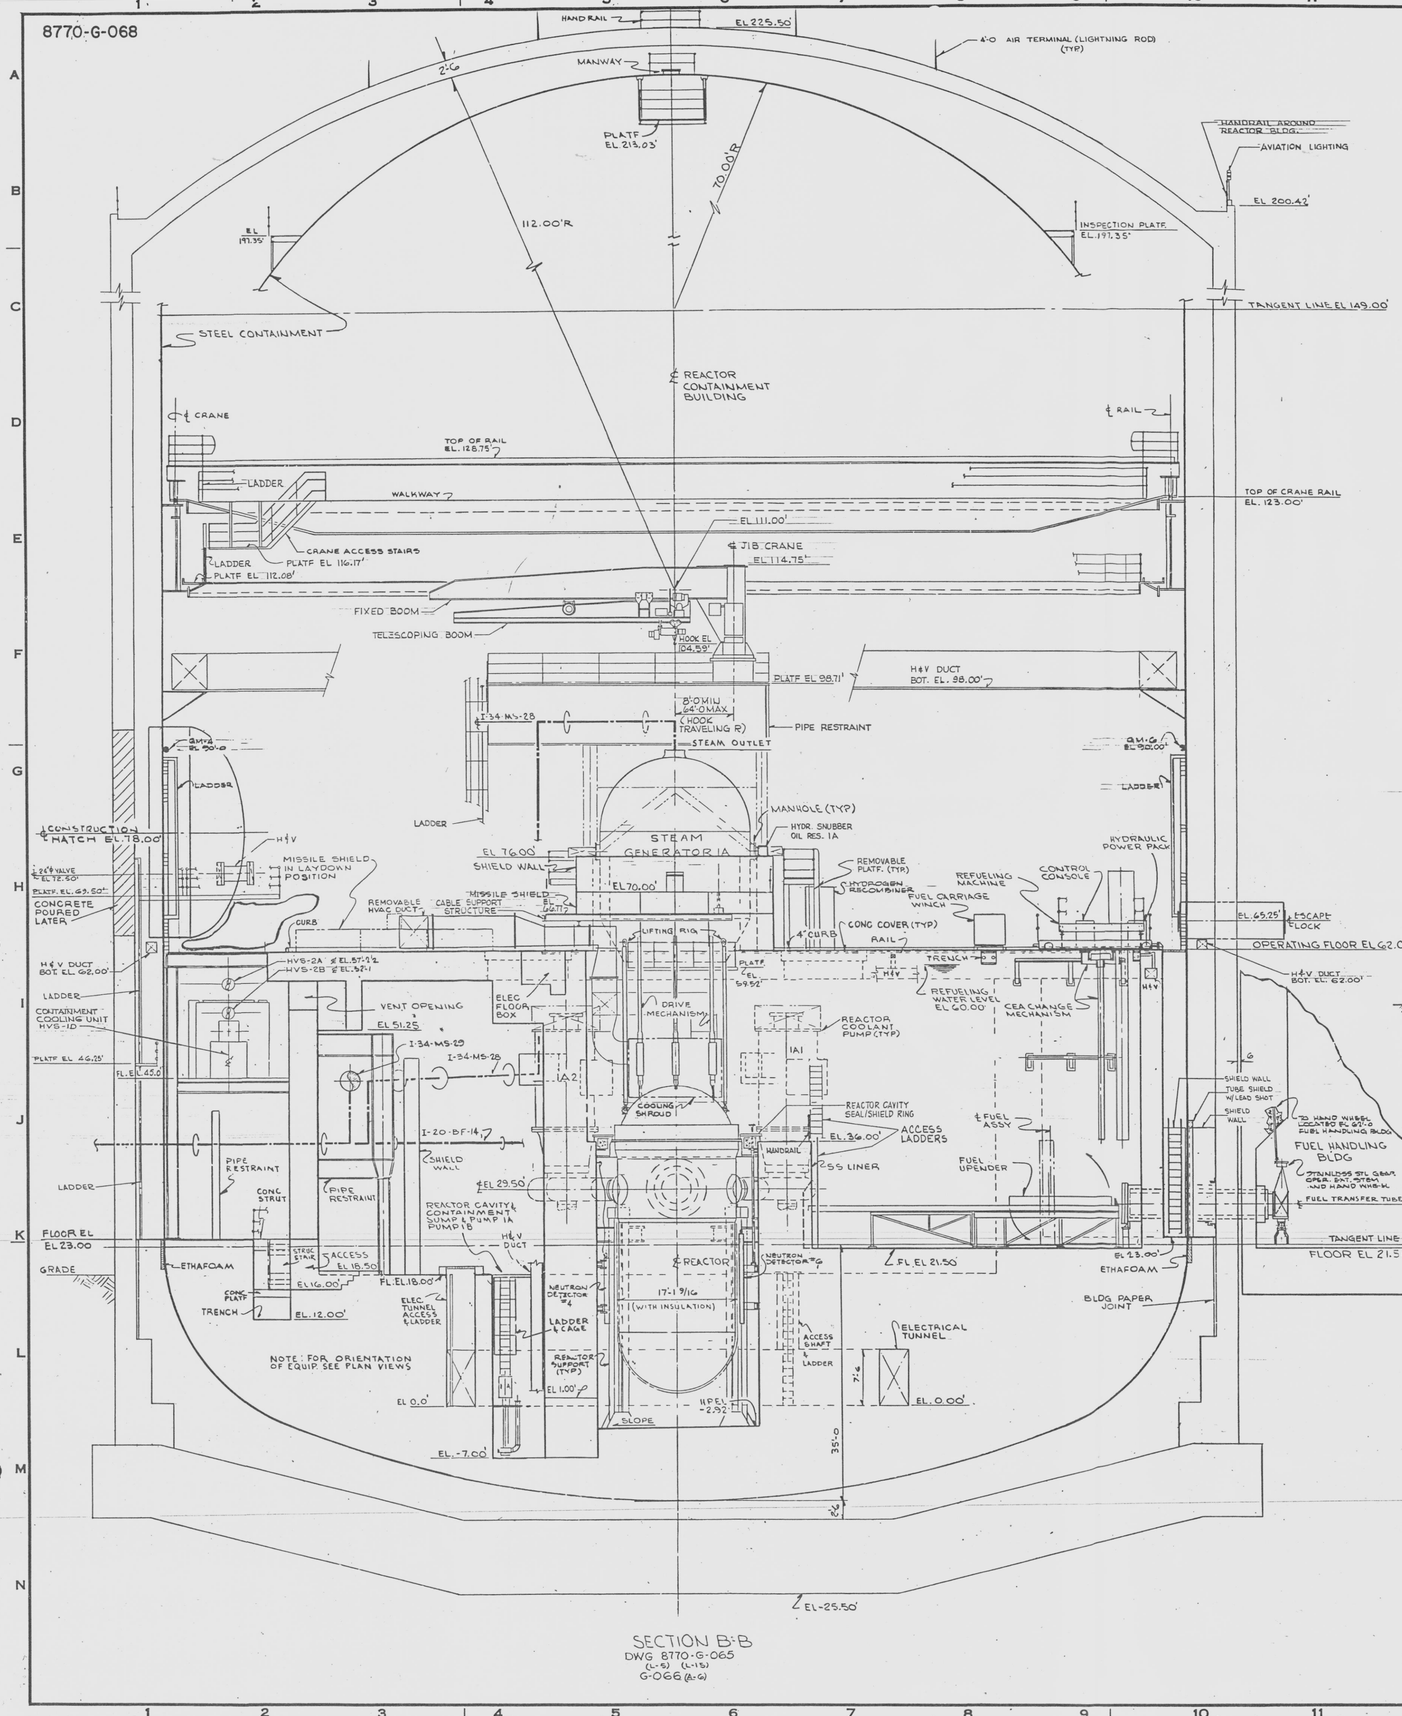

SECTION B-B
DWG 8770-G-065 (L-6) (L-15)
G-066 (L-6)

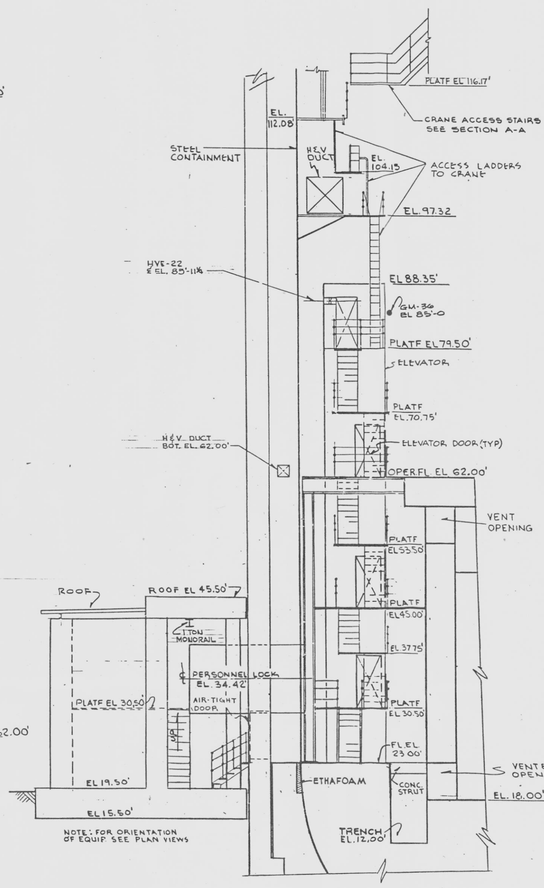

SECTION C-C
DWG 8770-G-065 (K-8) (K-11)
G-066 (K-8)

LEGEND

- ● GM- GEIGER-MUELLER MONITOR
- △ INDICATES AREA HAS IONIZATION DETECTORS (FIRE PROTECTION)
- CO₂ FIRE EXTINGUISHER
- ■ LOCAL/ALARM INDICATOR
- SEISMIC MONITOR

REFERENCE DRAWINGS

LIST OF DRAWINGS	8770-A-146
SITE PLAN	2998-G-058
ENLARGED PLOT PLAN	2998-G-059
GENERAL ARRANGEMENT- REACTOR BUILDING-	
PLANS - SHEET 1	8770-G-065
PLANS - SHEET 2	8770-G-066
SECTIONS - SHEET 1	8770-G-067

NOTE

PLANT DATUM SHALL BE MEAN LOW WATER IN ATLANTIC OCEAN EL 0.00'

RECEIVED
MAR 26 1998
NRC RECORDS DOCUMENT CONTROL CENTER

ALBERT J. UGELOW CERTIFICATE No. 31840 STATE OF FLORIDA REGISTERED ENGINEER

1 0FT 5 10 15 20 25

NO.	DATE	REVISION	BY	CH	APPROVED
17	2-19-95	PC/M 228-193: REV: (J5, G) REACTOR CAVITY SEAL/SHIELD RING DEL: (J5, G) WATER BAGS, NEUTRON STREAMG SHIELD & SUPPORT STEEL	WJ	PDB	
16	9-27-93	PC/M 285-192- DEL: (H6) (16), INCORE DETECTOR.	RB		
15	3-18-87	PC/M 086-183 ADD: (J-7) HANDRAIL	MM	HK	
14	7-26-84	PC/M 274-183 ADD: (J-7) WATER BAG	FP	HS	
13	3-28-84	GEN. REV: (T-19) DWG. NO DEL: (C-14) (E-3) NOT RELEASED	FP	HS	
12	12-12-83	GEN. REV: (T-19) DWG. NO ADD: (Z-K-10) SHIELD WALL DEL: (B-C) NOT RELEASED PC/M 3-83 Δ ADD: (H-13) MONORAIL PC/M 95-81 ADD: (J-K-10) TUBE SHIELD	MAC	FP	
11	8-01-83	PC/M 136-81 REV: (H-5) HVAC	AA	FP	
10	2-23-83	PC/M 53-82 REV: (C-15) (E-2) CRANE ACCESS PLATF. LOC PC/M 56-81 Δ ADD: (H-12) , ROOF GEN. REV: (N-19) TITLE BLOCK (E-5) HANDRAIL (F-5) 71B CRANE PC/M 58-80 Δ ADD: (H-13) CONT. TL RM	AA	FP	
18	2/9/98	PC/M 370-86 DEL: (H2) CONT TOOL RM	PDB		

FOR PREVIOUS REV BLOCKS SEE RECORD MYLAR 8770-G-068 REV 9

⚠ THE DESIGN INFORMATION FOR THE CHANGES SHOWN IN THIS REVISION HAS BEEN ENGINEERED BY FLORIDA POWER & LIGHT COMPANY.

THIS DOCUMENT IS THE PROPERTY OF EBASCO SERVICES INCORPORATED. ITS USE IS EXPRESSLY RESTRICTED BY THE TERMS OF THE CONTRACT, DATED AS OF AUGUST 10, 1968 BETWEEN EBASCO SERVICES INCORPORATED AND FLORIDA POWER & LIGHT COMPANY.

FLORIDA POWER & LIGHT COMPANY
ST LUCIE PLANT
1976 - 890,000 KW INSTALLATION - UNIT NO. 1
GENERAL ARRANGEMENT
REACTOR BUILDING - SECTIONS SHEET 2
EBASCO SERVICES INCORPORATED NEW YORK

SCALE: 1/8"=1'-0 | APPROVED | DATE 2-23-83
DIV. MECH.
DR. A. ANDERSON
CH. F. PAGANI
8770-G-068
18

DRAWING NUMBER 8770-G-068
PLAN HOLD CORPORATION • IRVINE, CALIFORNIA
DRAWING NUMBER
PLAN HOLD CORPORATION • IRVINE, CALIFORNIA
DRAWING NUMBER
PLAN HOLD CORPORATION • IRVINE, CALIFORNIA