BACK MN CONTROL BD-DC PNL 1-1

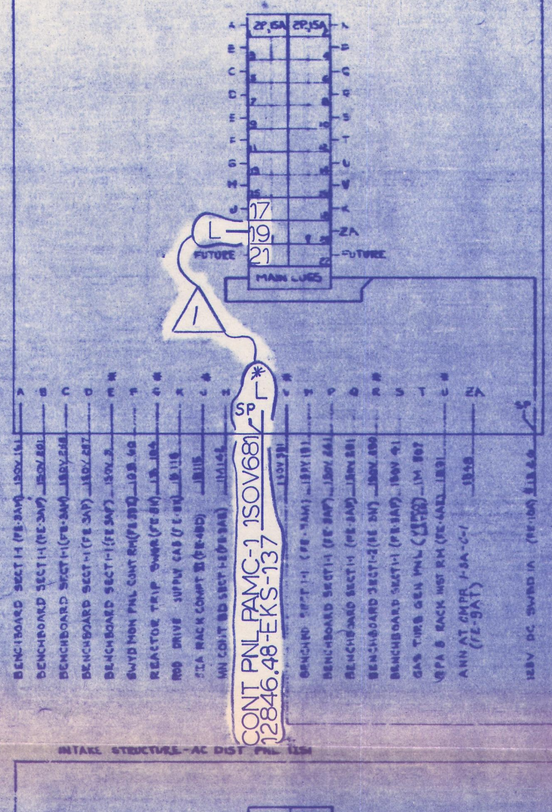

BACK MN CONTROL BD-DC PNL 1-2

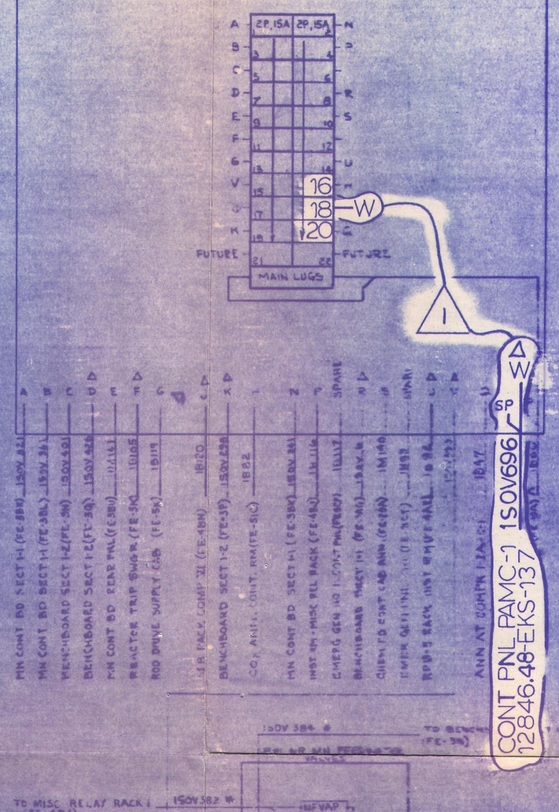

BACK MN CONTROL BD-AC PNL 1-1

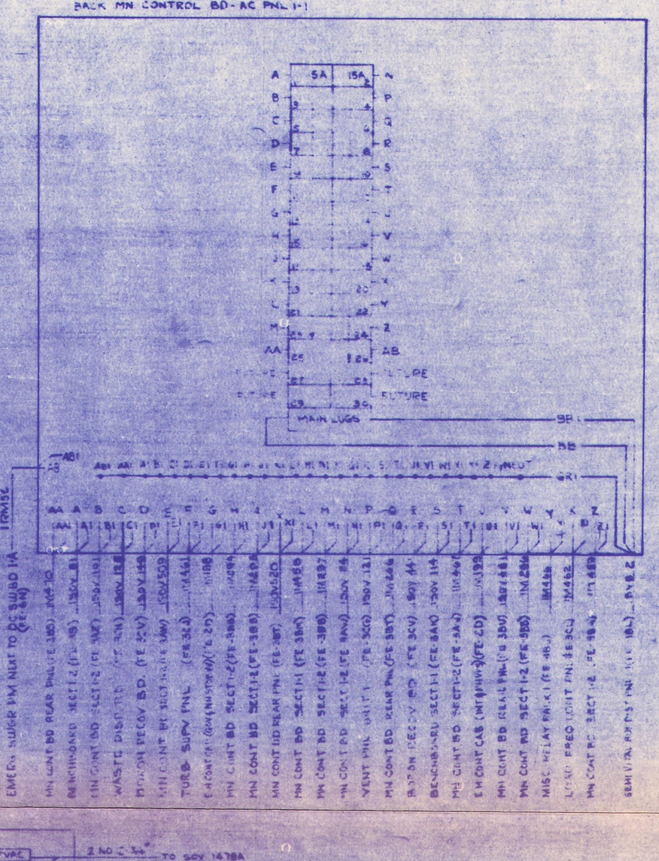

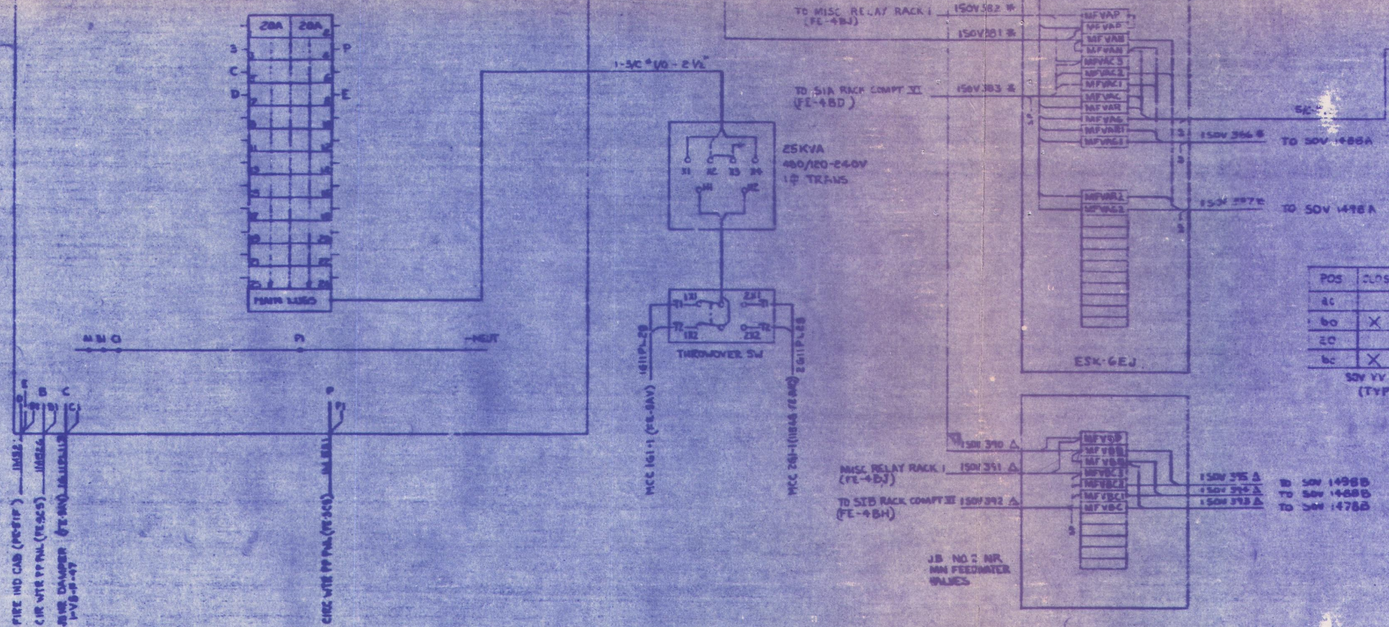

NOTE:
1 IDENTIFICATION OF VITAL CKTS
B VITAL CKTS (ORANGE CABLE)
A VITAL CKTS (PURPLE CABLE)
ALL COMPONENTS OF VITAL CKTS SUCH AS MOTOR CONTROL ETC TO HAVE COLOR CODE OF RESPECTIVE CKT.

ISSUED FOR J.O. 12846.51 DC-80-S29A/B

THIS IS A COPY OF 11448-FE-18J-7 VEPCO TO UPDATE ORIGINAL

APPROVED

WIRING DETAILS
MISCELLANEOUS CKTS SH2

SURRY POWER STATION
VIRGINIA ELECTRIC AND POWER COMPANY
STONE & WEBSTER ENGINEERING CORPORATION
BOSTON, MASS.

DRAWING NUMBER 11448-FE-18J

RESP. ENGR. P. REILLY
DES. ENGR. L. FOSSE

NO	DESCRIPTION	CHKD	CONC	APPD	DATE
1	ISSUED FOR JO 12846.51				

12846.51-EKS-5-1

00040

THE INFORMATION ON THIS DRAWING MAY NOT BE COPIED OR USED FOR OTHER THAN THE CONSTRUCTION, MAINTENANCE OR REPAIR OF THE PLANT FACILITY DESCRIBED IN THE TITLE BLOCK.

TERA APERTURE CARD

8107170292