

VIRGINIA ELECTRIC AND POWER COMPANY
RICHMOND, VIRGINIA 23261

December 15, 1980

Mr. Harold R. Denton, Director
Office of Nuclear Reactor Regulation
Attn: Mr. Steven A. Varga, Chief
Operating Reactors Branch 1
Division of Licensing
U. S. Nuclear Regulatory Commission
Washington, D.C. 20555

Serial No. 945
PO/ATV:mmf
Docket No.: 50-280
License No.: DPR-32

Dear Mr. Denton:

REQUESTED RELIEF FROM INSERVICE
INSPECTION AND TESTING REQUIREMENTS
SURRY POWER STATION UNIT NO. 1

Pursuant to 10 CFR 50.55a (g), the Virginia Electric and Power Company submitted its programs for inservice inspection and testing of pumps and valves during the last forty month period of the first ten year interval for Surry Power Station Unit 1 on May 17, 1979. After reviewing the program for inservice inspection and testing of pumps and valves following the NRC working group meeting held April 15, 16, 17, 1980, we hereby resubmit our program with the detailed specific relief we require from ASME Code requirements pertaining to inservice inspection and testing of pumps and valves as outlined in attachments A, B, and C.

Very truly yours,

B.R. Sylvia
B. R. Sylvia
Manager-Nuclear Operations
and Maintenance

RECEIVED DISTRIBUTION
SERVICES UNIT

1980 DEC 17 AM 8 50

US NRC
DISTRIBUTION SERVICES
BRANCH

App
S
40/40

8012170

454

0

DOCKET NO. 50-280

SURRY #1

REQUESTED RELIEF FROM INSERVICE INSPECTION
AND TESTING REQUIREMENTS

LTR DTD 12/15/80 (8012170454)

— NOTICE —

THE ATTACHED FILES ARE OFFICIAL RECORDS OF THE
DIVISION OF DOCUMENT CONTROL. THEY HAVE BEEN
CHARGED TO YOU FOR A LIMITED TIME PERIOD AND
MUST BE RETURNED TO THE RECORDS FACILITY
BRANCH 016. PLEASE DO NOT SEND DOCUMENTS
CHARGED OUT THROUGH THE MAIL. REMOVAL OF ANY
PAGE(S) FROM DOCUMENT FOR REPRODUCTION MUST
BE REFERRED TO FILE PERSONNEL.

DEADLINE RETURN DATE

50-280

LTR DTD

12/15/80

8012170454

RECORDS FACILITY BRANCH

ATTACHMENT A

SURRY UNIT 1

REQUESTED RELIEF FROM THE INSERVICE INSPECTION REQUIREMENTS
FOR CLASS 1, 2 and 3 COMPONENTS AS SET FORTH
IN SECTION XI OF THE ASME BOILER AND PRESSURE VESSEL CODE,
1974 EDITION WITH ADDENDA THROUGH THE SUMMER OF 1975
(LAST 40 MONTH PERIOD OF THE FIRST 10 YEAR INTERVAL)

The enclosed tables provide a listing of the Class 1, 2 and 3 pressure-retaining components (and their supports) which are subject to the inspection requirements of Subsections IWB, IWC and IWD of Section XI of the ASME Boiler and Pressure Vessel Code 1974 Edition with Addenda thru the Summer of 1975.

These tabulations identify the components to be inspected, the components safety class, the applicable code to which the component was built, and the method of examination. Relief from the inspection requirements of each Subsection is requested in cases where these inspection requirements have been determined to be impractical. Where relief is requested, specific information is provided which identifies the applicable code requirement, justification for the relief request, and the inspection method to be used as an alternative.

The following provide further clarification concerning the Class 1, 2 and 3 system inspection programs.

- 5/17/79 -db
12/15/80
#2 9/28/79
have
- (a) Articles IWC-3000 and IWD-3000 entitled, "Evaluation of Examination Results" are in the course of preparation by the Code Committee and, as yet, are not available for use. Standards for examination evaluations as included in the 1974 Edition of Section XI with Addenda through the Summer, 1975, are incomplete and "Acceptance Standards for Flaw Indications" as given in Article IWB-3000 of the 1977 Edition of Section XI will be utilized.
 - (b) Articles IWA-4000, IWB-4000, IWC-4000 and IWD-4000 entitled "Repair Procedures" in the 1977 Edition of Section XI with Addenda thru the Summer of 1978 provide additional guidelines for making repairs and will be used in lieu of those contained in the 1974 Edition of Section XI with Addenda thru the Summer of 1975.
 - (c) Requirements for the visual examination of Class 1 systems and components for evidence of leakage during the performance of a system pressure test following each refueling are identified by IWB-5200. Exception is taken to the implementation of these requirements on those portions of Class 1 systems which are contained between two check valves or two normally closed valves, where pressure applied to the reactor coolant system will be retained at the first valve in the line. The portions of systems affected by this limitation are:
 - (i) Cold leg injection from accumulators between check valves 1-SI-109, 130 and 147 and 1-SI-107, 129 and 147, test lines to valves HCV-1850B, D and F, RHR return to valves MOV-1720A and B.

During normal operation these portions of the systems are filled and pressurized to the normal accumulator operating pressure of 620 to 665 psig (refer to drawings 11448-FM-87A and 89B).

- (ii) Hot leg injection between check valves 1-SI-88, 91 and 94 and check valves 1-SI-238, 239 and 240. These portions of systems are filled and vented but not pressurized during normal operation (refer to drawing 11448-FM-89B).
 - (iii) Cold leg low head injection line between check valves 1-SI-79, 82 and 85 and check valves 1-SI-241, 242 and 243; and high head and boron injection to check valves 1-SI-235, 236 and 237 (refer to drawing 11448-FM-89B).
 - (iv) RHR take-off line between normally closed (with pressure interlock) valves MOV-1700 and 1701. This portion of the system will be pressurized whenever the system is put into operation during plant shutdown when the reactor coolant system is cooled to 350°F and depressurized to 450 psig (refer to drawing 11448-FM-87A).
- (d) Subsections IWB and IWC contain differing requirements for the hydrostatic testing of Class 1 and Class 2 systems and components. The implementation of these requirements is impractical when the only means of pressurizing the Class 2 system is through the Class 1 system or when the boundary between the two systems is a check valve arranged for flow from Class 2 to the Class 1 system.

Exception is taken to the performance of the hydrostatic test requirements as required by Article IWC-2412(a) on those portions of the Class 2 systems identified below. Visual examination for evidence of leakage will be conducted on these portions of the systems at the system nominal operating pressure in accordance with the requirements of IWB-5221 for the adjoining Class 1 system.

- (i) R. C. Pump seal bypass lines from the flow orifice to valve HCV-1307 (refer to drawing 11448-FM-88C).
- (ii) Hot leg injection between check valves 1-SI-88, 91 and 94 and check valves 1-SI-238, 239 and 240. These portions of systems are filled and vented but not pressurized during normal operation (refer to drawing 11448-FM-89B).
- (iii) R. C. Pump seal injection line from check valve 1-CH-323, 333 and 349 to manually operated valve 1-CH-294, 297 and 300 (refer to drawings 11448-FM-88B and 88C).
- (iv) Excess letdown system from valve HCV-1201 to HCV-1137 (refer to drawing 11448-FM-88C).

- (v) Letdown line from valve LCV-1460B to orifice outlet valves HCV-1200A, B and C (refer to drawing 11448-FM-88C).
- (e) The examination requirements for Class 3 systems and components as given in the enclosed tabulation are in accordance with IWD-2410(c) which specifies that 100 percent of the components be examined as required by IWA-5240 and IWD-2600 either during normal operation or during system inservice testing. An additional requirement of IWD-2410(b) is the examination of Class 3 systems and components for evidence of leakage during the performance of a system pressure test in accordance with IWD-5000. It should be noted, that these system pressure tests when required are impractical in those portions of systems, such as component cooling, service water, spent fuel pit cooling, and boric acid transfer and recirculation, which are in continuous operation during plant operation. The continuous functional operation serves to demonstrate the structural and leak-tight integrity of these systems. Visual examinations of these systems will be performed at normal operation pressures to verify leaktightness.
- (f) Ultrasonic examinations will be conducted in accordance with the provisions of Appendix I and Article 5 of Section V as required by Paragraph IWA-2232.

As an alternative to using Article 5 of Section V, Appendix III of Section XI of the 1974 Edition, Winter, 1975 Addenda of the ASME Boiler and Pressure Vessel Code will be used for ultrasonic examination of piping systems with the following changes:

- (1) Non-geometric indications 50% of DAC or greater shall be recorded.
- (2) An indication 100% of DAC or greater shall be investigated by a Level II or Level III examiner to the extent necessary to determine the size, shape, identity and location of the reflector and evaluated in accordance with the acceptance requirements of Section XI.
- (3) Any non-geometric indication, 20% of DAC or greater, discovered during the ultrasonic (UT) examination shall be evaluated by a Level II or Level III examiner to the extent necessary to determine the shape, identity and location of the reflector.

It is recognized that Appendix III of Section XI was issued in the Winter, 1975, Addenda and, as such, has not been officially recognized by the NRC by reference in 10 CFR 50. However, Appendix III is the first guideline that has been published in the ASME Code for the ultrasonic examination of pipe welds and, as such, its use is essential.

- (g) As an alternative for T-3121 of Section XI: "Calibration blocks required for the examination of welds in ferritic vessels 2 1/2 inches thick and over will be fabricated from material of the same specification, product form, and heat treatment as one of the materials being joined as allowed by article T-434.1 in the Winter, 1976 Addenda of Section V of the ASME Boiler and Pressure Vessel Code."

The reason this alternative is requested is that the Code requires that calibration blocks for the examination of welds in ferritic vessels 2 1/2 inches thick and greater be fabricated from material taken from the component nozzle drop out or material from the component prolongation. As a third alternative, when it is not possible to fabricate the block from material taken from the component, the block may be fabricated from a material of a specification included in the applicable examination volumes of the component. It is required that the acoustic velocity and attenuation of such a block be demonstrated to fall within the range of straight beam longitudinal wave velocity and attenuation found in the unclad components.

For the components in Surry Unit 1, particularly the pressurizer and steam generators, it will be impossible to meet the requirements of alternatives 1 or 2. Materials of the specification are readily available, but because all the components involved are clad on the inner surfaces, it would be impossible to obtain a comparison of sound beam velocities and attenuations in the unclad component.

Limitations may occur for the examination of piping system circumferential butt welds (Category B-J) when the welds occur at geometric discontinuities such as pipe to vessel welds, pipe to fitting welds or fitting to fitting welds. For pipe to fitting or pipe to vessel nozzle welds, examinations can be performed to the extent required by T-532 of Section V from the weld and pipe surfaces. Examination from the fitting side would be dependent upon the geometric configuration. Where elbows or tees are concerned, examination can be performed from the fitting side except where the intrados of the fitting prevents adequate ultrasonic coupling. No examinations can be performed from the fitting side when it is a valve or a flange. In most cases one hundred percent of the weld material can be examined. In instances where welds occur at fitting to fitting, access restrictions as outlined above occur on both sides of the weld. In instances where ultrasonic examinations cannot be performed on one hundred percent of the volume of the weld and heat affected zone, surface examinations may be performed to supplement the limited volumetric examination.

Welds in the Surry Unit 1, Class 1 system which due to limitations, would require surface examinations are:

- (i) Loop 1 Cold Leg Injection line; Welds 6 and 7.
- (ii) Loop 2 Charging line; weld 11.
- (iii) Loop 2 Cold Leg injection line; welds 4 and 5.
- (iv) Loop 1 RTD return line; weld 7.
- (v) Loop 2 RTD return line; weld 7.
- (vi) Loop 3 RTD return line; weld 7.

- (vii) Loop 3 Cold leg injection line; welds 3 and 4.
- (viii) Pressurizer safety valve lines welds 7 and 8.
- (ix) Pressurizer Relief line; welds 4 and 8

Welds in the Surry Unit 1, Class 2 system with limitations at geometric discontinuities are:

- (i) Loop 1 Mainsteam By-Pass; welds 1,7,13,20
- (ii) Loop 2 Mainsteam Relief line; welds 12,13,16,18,20,22,29,31
- (iii) Loop 2 Mainsteam By-Pass; welds 1,7,13,20
- (iv) Loop 2 SIS Hot Leg; weld 15
- (v) 14" RHR; welds 1,10,15,22,27
- (vi) 8", 10", 12" RHR; welds 2,3,4,11,15,14,13,38,36,45
- (vii) 12", 10", RHR; welds 1,7,20,27,15
- (viii) 12", 10", 6" RHR; weld 10
- (ix) 10" SIS; weld 9
- (x) 10" 6" SIS welds 6 and 14

In instances where the locations of pipe supports or hangers restrict the access available for the examination of pipe welds as required by IWB-2600, examinations will be performed to the extent practical unless removal of the support is permissible without unduly stressing the system.

Certain Class 2 systems or portions of Class 2 systems and components are exempt from the examination requirements of the IWC-2520 by IWC-1220. A summary of these exemptions as applicable to the Surry plant systems are as follows:

- (i) All CVCS piping equal to or less than four-inch nominal diameter and is exempted by IWC-1220(d).
- (ii) During plant operation, the boric acid solution will be constantly recirculated through the boron injection tank by the transfer pump system. Samples would normally be taken on a regular basis and the component and associated piping would be exempt from examination by IWC-1220(c).
- (iii) The boron injection tank discharge piping is all equal to or less than four inch nominal diameter.
- (iv) During plant operation, the contents of the SIS accumulators are normally sampled on a regular basis and this component and associated piping would also be exempted by IWC-1220(c).
- (v) During plant operation, the low head SIS injection pumps are run on a periodic basis to recirculate flow and from the RWST. Samples taken on a regular basis from the RWST would verify the chemistry of the system fluid and the pump and associated suction piping would be exempt from examination by IWC-1220(c).

- (vi) The high head SIS piping equal to or less than four inch nominal diameter is exempted by IWC-1220(d).
- (vii) The containment spray system and recirculation spray systems do not function during normal reactor operation and are exempt by IWC-1220(b).
- (viii) The RWST, CAT and associated piping have design pressures and temperature less than 275 psig and 200°F and are exempt by IWC-1220(a).

The inservice inspection programs outlined in the attached tabulations have been developed as a result of a design review. Should certain ASME Section XI Code requirements be discovered to be impractical due to unforeseen reasons during the process of performing inspections or tests, relief will be requested from the specific Section XI Code requirement at that time.

Radiation levels in certain areas or of certain components may be found to prohibit the access for operators or inspectors to perform the inspections or tests described in this program. If source strengths cannot be reduced and access is still restricted by considerations of compliance with the requirements of Regulatory Guides 8.8 and 8.10, relief will be requested from the specific Section XI Code requirements and alternative examination or test requirements be proposed.

Codes references as being applicable to construction of components in the attached tables are:

- IIIA ASME Boiler and Pressure Vessel Code, Section III, Class A Nuclear Vessels
- IIIC ASME Boiler and Pressure Vessel Code, Section III, Class C Nuclear Vessels
- VIII ASME Boiler and Pressure Vessel Code, Section VIII, Pressure Vessels
- B 31.1 USA Standard USAS B 31.1 Code for Pressure Piping
- B 16.5 USA Standard USAS B 16.5 Steel Pipe Flanges, Flanged Valves and Fittings

SUPPLEMENT 1
INSERVICE INSPECTION
ASME CODE CLASS 1 COMPONENTS

TABLE IWB-2600 ITEM NO.	TABLE IWB-2500 EXAMINATION CATEGORY	SYSTEM OR COMPONENT	CODE APPLICABLE TO CONSTRUCTION	AREA TO BE EXAMINED	EXAMINATION REQUIREMENT	SECTION XI CODE RELIEF REQUESTED
B1.1	B-A	Reactor Vessel 1-RC-R-1	III-A	Upper to intermediate shell course circumferential weld	Volumetric	No
B1.1	B-A			Intermediate to lower shell course circumferential weld	Volumetric	No
B1.1	B-A			Intermediate shell course longitu- dinal welds (2)	Volumetric	No
B1.1	B-A			Lower shell course longitudinal welds (2)	Volumetric	No
B1.2	B-A			Lower head to shell circumferential weld	Volumetric	No
B1.2	B-B			Lower head ring to disc circumferen- tial weld	Volumetric	No
B1.3	B-C			Vessel to flange weld	Volumetric	No
B1.3	B-C			Closure head to flange weld	Volmetric	No
B1.4	B-D			Outlet nozzle to vessel welds (3)	Volmetric	No
B1.4	B-D			Inlet Nozzle to vessel welds (3)	Volmetric	No
B1.5	B-E			CRDM, Vent and In-Core Instrumen- tation penetrations and CRDM seal welds	Visual	No
B1.6	B-F			Outlet nozzle to safe-ends welds (3)	Volmetric & Surface	No

SUB UNIT 1
INSERVICE INSPECTION
ASME CODE CLASS 1 COMPONENTS

TABLE IWB-2600 ITEM NO.	TABLE IWB-2500 EXAMINATION CATEGORY	SYSTEM OR COMPONENT	CODE APPLICABLE TO CONSTRUCTION	AREA TO BE EXAMINED	EXAMINATION REQUIREMENT	SECTION XI CODE RELIEF REQUESTED
B1.6	B-F			Inlet nozzle to safe-end welds (3)	Volumetric & Surface	No
B1.7	B-G-1			Closure Head Studs (In-Place)	Not Applicable	No- Note 1
B1.8	B-G-1			Closure Head Studs & Nuts	Volumetric & Surface	No
B1.9	B-G-1			Vessel flange ligaments	Volumetric	No
B1.10	B-G-1			Closure head Washers	Visual	No
B1.11	B-G-2			Conoseal Bolting	Visual	No
B1.12	B-H			Integrally Welded vessel supports	Not Applicable	No- Note 2
B1.13	B-I-1			Closure Head Cladding	Surface & Visual or Volumetric	No- Note 3
B1.14	B-I-1			Vessel Cladding	Visual	No
B1.15	B-N-1			Vessel Interior Surfaces and Internals	Visual	No
B1.16	B-N-2			Interior Attachments and Core Support Structures	Not Applicable	No - Note 4
B1.17	B-N-3			Core Support Structures	Visual	No

SUPPLEMENT 1
INSERVICE INSPECTION
ASME CODE CLASS 1 COMPONENTS

TABLE IWB-2600 ITEM NO.	TABLE IWB-2500 EXAMINATION CATEGORY	SYSTEM OR COMPONENT	CODE APPLICABLE TO CONSTRUCTION	AREA TO BE EXAMINED	EXAMINATION REQUIREMENT	SECTION XI CODE RELIEF REQUESTED
B1.18	B-O			Control Rod Drive Housings	Volumetric	No
B1.19	B-P			Exempted Components	Visual	No
B2.1	B-B	Pressurizer 1-RC-E-2	III-A	Longitudinal Shell welds (6)	Volumetric	No
B2.1	B-B			Circumferential shell welds (7)	Volumetric	Yes - Note 17
B2.2	B-D			Nozzle to vessel welds (6)	Not Applicable	No - Note 5
B2.3	B-E			Heater Penetrations	Visual	No
B2.4	B-F			Nozzle to safe-end welds (6)	Volumetric & Surface	No
B2.5	B-G-1			Pressure Retaining Bolting (in place)	Not Applicable	No - Note 6
B2.6	B-G-1			Pressure Retaining Bolting when removed	Not Applicable	No - Note 6
B2.7	B-G-1			Pressure Retaining Bolting	Not Applicable	No - Note 6
B2.8	B-H			Integrally Welded Vessel Supports	Volumetric	No
B2.9	B-I-2			Vessel cladding	Visual	No
B2.10	B-P			Exempted Components	Visual	No
B2.11	B-G-2			Manway Bolting	Visual	No
B3.1	B-B	Steam Generators (3) Primary Side	III-A	Channel Head to tubesheet Weld (3)	Volumetric	No

SUBMIT UNIT 1
INSERVICE INSPECTION
ASME CODE CLASS 1 COMPONENTS

TABLE IWB-2600 ITEM NO.	TABLE IWB-2500 EXAMINATION CATEGORY	SYSTEM OR COMPONENT	CODE APPLICABLE TO CONSTRUCTION	AREA TO BE EXAMINED	EXAMINATION REQUIREMENT	SECTION XI CODE RELIEF REQUESTED
B3.2	B-D	1-RC-E-1A 1-RC-E-1B 1-RC-E-1C		Nozzle to Vessel welds (6)	Not Applicable	No - Note 7
B3.3	B-F			Nozzle to safe-end welds (6)	Volumetric & Surface	Yes - Note 8
B3.4	B-G-1			Pressure Retaining Bolting (in place)	Not Applicable	No - Note 6
B3.5	B-G-1			Pressure Retaining Bolting, when removed	Not Applicable	No - Note 6
B3.6	B-G-1			Pressure Retaining Bolting	Not Applicable	No - Note 6
B3.7	B-H			Integrally welded supports	Not Applicable	No - Note 6
B3.8	B-I-2			Vessel Cladding	Visual	No
B3.9	B-P			Exempted Components	Visual	No
B3.10	B-G-2			Manway Bolting	Visual	No
B4.1	B-F	Piping Pressure Boundary		Safe end to pipe welds	Not Applicable	No - Note 6
B4.2	B-G-1			Pressure Retaining Bolts (in place)	Not Applicable	No - Note 6
B4.3	B-G-1			Pressure Retaining Bolts when removed	Not Applicable	No - Note 6
B4.4	B-G-1			Pressure Retaining Bolting	Not Applicable	No - Note 6
B4.5	B-J			Circumferential and Longitudinal Pipe Welds	Volumetric	Yes - Notes 9 and

UNIT 1
INSERVICE INSPECTION
ASME CODE CLASS 1 COMPONENTS

TABLE IWB-2600 ITEM NO.	TABLE IWB-2500 EXAMINATION CATEGORY	SYSTEM OR COMPONENT	CODE APPLICABLE TO CONSTRUCTION	AREA TO BE EXAMINED	EXAMINATION REQUIREMENT	SECTION XI CODE RELIEF REQUESTED
B4.6	B-J			Branch Pipe connection welds exceeding 6" diameter.	Volumetric	Yes - Note 11
B4.7	B-J			Branch Pipe Connections Weld 6" diameter and smaller	Surface	No
B4.8	B-J			Socket Welds	Surface	No
B4.9	B-K-1			Integrally Welded Supports	Volumetric	Yes - Note 12
B4.10	B-K-1			Support Components	Visual	No
B4.11	B-P			Exempted Components	Visual	No
B4.12	B-G-2			Pressure Retaining Bolting	Visual	No
B5.1	B-G-1	Reactor Coolant Pumps (3)	III-A	Main Flange Bolting (in place)	Volumetric	No
B5.1	B-G-1	1-RC-P-1A 1-RC-P-1B 1-RC-P-1C		Seal Housing Bolting (in place)	Volumetric	Yes - Note 13
B5.2	B-G-1			Main Flange Bolting when removed	Volumetric & Surface	No - Note 14
B5.2	B-G-1			Seal Housing Bolting when removed	Volumetric & Surface	No - Note 14
B5.3	B-G-1			Main Flange Bolting	Visual	No
B5.3	B-G-1			Seal Housing Bolting	Visual	No
B5.4	B-K-1			Integrally Welded Supports	Volumetric	Yes - Note

SUPPLEMENT 1
INSERVICE INSPECTION
ASME CODE CLASS 1 COMPONENTS

TABLE IWB-2600 ITEM NO.	TABLE IWB-2500 EXAMINATION CATEGORY	SYSTEM OR COMPONENT	CODE APPLICABLE TO CONSTRUCTION	AREA TO BE EXAMINED	EXAMINATION REQUIREMENT	SECTION XI CODE RELIEF REQUESTED
B5.5	B-K-2			Support Components	Visual	No
B5.6	B-L-1			Pump Casing Weld	Volumetric	No - Note 16
B5.7	B-L-2			Pump Casings	Visual	No
B5.8	B-P			Exempted Components	Visual	No
B5.9	B-G-2			Pressure Retaining Bolting	Not Applicable	No - Note 6
B6.1	B-G-1	Valve Pressure Boundary		Pressure Retaining Bolting (in place)	Volumetric	No
B6.2	B-G-1			Pressure Retaining Bolting when removed	Volumetric & Surface	No
B6.3	B-G-1			Pressure Retaining Bolting	Visual	No
B6.4	B-K-1			Integrally welded supports	Not Applicable	No - Note 6
B6.5	B-K-2			Support Components	Visual	No
B6.6	B-M-1			Valve Body Welds	Not Applicable	No - Note 6
B6.7	B-M-2			Valve Bodies	Visual	No
B6.8	B-P			Exempted Components	Visual	No
B6.9	B-G-2			Pressure Retaining Bolting	Visual	No

SURRY UNIT 1
INSERVICE INSPECTION
ASME CODE CLASS 1 COMPONENTS

NOTES

1. The Reactor Vessel Closure Head Studs are removed during each refueling and there will be no need for examination in place as required by IWB-2600.
2. The reactor vessel is supported on pads integral with the inlet and outlet nozzles and therefore are excluded from examination requirements of IWB-2500 by Category B-H.
3. Radiation levels beneath the closure head may affect the allowable dosage of personnel doing surface and visual examination. Relief is requested from volumetric examination of the reactor vessel head cladding. Ultrasonic examination of the meridional and circumferential head welds from the O.D. will cover sufficient clad-metal interface area to provide assurance of closurehead structural integrity.
4. This requirement is applicable only to Boiling Water Type Reactors.
5. The pressurizer nozzles are integrally cast with the vessel head and therefore there are no welds requiring examination in accordance with the requirement IWB-2600. However, the inner radiused sections of the integrally cast nozzles will be ultrasonic examined from the outside and the area will be visual examined to the extent practical as this is a high radiation area (20 to 30R).
6. There are no items in this category on this component in the Surry Unit 1 Class 1 Systems.
7. The steam generator nozzles are integrally cast with the channel head and therefore are no welds in this category. However, the inner radiused sections of the integrally cast nozzles will be ultrasonic examined from the outside and the area will be visual examined to the extent practical as this is a high radiation area (20 to 30R).
8. Examinations of the steam generator primary nozzle to safe-end and safe-end to pipe weld is limited both by the nozzle geometry and surface condition and the limited surface preparation on the pipe side of the weld. The surface on the pipe side of the weld, which is a cast elbow, is machined for a distance of approximately three inches from the edge of the weld. Ultrasonic examination is limited to this from the edge of the weld. Examinations can be performed on the surface of the weld but are severely limited from the nozzle side by the rough, as cast surface. Surface examination can be performed on one hundred percent of the weld and the base metal on the pipe side. The configuration is shown in Figure 1.

9. Limitations may occur from the examination of piping system circumferential butt welds (Category B-J) when the welds occur at geometric discontinuities such as pipe to vessel welds, pipe to fitting welds or fitting to fitting welds. For pipe to fitting or pipe to vessel nozzle welds, examinations can be performed to the extent required by T-532 of Section V from the weld and pipe surfaces. Examinations from the fitting side would be dependent upon the geometric configuration. Where elbows or tees are concerned, examination can be performed from the fitting side except where the intrados of the fitting prevents adequate ultrasonic coupling. No examinations can be performed from the fitting side when it is a valve or a flange. In all cases one hundred percent of the weld material can be examined. In instances where welds occur at fitting to fitting, access restrictions as outlined above occur on both sides of the weld. In instances where ultrasonic examinations cannot be performed on one hundred percent of the volume of the weld and head affected zone, surface examinations will be performed to supplement the limited volumetric examination. Welds in the Surry Unit 1, Class 1 system which due to limitations would require surface examinations are:

- (i) Loop 1 cold leg injection line; weld 6 and 7.
- (ii) Loop 2 charging line; weld 11.
- (iii) Loop 2 cold leg injection line; welds 4 and 5.
- (iv) Loop 1 RTD return line; weld 7.
- (v) Loop 2 RTD return line; weld 7.
- (vi) Loop 3 RTD return line; weld 7.
- (vii) Loop 3 cold leg injection line; welds 3 and 4.
- (viii) Pressurizer safety valve lines welds 7 and 8.
- (ix) Pressurizer relief line; welds 4 and 8.

10. The ninety degree elbows on the crossover leg of the reactor coolant system are fabricated in two halves from austenitic stainless steel castings welded together by the electroslag process. The structure and nature of the electroslag weld in the cast austenitic ninety degree elbows is such that the material is opaque to ultrasonic transmissions utilizing currently available techniques. Radiography is the only other available technique for volumetric examination. It is not possible to obtain code acceptable radiographs with double wall "shots" on these components which are approximately thirty-eight inches diameter, 3.5 inches wall thickness, containing a two-inch thick splitter plate and having radiation levels of up to three hundred mr/hr on contact. Surface examination will be performed as a substitute for volumetric.

11. The configuration of the reactor coolant branch nozzle connection welds is as shown in Figure 2. Ultrasonic examinations cannot be performed on the surface of the weld. Examinations will be performed to the extent practical from the pipe and nozzle adjacent to the weld. Surface examination will be performed to supplement this volumetric examination.

12. The piping system integrally welded supports are attached to the pipe by fillet welds. The configuration of such welds is such that examinations cannot be performed to the extent required by IWB-2600 and only the base material of the pipe wall can be examined by ultrasonic techniques. Surface examination will be performed on the integrally welded attachments to supplement the limited volumetric examinations.
13. The reactor coolant pump seal housing bolts are of the socket head type and the configuration is such that ultrasonic examinations as required by IWB-2600 cannot be performed when the bolting is in place. Examinations will be performed to the extent required by IWB-2600 when the seal housing is disassembled for maintenance.
14. The reactor coolant pump main flange bolting is ultrasonically examined, in place in accordance with the requirements of IWB-2600, Item B5.1. Both the main flange and seal housing bolting will be examined as required by IWB-2600, Item B5.2 whenever a pump is disassembled for maintenance at the end of the ten-year interval when a pump will be disassembled for the performance required by Category B-L-1.
15. The structure and nature of the material of integrally welded pump supports are such that it is opaque to ultrasonic transmission. Surface and visual examination will be performed as a substitute for volumetric.
16. The reactor coolant pump casings in Surry Unit 1 are fabricated from two heavy wall austenitic steel castings joined together by a weld formed by the electroslag process. The structure and nature of this material are such that it is opaque to ultrasonic transmission.

Volumetric examination as required by IWB-2600 will be attempted utilizing radiographic techniques. The success of these examinations will be dependent upon the availability of high energy gamma sources and the level of background radiation. Internal fittings in the pump may also provide restriction to the extent of examination that can be performed.

17. Two of the pressurizer circumferential shell (C-5 and C-7) welds are not accessible for examination by volumetric or surface method due floor penetration and support structure interference. They will be subject to visual examination for evidence of leakage during system pressure tests.

FIGURE 1

STEAM GENERATOR PRIMARY NOZZLE SAFE-END TO PIPE WELD
CONFIGURATION


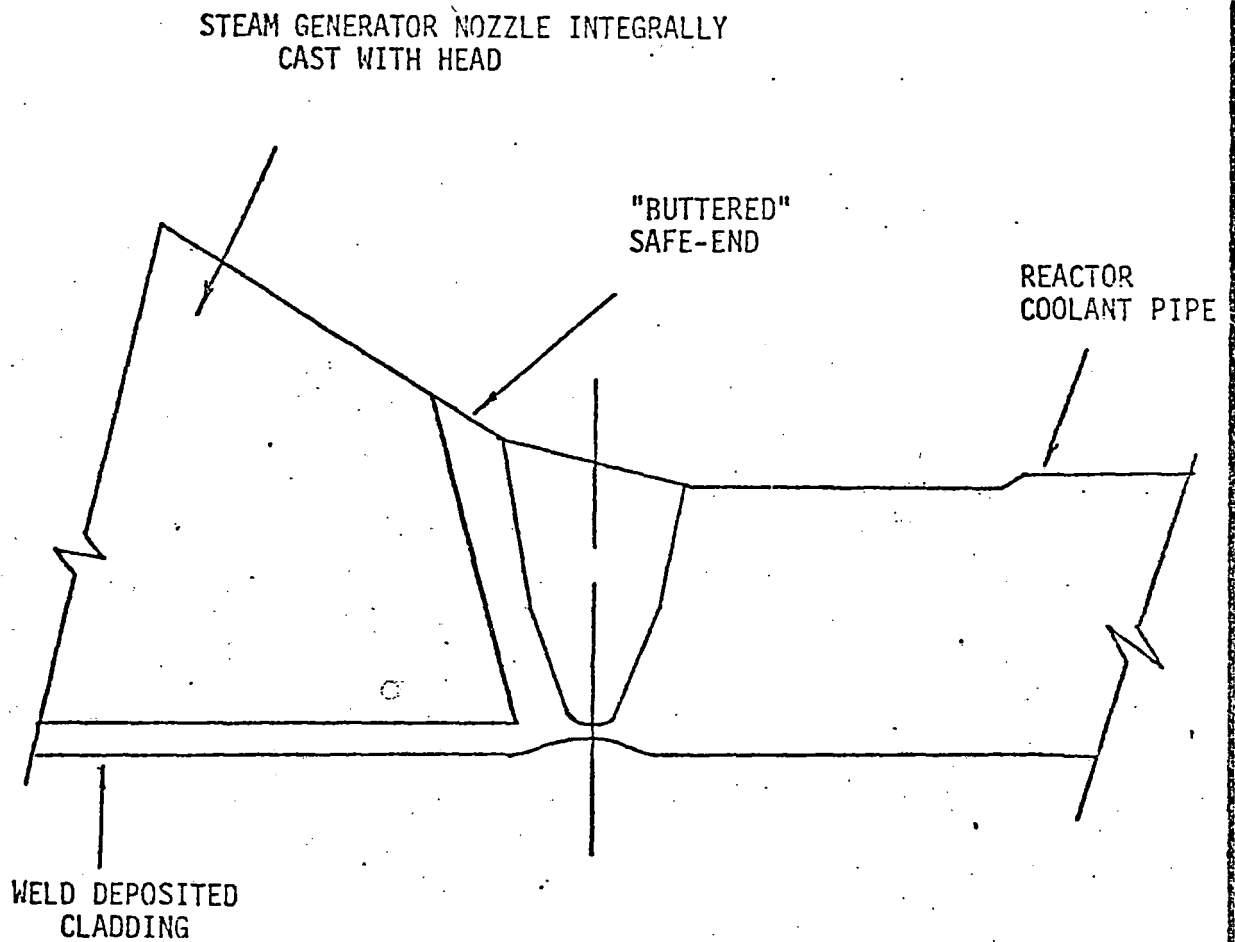


FIGURE 2

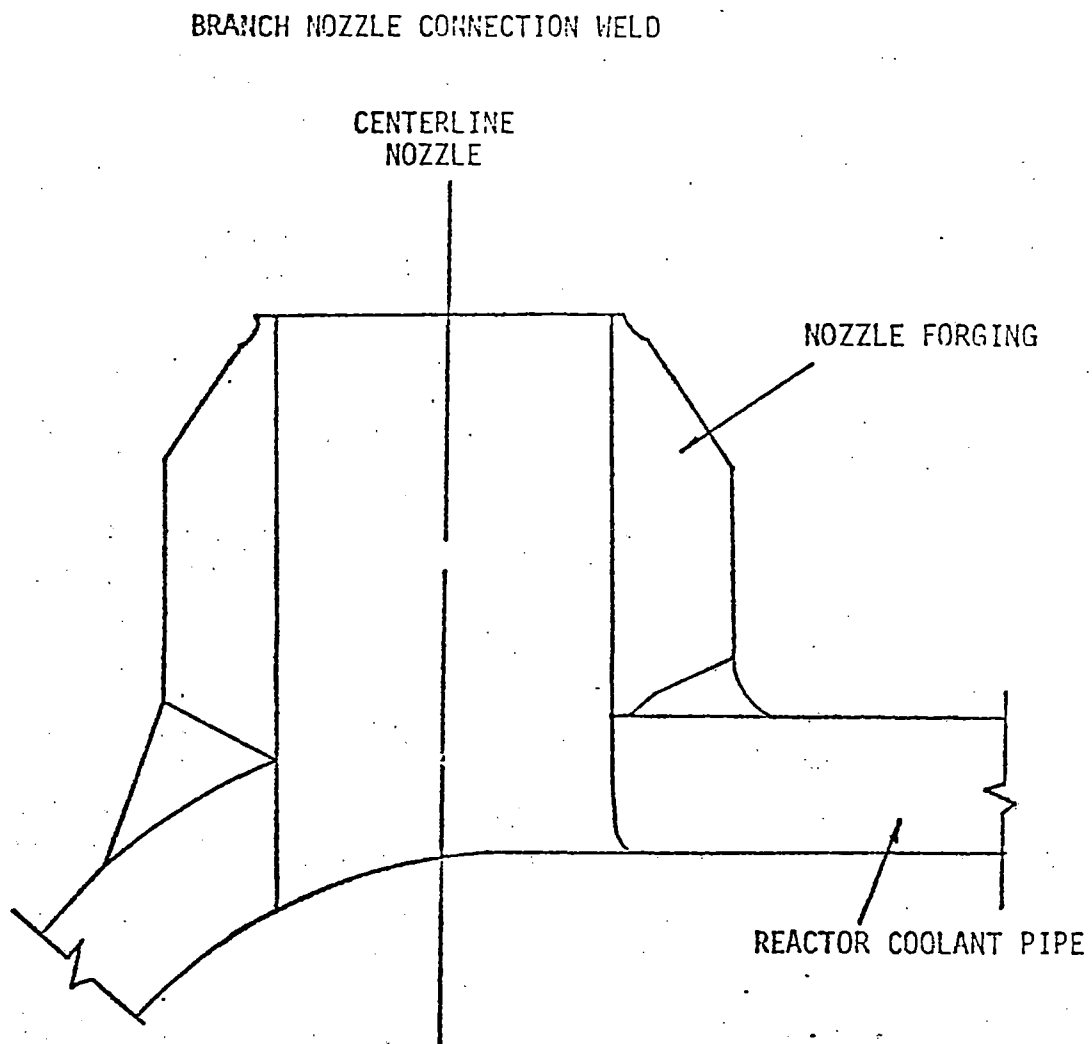

SUBUNIT 1
INSERVICE INSPECTION
ASME CODE CLASS 2 COMPONENTS

TABLE IWC-2600 ITEM NO.	TABLE IWC-2520 EXAMINATION CATEGORY	SYSTEM OR COMPONENT	CODE APPLICABLE TO CONSTRUCTION	AREA TO BE EXAMINED	EXAMINATION REQUIREMENT	SECTION XI CODE RELIEF REQUESTED
Cl.1	C-A-2	Steam Genera- rators (3) (Shell Side)	IIIA	Upper Head to Shell Weld	Volumetric	No
Cl.1	C-A	1-RC-E-1A 1-RC-E-1B 1-RC-E-1C		Upper Shell to Transition Weld	Volumetric	No
Cl.1	C-A			Transition to lower shell weld	Volumetric	No
Cl.1	C-A			Lower Shell to Stub barrel weld	Volumetric	No
Cl.1	C-A			Stub barrel to tubesheet weld	Volumetric	No
Cl.1	C-B			Steam Outlet Nozzle to shell weld	Volumetric	No
Cl.2	C-B			Feedwater Inlet Nozzle to shell weld	Volumetric	No
Cl.3	C-C			Integrally Welded Supports	Not Applicable	No - Note 1
Cl.4	C-D			Manway Bolting	Visual and Volumetric	No
Cl.1	C-A	Residual Heat Exchangers (2) (Tube Side)	IIIC	Head to Shell Welds	Volumetric	No
Cl.1	C-A	1-RH-E-1A 1-RH-E-1B		Shell to flange welds	Volumetric	No
Cl.2	C-B			Nozzle to vessel welds	Volumetric	Yes - Note 2
Cl.3	C-C			Integrally Welded Supports	Surface	No
Cl.4	C-D			Tubesheet Flange Bolting	Visual and Volumetric	No
Cl.1	C-A	Regenerative Heat Exchanger	III-C	Head to shell welds (6)	Volumetric	Yes - Note 3

UNIT 1
INSPECTION
ASME CODE CLASS 2 COMPONENTS

TABLE IWC-2600 ITEM NO.	TABLE IWC-2520 EXAMINATION CATEGORY	SYSTEM OR COMPONENT	CODE APPLICABLE TO CONSTRUCTION	AREA TO BE EXAMINED	EXAMINATION REQUIREMENT	SECTION XI CODE RELIEF REQUESTED
C1.1	C-A	1-CH-E-3		Shell to tubesheet welds (6)	Volumetric	Yes - Note 3
C1.2	C-B			Nozzle to vessel welds (12)	Not Applicable	No - Note 4
C1.3	C-C			Integrally welded supports	Not Applicable	No - Note 4
C1.4	C-D			Pressure Retaining Bolting	Not Applicable	No - Note 4
C1.1	C-A	Excess Letdown Heat Exchanger (Tube side)	III-C	Head to shell weld	Volumetric	No
C1.1	C-A	1-CH-E-4		Shell to flange weld	Volumetric	No
C1.2	C-B			Nozzle to vessel welds	Not Applicable	No - Note 5
C1.3	C-C			Integrally welded supports	Not Applicable	No - Note 5
C1.4	C-D			Pressure Retaining Bolting	Visual and Volumetric	No
C1.1	C-A	Non Regenera- tive Letdown Heat Exchanger (Tube Side)	III-C	Head to shell weld	Volumetric	No
C1.1	C-A	1-CH-E-2		Shell to flange weld	Volumetric	No
C1.2	C-B			Nozzle to vessel welds	Not Applicable	No - Note 6
C1.3	C-C			Integrally welded supports	Surface	No
C1.4	C-D			Pressure Retaining Bolting	Visual and Volumetric	No

UNIT 1
INSPECTION
ASME CODE CLASS 2 COMPONENTS

TABLE IWC-2600 ITEM NO.	TABLE IWC-2520 EXAMINATION CATEGORY	SYSTEM OR COMPONENT	CODE APPLICABLE TO CONSTRUCTION	AREA TO BE EXAMINED	EXAMINATION REQUIREMENT	SECTION XI CODE RELIEF REQUESTED
C1.1	C-A	Seal Water Heat Exchanger (Tube Side)	III-C	Head to shell welds	Volumetric	No
C1.1	C-A	1-CH-E-1		Shell to flange welds	Volumetric	No
C1.2	C-B			Nozzle to vessel welds	Not Applicable	No - Note 7
C1.3	C-C			Integrally welded supports	Surface	No
C1.4	C-D			Pressure Retaining Bolting	Not Applicable	No - Note 7
C1.1	C-A	Volume Control Tank	III-C	Upper Head to shell weld	Volumetric	No
C1.1	C-A	1-CH-TK-2		Lower head to shell weld	Volumetric	No
C1.2	C-B			Nozzle to vessel welds	Not Applicable	No - Note 8
C1.3	C-C			Integrally Welded Supports	Surface	No
C1.4	C-D			Pressure Retaining Bolting	Visual and Volumetric	No
C1.1	C-A	Seal Water Injection Filters (2)	III-C	Shell to flange weld	Volumetric	No
C1.1	C-A	1-CH-FL-4A 1-CH-FL-4B		Head to shell weld	Volumetric	No
C1.2	C-B			Nozzle to vessel welds	Not Applicable	No - Note 9
C1.3	C-C			Integrally Welded Supports	Surface	No
C1.4	C-D			Pressure Retaining Bolting	Visual and Volumetric	No

UNIT 1
INSPECTION
ASME CODE CLASS 2 COMPONENTS

TABLE IWC-2600 ITEM NO.	TABLE IWC-2520 EXAMINATION CATEGORY	SYSTEM OR COMPONENT	CODE APPLICABLE TO CONSTRUCTION	AREA TO BE EXAMINED	EXAMINATION REQUIREMENT	SECTION XI CODE RELIEF REQUESTED
C1.1	C-A	Reactor Cool- ant Filter	III-C	Cover Weldment to shell weld	Volmetric	Yes - Note 10
C1.1	C-A	1-CH-FL-2		Head to shell weld	Volumetric	Yes - Note 10
C1.2	C-B			Nozzle to vessel welds	Not Applicable	No - Note 10
C1.3	C-C			Integrally Welded Supports	Surface	No
C1.4	C-D			Pressure Retaining Bolting	Not Applicable	No - Note 10
C1.1	C-A	Seal Water Return Filter	III-C	Cover Weldment to shell weld	Volumetric	Yes - Note 10
C1.1	C-A	1-CH-FL-3		Head to shell weld	Volumetric	Yes - Note 10
C1.2	C-B			Nozzle to vessel welds	Not Applicable	No - Note 10
C1.3	C-C			Integrally welded supports	Surface	No
C1.4	C-D			Pressure Retaining Bolting	Not Applicable	No - Note 10
C2.1	C-F;C-G	Piping Systems		Circumferential Butt Welds	Volumetric	Yes - Note 11
C2.2	C-F;C-G			Longitudinal weld joints in fittings	Volumetric	No
C2.3	C-F;C-G			Branch Pipe to Pipe Welds	Volumetric	Yes - Note 12
C2.4	C-D			Pressure Retaining Bolting	Visual and Volumetric	No

UNIT 1
INSPECTION
ASME CODE CLASS 2 COMPONENTS

TABLE IWC-2600 ITEM NO.	TABLE IWC-2520 EXAMINATION CATEGORY	SYSTEM OR COMPONENT	CODE APPLICABLE TO CONSTRUCTION	AREA TO BE EXAMINED	EXAMINATION REQUIREMENT	SECTION XI CODE RELIEF REQUESTED
C2.5	C-E-1			Integrally Welded Supports	Surface	No
C2.6	C-E-2			Support Components	Visual	No
C3.1	C-F	Residual Heat Removal Pumps (2)		Pump Casing Welds	Not Applicable	No - Note 13
C3.2	C-D	1-RH-P-1A 1-RH-P-1B		Pressure Retaining Bolting	Visual and Volumetric	No
C3.3	C-E-1			Integrally Welded Supports	Not Applicable	No - Note 13
C3.4	C-E-2			Support Components	Visual	No
C3.1	C-D	Charging Pumps (3)		Pump Casing Welds	Not Applicable	No - Note 13
C3.2	C-D	1-CH-P-1A 1-CH-P-1B 1-CH-P-1C		Pressure Retaining Bolting	Visual and Volumetric	No
C3.3	C-E-1			Integrally Welded Supports	Not Applicable	No - Note 13
C3.4	C-E-2			Support Components	Visual	No
C4.1	C-F;C-G	Valves		Valve Body Welds	Not Applicable	No - Note 14
C4.2	C-D			Pressure Retaining Bolting	Visual and Volumetric	No
C4.3	C-E-1			Integrally Welded Supports	Not Applicable	No - Note 14
C4.4	C-E-2			Support Components	Visual	No

SURRY UNIT 1
INSERVICE INSPECTION
ASME CODE CLASS 2 COMPONENTS

NOTES

1. There are no items in this category on this component in the Surry Unit 1 Class 2 systems.
2. The nozzle to vessel welds of the residual heat exchangers are covered by 1" thick by 3" wide reinforcement pad as shown in Figure 3. These welds are not accessible for examination by volumetric or surface methods. The area will be subject to visual examination for evidence of leakage during system pressure tests.
3. The regenerative heat exchanger is a three pass vessel, having a total of six head to shell welds and six shell to tubesheet welds. Radiation levels adjacent to this heat exchanger are between six and seven R/hr. The total time required for erection of scaffolding, removal of all insulation covering welds, cleaning, performing examinations and restoration of insulation could take a total of three to four hours. For the examination of a 1/2" long portion of each of twelve welds in this category, personnel involved could be subjected to a total accumulated dose of up to fifty-six man rem. It is felt that potential personnel exposure to complete these examinations is excessive particularly when the examination is to establish the continued integrity of a vessel in a system in which all the piping welds are exempt from examination by IWC-1220(d). Efforts will be made to examine 10% of one weld volumetrically when practical however, examination of this vessel for evidence of leakage during the performance of pressure tests will provide the same assurance of continued integrity as for the piping system with which it is associated.
4. Regenerative heat exchanger nozzles are 3" and 2" diameter, there are no integrally welded supports and pressure retaining bolting on this vessel therefore no examination is required under these categories.
5. Excess Letdown Heat Exchanger nozzles are 2" diameter. There are not any integrally welded supports on this vessel. Therefore no examination is required under these categories.
6. Non Regenerative Letdown Heat Exchanger nozzle to vessel welds are 2" diameter and therefore requires no examination under this category.
7. Seal Water Heat Exchanger nozzle to vessel welds are 4" diameter and the pressure retaining bolting is .75" diameter therefore they require no examination under this category.
8. Volume Control Tank nozzle to vessel welds are 4" and 3" diameter therefore require no examination under this category.

9. Seal Water Injection Filters nozzle to vessel welds are 2" diameter, therefore require no examination under this category.
10. Reactor Coolant Filter and Seal Water Return Filter nozzle to vessel welds are 3" diameter and the bolting is .75" diameter therefore no examination is required under these categories. The thickness of the materials (0.188" thick) used for the construction of these filters is such that meaningful results could not be expected with ultrasonic examination as required by IWC-2600. Surface and visual examination of these welds (Cover weldment to shell and head to shell) will be performed as an alternative method.
11. Examination of Class 2 piping systems is limited to those occurring at geometric discontinuities such that some limitations may be expected at all locations. For pipe to fitting or pipe to vessel nozzle welds, examinations can be performed to the extent required by T-532 of Section V from the weld and pipe surfaces. Examination from the fitting side would be dependent upon the geometric configuration. Where elbows or tees are concerned, examination can be performed from the fitting side except where the intrados of the fitting prevents adequate ultrasonic coupling. No examination can be performed from the fitting side when it is a valve or a flange. In all cases one hundred percent of the weld material can be examined. In instances where welds occur at fitting to fitting access restrictions as outlined above occur on both sides of the weld. In instances where ultrasonic examinations cannot be performed on one hundred percent of the volume of the weld and heat effected zone, surface examinations may be performed to supplement the limited volumetric examination. Welds in the Surry Unit 1, Class 2 system with limitations at geometric discontinuities are:
 - (i) Loop 1 Mainsteam By-Pass; Welds 1, 7, 13, 20
 - (ii) Loop 2 Mainsteam Relief line welds 12, 13, 16, 18, 20, 22, 29, 31
 - (iii) Loop 2 Mainsteam By-Pass; welds 1, 7, 13, 20
 - (iv) Loop 2 SIS Hotleg; weld 15
 - (v) 14" RHR; welds 1, 10, 15, 22, 27
 - (vi) 8", 10", 12" RHR; welds 2, 3, 4, 11, 13, 14, 15, 36, 38, 45
 - (vii) 12", 10" RHR; welds 1, 7, 15, 20, 27
 - (viii) 12", 10", 6" RHR weld 10
 - (ix) 10" SIS; weld 9
 - (x) 10", 6" SIS welds 6 and 14
12. The configuration of typical branch pipe welds is shown in Figure 4. Ultrasonic examinations cannot be performed on the surface of the weld. Examinations will be performed to the extent practical from the pipe and nozzle surfaces adjacent to the weld. Surface examination of the weld will be performed to supplement the volumetric examination.
13. The residual heat removal pumps and charging pumps do not have any pump casing welds or integrally welded supports.
14. There are no valve body welds or integrally welded supports on the valves in Surry Unit 1.

RESIDUAL HEAT REMOVAL HEAT EXCHANGER
NOZZLE TO VESSEL CONFIGURATION


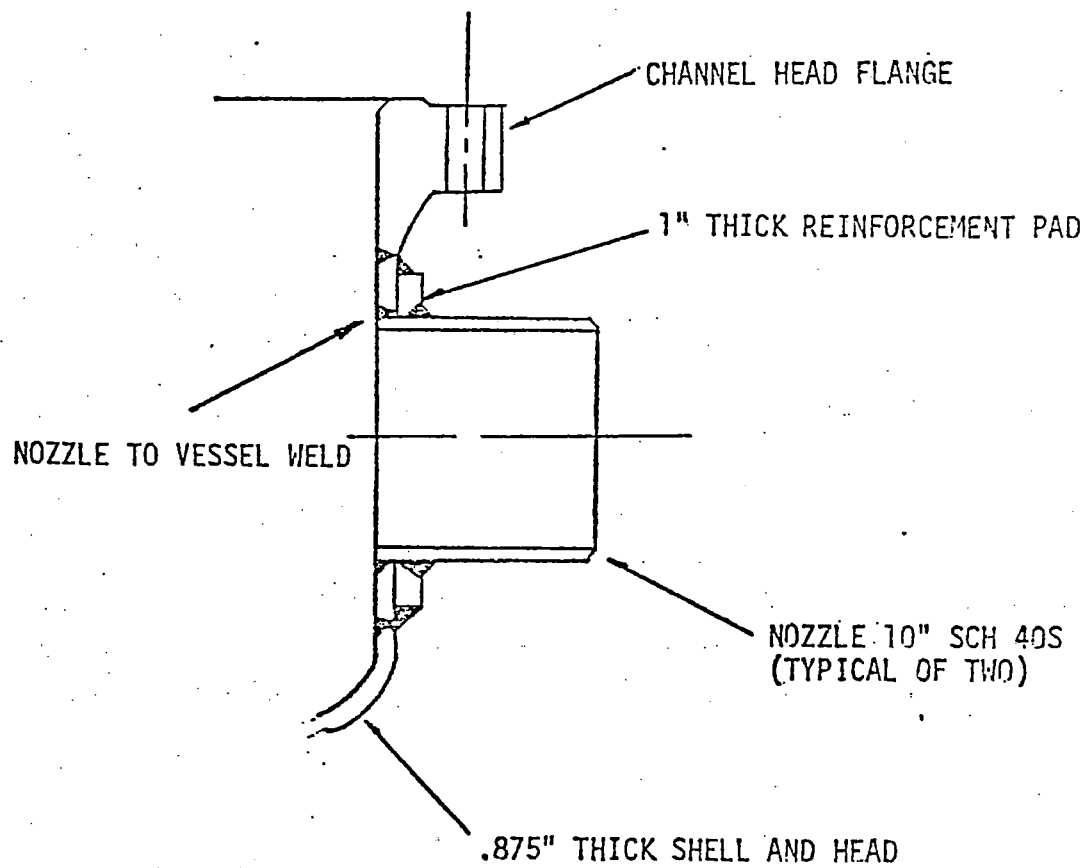


Figure 4

BRANCH NOZZLE CONNECTION WELD

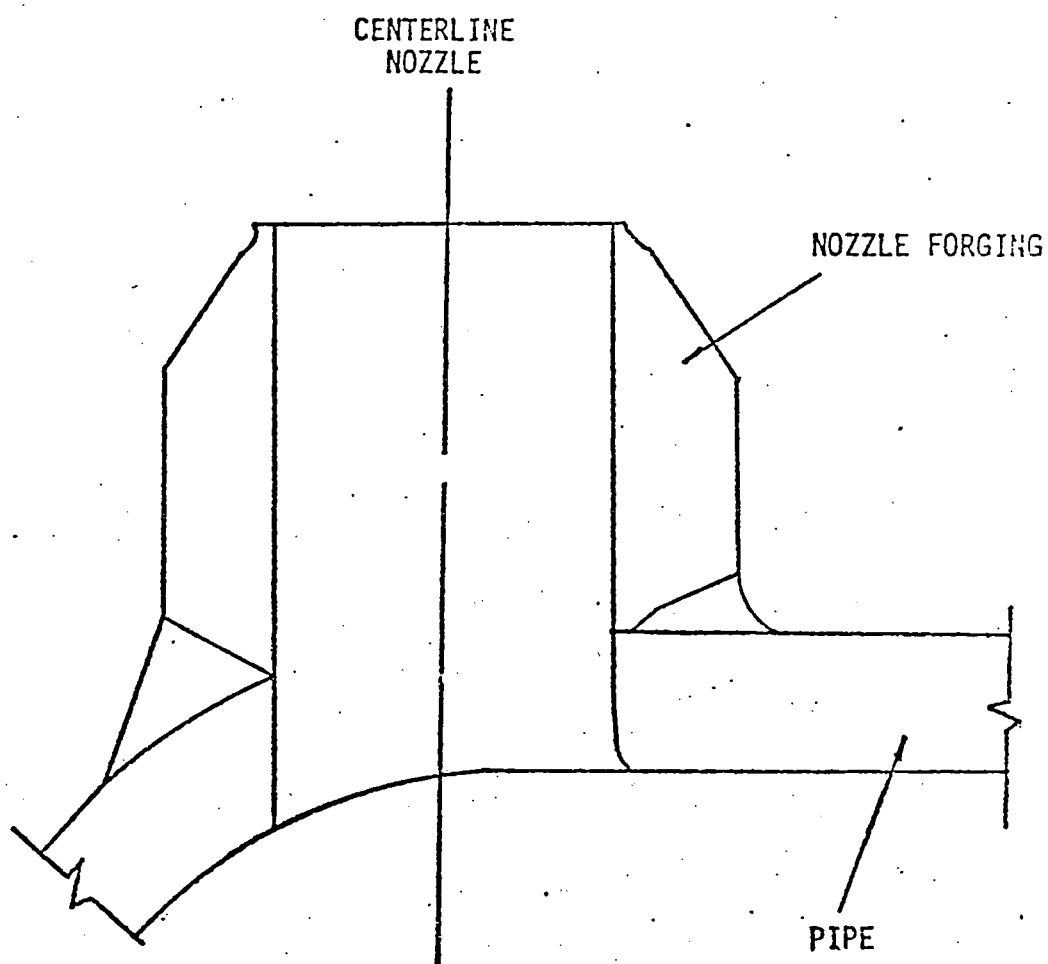

SURRY UNIT
INSERVICE INSPECTION
ASME CODE CLASS 3 COMPONENTS

SYSTEM	COMPONENT DESCRIPTION/IDENTIFICATION	CODE APPLICABLE TO CONSTRUCTION	METHOD OF EXAMINATION	SECTION XI CODE RELIEF REQUESTED
Chemical and Volume Control	Boric Acid Tank 1-CH-TK-1A	VIII	Visual/Operating Pressure	
	Boric Acid Tank 1-CH-TK-1B	VIII	Visual/Operating Pressure	
	Boric Acid Transfer Pump 1-CH-P-2A		Visual/Operating Pressure	
	Boric Acid Transfer Pump 1-CH-P-2B		Visual/Operating Pressure	
	Boric Acid Filter 1-CH-FL-1	IIIC	Visual/Operating Pressure	
	Boric Acid Blender 1-CH-BL-1		Visual/Operating Pressure	
	Piping		Visual/Operating Pressure	
	Supports and Hangers		Visual	
Main Steam to Turbine Driven Auxiliary Feedwater Pump	Piping		Visual/Operating Pressure	
	Supports & Hangers		Visual	
Auxiliary Feedwater	Auxiliary Feed Pump 1-FW-P-2 (Turbine Driven)		Visual/Operating Pressure	
	Auxiliary Feed Pump 1-FW-P-3A (Motor Driven)		Visual/Operating Pressure	
	Auxiliary Feed Pump 1-FW-P-3B (Motor Driven)		Visual/Operating Pressure	
	Auxiliary Feed Pump 1-FW-P-2 Oil Cooler		Visual/Operating Pressure	

SURREY UN
INSERVICE INSPECTION
ASME CODE CLASS 3 COMPONENTS

SYSTEM	COMPONENT DESCRIPTION/IDENTIFICATION	CODE APPLICABLE TO CONSTRUCTION	METHOD OF EXAMINATION	SECTION XI CODE RELIEF REQUESTED
Auxiliary Feedwater	Auxiliary Feed Pump 1-FW-P-3A Oil Cooler		Visual/Operating Pressure	
	Auxiliary Feed Pump 1-FW-P-3B Oil Cooler		Visual/Operating Pressure	
	Condensate Storage Tank 1-CN-TK-1A		Visual/Operating Pressure	
	Piping		Visual/Operating Pressure	
	Supports and Hangers		Visual	
Circulating and Service Water	Recirculation Spray Heat Exchanger 1-RS-E-1A (tube side)		Visual/Operating Pressure	
	Recirculation Spray Heat Exchanger 1-RS-E-1B (tube side)		Visual/Operating Pressure	
	Recirculation Spray Heat Exchanger 1-RS-E-1C (tube side)		Visual/Operating Pressure	
	Recirculation Spray Heat Exchanger 1-RS-E-1D (tube side)		Visual/Operating Pressure	
	Component Cooling Water Heat Exchanger 1-CC-E-1A (tube side)		Visual/Operating Pressure	
	Component Cooling Water Heat Exchanger 1-CC-E-1B (tube side)		Visual/Operating Pressure	
	Emergency Service Water Pump 1-SW-P-1A		Visual/Operating Pressure	

SURRY UNIT
INSERVICE INSPECTION
ASME CODE CLASS 3 COMPONENTS

SYSTEM	COMPONENT DESCRIPTION/IDENTIFICATION	CODE APPLICABLE TO CONSTRUCTION	METHOD OF EXAMINATION	SECTION XI CODE RELIEF REQUESTED
Circulating and Service Water	Emergency Service Water Pump 1-SW-P-1B		Visual/Operating Pressure	
	Emergency Service Water Pump 1-SW-P-1C		Visual/Operating	
	Charging Pump 1-CH-E-5A Lubricating Oil Cooler		Visual/Operating Pressure	
	Charging Pump 1-CH-E-5B Lubricating Oil Cooler		Visual/Operating Pressure	
	Charging Pump 1-CH-E-5C Lubricating Oil Cooler		Visual/Operating Pressure	
	Charging Pump 1-CH-E-7A Seal Cooler		Visual/Operating Pressure	
	Charging Pump 1-CH-E-7B Seal Cooler		Visual/Operating	
	Charging Pump 1-CH-E-7C Seal Cooler		Visual/Operating Pressure	
	Charging Pump 1-CH-E-7D Seal Cooler		Visual/Operating Pressure	
	Charging Pump 1-CH-E-7E Seal Cooler		Visual/Operating Pressure	
	Charging Pump 1-CH-E-7F Seal Cooler		Visual/Operating Pressure	
	Charging Pump Seal Cooling Surge Tank 1-CC-TK-3		Visual/Operating Pressure	
	Charging Pump Cooling Water Pump 1-CC-P-2A		Visual/Operating Pressure	
	Charging Pump Cooling Water Pump 1-CC-P-2B		Visual/Operating Pressure	

SURRY UNIT
INSERVICE INSPECTION
ASME CODE CLASS 3 COMPONENTS

SYSTEM	COMPONENT DESCRIPTION/IDENTIFICATION	CODE APPLICABLE TO CONSTRUCTION	METHOD OF EXAMINATION	SECTION XI CODE RELIEF REQUESTED
Circulating and Service Water	Charging Pump Intermediate Seal Cooler 1-SW-E-1A		Visual/Operating Pressure	
	Charging Pump Intermediate Seal Cooler 1-SW-E-1B		Visual/Operating Pressure	
	Charging Pump Service Water Pump 1-SW-P-10A		Visual/Operating Pressure	
	Charging Pump Service Water Pump 1-SW-P-10B		Visual/Operating Pressure	
	Recirculation Spray Hx Radiation Monitori- ing Sample Pump 1-SW-P-5A		Visual/Operating Pressure	
	Recirculation Spray Hx Radiation Monitro- ing Sample Pump 1-SW-P-5B		Visual/Operating Pressure	
	Recirculation Srpay Hx Radiation Monitor- ing Sample Pump 1-SW-P-5C		Visual/Operating Pressure	
	Recirculation Spray Hx Radiation Monitor- ing Sample Pump 1-SW-P-5D		Visual/Operating Pressure	
	Piping		Visual/Operating Pressure	
	Supports and Hangers		Visual	
Component Cooling Water	Reactor Coolant Pump 1-RC-P-1A Oil Cooler		Visual/Operating Pressure	
	Reactor Coolant Pump 1-RC-P-1B Oil Cooler		Visual/Operating Pressure	
	Reactor Coolant Pump 1-RC-P-1C Oil Cooler		Visual/Operating Pressure	

SURRY UNIT
INSERVICE INSPECTION
ASME CODE CLASS 3 COMPONENTS

SYSTEM	COMPONENT DESCRIPTION/IDENTIFICATION	CODE APPLICABLE TO CONSTRUCTION	METHOD OF EXAMINATION	SECTION XI CODE RELIEF REQUESTED
Component Cooling Water	Reactor Coolant Pump 1-RC-P-1A Shroud Cooling Coil 1-VS-E-6A		Visual/Operating Pressure	
	Reactor Coolant Pump 1-RC-P-1B Shroud Cooling Coil 1-VS-E-6B		Visual/Operating Pressure	
	Reactor Coolant Pump 1-RC-P-1C Cooling Coil 1-VS-E-6C		Visual/Operating Pressure	
	Excess Letdown Heat Exchanger 1-CH-E-4 (shell side)	VIII	Visual/Operating Pressure	
	Residual Heat Removal Pump Seal Cooler 1-RH-E-2A		Visual/Operating Pressure	
	Residual Heat Removal Pump Seal Cooler 1-RH-E-2B		Visual/Operating Pressure	
	Residual Heat Removal Heat Exchanger 1-RH-E-1A (shell side)	VIII	Visual/Operating Pressure	
	Residual Heat Removal Heat Exchanger 1-RH-E-1B (shell side)	VIII	Visual/Operating Pressure	
	Reactor Containment Air Recirculation Cooler 1-VS-E-2-A		Visual/Operating Pressure	
	Reactor Containment Air Recirculation Cooler 1-VS-E-2-B		Visual/Operating Pressure	
	Reactor Containment Air Recirculation Cooler 1-VS-E-2-C		Visual/Operating Pressure	
	Fuel Pit Cooler 1-FC-E-1A (shell side)		Visual/Operating Pressure	
	Fuel Pit Cooler 1-FC-E-1B (shell side)		Visual/Operating Pressure	

SURREY UN
INSERVICE INSPECTION
ASME CODE CLASS 3 COMPONENTS

SYSTEM	COMPONENT DESCRIPTION/IDENTIFICATION	CODE APPLICABLE TO CONSTRUCTION	METHOD OF EXAMINATION	SECTION XI CODE RELIEF REQUESTED
Component Cooling Water	Non Regenerative Heat Exchanger 1-CH-E-2 (shell side)	VIII	Visual/Operating Pressure	
	Seal Water Heat Exchanger 1-CH-E-1 (shell side)	VIII	Visual/Operating Pressure	
	Component Cooling Surge Tank 1-CH-TK-1		Visual/Operating Pressure	
	Component Cooling Pump 1-CC-P-1A		Visual/Operating Pressure	
	Component Cooling Pump 1-CC-P-1B		Visual/Operating Pressure	
	Component Cooling Water Heat Exchanger 1-CC-E-1A (shell side)		Visual/Operating Pressure	
	Component Cooling Water Heat Exchanger 1-CC-E-1B (shell side)		Visual/Operating Pressure	
	Piping		Visual/Operating Pressure	
Fuel Pit Cooling	Support and Hangers		Visual	
	Spent Fuel Pit Pump 1-FC-P-1A		Visual/Operating Pressure	
	Spent Fuel Pit Pump 1-FC-P-1B		Visual/Operating Pressure	
	Spent Fuel Pit Cooler 1-FC-E-1A (tube side)		Visual/Operating Pressure	

SURRY UNIT
INSERVICE INSPECTION
ASME CODE CLASS 3 COMPONENTS

SYSTEM	COMPONENT DESCRIPTION/IDENTIFICATION	CODE APPLICABLE TO CONSTRUCTION	METHOD OF EXAMINATION	SECTION XI CODE RELIEF REQUESTED
Fuel Pit Cooling	Spent Fuel Pit Cooler 1-FC-E-1B (tube side)		Visual/Operating Pressure	
	Piping		Visual/Operating Pressure	
	Support and Hangers		Visual	

ATTACHMENT B

SURRY UNIT 1

REQUESTED RELIEF FROM THE INSERVICE TESTING REQUIREMENTS
FOR PUMPS AS SET FORTH IN SUBSECTION IWP TO
SECTION XI OF THE ASME BOILER AND PRESSURE VESSEL CODE,
1974 EDITION WITH ADDENDA THROUGH THE SUMMER OF 1975
(LAST 40 MONTH PERIOD OF THE FIRST 10 YEAR INTERVAL)

The enclosed tabulations provide a listing of the Class 1, 2 and 3 pumps which are subject to the testing requirements of Subsections IWP of Section XI of the ASME Boiler and Pressure Vessel Code, 1974 Edition, with Addenda thru the Summer of 1975.

This tabulation identifies the pumps to be tested, code class, test flow path system resistance, and required test quantities and frequencies. Relief from test requirements is requested in cases where their test requirements have been determined to be impractical. Where relief is requested, technical justification is provided along with alternative test methods when applicable.

SURREY UNIT
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 PUMPS

PUMP MARK NUMBER	PUMP DESCRIPTION	CODE CLASS	SYSTEM RESIS- TANCE	TEST QUANTITIES	TEST FREQUENCY	RELIEF REQUESTED	REMARKS
1-CH-P-1A 1-CH-P-1B 1-CH-P-1C	High Head Safety Injection (Charging) (Dwg. No. 11448- FM-88B)	2	FIXED or VARIABLE (NOTE 2)	Speed (if variable) Inlet Pressure (Pi) Differential Pressure (ΔP) Flow Rate (Q) Vibration Amplitude (V) Bearing Temperature (Tb) Lubricant Level or Pressure	NA Monthly Monthly Monthly Monthly Yearly Monthly	YES-NOTE 1	CONSTANT NOTE 2
1-SI-P-1A 1-SI-P-1B	Low Head Safety Injection (Dwg. No. 11448- FM-89A)	2	FIXED	Speed (if variable) Inlet Pressure (Pi) Differential Pressure (ΔP) Flow Rate (Q) Vibration Amplitude (V) Bearing Temperature (Tb) Lubricant Level or Pressure	NA Monthly NA Monthly Monthly NA NA	YES-NOTE 3	CONSTANT NOTE 4 NOTE 4
1-CS-P-1A 1-CS-P-1B	Containment Spray (Dwg. No. 11448- FM-84A)	2	FIXED	Speed (if variable) Inlet Pressure (Pi) Differential Pressure (ΔP) Flow Rate (Q) Vibration Amplitude (V) Bearing Temperature (Tb) Lubricant Level or Pressure	NA Monthly NA Monthly Monthly Yearly Monthly		CONSTANT
1-RS-P-2A 1-RS-P-2B	Outside Recirc- ulation Spray (Dwg. No. 11448- FM-84A)	2	FIXED	Speed (if variable) Inlet Pressure (Pi) Differential Pressure (ΔP) Flow Rate (Q) Vibration Amplitude (V) Bearing Temperature (Tb) Lubricant Level or Pressure	NA NA Monthly NA Monthly NA NA	Yes-Note 5	CONSTANT Note 4 Note 4

SURREY UNIT
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 PUMPS

PUMP MARK NUMBER	PUMP DESCRIPTION	CODE CLASS	SYSTEM RESIS- TANCE	TEST QUANTITIES	TEST FREQUENCY	RELIEF REQUESTED	REMARKS
1-RS-P-1A 1-RS-P-1B	Inside Recirculation Spray (Dwg. No. 11448-FM-84A)	2	FIXED	Speed (if variable) Inlet Pressure (Pi) Differential Pressure (ΔP) Flow Rate (Q) Vibration Amplitude (V) Bearing Temperature (Tb) Lubricant Level or Pressure	NA NA NA NA NA NA NA	Yes-Note 6 Yes-Note 6 Yes-Note 6	CONSTANT Note 4 Note 4
1-FW-P-3A 1-FW-P-3B 1-FW-P-2	Auxiliary Feedwater (Dwg. No. 11448-FM-68A)	3	FIXED	Speed (if variable) Inlet Pressure (Pi) Differential Pressure (ΔP) Flow Rate (Q) Vibration Amplitude (V) Bearing Temperature (Tb) Lubricant Level or Pressure	Monthly Monthly Monthly NA Monthly Yearly Monthly		Note 8
1-RH-P-1A 1-RH-P-1B	Residual Heat Removal (Dwg. 11448-FM-87A)	2	FIXED	Speed (if variable) Inlet Pressure (Pi) Differential Pressure (ΔP) Flow Rate (Q) Vibration Amplitude (V) Bearing Temperature (Tb) Lubricant Level or Pressure	NA Cold Shutdown Cold Shutdown Cold Shutdown Cold Shutdown NA NA	Yes-Note 7 Yes-Note 7 Yes-Note 7 Yes-Note 7	CONSTANT Note 4 Note 4
1-CC-P-1A 1-CC-P-1B	Component Cooling (Dwg. No. 11448-FM-72D)	3	VARIABLE	Speed (if variable) Inlet Pressure (Pi) Differential Pressure (ΔP) Flow Rate (Q) Vibration Amplitude (V) Bearing Temperature (Tb) Lubricant Level or Pressure	NA Monthly Monthly Monthly Monthly Yearly Monthly	Yes-Note 9 Yes-Note 9 Yes-Note 9	CONSTANT

SURRY UNIT
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 PUMPS

PUMP MARK NUMBER	PUMP DESCRIPTION	CODE CLASS	SYSTEM RESIS- TANCE	TEST QUANTITIES	TEST FREQUENCY	RELIEF REQUESTED	REMARKS
1-CH-P-2A 1-CH-P-2B	Boric Acid Transfer (Dwg. No. 11448- FM-88A)	3	FIXED	Speed (if variable) Inlet Pressure (Pi) Differential Pressure (ΔP) Flow Rate (Q) Vibration Amplitude (V) Bearing Temperature (Tb) Lubricant Level or Pressure	NA Monthly Monthly NA NA NA NA	Yes-Note 10 Yes-Note 10 Yes-Note 10	CONSTANT Note 10
1-CC-P-2A 1-CC-P-2B	Charging Pump Cooling Water (Dwg. No. 11488- FM-71B)	3	FIXED	Speed (if variable) Inlet Pressure (Pi) Differential Pressure (ΔP) Flow Rate (Q) Vibration Amplitude (V) Bearing Temperature (Tb) Lubricant Level or Pressure	NA NA NA Monthly Monthly NA NA	Yes-Note 11	CONSTANT Note 12 Note 12
1-SW-P-10A 1-SW-P-10B	Charging Pump Service Water (Dwg. No. 11448- FM-71B)	3	VARIABLE	Speed (if variable) Inlet Pressure (Pi) Differential Pressure (ΔP) Flow Rate (Q) Vibration Amplitude (V) Bearing Temperature (Tb) Lubricant Level or Pressure	NA NA NA Monthly Monthly NA NA	Yes-Note 13 Yes-Note 13	CONSTANT Note 12 Note 12
1-SW-P-1A 1-SW-P-1B 1-SW-P-1C	Emergency Service Water (Dwg. No. 11448-FM-71A)	3	FIXED	Speed (if variable) Inlet Pressure (Pi) Differential Pressure (ΔP) Flow Rate (Q) Vibration Amplitude (V) Bearing Temperature (Tb) Lubricant Level or Pressure	Monthly Monthly Monthly NA Monthly NA Monthly	Yes-Note 14 Yes-Note 15	Variable Note 15

SURRY UNIT 1
INSERVICE TESTING
ASME CODE CLASS 1, 2 and 3 PUMPS

NOTE

1. Suction pressure instrumentation is not installed nor required. There pumps are capable of producing greater than 2400 psig discharge pressure, while the suction pressure is nominally 15 to 20 psig. Therefore, the ΔP developed by the pump is more than 100 times the suction pressure and a gage for suction pressure would not provide significant data. We propose to observe VCT pressure using control room indication to assure repeated initial conditions for testing the pumps. This indication is approximately 4% accurate.
2. When the nonoperating pump is tested on recirculation flow, the flow path is a fixed resistance system and it is required to measure ΔP or Q, not both (Table IWP-3100-1). When the operating pump is tested, the flow path is a variable resistance system and it is required to measure both ΔP and Q.
3. No inlet pressure instrumentation is installed for these pumps. These pumps take suction from the RWST for performance testing. This tank has a minimum level required by the Technical Specifications which is observed from the Control Room. Tank level will be used to establish initial conditions for testing.
4. Proper lubricant level or pressure cannot be observed since bearings are in main flow path. Reference is made to IWP-4310 which establishes exception to Tb for bearings within the main flow path.
5. These pumps are flow tested at shut of head as required by T.S. 4.5.A.3 by filling pump casings with water and running on recirculation flow path. Suction pressure is the same for each test (head of water with casing filled) and thus will not be measured.
6. These pumps cannot be tested to code requirements as the test would require filling the sump and spraying water on components in the containment. Pump current is the only pump parameter measured, this test is performed monthly. This system is always dry which prevents longer pump run time (30 second max.) and prevents performing periodic flow testing.
7. It is considered impractical to make a containment entry on a monthly basis in order to test these pumps. These pumps are not Engineered Safety Feature pumps. Operability during use can be determined by monitoring reactor coolant system temperature. Testing as required by subsection IWP will be performed during each cold shutdown provided that containment is accessible.
8. The turbine-driven auxiliary feed pump speed will be measured monthly. The motor driven auxiliary feed pumps are not required to have the speed measured.

SURRY UNIT 1
INSERVICE TESTING
ASME CODE CLASS 1, 2 and 3 PUMPS

NOTES cont'd.

9. Flow rates from these pumps vary to meet the unit heat load requirements. Instead of varying the system resistance (as required by IWP-3100) to establish a reference flow, sets of reference values will be established to cover the range of system flow rates.
10. No inlet pressure instrumentation is installed for these pumps. These pumps take suction from the Boric Acid Storage Tanks. Tanks level will be observed from the control room to establish initial conditions for testing. The pumps are totally encased in insulation making vibration and bearing temperature impractical to measure. Lubricant is provided by pump flow.
11. No inlet pressure instrumentation is installed for these pumps. The charging pump seal cooling surge tank maintains a constant suction head for these pumps therefore it is not considered necessary to measure inlet pressure.
12. Pump bearings are carried in the driver motor and are grease lubricated.
13. No inlet or outlet pressure instrumentation is installed for these pumps. Flow rate and vibration amplitude will be measured to assure adequate pump performance. Also a system low pressure alarm is provided to alert the operator of inadequate system flow.
14. No inlet pressure instrumentation is installed for these pumps. These pumps take suction from the James River. The river water level will be used to establish initial conditions for testing.
15. The service water pumps are open line shaft pumps that depend primarily of the liquid being pumped for the lubrication of the pump and lineshaft bearings. The bearing lubricating water flow can be verified by sight glass and pressure can be monitored. All pump bearings are submerged and lubricant is allowed to leak off into the sump and is not piped back, such that bearing or lubricant outlet temperature cannot be monitored.

ATTACHMENT C

SURRY UNIT 1

REQUESTED RELIEF FROM THE INSERVICE TESTING REQUIREMENTS FOR VALVES AS
SET FORTH IN SUBSECTION IWV TO SECTION XI OF THE ASME BOILER AND PRESSURE
VESSEL CODE, 1974 EDITION WITH ADDENDA THRU THE SUMMER OF 1975
(LAST 40 MONTH PERIOD OF THE FIRST 10 YEAR INTERVAL)

The enclosed tabulation provides a listing of the Class 1, 2 and 3 valves which are subject to the testing requirements of Subsection IWV of Section XI of the ASME Boiler and Pressure Vessel Code, 1974 Edition, with Addenda thru the Summer of 1975.

This tabulation identifies the valve to be tested, drawing location, function, code class, category, size, valve type, actuator type, normal position and test requirements. Relief from test requirements is requested in cases where these test requirements have been determined to be impractical. Where relief is requested, technical justification is provided along with alternative test methods when applicable.

Leak testing of containment isolation valves shall be performed in accordance with Appendix J of 10CFR50 in lieu of ASME Section XI subsub-article IWV-3420.

There are no testable Category D valves in Surry Unit 1 Systems.

Any inspection requirements identified as impractical during the course of the inspection period will be noted and included in the inspection program at the time of the next revision.

Any valve which when exercised could put the plant in an unsafe condition will not be tested. Below are some examples of the types of valves specifically excluded from exercising tests during plant operation:

- (i) All valves whose failure in a non-conservative position during the cycling that would cause a loss of system function will not be exercised. Valves in this category would typically include all non-redundant valves in lines. Some valves may fall into this category under certain system configurations or plant operating modes.
- (ii) All valves whose failure to close during a cycling test would result in a loss of containment integrity. Valves in this category would typically include all valves in containment penetrations where the redundant valve is open and inoperable.
- (iii) All valves, which when cycled, could subject a system to pressure in excess of their design pressures. It is assumed for the purpose of a cycling test, that one or more of the upstream check valves has failed unless positive methods are available for determining the pressure or lack thereof on the high pressure side of the valve to be cycled.

This valve testing program addresses those valves for which demonstration of operability is necessary to assure safe shutdown of the unit or mitigation of the consequences of an accident. The program has been reviewed to assure that testing the valves at the intervals specified will not place the plant in an unsafe condition. Where practical, valves will be cycled at 3 month test intervals.

When a commitment is made to test valves during hot or cold shutdown it is not intent to shutdown the unit solely for the purpose of valve testing nor to perform the testing more often than once per 92 days due to more frequent shutdowns.

The following clarification shall apply to those valves which are scheduled to be exercised during cold shutdown:

"Valve testing shall commence not later than 48 hours after reaching cold shutdown and continue until complete or unit is ready to return to power. Completion of all valve testing is not a prerequisite to return to power."

Reactor coolant Class 1 and Class 2 pressure boundary valves have not been included in the test program. The reactor coolant pressure boundary is subject to pressure tests and adequately monitored for leakage following each refueling in accordance with the requirements of Article IWB-5000. Gross leakage test requirements for check valves providing Class 1 to Class pressure boundaries are defined in 4.5.B.2(c) and (d) of the Surry technical specification.

Article IWV-3520(b) requires that check valves be exercised to the position required to fulfill their function. Check valves at Surry are not equipped with position indicating devices and verification of operation to the required position will be achieved by observing that normal required flows are established in the systems.

The stroke times of solenoid controlled, air operated valves is both extremely rapid and subject to considerable variation. Exception is taken to complying with stroke variations defined by Article IWV-3410(c) (3). The valve stroke timing tolerance specified is based on a reference valve. This will not exceed the maximum stroke time.

A review of containment isolation valves is being conducted to ensure compliance to Appendix J of 10 CFR 50. At the completion of this review some valves may be added to this program.

SURRY UNIT 1

INSERVICE TESTING

ASME CODE CLASS 1, 2 AND 3 VALVES

LEGEND

TEST REQUIREMENTS

- SP - SETPOINTS of safety and relief valves shall be tested per Section XI subsubarticle IWV-3510 or as modified by specific relief request.
- VP - VALVE POSITION shall be verified per Section XI subarticle IWV-3700 or as modified by specific relief request.
- CV - CHECK VALVES shall be exercised at least once every (3) months per Section XI subsubarticle IWV-3520 or as modified by specific relief request.
- LT - LEAK TESTS shall be performed per Section XI subsubarticle IWV-3420 or as modified by specific relief request.
- EV - EXERCISE VALVE for operability at least once every (3) months per Section XI subsubarticle IWV-3410 or as modified by specific relief request.
- ST - STROKE TIMES shall be measured per Section XI subsubarticle IWV-3410 or as modified by specific relief request.

VALVE POSITIONS

O-Open
C-Closed
OC-Open or Closed
T-Throttled

VALVE TYPES

CK-Check
RE-Relief
SF-Safety
BA-Ball
GL-Globe
GA-Gate
BU-Butterfly
SCK-Stop Check
PL-Plug
DA - Diaphragm

ACTUATOR TYPES

SA-Self Actuating
MO-Motor
PN-Pneumatic
HW-Handwheel

SURRY UNIT 1
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME MAIN STEAM

DRAW. NO. 11448-FM-64A

PAGE 1

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSTI- TION	TEST REQ.	RELIEF REQUEST
SV-MS101A,B,C	B-3,B-4,B-6	Main Steam Safety Valves	2	C	4	SF	SA	C	SP	YES (1)
SV-MS102A,B,C SV-MS103A,B,C	C-3,C-4,C-6 B-3,B-4,B-6	Main Steam Safety Valves	2	C	6	SF	SA	C	SP	YES (1)
SV-MS104A,B,C SV-MS105A,B,C	B-3,B-4,B-6 C-3,C-4,C-6									
TV-MS101A,B,C	D-3,D-5,D-7	Main Steam Line Trip Valves	2	B	30	CK	PN	O	EV ST	YES (1)
PCV-MS102	F-8	Main Steam to Turbine Driven Auxiliary Feedwater Pump	3	B	3	GL	PN	C	EV ST	NO
MOV-MS102	G-8	Main Steam to Turbine Driven Auxiliary Feedwater Pump	3	B	3	GA	MO	C	EV ST	NO
1-MS-176,178, 182	F-8,F-8,F-8	Main Steam to Turbine Driven Auxiliary Feedwater Pump Check Valves	3	C	3	CK	SA	C	CV	NO
NRV-MS101A,B,C	D-3,D-5,D-6	Main Steam Non-Return Valves	2	C	30	SCK	MO	O	CV	YES (1)
TV-MS109	F-7	Main Steam Drain to Condenser	-	B	3	GA	PN	O	EV ST	NO
TV-MS110	E-7	Main Steam Drain to Blowdown	-	B	2	GA	PN	O	EV ST	NO
NRV-MS102A,B,C	C-2,C-4,C-6	Decay Heat Release Non-Return Valves	2	C	3	SCK	HW	C	CV	NO

SURRY UNIT 1
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME AUX. STEAM & AIR REMOVAL

DRAW. NO. 11448-FM-66A

PAGE 2

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
TV-SV102	L-2	Air Removal Divert to Reactor Containment	-	A	6	GA	PN	C	LT EV ST	NO
TV-SV103	L-2	Air Removal Divert to Atmosphere	-	B	6	GA	PN	C	LT EV ST	No
1-VP-12	L-1	Air Removal Divert to Reactor Containment	-	AC	6	CK	SA	C	LT CV	Yes (26)

SURRY UNIT 1
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME FEEDWATER

DRAW. NO. _____

11448-FM-68A

PAGE 3

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSTI- TION	TEST REQ.	RELIEF REQUEST
1-FW-27,58,89	C-2,B-4,B-5	Auxiliary Feedwater Header Check Valves at Main Feedwater Header	2	C	3	CK	SA	C	CV	YES (2)
1-FW-10,12, 41,43, 72,74	C-2,C-2 C-4,C-4, C-5,C-5	Main Feedwater Check Valves at Containment Penetrations	2	C	14	CK	SA	O	CV	YES (3)
MOV-FW151A,B,C, D,E,F	B-6,B-6, B-6,B-6, C-6,C-6	Auxiliary Feedwater to Steam Generators	3	B	3	GL	MO	O	EV ST	NO
1-FW-131,133, 136,138	C-6,C-6, C-6,C-6	Auxiliary Feedwater Header Check Valves at Containment Penetration	3	C	6	CK	SA	C	CV	YES (2)
1-FW-142,157, 172	D-7,E-7 F-7	Auxiliary Feedwater Pump Discharge Check Valves	3	C	6	CK	SA	C	CV	YES (2)
1-FW-144, 159, 174	D-7, F-7 G-7	Auxiliary Feedwater Pump Recirculation Check Valves	3	C	1	CK	SA	O	CV	No

SURRY UNIT 1
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME CROSS-CONNECTS FOR AUXILIARY FEED

DRAW. NO. 11448-FM-68B

PAGE 4

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
MOV-FW160A,B	J-5,J-6	Cross-Connects for Unit No. 1 Aux. Feed from Unit No. 2	3	B	6	GL	MO	C	EV ST	NO
1-FW-272,273	I-7,I-7	Cross-Connect for Unit No. 1 Aux. Feed from Unit No. 2 Check Valves at Cont. Penet.	3	C	6	CK	SA	C	CV	YES (2)
1-FW-309,310	H-7,H-7	Cross-Connect for Unit No. 1 Aux. Feed from Unit No. 2 Check Valves	3	C	6	CK	SA	C	CV	YES (2)

SURRY UNIT 1
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME SERVICE WATER

DRAW. NO. 11448-FM-71A

PAGE 5

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
MOV-CW106A,B, C,D	E-4,E-4, F-4,F-4	Condenser Inlet Isolation Valves	3	B	96	BU	MO	O	EV ST	NO
MOV-SW102A,B	E-6,F-6	Service Water to Component Cooling Water Heat Exchangers	3	B	42	BU	MO	O	EV ST	NO
MOV-SW103A,B, C,D	B-6,B-6 D-6,E-6	Service Water to Recircula- tion Spray Heat Exchangers	3	B	30	BU	MO	C	EV ST	YES (4)
MOV-SW104A,B, C,D MOV-SW105A,B, C,D	A-2,B-2,C-2, C-2,A-2,A-2, B-2,C-2	Recirculation Spray Heat Exchangers Isolation Valves	3	B	24	BU	MO	O	EV ST	NO
MOV-SW106A,B	D-4,D-4	Recirculation Spray Heat Exchangers Cross Connect Valves	3	B	36	BU	MO	O	EV ST	NO
MOV-SW101A,B	B-4C-4	Bearing Cooling Water Heat Exchanger Isolation Valves	3	B	36	BU	MO	O	EV ST	NO

SURRY UNIT 1
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME CIRCULATING & SERVICE WATER

DRAW. NO. 11448-FM-71B

PAGE 6

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
1-CC-764,752	D-6,G-6	Charging Pump Cooling Water Pump Discharge Check Valve	3	C	2	CK	SA	OC	CV	NO
1-SW-113,108	D-8,G-8	Charging Pump Service Water Pump Check Valve	3	C	2	CK	SA	OC	CV	NO

SURREY UNIT 1
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME COMPONENT COOLING WATER

DRAW. NO. 11448-FM-72A

PAGE 7

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
RV-CC119A,B	L-2,L-3	Component Cooling from RHR Heat Exchanger Relief Valve	3	C	1½	RE	SA	C	SP	NO
1-CC-176,177	B-1,B-1	Component Cooling to RHR Heat Exchanger Check Valves	3	C	18	CK	SA	OC	CV	YES (5)
1-CC-1,58,59	A-2,A-2,A-2	Component Cooling to Reactor Coolant Pumps	3	C	6	CK	SA	O	CV	YES (6)
TV-CC105A,B,C	D-8,D-8,E-8	Component Cooling from Reactor Coolant Pumps	3	B	6	BA	PN	O	EV ST	YES (6)
TV-CC107	D-8	Component Cooling from Reactor Coolant Pumps	3	B	2½	GL	PN	O	EV ST	YES (6)
TV-CC109A,B	F-8,F-9	Component Cooling from RHR Heat Exchangers	3	B	18	BU	PN	O	EV ST	NO

SURRY UNIT 1
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME COMPONENT COOLING

DRAW. NO. 11448-FM-72B

PAGE 8

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
1-CC-242, 233, 224	C-4, E-4, I-4	Component Cooling to Reactor Containment Air Recirculation Coolers	3	C	6	CK	SA	O	CV	YES (7)
TV-CC110A, B, C	D-3, F-3, H-3	Component Cooling from Reactor Containment Air Recirculation Coolers	3	B	6	BU	PN	O	EV ST	NO
RV-CC112A, B, C	E-5, F-5, G-5	Component Cooling from Reactor Containment Air Recirc. Coolers Relief	3	C	3/4	RE	SA	C	SP	NO

SURRY UNIT 1
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME COMPONENT COOLING

DRAW. NO. 11448-FM-72C

PAGE 9

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
RV-CC111A,B	I-3,I-4	Component Cooling to Fuel Pit Coolers Relief Valves	3	C	3/4	RE	SA	C	SP	NO

SURRY UNIT 1
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME COMPONENT COOLING

DRAW. NO. 11448-FM-72D

PAGE 10

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
1-CC-557,563	C-2,C-2	Component Cooling Pump Discharge Check	3	C	18	CK	SA	OC	CV	NO

SURRY UNIT 1
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME SAMPLING

DRAW. NO. 11448-EM-82B

PAGE 11

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
TV-SS103	E-1	Residual Heat Removal System Sample	2	A	3/8	GA	PN	OC	LT EV ST	NO
TV-SS100A,B	D-1,E-1	Pressurizer Liquid Space Sample	1	A	3/8	GA	PN	OC	LT EV ST	NO
TV-SS101A,B	D-1,E-1	Pressurizer Vapor Space Sample	1	A	3/8	GA	PN	OC	LT EV ST	NO
TV-SS106A,B	D-2,E-2	Primary Coolant Hot Leg Samples	1	A	3/8	GA	PN	OC	LT EV ST	NO
TV-SS102A,B	D-2,E-2	Primary Coolant Cold Leg Samples	1	A	3/8	GA	PN	OC	LT EV ST	NO
TV-SS104A,B	D-2,E-2	Pressurizer Relief Tank Gas Space Sample	-	A	3/8	GA	PN	OC	LT EV ST	NO

SURRY UNIT 1
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME VENTS & DRAINS

DRAW. NO. 11448-FM-83A

PAGE 12

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
TV-DA100B	A-8	R. C. Sump Pump Discharge Isolation	-	A	2	GA	PN	OC	LT EV ST	NO
TV-DG108B	A-3	Pr. Dr. Transfer Pump Disch. Isolation	-	A	2	GA	PN	OC	LT EV ST	NO
TV-VG109B	A-1	Gas Vent Hdr. Isolation	-	A	2	GA	PN	O	LT EV ST	NO
1-VA-1, 6	A-3	Containment Isolation	-	AE	2	GA	HW	C	VP	(YES) (26)

SURRY UNIT 1
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME VENTS & DRAINS

DRAW. NO. 11448-FM-83B

PAGE 13

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
TV-DA100A	I-8	R. C. Sump Pump Discharge Isolation	-	A	2	GA	PN	OC	LT EV ST	NO
TV-DG108A	L-5	Pr. Dr. Transfer Pump Disch. Isolation	-	A	2	GA	PN	OC	LT EV ST	NO
TV-VG109A	L-2	Gas Vent Hdr. Isolation	-	A	2	GA	PN	O	LT EV ST	NO

SURRY UNIT 1
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME CONTAINMENT & RECIRCULATION SPRAY

DRAW. NO. 11448PM84A

PAGE 14

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
MOVRS155A,B	F8,F8	Recirculation Spray Pump Suction from Containment Sump	2	A	12	PL	MO	O	LT EV ST	NO
MOVRS156A,B	F6,F6	Recirculation Spray Pump Discharge	2	A	10	GA	MO	O	LT EV ST	NO
IRS11,17	F6,F6	Recirculation Spray Pump Discharge Check Valves	2	AC	10	CK	SA	C	CV LT	YES (8)
MOV-CS100,A,B	I-4,I-4	Containment Spray Pump Suction from RWST	2	B	12	GA	MO	O	EV ST	NO
MOVCS101A,B, C,D	F2,F2, F1,F1	Containment Spray Pump Discharge	2	A	8	GA	MO	C	LT EV ST	NO
ICS13,24	E2,E1	Containment Spray PUmp Discharge Check Valves	2	AC	8	CK	SA	C	CV LT	YES (8)
MOVCS102A,B	J3,K3	Chemical Addition Tank to RWST Isolation Valve	2	B	6	GA	MO	C	EV ST	NO
ICS 25	J-3	RWST to LHSI	2	E	16	GA	HW	O	VP	NO
MOV RH-100	K-3	RHR to RWST	-	A	6	GA	MO	O	EV ST	YES (26)

SURRY UNIT 1
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME CONT. VACUUM & LEAKAGE MONITORING

DRAW. NO. _____

11448-FM-85A

PAGE 15

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
TV-LM100A,B C,D,E,F,G,H	E-3,E-3,E-3, E-3,E-3,E-3, D-3,E-3	Open Pressure System Isolation	-	A	3/8	GA	PN	C	LT EV ST	NO
TV-LM101A,B	H-4,I-4	Closed Pressure System Isolation	-	A	3/8	GA	PN	C	LT EV ST	NO
HCV-CV100	J-5	Cont. Vacuum Air Ejector Isolation	-	A	8	GA	PN	C	LT EV ST	YES (26)
TV-CV-150A,B, C,D	H-7,H-7, H-8,H-8	Cont. Vacuum Pump Suction Isolation	-	A	2	GA	PN	O	LT EV ST	NO
1-CV-2	I-5	Cont. Vacuum Air Ejector Isolation	-	AE	8	GA	HW	C	VP EV	YES (26)

SURRY UNIT 1
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME CONT. VACUUM & LEAKAGE MONITORING

DRAW. NO. 11448-FM-90A

PAGE 15A

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
1-GW-166,175	B-3, A-3	Gaseous Waste Disposal Isolation	-	A	2	DA	HW	C	VP LT EV	Yes (26)
1-GW-174,183	A-2, B-2	Gaseous Waste Disposal Isolation	-	AE	2	DA	HW	C	VP LT EV	YES (26)

SURRY UNIT 1
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME REACTOR COOLANT

DRAW. NO. 11448-FM-86B

PAGE 16

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
SV-1551A,B,C	F-4,G-4,H-4	Pressurizer Safety Valves	1	C	6	SF	SA	C	SP	NO
TV-1519A	A-6	Primary Grade Water to PRZ Relief Tank	-	A	3	GA	PN	C	LT EV ST	NO
1-RC-160	D-6	Primary Grade Water to PRZ Relief Tank	-	AC	3	CK	SA	C	LT CV	YES (27)

SURRY UNIT 1
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME CHEMICAL AND VOLUME CONTROL

DRAW. NO. 11448-FM-88B

PAGE 17

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
1-CH-258,267, 276	D-6,F-6 G-6	Charging Pump Discharge Check Valve	2	C	3	CK	SA	OC	CV	YES (17)
LCV-1115B,D	C-9,C-9	Charging Pump Suction from Refueling Water Storage Tank	2	B	8	GA	MO	C	EV ST	NO
LCV-1115C,E	H-3,H-3	Charging Pump Suction from Volume Control Tank	2	B	4	GA	MO	O	EV ST	YES (12)
MOV-1275A,B,C	D-6,F-6,H-6	Charging Pump Recirculation Flow Path Isolation	2	B	2	GA	MO	O	EV ST	YES (17)
MOV-1373	F-5	Charging Pump Recirculation Header Stop Valve	2	B	3	GA	MO	O	EV ST	YES (13)
MOV-1381	A-3	Reactor Coolant Pump Seal Water Return	2	A	3	GA	MO	O	LT EV ST	YES (14)

SURREY UNIT 1
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME CHEMICAL AND VOLUME CONTROL

DRAW. NO. 11448-FM-88B

PAGE 18

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
TV-1204	A-3	Reactor Coolant System Letdown Isolation Trip Valve	2	A	2	GA	PN	O	LT EV ST	YES (15)
RV-1209	F-1	Reactor Coolant System Letdown Relief Valve	2	C	2	RE	SA	C	SP	NO
RV-1257	H-1	Volume Control Tank Relief Valve	2	C	3	RE	SA	C	SP	NO
MOV-1289A & B	B-5	Normal Charging Header Isolation	2	A	4	GA	MO	O	LT EV ST	YES (16)
FCV-1160	A-3	RCS Loop Fill Header Isolation	1	A	2	GL	PN	C	LT EV ST	YES (26)

SURRY UNIT 1
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME

CHEMICAL AND VOLUME CONTROL

DRAW. NO.

11448-FM-88C

PAGE 19

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
RV-1203	H-1	Letdown Header Relief	2	C	2	CK	SA	C	SP	NO
HCV-1200A,B,C	H-2, H-2, H-2	Letdown Orifice Isolation	2	A	2	GA	PN	OC	LT EV ST	NO

SURREY UNIT 1
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME SAFETY INJECTION

DRAW. NO. 11448 FM 89A

PAGE 20

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
MOV-1860A,B	B-8, E-8	Low Head Safety Injection Pump Suction from Contain- ment Sump	2	A	12	GA	MO	C	LT EV ST	NO
1-SI-56,47	C-8, F-8	Low Head Safety Injection Pump Suction from Contain- ment Sump Check	2	C	12	CK	SA	C	CV	YES (18)
MOV-1862A, B	G-9, G-8	Low Head Safety Injection Pump Suction from Refueling Water Storage Tank	2	B	12	GA	MO	O	EV ST	NO
1-SI-46A, B	G-9, G-8	Low Head Safety Injection Pump Suction from Refueling Water Storage Tank Check	2	C	12	CK	SA	C	CV	YES (28)
1-SI-58, 50	D-7, G-7	Low Head Safety Injection Pump Discharge Check	2	C	10	CK	SA	C	CV	YES (28)
MOV-1863A, B	E-6, G-6	Low Head Safety Injection Pump Dischrge to High Head Safety Injection Pump Suction	2	B	8	GA	MO	C	EV ST	NO
MOV-1885A, B, C, D	C-7, G-6, G-6, C-7	Low Head Safety Injection Pump Recirculation to Refueling Water Storage Tank	2	B	2	GA	MO	O	EV ST	NO
1-SI-61, 53	C-6, G-6	Low Head Safety Injection Pump Recirculation to Refueling Water Storage	2	C	2	CK	SA	C	CV	NO

SURREY UNIT 2
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME SAFETY INJECTION

DRAW. NO. 11448-EM-89A

PAGE 21

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
MOV-1864A, B	D-6, G-5	Low Head Safety Injection Pump Discharge to Reactor Coolant System Cold Legs	2	B	10	GA	MO	O	EV ST	NO
RV-1845A, B, C	C-6, D-5 C-5	Low Head Safety Injection Flow Path Relief	2	C	1	RE	SA	C	SP	NO
MOV-1890A, B	B-6, B-5	Low Head Safety Injection to Reactor Coolant System Hot Legs	2	AE	10	GA	MO	C	LT EV ST VP	NO
MOV-1890C	B-6	Low Head Safety Injection to Reactor Coolant System Cold Legs	2	AE	10	GA	MO	O	LT EV ST VP	YES (19)
MOV-1869A, B, 1842	A-3, I-3, A-1	High Head Safety Injection to Reactor Coolant Sys.	2	AE	3	GA	MO	C	LT EV ST VP	YES (20)
MOV-1867C, D	B-1, B-2	Boron Injection Tank Outlet Isolation	2	A	3	GA	MO	C	LT EV ST	YES (21)
MOV-1867A, B	I-2, I-2	Boron Injection Tank Inlet Isolation	2	B	3	GA	MO	C	EV ST	YES (21)

SURREY UNIT 2
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME SAFETY INJECTION

DRAW. NO. 11448-FM-89A

PAGE 22

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
TV-1884A	H-1	Boron Injection Tank Recirculation	2	B	1	GA	PN	O	EV ST	NO
TV-1884B, C	H-1, G-2	Boron Injection Tank Recirculation	3	B	1	GA	PN	O	EV ST	NO
RV-1857	D-1	Boron Injection Tank Relief	2	C	3/4	RE	SA	C	SP	NO
TV-SI100	B-4	Nitrogen Accumulators	-	A	1	GA	PN	O	LT EV ST	NO
1-SI-73	A-5	Accumulator Isolation	-	AE	3/4	GL	HW	C	EV LT	YES (26)
1-SI-32	A-5	Accumulator Isolation	-	AE	1	GL	HW	C	EV LT	YES (26)
1-SI-150	E-1	Boron Injection Tank	-	A	1	GL	HW	O	EV LT	YES (26)
1-SI-174	C-2	High Head Safety Injection to Reactor Coolant System	-	A	3/4	GA	HW	C	EV LT	YES (26)

SURRY UNIT 2
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME SAFETY INJECTION

DRAW. NO. 11448-FM-89B

PAGE 23

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSTI- TION	TEST REQ.	RELIEF REQUEST
RV-1858A, B, C	C-4, G-5, C-7	Accumulator Tank Relief	2	C	1	RE	SA	C	SP	NO
1-SI-107, 109 128, 130, 145, 147	C-5, A-5, G-7, A-7, C-8, A-9	Accumulator Discharge Check	1	C	12	CK	SA	C	CV	YES (22)
MOV-1865A, B, C	C-5, G-6, C-8	Accumulator Discharge	2	BE	12	GA	MO	O	EV ST VP	NO
1-SI-88, 91, 94, 238, 239, 240	A-2, A-2, A-3, B-2 B-2, A-3	Safety Injection to RCS Hot Legs	1	C	6	CK	SA	C	CV	YES (23)
1-SI-235, 236, 237	B-1, B-1 B-2	High Head Safety Injection to RCS Cold Legs	1	C	2	CK	SA	C	CV	YES (24)
1-SI-241, 242, 243	B-1, B-1, B-2	Low Head Safety Injection to RCS Cold Legs	1	C	6	CK	SA	C	CV	YES (30)
1-SI-224, 225, 226, 227	J-1, J-1, J-2, J-3	High Head Safety Injection Check Valves at Containment Penetrations	2	C	3	CK	SA	C	CV	YES (24)
1-SI-228, 229	J-3, J-3	Low Head Safety Injection Check Valves at Containment Penetrations	2	C	6	CK	SA	C	CV	YES (30)

SURREY UNIT 2
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME SAFETY INJECTION

DRAW. NO. 11448-FM-89B

PAGE 24

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
MOV-1866A, B, C, D, E, F	E-3, E-2, E-2, E-2 E-1, E-1	Cold & Hot Leg Safety Injection Line Throttle Valve	2	E	2	GL	HW	T	VP	NO
1-SI-79, 82, 85	A-1, A-1, A-2	Safety Injection to RCS Cold Legs	2	C	6	CK	SA	C	CV	YES (23)
TV-SI101A, B	J-5, J-5	Accumulator Nitrogen Relief Line Isolation	-	A	1	GA	PN	O	LT EV ST	NO
1-SI-234	J-4	Nitrogen Accumulators	-	AC	1	CK	SA	C	CV LT	YES (29)

SURREY UNIT 2
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME R.W.S.T. CROSS TIE

DRAW. NO. 11448-FM-106C

PAGE 5

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
TV-SI102A, B	D-3, D-3	Unit No. 1 RWST to Unit No. 2 RWST Cross Tie	2	B	8	GA	PN	C	EV ST	NO
1-SI-25	C-3	Charging Pump Suction from RWST Check Valve	2	C	8	CK	SA	C	CV	YES (12)
1-SI-410	B-3	Charging Pump Suction from RWST Check Valve	2	C	10	CK	SA	C	CV	YES (12)

SURREY UNIT
INSERVICE TESTING
ASME CODE CLASS 1, 2 AND 3 VALVES

SYSTEM NAME

STEAM GENERATOR BLOWDOWN

DRAW. NO.

11448-FM-124A

PAGE 26

VALVE NUMBER	DRAW. LOCN.	FUNCTION	CODE CLASS	CATE- GORY	SIZE (IN.)	VALVE TYPE	ACTUA- TOR TYPE	NORMAL POSI- TION	TEST REQ.	RELIEF REQUEST
TV-BD100A,B,C D,E,F	C-2,C-2,C-4 C-4,C-5,C-5	Steam Generator Blowdown Trip Valves	2	B	3	GA	PN	0	EV ST	YES (25)

SURRY UNIT 1

INSERVICE TESTING

ASME CODE CLASS 1, 2 AND 3 VALVES

RELIEF REQUESTS

- (1) A full stroke or partial stroke exercise of these valves during power operation could result in a turbine and reactor trip. As an alternative, they will be full stroke exercised during cold shutdown.
- (2) Opening these valves during power operation would introduce cold and out of chemistry specifications auxiliary feedwater to the steam generators resulting in thermal stress and possible degradation. As an alternative, they will be tested during cold shutdown.
- (3) Closure of these valves during power operation would require securing feedwater (resulting in a reactor trip) and initiation of auxiliary feedwater flow to back seat the disc. These valves will be tested during cold shutdown.
- (4) Opening these valves would result in the introduction of service water into the recirculation spray heat exchangers and cause fouling of the heat exchanger tubing. As an alternative, these valves will be tested during cold shutdown.
- (5) These check valves are located in the containment and may be normally open or closed depending on system lineup. A containment entry and manipulation of other system valves is necessary to test these valves. This is considered impractical during power operation and therefore they will be tested during cold shutdown.
- (6) Component cooling water flow to the reactor coolant pumps is required at all times the pumps are in operation. Failure of one of these valves in a closed position during cycling would result in a loss of the cooling flow to the pump. These valves will be tested during cold shutdown when the reactor coolant pumps are secured.
- (7) These valves remain open during normal plant operations. It is not practical to test for closure unless the containment air coolers are taken out of service. As an alternative, these valves will be tested during cold shutdown.
- (8) These valves are located inside the containment and not accessible during power operation, using flow to exercise these valves would result in spraying the containment, manual exercising requires building scaffolding that requires venting the containment that in turn requires leak testing both doors prior to plant startup to establish subatmospheric containment pressure. As an alternative, these valves will be manually full stroke exercised during refueling outages.

- (9) Cycling of these RHR system valves during power operations would subject the RHR system to full RCS pressure. These valves will be exercised when the RHR system is placed into operation during cooldown of the reactor coolant system.
- (10) This relief valve cannot be tested unless the entire RHR system is removed from service and drained. The RHR system must be available during operation and refueling outages for core cooling capability. The valve will be tested whenever the RHR system is removed from service and drained for maintenance.
- (11) This valve can only be cycled when the RHR pumps are started. As an alternative to testing once per (3) months, they will be tested when the RHR pumps are tested in the pump testing program.
- (12) Exercising this valve during power operation would require the charging pump suction to be aligned with the refueling water storage tank. This would cause a sudden increase in RCS boron inventory. It will be exercised during cold shutdown when the RCS is borated to shutdown conditions.
- (13) This valve cannot be exercised without possible damage to the charging pumps. As an alternative, it will be exercised when the charging pumps are secured during cold shutdown.
- (14) This valve cannot be shut down when the RC system is above atmospheric pressure or when the RCS is being filled. Closure of this valve cause loss of RCP seal flow resulting in pump seal damage. As an alternative, this valve will be tested at refueling outages.
- (15) Exercising this valve shut dueing power operation could result in a loss of RC inventory and pressurizer level control. This valve will be exercised during cold shutdowns.
- (16) Failure of this valve in a closed position during exercising would cause a loss of charging flow and could result in an inability to maintain reactory coolant inventory. This valve will be exercised during cold shutdown.
- (17) With the present plant design, these valves can only be partial stroke exercised during power operation and the charging pumps cannot achieve design accident flow when pumping into the RCS at operating pressure, the only available flow path to test these valves is into the RCS.

During cold shutdown, full stroke exercising these valves could result in an over-pressurization of the RC's and could force a safety system (PORV's) to function. These valves will be full stroke exercised during refueling outages when the vessel head is removed providing an adequate expansion volume.

- (18) This normally closed check valve cannot be exercised without isolating suction to the LHSI pump and draining a portion of the system. This valve will be part-stroke exercised during each refueling outage using the leakage monitoring test connections.
- (19) This valve will not be exercised during power operation if this valve failed in the closed position, LHSI to the cold leg would be rendered inoperable. This valve is full stroke exercised during cold shutdowns.
- (20) These valves cannot be exercised during power operation, opening these valves would allow charging flow into the RCS thermally shocking the HHSI nozzles and causing reactivity transients. During cold shutdown the charging (HHSI) flow could cause an over-pressurization of the RCS and could force a safety system (PORV's) to function. These valves are full stroke exercised during refueling outages.
- (21) Opening these valves during power operation would allow concentrated boric acid to flow into the piping systems that are not heat traced and a boron build-up could crystalize and block system flow. These valves are full stroke exercised during cold shutdowns.
- (22) These valves cannot be exercised during power operation because accumulator pressure cannot overcome RCS pressure. The 3/4" test line will not partial stroke these valves. These valves cannot be exercised during cold shutdown because an overpressurization accident could occur. These valves are partial stroke exercised during refueling outages.
- (23) These valves cannot be exercised during power operation, HHSI flow through these valves would thermal shock the injection nozzles. During cold shutdown the RCS pressure is greater than accident pressure and full design flow cannot be achieved. These valves are full stroke exercised during refueling outages when the vessel head is removed.
- (24) These valves cannot be exercised during power operation, exercising valves requires flow into the RCS, thermal shocking the injection nozzles. Exercising these valves during cold shutdown could result in an overpressurization of the RCS and force a safety system (PORV's) to function. These valves are full stroke exercised during refueling outages when the vessel head is removed.
- (25) Closing these valves during power operation causes the downstream piping to become empty due to drainage and water flashing to steam. When the valves are reopened a flow surge occurs which automatically isolates the inner valves due to high flow. Then a containment entry is necessary to reset these valves and upon reopening the process may occur again. As an alternative these valves will be exercised during cold shutdown.

- (26) These are passive valves and are not required to change position to perform their safety related function. As an alternative these valves will be tested during each refueling outage.
- (27) Plant design does not permit verification of valve position during power operation or cold shutdown. The only way to verify its safety position is during leak rate testing at refueling outages.
- (28) These valves cannot be full stroke exercised during power operation, the only full flow path is into the RCS and the LHSI pumps cannot overcome RCS operating pressure. This valve is partial stroke exercised quarterly through the pump recirculation line. During cold shutdown the RCS pressure is greater than design accident pressure and the LHSI pump cannot achieve design flow. These valves are full stroke exercised during refueling outages with the vessel head removed which provides minimum RCS back pressure which allows full LHSI flow.
- (29) This valve cannot be verified shut (its safety related position) during power operation or cold shutdown. The only method to verify valve closure is during a leak rate test at refueling outages.
- (30) These valves cannot be exercised during power operation as the only full flow path into the RCS and the LHSI pumps cannot be full stroke exercised because RCS pressure is greater than accident pressure. These valves are full stroke exercised during refueling outages with the vessel head removed.