



April 28, 1978

L-78-157

Central File
50-389

Mr. James P. O'Reilly, Director
Office of Inspection and Enforcement
U. S. Nuclear Regulatory Commission
230 Peachtree Street, N.W., Suite 818
Atlanta, Georgia 30303

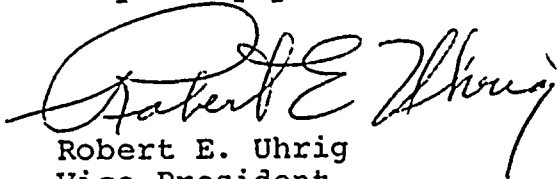
Dear Mr. O'Reilly:

RE: RII:JPO
50-389

Florida Power and Light Company has reviewed IE Bulletin 78-04, concerning the environmental qualifications of stem mounted limit switches inside the containment, and submit the following response:

Both our Nuclear Steam System Supplier and our Architect-Engineer have reviewed the safety-related valves and limit switches to be used inside the St. Lucie 2 Reactor Containment and have determined that neither NAMCO Model D2400X nor EA-170-302 snap lock limit switches are used in any safety-related equipment in the primary containment; therefore the subject Bulletin is not applicable to St. Lucie Unit 2.

Very truly yours,


Robert E. Uhrig
Vice President

cc: Harold F. Reis, Esquire

AO 2
GD