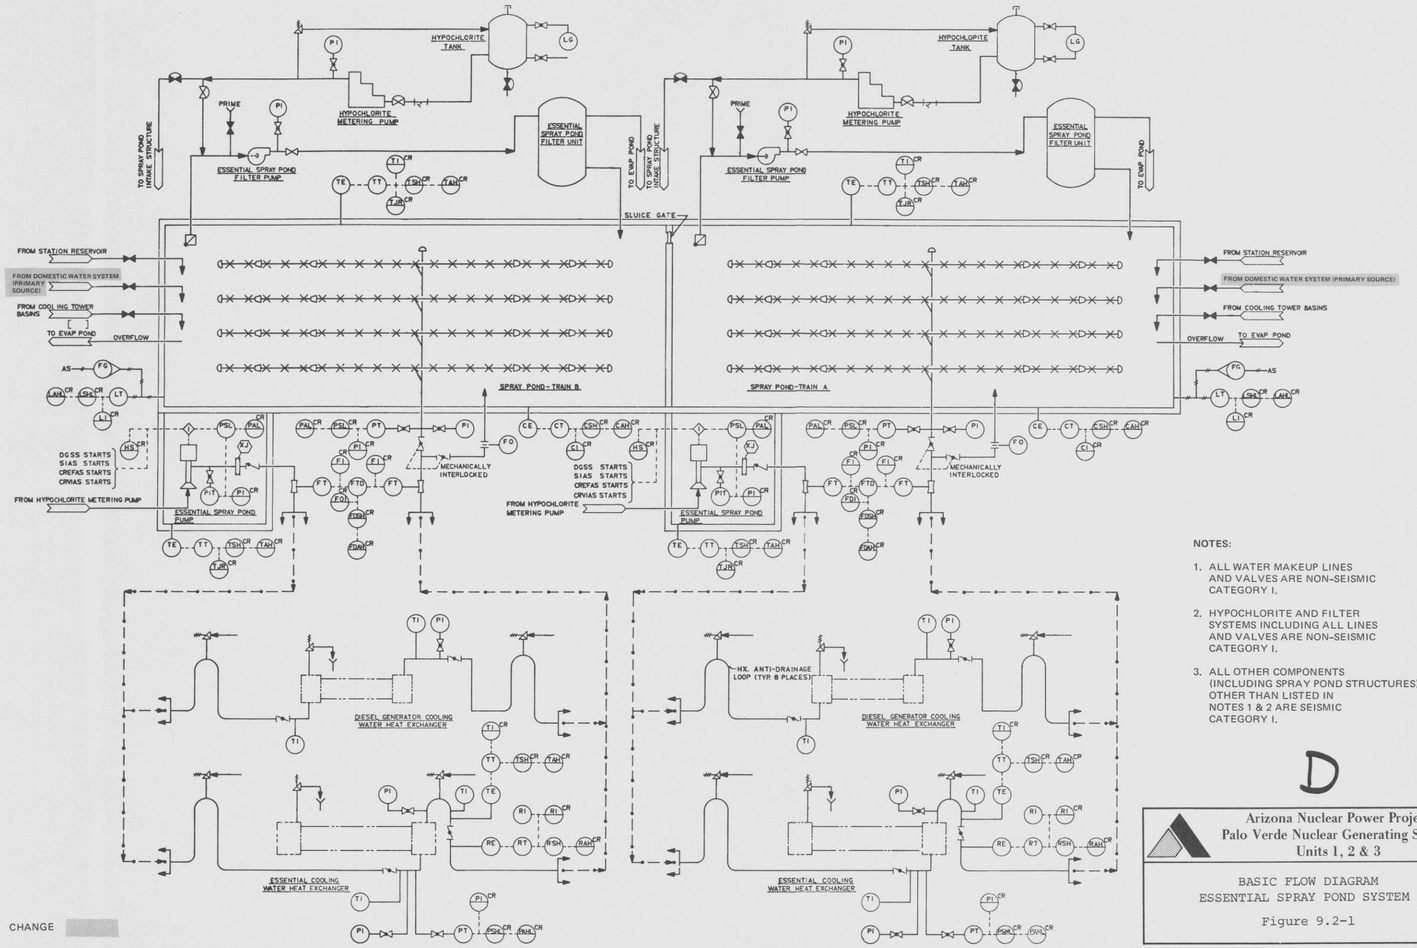

NOTES:

1. ALL WATER MAKEUP LINES AND VALVES ARE NON-SEISMIC CATEGORY I.
2. HYPOCHLORITE AND FILTER SYSTEMS INCLUDING ALL LINES AND VALVES ARE NON-SEISMIC CATEGORY I.
3. ALL OTHER COMPONENTS (INCLUDING SPRAY POND STRUCTURES) OTHER THAN LISTED IN NOTES 1 & 2 ARE SEISMIC CATEGORY I.

D

CHANGE

10407-11A-491
01NO5

Arizona Nuclear Power Project
Palo Verde Nuclear Generating Station
Units 1, 2 & 3

BASIC FLOW DIAGRAM
ESSENTIAL SPRAY POND SYSTEM

Figure 9.2-1

November 17, 1975 Amendment 14