

50-315/316

NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL

FILE NUMBER

TO:

DF MR B RUSCHE

FROM: INDIANA & MICH POWER CO
NEW YORK, NY
J TILLINGHAST

DATE OF DOCUMENT

3-29-76

DATE RECEIVED

4-1-76

☒ LETTER☐ NOTORIZED

PROP

INPUT FORM

NUMBER OF COPIES RECEIVED

☐ ORIGINAL☒ COPY☒ UNCLASSIFIED

1 SIGNED

DESCRIPTION

LTR D NOTORIZED 3-29-76.....2-23-76
LTR RE OUR 2-23-76 LTR.....ADVISING THEIR
INTENTIONS OF SUPPLYING REQUEST INFO TO
APPENDIX I NLT -6-4-76.....

ENCLOSURE

ACKNOWLEDGED

DO NOT REMOVE

PLANT NAME: Cook 1 & 2

SAFETY

FOR ACTION/INFORMATION

ENVIRO

4-5-76 RR

<input checked="" type="checkbox"/>	ASSIGNED AD :	DeYoung	<input checked="" type="checkbox"/>	ASSIGNED AD :	V. Moore
<input type="checkbox"/>	BRANCH CHIEF :		<input checked="" type="checkbox"/>	BRANCH CHIEF :	Knighton
<input checked="" type="checkbox"/>	PROJECT MANAGER:	Benedict	<input checked="" type="checkbox"/>	PROJECT MANAGER :	COTA
<input checked="" type="checkbox"/>	LIC. ASST. :	SERVICE	<input checked="" type="checkbox"/>	LIC. ASST. :	SLATER

INTERNAL DISTRIBUTION

<input checked="" type="checkbox"/>	REG FILE		SYSTEMS SAFETY		PLANT SYSTEMS		ENVIRO TECH
<input checked="" type="checkbox"/>	NRC PDR		HEINEMAN		TEDESCO		ERNST
<input checked="" type="checkbox"/>	I & E (3)		SCHROEDER		BENAROYA	<input checked="" type="checkbox"/>	BALLARD
<input checked="" type="checkbox"/>	OELD				LAINAS		SPANGLER
<input checked="" type="checkbox"/>	GOSSICK & STAFF		ENGINEERING		IPPOLITO		
	MIPC		MACCARY				SITE TECH
	CASE		KNIGHT		OPERATING REACTORS	<input checked="" type="checkbox"/>	GAMMILL
	HANAUER		SIHWEIL		STELLO		STEFF
	HARLESS		PAWLICKI			<input checked="" type="checkbox"/>	HULMAN
					OPERATING TECH	<input checked="" type="checkbox"/>	MARKEE
	PROJECT MANAGEMENT		REACTOR SAFETY		EISENHUT		SITE ANALYSIS
	BOYD		ROSS		SHAO	<input checked="" type="checkbox"/>	VOLMER
	P. COLLINS		NOVAK		BAER		BUNCH
	HOUSTON		ROSZTOCZY		SCHWENCER	<input checked="" type="checkbox"/>	J. COLLINS
	PETERSON		CHECK		GRIMES	<input checked="" type="checkbox"/>	KREGER
	MELTZ						
	HELTEMES		AT & I		SITE SAFETY & ENVIRO		
	SKOVHOLT		SALTZMAN		ANALYSIS		
			RUTBERG	<input checked="" type="checkbox"/>	DENTON & MULLER		

EXTERNAL DISTRIBUTION

CONTROL NUMBER

<input checked="" type="checkbox"/>	LPDR: ST. JOSEPH, MT.	<input checked="" type="checkbox"/>	NATL LAB		BROOKHAVEN NATL LAB
<input checked="" type="checkbox"/>	TIC		REG. V-IE		ULRIKSON (ORNL)
<input checked="" type="checkbox"/>	NSIC		LA PDR		
	ASLB		CONSULTANTS		
	ACRS				
	HOLDING/SENT				

3044

.....
.....
.....

.....


INDIANA & MICHIGAN POWER COMPANY

P. O. BOX 18
BOWLING GREEN STATION
NEW YORK, N. Y. 10004

Regulatory Docket File

March 29, 1976

Donald C. Cook Nuclear Plant
Docket No. 50-315
50-316
DPR No. 58

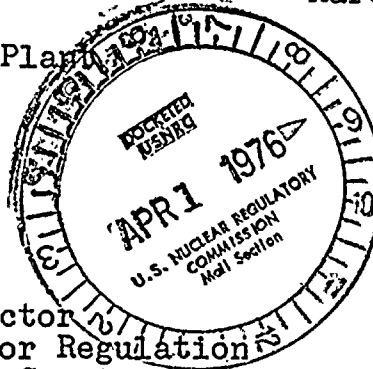

Mr. Benard Rusche, Director
Office of Nuclear Reactor Regulation
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

Dear Mr. Rusche:

On February 27, 1976, we received a letter from Mr. R. C. DeYoung, dated February 23, 1976, regarding guidance for licensees required to file information with the Commission under the provisions of Section V.B. of 10 CFR 50, Appendix I. This letter asked that within 30 days the NRC be informed of the measures we intend to adopt or propose to meet the requirements of paragraph 50.34a.

We presently have work in progress with the intention of supplying the information requested in Enclosures 1 and 2 by June 4, 1976.

However, we know there have been questions raised on the new rulemaking by licensees indicating the need for clarification of the NRC February 23, 1976 letter and attachments. In order to clarify the intent and information requested by the letter, the NRC has scheduled meetings with licensees in the various NRC Regional Offices. We are planning to attend such a meeting on Tuesday, March 30, 1976 at the Region III Office in Glen Ellyn, Illinois.


As a result of the meeting, we may find that our interpretation of the NRC requirements is not accurate. We may also find that we must change our approach to prepare the information requested in Enclosures 1 and 2. If this

3044

March 29, 1976


should be the case and we need additional time to complete the work, we will notify you as to when we will be able to submit the required information.

Very truly yours,

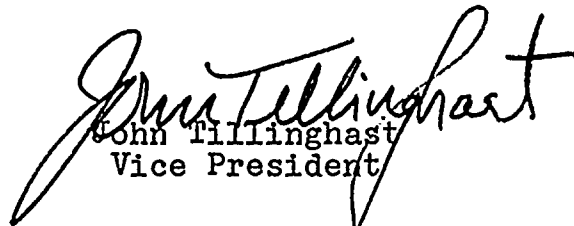
John Tillinghast
Vice President

JT:mam

Sworn and subscribed to before
me this 29th day of March, 1976
in New York County, New York


Notary Public

KATHLEEN BARRY,
NOTARY PUBLIC, State of New York
No. 41-4606792
Qualified in Queens County
Certificate filed in New York County
Commission Expires March 30, 1977

cc: G. Charnoff
R. J. Vollen
R. C. Callen
P. W. Steketee
R. Walsh
R. S. Hunter
R. W. Jurgensen - Bridgman

100-50-500

78

50-23-315

NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL

FILE NUMBER
INCIDENT REPORT

TO: J.G. Keppler

FROM: Indiana & Michigan PowerCo.
Bridgman, Michigan
R.W. JurgensenDATE OF DOCUMENT
3-25-76DATE RECEIVED
4-5-76☐ LETTER
☒ ORIGINAL
☐ COPY☐ NOTORIZED
☐ UNCLASSIFIED

PROP

INPUT FORM

NUMBER OF COPIES RECEIVED

1

DESCRIPTION

ENCLOSURE

Ltr. confirming verbal report of 3-4 and 3-5-76
Concerning Violation of Appendix A. Tech, Spec....

(1 Cy. Received)

DO NOT REMOVE
ACKNOWLEDGED

PLANT NAME: Cook # 1

NOTE: IF PERSONNEL EXPOSURE IS INVOLVED
SEND DIRECTLY TO KREGER/J. COLLINS

SAFETY

FOR ACTION/INFORMATION

ENVIRO

SAB 4-5-76

BRANCH CHIEF: Kniel
W/3 CYS FOR ACTION
LIC. ASST: Service
W/ CYS
ACRS 16 CYS ~~HOLDING~~/SENT TO LA

INTERNAL DISTRIBUTION

~~REG FILE~~
NRC PDR
I & E (2)
MIPC (3)
SCHROEDER/IPPOLITO
HOUSTON
NOVAK/CHECK
GRIMES/SCHWENCER
CASE
F. WILLIAMS
HANAUER
TEDESCO/MACCARY
EISENHUT
BAER
SHAO
VOLLMER/BUNCH
KREGER/J. COLLINS
RU (3)

EXTERNAL DISTRIBUTION

CONTROL NUMBER

LPDR: St. Joseph, Michigan
TIC
NSIC

3373

... 43-20593 ...
... 43-20593 ...



Page 1
10/1/54

**INDIANA & MICHIGAN POWER COMPANY**

DONALD C. COOK NUCLEAR PLANT
P.O. Box 458, Bridgman, Michigan 49106

March 25, 1976

Mr. J.G. Keppler, Regional Director
Office of Inspection and Enforcement
United States Nuclear Regulatory Commission
Region III
799 Roosevelt Road
Glen Ellyn, IL 60137

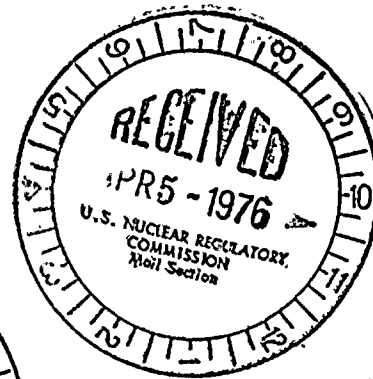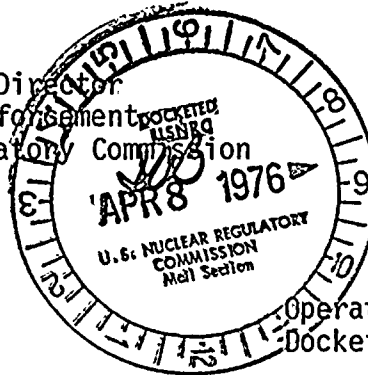

Operating License DPR-58
Docket No. 50-315

Dear Mr. Keppler:

This letter is to confirm our verbal report made at 1430 hours to NRC RO: III Inspector, Mr. K.R. Baker, on March 25, 1976.

In that conversation we reported that through review of test data we had determined that we are in violation of Appendix A Technical Specifications Section 4.6.5.3.1.b.3 on five (5) Ice Condenser Inlet Doors.

A plant shutdown was commenced at approximately 1700 hours.

We will continue our investigation of the condition and will submit a report of this event within 14 days as required by Regulatory Guide 1.16, Revision 3, Section 2.a.

Sincerely,

R.W. Jurgensen
Plant Manager

/bab

cc: R.S. Hunter
J.E. Dolan
G.E. Lien
R. Kilburn
R.J. Vollen BPI
R.C. Callen MPSC
K.R. Baker RO: III
P.W. Stoketee, Esq.
R. Walsh, Esq.
G. Charnoff, Esq.

G. Olson
J.M. Hennigan
PNSRC
R.S. Keith
Dir., IE (30 copies)
Dir., MIPC (3 copies)

3373

MAR 29 1976

— 577
22.1. 1947