

NRC FC-1M 195
(2-76)

U.S. NUCLEAR REGULATORY COMMISSION

DOCKET NUMBER

50-316/316

NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL

FILE NUMBER

TO:

Mr. Edson G. Case

FROM:

Indiana & Michigan Power Company
New York, N. Y.
John Tillinghast

DATE OF DOCUMENT

11/18/77

DATE RECEIVED

11/21/77

☒ LETTER

☐ NOTORIZED

PROP

INPUT FORM

NUMBER OF COPIES RECEIVED

☒ ORIGINAL

☒ UNCLASSIFIED

☐ COPY

1516200

DESCRIPTION

Consists of additional info. concerning
the Overpressurization Mitigating System
for both units of Cook Nuclear Plant....
notorized 11/18/77....w/att drawings.....

PLANT NAME:

Cook Units 1 & 2

(2-P)+(2-P)

RJL 11/21/77

DISTRIBUTION FOR REACTOR VESSEL INFO FOR
NON-OPERATING REACTORS PER H. SMITH 9-8-76

ENCLOSURE

Dist Per J. Lee 11/21/77

UNIT #2

1 ENCL / BALANCE REPROD

SAFETY

UNIT #1 FOR ACTION/INFORMATION

BRANCH CHIEF:

DAVIS (7)

KNIEL (1)

PROJECT MANAGER:

MLYNIAZAK (1)

LIC. ASST:

J. LEE (1)

INTERNAL DISTRIBUTION

REG FILE

NRC-PDR

I & E (3)

OELD

HEITHMAN

SCHROEDER

BOSNAK

ROSS

TEDESCO

H. SMITH

CROCKER

GOSSICK

PAWLICKI

NOVAK

EISENHUT

SHAO

BAER

BUTLER

ZECH

EXTERNAL DISTRIBUTION

LPDR: ST JOSEPH N.

TIC:

NSIC:

ACRS 16 CYS HOLDING/SENT CAT B

CONTROL NUMBER

773250106

MA 4

60


INDIANA & MICHIGAN POWER COMPANY

P. O. BOX 18
BOWLING GREEN STATION
NEW YORK, N. Y. 10004

November 18, 1977

Donald C. Cook Nuclear Plant Units 1 & 2
Docket Nos. 50-315 & 50-316
DPR. NO. 58 & CPPR NO. 61.

Mr. Edson G. Case, Acting Director
Office of Nuclear Reactor Regulation
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

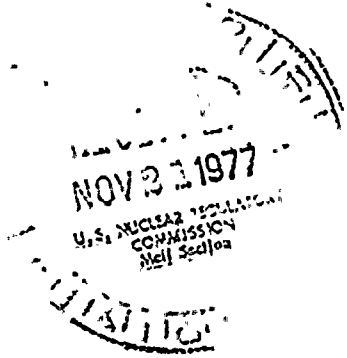

Dear Mr. Case:

The purpose of this letter is to provide additional information concerning the Overpressurization Mitigating System for both units of Cook Nuclear Plant.

In our letter of August 4, 1977 we indicated, in response to Item No.4, that control room annunciation will be provided for the motor operated valves up-stream of the PORV's to alert the operator if these valves are closed when the mitigating system is enabled. Figure No. 1 provides the revised electrical schematic for the mitigating system annunciators and shows electrical contacts for the "hard-wired" motor operated valve alarms. In addition, this figure shows electrical contacts for a pressure alarm, transmitting to the control room, to alert the operator that the compressed air bottle air pressure is low, as indicated in response to Item 6 of our August 4, 1977 letter. Figure No. 1 is the final version for Overpressurization Mitigating System annunciators and replaces Figure No. 3 of our August 4, 1977 letter.


775150103

November 18, 1977

The Overpressurization Mitigating System (OMS) will be enabled when the Reactor Coolant System pressure reaches 425 psig. This system will actuate the PORV when pressure increases above the system set point of 435 psig as indicated in Attachment 1 of our August 4, 1977 letter.

We will be installing surface thermocouples on each steam generator (SG), above the tube sheet, to measure SG shell side temperature. The SG temperature will be shown on a temperature indicator so that the operator can compare SG temperature to the RCS cold leg temperature for the RCS loop in which a Reactor Coolant Pump (RCP) is to be started. Should the SG temperature exceed the RCS temperature by more than 50°F (ΔT) in a loop, the RCP in that loop will not be started up until ΔT is brought within limits ($\Delta T \leq 50^\circ F$). Figure No. 2 shows the thermocouple locations on the SG. In addition, a spare thermocouple will be installed on each SG. We shall include this ΔT limit in our proposed technical specifications for Donald C. Cook Unit 2 and propose the same technical specification for Unit 1 so that it can be available by the time of installation of the OMS in Unit 1.

Very truly yours,

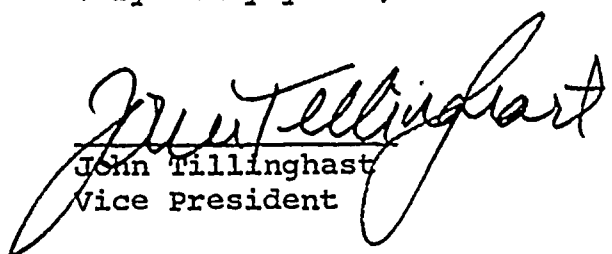

John Tillinghast
Vice President

Sworn and subscribed to before
me on this 18 day of November 1977
in New York County, New York



Notary Public


GREGORY M. GURICAN
Notary Public, State of New York
No. 31-4643431
Qualified in New York County
Commission Expires March 30, 19....

cc: G. Charnoff
R. J. Vollen
R. C. Callen
P. W. Steketee
R. Walsh
R. W. Jurgensen
D. V. Shaller - Bridgman

DONALD C. COOK NUCLEAR PLANT

FIGURE #1

O.M.S. ANNUNCIATORS

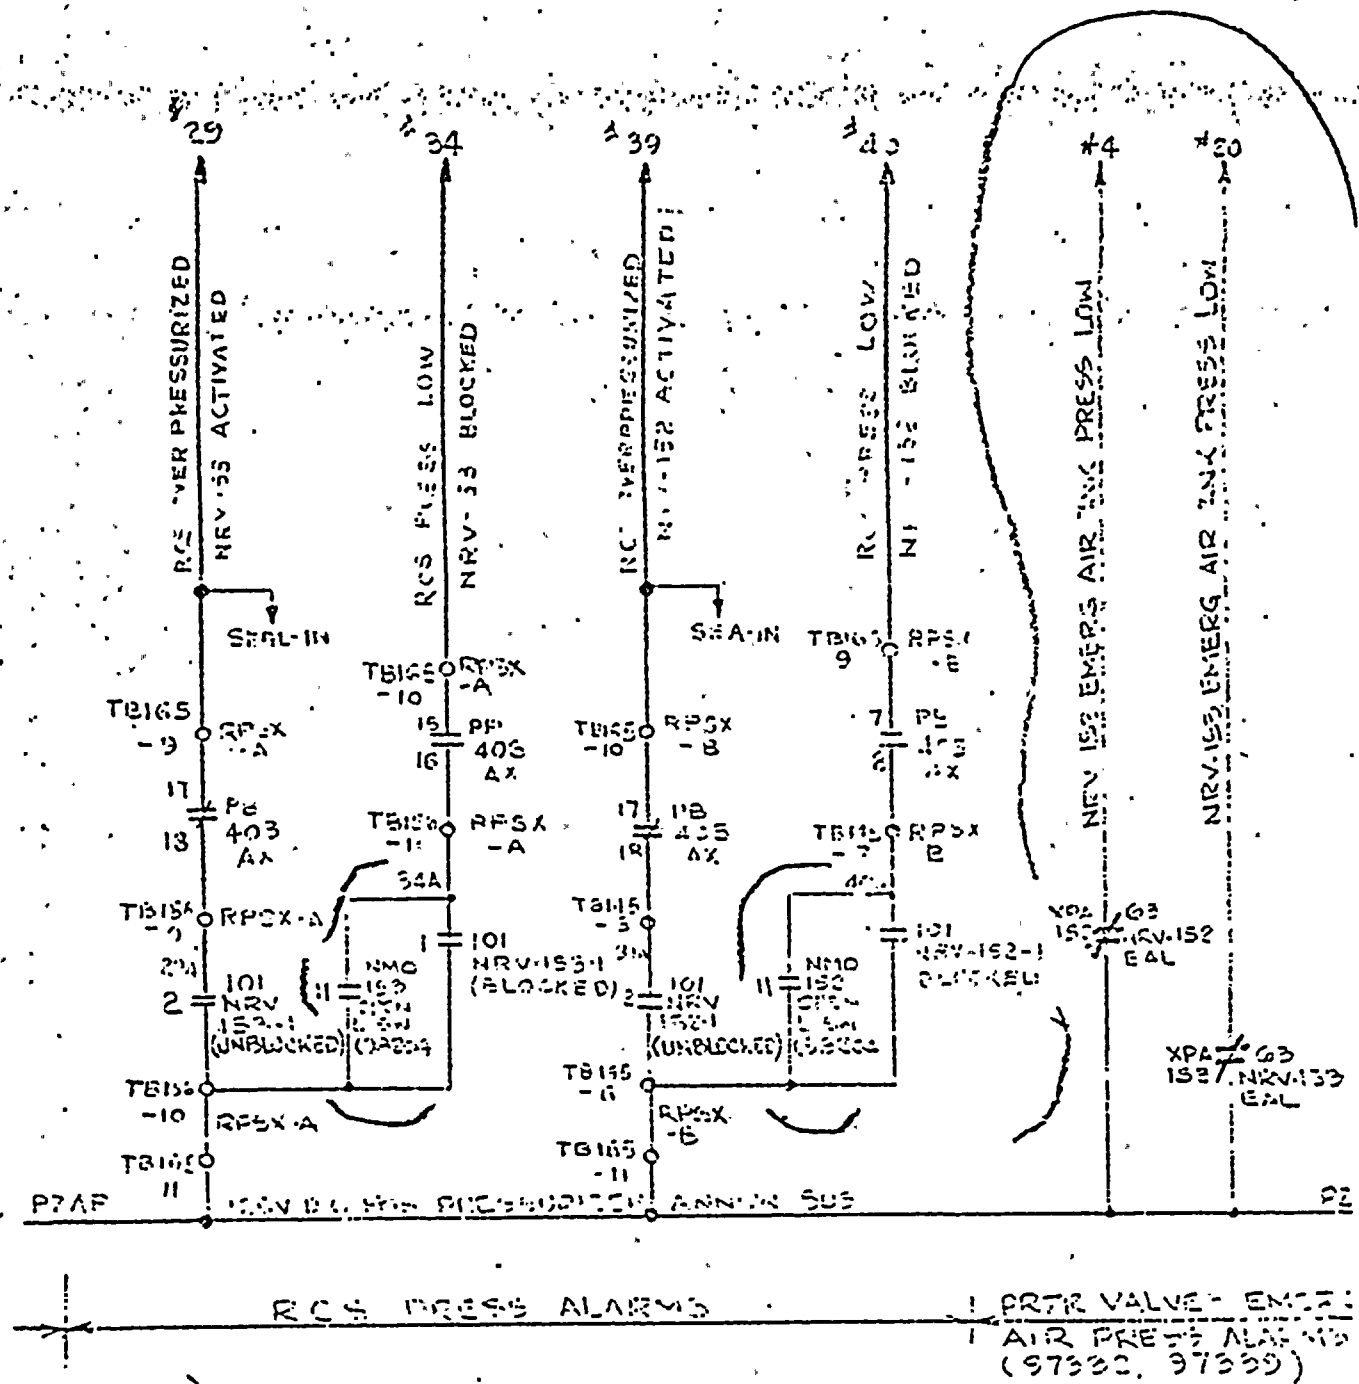


DONALD C. COOK NUCLEAR PLANT

FIGURE #2

SUBJECT Proposed Thermocouple Locations - Steam Generators

Two (2) thermocouples are to be located 14" down from the centerline of the hand hole (secondary side). And 90° around the circumference of the steam generator hand hole on the hot leg side. One thermocouple should be on the 90° azimuth and the other located 4" away on either side.

To determine the hot leg side of the steam generator visually check to see which side the hot leg pipe enters. This should be located between the two hand hole plates. Select a hand hole and measure down 14" from its centerline. Keeping a line of 7" in the same plane locate the first probe 90° away from the hand hole on the hot leg side.

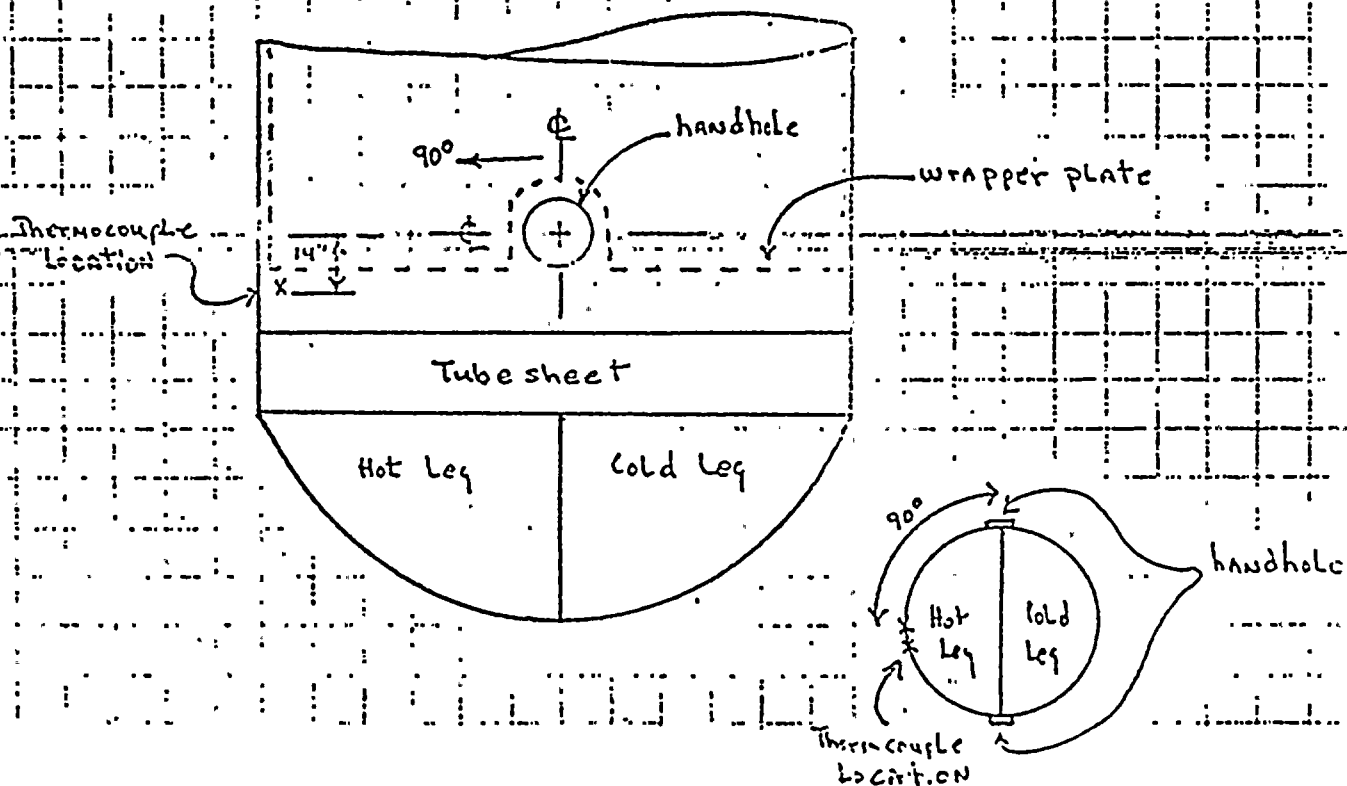

Steam Generator Insulation will have to be modified for thermocouple and leads.