



Callaway Plant

September 4, 2018

ULNRC-06433

U.S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, DC 20555-0001

10 CFR 50.47
10 CFR 50.54(q)
10 CFR 50 Appendix E, IV.B.2
10 CFR 50.90

Ladies and Gentlemen:

**DOCKET NUMBERS 50-483 AND 72-1045
CALLAWAY PLANT UNIT 1
UNION ELECTRIC CO.
RENEWED FACILITY OPERATING LICENSE NPF-30
LICENSE AMENDMENT REQUEST FOR
EMERGENCY ACTION LEVEL (EAL) CHANGES**

- References: 1) Regulatory Issue Summary 2003-18, Supplement 2, "Use of Nuclear Energy Institute (NEI) 99-01, Methodology for Development of Emergency Action Levels," Revision 4 (ADAMS Accession No. ML051450482)
- 2) NRC Regulatory Issue Summary 2005-02, Revision 1, "Clarifying the Process for Making Emergency Plan Changes" (ADAMS Accession No. ML100340545)
- 3) EPFAQ 2016-002, "Clarification of Equipment Damage as a Result of a Hazardous Event" (ADAMS Accession No. ML17195A299)
- 4) EPFAQ 2015-0013, "Hostile Action resulting in a loss of control of the facility declarations when fuel damage is likely within 4-hours or results in a loss of physical control of spent fuel" (ADAMS Accession No. ML16166A366)

Per the guidance provided in References 1, 2, 3 and 4, Union Electric Company (Ameren Missouri) herewith requests a license amendment for changes to Emergency Action Levels (EALs) CA6.1, "Cold Shutdown / Refueling System Malfunction – Hazardous event affecting a SAFETY SYSTEM needed for the current operating MODE: Alert," and SA9.1, "System Malfunction – Hazardous event affecting a SAFETY SYSTEM needed for the current operating MODE: Alert" (including addition of a new definition for the term "Loss of Safety Function (LOSF)" and re-definition of the term "Visible Damage"), along with deletion of Initiating Condition (IC) HG1 and associated EAL HG1.1, "Hazard – HOSTILE ACTION resulting in loss of physical control of the facility: General Emergency," in

connection with the Callaway Plant Radiological Emergency Response Plan (RERP). These changes, taken together, are conservatively considered to constitute a reduction in effectiveness of the RERP (such that NRC approval is required prior to implementation).

The enclosed package contains Ameren Missouri's evaluation of the proposed changes to the EALs and definition, as well as mark-ups of the affected EAL Technical Bases Document pages, and a clean copy of the revised EAL Technical Bases Document, as proposed. The evaluation includes the basis for concluding that the Emergency Plan for Callaway Plant will continue to meet the requirements of 10 CFR 50 Appendix E and the planning standards of 10 CFR 50.47 (b). A copy of the proposed EAL matrix (wall charts) is also provided for information.

The Callaway Onsite Review Committee has reviewed and approved the proposed changes and has approved the submittal of this amendment application. In addition, in accordance with 10 CFR 50.91 "Notice for public comment; State consultation," Section (b)(1), a copy of this amendment application is being provided to the designated Missouri State official.


Ameren Missouri respectfully requests approval of this license amendment request by August 30, 2019. Implementation of the revised EALs and EAL Technical Bases Document will be made within 90 days following NRC approval.

This submittal does not contain new commitments. For any questions concerning this letter, please contact Tim Wiltman at 573-590-2225 or Gerry Rauch at 314-225-1727.

I declare under penalty of perjury that the foregoing is true and correct.

Sincerely,

Executed on: September 4, 2018

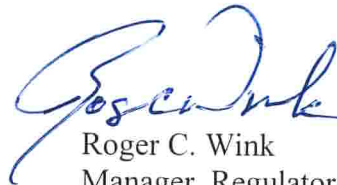A handwritten signature in blue ink, appearing to read "Roger C. Wink".

Roger C. Wink
Manager, Regulatory Affairs

- Attachments:
- 1) Evaluation of Proposed Emergency Action Levels
 - 2) Mark-ups of Callaway EAL Technical Bases Document Affected Pages
 - 3) EIP-ZZ-00101 Addendum 2, "Emergency Action Level Technical Bases Document," Proposed Revision 016 (Clean Copy)
 - 4) EIP-ZZ-00101 Addendum 1, "Emergency Action Level Classification Matrix," Proposed Revision 009 (Clean Copy – Information Only)

cc: Mr. Kriss M. Kennedy
Regional Administrator
U. S. Nuclear Regulatory Commission
Region IV
1600 East Lamar Boulevard
Arlington, TX 76011-4511

Senior Resident Inspector
Callaway Resident Office
U.S. Nuclear Regulatory Commission
8201 NRC Road
Steedman, MO 65077

Mr. L. John Klos
Project Manager, Callaway Plant
Office of Nuclear Reactor Regulation
U. S. Nuclear Regulatory Commission
Mail Stop O9E3
Washington, DC 20555-0001

Senior Emergency Preparedness Analyst
U.S. Nuclear Regulatory Commission
Region IV
1600 East Lamar Boulevard
Arlington, TX 76011-4511

Index and send hardcopy to QA File A160.0761

Hardcopy:

Certrec Corporation
6100 Western Place, Suite 1050
Fort Worth, TX 76107
(Certrec receives ALL attachments as long as they are non-safeguards and may be publicly disclosed.)

Electronic distribution for the following can be made via RERP ULNRC Distribution:

F. M. Diya
T. E. Herrmann
S. P. Banker
B. L. Cox
G. P. Rauch
R. C. Wink
T. B. Elwood
T. R. Wiltman
Corporate Communications
NSRB Secretary
STARS Regulatory Affairs
Mr. Jay Silberg (Pillsbury Winthrop Shaw Pittman LLP)
Missouri Public Service Commission
Mrs. Collette Linder, REP Manager (SEMA)
Mr. Chris Wieberg (DNR)
Mr. Steve Feeler (DNR)
Mr. Dru Buntin (DNR)

Attachment 1 to ULNRC-06433

Evaluation of Proposed Emergency Action Levels

(8 pages)

1.0 DESCRIPTION

In accordance with the provisions of Part 50, Appendix E, section IV, item B, paragraph 2 and 50.90 of Title 10 of the Code of Federal Regulations (10 CFR), Union Electric Company (Ameren Missouri), is proposing changes to the emergency action levels (EALs) and their technical bases, as used at Callaway Plant.

Ameren Missouri proposes to modify EALs CA6.1, "Cold Shutdown / Refueling System Malfunction – Hazardous event affecting a SAFETY SYSTEM needed for the current operating MODE: Alert," and SA9.1, "System Malfunction – Hazardous event affecting a SAFETY SYSTEM needed for the current operating MODE: Alert," and eliminate initiating condition (IC) HG1 and associated EAL HG1.1, "Hazard – HOSTILE ACTION resulting in loss of physical control of the facility: General Emergency." Consistent with those changes, Ameren Missouri also proposes to re-define the term VISIBLE DAMAGE and add a new definition for the term LOSS OF SAFETY FUNCTION. Such changes to the EAL scheme require NRC approval prior to implementation. With these changes incorporated, the Emergency Plan for Callaway Plant would continue to meet the standards in 10 CFR 50.47(b) and the requirements in Appendix E to 10 CFR 50.

2.0 PROPOSED CHANGE

A brief description of the proposed EAL changes is provided below along with a discussion of the justification for each change.

1. Change the verbiage in the EAL matrix and technical bases for EAL CA6.1 which reads:

The occurrence of **any** Table C-6 hazardous event.

AND EITHER:

- Event Damage has caused indications of degraded performance in at least one train of a SAFETY SYSTEM needed for the current operating MODE.
- The event has caused VISIBLE DAMAGE to a SAFETY SYSTEM component or structure needed for the current operating MODE.

to read:

The occurrence of **any** Table C-6 hazardous event

AND

Event damage has caused indications of degraded performance on one train of a SAFETY SYSTEM needed for the current operating MODE

AND EITHER:

- Event damage has caused indications of degraded performance in a second train of a SAFETY SYSTEM needed for the current operating MODE.
- Event damage has resulted in VISIBLE DAMAGE to a second train of a SAFETY SYSTEM needed for the current operating MODE.

2. Add Note 11 and Note 12 to the EAL Matrix (in the Notes text box and in the CA6.1 EAL description text) per Emergency Preparedness Frequently Asked Question (EPFAQ) 2016-002, "Clarification of Equipment Damage as a Result of a Hazardous Event":

Note 11: If the hazardous event only resulted in VISIBLE DAMAGE, with no indications of degraded performance to at least one train of a SAFETY SYSTEM, then this emergency classification is not warranted.

Note 12: This EAL is applicable when a Table C-6, Hazardous Events, causes a LOSS OF SAFETY FUNCTION on a SAFETY SYSTEM required for the current operating MODE, then this emergency classification is not warranted.

3. Change the verbiage in the EAL matrix and technical bases for EAL SA9.1 which reads:

The occurrence of **any** Table S-5 hazardous event.

AND EITHER:

- Event damage has caused indications of degraded performance in at least one train of a SAFETY SYSTEM needed for the current operating MODE.
- The event has caused VISIBLE DAMAGE to a SAFETY SYSTEM component or structure needed for the current operating MODE.

to read:

The occurrence of **any** Table S-5 hazardous event

AND

Event damage has caused indications of degraded performance on one train of a SAFETY SYSTEM needed for the current operating MODE

AND EITHER:

- Event damage has caused indications of degraded performance in a second train of a SAFETY SYSTEM needed for the current operating MODE.
- Event damage has resulted in VISIBLE DAMAGE to a second train of a SAFETY SYSTEM needed for the current operating MODE.

4. Add Note 11 and Note 12 to the EAL Matrix (in the Notes text box and in the SA9.1 AL description text) per Emergency Preparedness Frequently Asked Question (EPFAQ) 2016-002, "Clarification of Equipment Damage as a Result of a Hazardous Event":

Note 11: If the hazardous event only resulted in VISIBLE DAMAGE, with no indications of degraded performance to at least one train of a SAFETY SYSTEM, then this emergency classification is not warranted.

Note 12: This EAL is applicable when a Table C-6, Hazardous Events, causes a LOSS OF SAFETY FUNCTION on a SAFETY SYSTEM required for the current operating MODE, then this emergency classification is not warranted.

5. Change the verbiage in the EAL technical bases document definition of VISIBLE DAMAGE, which reads:

Damage to a component or structure that is readily observable without measurements, testing or analysis. The visual impact of the damage is sufficient to cause concern regarding the operability or reliability of the affected component or structure.

to read:

Damage to a SAFETY SYSTEM train that is readily observable without measurements, testing or analysis. The visual impact of the damage is sufficient to cause concern regarding the operability or reliability of the affected SAFETY SYSTEM train.

6. Add the following verbiage in the EAL technical bases document to provide a definition for the new term LOSS OF SAFETY FUNCTION:

Loss of Safety Function (LOSF) – A LOSF exists when, assuming no concurrent single failure, a safety function assumed in the accident analysis cannot be performed. For the purpose of the Safety Function Determination Program, a LOSF may exist when a support system is INOPERABLE, AND:

- a) A required system redundant to the system supported by the INOPERABLE support system is also INOPERABLE; OR
- b) A required system redundant to the system in turn supported by the INOPERABLE supported system is also INOPERABLE; OR
- c) A required system redundant to the support system for the supported systems (a) and (b) above is also INOPERABLE.

7. Remove EAL HG1.1 and its associated IC HG1 from the EAL Matrix per EPFAQ 2015-0013, "Hostile Action resulting in a loss of control of the facility declarations when fuel damage is likely within 4-hours or results in a loss of physical control of spent fuel" (and shade the resulting empty space in with gray shading to match the other gray shading on the wallcharts). Also remove EAL HG1.1 and IC HG1 from the EAL Technical Bases Document, and eliminate references to EAL HG1.1 and IC HG1 from the technical bases for other EALs.

Regarding the changes listed as 1, 2, 3, and 4 above, the wording of EALs CA6.1 and SA9.1 is being revised (and Notes 11 and 12 are being added) in order to preclude an unnecessary Alert declaration when the hazardous event has not caused indication of degraded performance or visible damage on a second train of the same safety system.

Regarding the change listed as 5 above, the definition of VISIBLE DAMAGE is being changed to work more seamlessly with modified EALs CA6.1 and SA9.1 (including added Note 11) described above.

Regarding the change listed as 6 above, a definition of the new term LOSS OF SAFETY FUNCTION as used in modified EALs CA6.1 and SA9.1 (including added Note 12) described above is being added to provide clarification.

Regarding the change listed as 7 above, EAL HG1.1 (with its associated IC HG1) is redundant to other EALs, (i.e., RA2.1, RA2.2, RA2.3, RS2.1, RG2.1, RS1.1, RS1.2, RS1.3, RG1.1, RG1.2, RG1.3, HS1.1, HS6.1, HS7.1, and HG7.1), which would encompass any escalation from a Hostile Action.

Mark-ups of affected pages and a clean copy of the revised EAL Technical Bases Document are provided as Attachments 2 and 3 to the license amendment request.

3.0 BACKGROUND

EALs are the plant-specific indications, conditions or instrument readings that are utilized to classify emergency conditions defined in the Callaway Plant Radiological Emergency Response Plan (RERP). In 2015, the NRC approved use of an EAL scheme for Callaway Plant that was developed in accordance with NEI 99-06 Revision 6, "Methodology for the Development of Emergency Action Levels for Non-Passive Reactors."

Regarding the NEI 99-01, Revision 6 EALs, the NRC staff position documented in EPFAQ 2016-002 states in part that:

An Alert should be declared only when actual or potential performance issues with SAFETY SYSTEMS have occurred as a result of a hazardous event. The occurrence of a hazardous event will result in a Notification of Unusual Event (NOUE) classification at a minimum. In order to warrant escalation to the Alert classification, the hazardous event should cause indications of degraded performance to one train of a SAFETY SYSTEM with either indications of degraded performance on the second SAFETY SYSTEM train or VISIBLE DAMAGE to the second SAFETY SYSTEM train, such that the operability or reliability of the second train is a concern. In addition, escalation to the Alert classification should not occur if the damage from the hazardous event is limited to a SAFETY SYSTEM that was inoperable, or out of service, prior to the event occurring. As such, the proposed guidance will reduce the potential of declaring an Alert when events are in progress that do not involve an actual or potential substantial degradation of the level of safety of the plant, i.e., does not cause significant concern with shutting down or cooling down the plant.

It should be noted that the verbiage of the proposed new Note 11 per the changes listed as 2 and 4 above is taken directly from EPFAQ 2016-002. The proposed new Note 12 per the changes listed as 2 and 4 above, changes to EALs and their technical bases that are listed as 1 and 3 above, and the definitions of the terms VISIBLE DAMAGE and LOSS OF SAFETY FUNCTION per the changes listed as 5 and 6 above provide additional clarification that is consistent with the guidance found in EPFAQ 2016-002.

Regarding the change listed as 7 above, Ameren Missouri originally developed IC HG1 and EAL HG1.1 in accordance with NEI 99-01, Revision 6. Since implementation, many questions have arisen that could not be clearly answered due to the wording of the IC and EAL. Furthermore, it has been noted that if a Hostile Action were to occur and major safety functions were lost (or damage to the fuel pool occurred), any accident that could cause a concern for the health and safety of the public would be identified by one or more of the other existing EALs. In regards to this issue, the NRC staff position documented in EPFAQ 2015-013 states in part that:

Consideration can be given to not include EAL HG1 in a site-specific EAL scheme. However, EALs AA2, AS2, AG2, AS1, AG1, HS1, HS6, HS7, and HG7 shall be as provided in NEI 99-01, Revision 6

Consistent with this guidance, Ameren Missouri has developed and implemented NEI 99-01 Revision 6 ICs AA2, AS2, AG2, AS1, AG1, HS1, HS6, HS7, and HG7, as endorsed by the NRC. In the Callaway RERP, the equivalent ICs are RA2, RS2, RG2, RS1, RG1, HS1, HS6, HS7, and HG7, respectively. EAL HG1.1 (and its associated IC HG1), which is proposed to be removed from the Callaway RERP, is redundant to EALs RA2.1, RA2.2, RA2.3, RS2.1, RG2.1, RS1.1, RS1.2, RS1.3, RG1.1, RG1.2, RG1.3, HS1.1, HS6.1, HS7.1, and HG7.1, as these EALs would encompass any escalation from a Hostile Action.

4.0 TECHNICAL ANALYSIS

The proposed changes affect the Callaway Plant Radiological Emergency Response Plan (RERP) and otherwise do not alter requirements of the Operating License or the Technical Specifications. These changes do not alter any of the assumptions used in the safety analyses, nor do they cause any safety system parameters to exceed their acceptance limits. Therefore, the proposed changes have no adverse effect on plant safety.

5.0 REGULATORY ANALYSIS

5.1 Applicable Regulatory Requirements / Criteria

Per 10 CFR 50.54(q)(2):

A holder of a license under this part, or a combined license under part 52 of this chapter after the Commission makes the finding under § 52.103(g) of this chapter, shall follow and maintain the effectiveness of an emergency plan that meets the requirements in appendix E to this part and, for nuclear power reactor licensees, the planning standards of § 50.47(b).

10 CFR 50.47(b)(4) requires the emergency response plan to meet the following standard:

A standard emergency classification and action level scheme, the bases of which include facility system and effluent parameters, is in use by the nuclear facility licensee, and State and local response plans call for reliance on information provided by facility licensees for determinations of minimum initial offsite response measures.

10 CFR 50.54(q)(4) states:

The changes to a licensee's emergency plan that reduce the effectiveness of the plan as defined in paragraph (q)(1)(iv) of this section may not be implemented without prior approval by the NRC. A licensee desiring to make such a change after February 21, 2012 shall submit an application for an amendment to its license. In addition to the filing requirements of §§ 50.90 and 50.91, the request must include all emergency plan pages affected by that change and must be accompanied by a forwarding letter identifying the change, the reason for the change, and the basis for concluding that the licensee's emergency plan, as revised, will continue to meet the requirements in appendix E to this part and, for nuclear power reactor licensees, the planning standards of § 50.47(b).

As defined in 10 CFR 50.54(q)(1)(iv):

Reduction in effectiveness means a change in an emergency plan that results in reducing the licensee's capability to perform an emergency planning function in the event of a radiological emergency.

The proposed changes listed as 1, 2, 3, 4, 5, and 6 above are consistent with the NRC staff position documented in EPFAQ 2016-002, and Ameren Missouri has therefore concluded that the Emergency Plan for Callaway Plant would continue to meet the planning standards of 10 CFR 50.47(b) and the requirements in Appendix E to 10 CFR 50. However, a classification based on NRC-endorsed industry guidance in NEI 99-01, Revisions 4, 5, and 6, as well as in NUMARC/NESP-007, could be different from a classification based on the revised EALs. Therefore, this proposed change is considered a "deviation" in accordance with Regulatory Issue Summary (RIS) 2003-18, Supplement 2, "Use of Nuclear Energy Institute (NEI) 99-01, Methodology for Development of Emergency Action Levels," Revision 4. Deviations are considered to be a reduction in effectiveness, and thus, prior NRC approval is required.

The proposed change listed as 7 above is consistent with the NRC staff position documented in EPFAQ 2015-013, and Ameren Missouri has therefore concluded that the Emergency Plan for Callaway Plant would continue to meet the planning standards of 10 CFR 50.47(b) and the requirements in Appendix E to 10 CFR 50. However, this proposed change is also considered a "deviation" in accordance with Regulatory RIS 2003-18, Supplement 2, and thus, prior NRC approval is required.

5.2 No Significant Hazards Consideration

Ameren Missouri has evaluated whether or not a significant hazards consideration is involved with the proposed changes by focusing on the three standards set forth in 10 CFR 50.92, "Issuance of amendment," as discussed below:

1. Does the proposed amendment involve a significant increase in the probability or consequences of an accident previously evaluated?

Response: No. The proposed changes to the Callaway Plant emergency action levels do not impact the physical function of plant structures, systems, or components (SSC) or the manner in which SSCs perform their design function. The proposed changes have no effect on accident initiators or precursors, nor do they alter design assumptions. The proposed changes do not alter or prevent the ability of SSCs to perform their intended function to mitigate the consequences of an initiating event within assumed acceptance limits. No operating procedures or administrative controls that function to prevent or mitigate accidents are affected by the proposed changes. Therefore, the proposed changes do not involve a significant increase in the probability or consequences of an accident previously evaluated.

2. Does the proposed amendment create the possibility of a new or different kind of accident from any accident previously evaluated?

Response: No. The proposed changes do not involve a physical alteration of the plant (i.e., no new or different type of equipment will be installed, and no equipment will be removed), nor do the proposed changes involve a change in the method of plant operation. The proposed changes will not introduce failure modes that could result in a new accident, nor do the changes alter assumptions made in the safety analysis. Therefore, the proposed change does not create the possibility of a new or different kind of accident from any accident previously evaluated.

3. Does the proposed amendment involve a significant reduction in a margin of safety?

Response: No. There is no change being made to safety analysis assumptions, safety limits, or limiting safety system settings that would adversely affect plant safety as a result of the proposed changes. There are no changes to setpoints or environmental conditions of any SSC or the manner in which any SSC is operated. Margins of safety are unaffected by the proposed changes. The applicable requirements of 10 CFR 50.47 and 10 CFR 50, Appendix E will continue to be met. Therefore, the proposed changes do not involve any reduction in a margin of safety.

Based on the above, Ameren Missouri concludes that the proposed amendment presents no significant hazards consideration under the standards set forth in 10 CFR 50.92, and accordingly, a finding of "no significant hazards consideration" is justified.

6.0 ENVIRONMENTAL CONSIDERATIONS

The proposed changes to the emergency action levels maintain the environmental bounds of the current environmental assessment associated with the Callaway Plant Unit 1. The proposed changes will not affect plant safety and will not have an adverse effect on the probability of an accident occurring. The proposed changes do not involve (i) a significant hazards consideration, (ii) a significant change in the types or significant increase in the amounts of any effluent that may be released offsite, or (iii) a significant increase in individual or cumulative occupational radiation exposure. Therefore, no environmental impact statement or environmental assessment need be prepared in connection with the proposed amendment.

7.0 PRECEDENTS

The proposed changes listed as 1, 2, 3, 4, 5, and 6 above are similar in nature to changes that were included in a license amendment request (LAR) for changes to Monticello Nuclear Generating Plant EALs that was submitted by Northern States Power Company (Xcel Energy) on September 27, 2017 (ADAMS Accession No. ML17269A076).

The proposed changes listed as 7 above are similar in nature to changes that were included in a LAR for changes to the Beaver Valley Power Station EALs that was submitted by First Energy Nuclear Operating Company on August 10, 2017 (ADAMS Accession No. ML17222A219).

Ameren Missouri is not aware of any similar LARs that have yet been approved by the NRC.

8.0 REFERENCES

1. EPFAQ 2016-002, "Clarification of Equipment Damage as a Result of a Hazardous Event" (ADAMS Accession No. ML17195A299)
2. EPFAQ 2015-013, "Hostile Action resulting in a loss of control of the facility declarations when fuel damage is likely within 4-hours or results in a loss of physical control of spent fuel" (ADAMS Accession No. ML16166A366)
3. NRC Regulatory Issue Summary 2005-02, Revision 1, "Clarifying the Process for Making Emergency Plan Changes" (ADAMS Accession No. ML100340545)
4. NEI 99-01, Revision 6, "Methodology for the Development of Emergency Action Levels for Non-Passive Reactors" (ADAMS Accession No. ML12326A805)
5. Regulatory Issue Summary 2003-18, Supplement 2, "Use of Nuclear Energy Institute (NEI) 99-01, Methodology for Development of Emergency Action Levels," Revision 4 (ADAMS Accession No. ML051450482)
6. NUMARC/NESP-007, Rev. 2, "Methodology for Development of Emergency Action Levels" (ADAMS Accession No. ML041120174)

Attachment 2 to ULNRC-06433

Mark-ups of Callaway EAL Technical Bases Document Affected Pages

(19 pages)

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Fire - Combustion characterized by heat and light. Sources of smoke such as slipping drive belts or overheated electrical equipment do not constitute fires. Observation of flame is preferred but is NOT required if large quantities of smoke and heat are observed.

Fission Product Barrier Threshold - A pre-determined, site-specific, observable threshold indicating the loss or potential loss of a fission product barrier.

Flooding - A condition where water is entering a room or area faster than installed equipment is capable of removal, resulting in a rise of water level within the room or area.

General Emergency - Events are in process or have occurred which involve actual or imminent substantial core degradation or melting with potential for loss of containment integrity or hostile actions that result in an actual loss of physical control of the facility. Releases can be reasonably expected to exceed EPA Protective Action Guideline exposure levels offsite for more than the immediate site area.

High Winds - Winds in excess of 40 mph (18 m/s) sustained, or 58 mph (26 m/s) gusting.

Hostage - A person(s) held as leverage against the station to ensure that demands will be met by the station.

Hostile Action - An act toward Callaway or its personnel that includes the use of violent force to destroy equipment, take hostages, and/or intimidate the licensee to achieve an end. This includes attack by air, land, or water using guns, explosives, projectiles, vehicles, or other devices used to deliver destructive force. Other acts that satisfy the overall intent may be included. Hostile action should not be construed to include acts of civil disobedience or felonious acts that are not part of a concerted attack on Callaway. Non-terrorism-based EALs should be used to address such activities (i.e., this may include violent acts between individuals in the owner controlled area).

Hostile Force - One or more individuals who are engaged in a determined assault, overtly or by stealth and deception, equipped with suitable weapons capable of killing, maiming, or causing destruction.

Imminent - The trajectory of events or conditions is such that an EAL will be met within a relatively short period of time regardless of mitigation or corrective actions.

Impede(d) - Personnel access to a room or area is hindered to an extent that extraordinary measures are necessary to facilitate entry of personnel into the affected room/area (e.g., requiring use of protective equipment, such as SCBAs, that is not routinely employed).

Independent Spent Fuel Storage Installation (ISFSI) - A complex that is designed and constructed for the interim storage of spent nuclear fuel and other radioactive materials associated with spent fuel storage.

Initiating Condition - An event or condition that aligns with the definition of one of the four emergency classification levels by virtue of the potential or actual effects or consequences.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Site Area Emergency - Events are in process or have occurred which involve actual or likely major failures of plant functions needed for protection of the public or hostile actions that result in intentional damage or malicious acts; (1) toward site personnel or equipment that could lead to the likely failure of or; (2) that prevent effective access to equipment needed for the protection of the public. Any releases are not expected to result in exposure levels which exceed EPA Protective Action Guidelines exposure levels beyond the site boundary.

Site Boundary - Exclusion Area Boundary is a synonymous term for Site Boundary. The Exclusion Area is defined as the area that encompasses the land surrounding the Plant to a radius of 1,200 meters (3,937 feet) from the midpoint of the Unit 1 Reactor Building and the canceled Unit 2 Reactor Building. Control of access to this is by virtue of ownership and in accordance with 10CFR100 (ref. 4.1.12).

Unisolable - An open or breached system line that cannot be isolated, remotely or locally.

Unplanned - A parameter change or an event that is not 1) the result of an intended evolution or 2) an expected plant response to a transient. The cause of the parameter change or event may be known or unknown.

Unusual Event - Events are in process or have occurred which indicate a potential degradation in the level of safety of the plant or indicate a security threat to facility protection has been initiated. No releases of radioactive material requiring offsite response or monitoring are expected unless further degradation of safety systems occurs.

Valid - An indication, report, or condition, is considered to be valid when it is verified by (1) an instrument channel check, or (2) indications on related or redundant indicators, or (3) by direct observation by plant personnel, such that doubt related to the indicator's operability, the condition's existence, or the report's accuracy is removed. Implicit in this definition is the need for timely assessment.

~~**Visible Damage** - Damage to a component or structure that is readily observable without measurements, testing, or analysis. The visual impact of the damage is sufficient to cause concern regarding the operability or reliability of the affected component or structure.~~

[Insert #2 here]

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**6.0 CALLAWAY-TO-NEI 99-01 REV. 6 EAL CROSS-REFERENCE**

This cross-reference is provided to facilitate association and location of a Callaway EAL within the NEI 99-01 IC/EAL identification scheme. Further information regarding the development of the Callaway EALs based on the NEI guidance can be found in the EAL Comparison Matrix.

Callaway	NEI 99-01 Rev. 6	
EAL	IC	Example EAL
RU1.1	AU1	1, 2
RU1.2	AU1	3
RU2.1	AU2	1
RA1.1	AA1	1
RA1.2	AA1	2
RA1.3	AA1	3
RA1.4	AA1	4
RA2.1	AA2	1
RA2.2	AA2	2
RA2.3	AA2	3
RA3.1	AA3	1
RA3.2	AA3	2
RS1.1	AS1	1
RS1.2	AS1	2
RS1.3	AS1	3
RS2.1	AS2	1
RG1.1	AG1	1
RG1.2	AG1	2
RG1.3	AG1	3
RG2.1	AG2	1
CU1.1	CU1	1
CU1.2	CU1	2
CU2.1	CU2	1
CU3.1	CU3	1
CU3.2	CU3	2
CU4.1	CU4	1

Callaway	NEI 99-01 Rev. 6	
EAL	IC	Example EAL
CU5.1	CU5	1, 2, 3
CA1.1	CA1	1
CA1.2	CA1	2
CA2.1	CA2	1
CA3.1	CA3	1, 2
CA6.1	CA6	1
CS1.1	CS1	1
CS1.2	CS1	2
CS1.3	CS1	3
CG1.1	CG1	1
CG1.2	CG1	2
FA1.1	FA1	1
FS1.1	FS1	1
FG1.1	FG1	1
HU1.1	HU1	1, 2, 3
HU2.1	HU2	1
HU3.1	HU3	1
HU3.2	HU3	2
HU3.3	HU3	3
HU3.4	HU3	4
HU4.1	HU4	1
HU4.2	HU4	2
HU4.3	HU4	3
HU4.4	HU4	4
HU7.1	HU7	1
HA1.1	HA1	1, 2

Callaway	NEI 99-01 Rev. 6	
EAL	IC	Example EAL
HA5.1	HA5	1
HA6.1	HA6	1
HA7.1	HA7	1
HS1.1	HS1	1
HS6.1	HS6	1
HS7.1	HS7	1
HG1.1	HG1	1
HG7.1	HG7	1
SU1.1	SU1	1
SU3.1	SU2	1
SU4.1	SU3	2
SU5.1	SU4	1, 2, 3
SU6.1	SU5	1
SU6.2	SU5	2
SU7.1	SU6	1, 2, 3
SU8.1	SU7	1, 2
SA1.1	SA1	1
SA3.1	SA2	1
SA6.1	SA5	1
SA9.1	SA9	1
SS1.1	SS1	1
SS2.1	SS8	1
SS6.1	SS5	1
SG1.1	SG1	1
SG1.2	SG8	1
EU1.1	E-HU1	1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

The existence of “damage” is determined by radiological survey. The technical specification multiple of “2 times”, which is also used in Recognition Category R IC RU1, is used here to distinguish between non-emergency and emergency conditions. The emphasis for this classification is the degradation in the level of safety of the spent fuel cask and not the magnitude of the associated dose or dose rate. It is recognized that in the case of extreme damage to a loaded cask, the fact that the “on-contact” dose rate limit is exceeded may be determined based on measurement of a dose rate at some distance from the cask.

Security-related events for ISFSIs are covered under ~~ICs HG1 and HS1.~~ **IC HS1.**

Callaway Basis Reference(s):

1. Certificate of Compliance No. 1040 Appendix A Technical Specifications for the HI-STORM UMAX Canister Storage System
2. NEI 99-01, E-HU1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: C – Cold Shutdown / Refueling System Malfunction
Subcategory: 6 – Hazardous Event Affecting Safety Systems
Initiating Condition: Hazardous event affecting a SAFETY SYSTEM needed for the current operating MODE

EAL:**CA6.1 Alert**The occurrence of ~~any~~ Table C-6 hazardous event**AND EITHER:**

- Event damage has caused indications of degraded performance in at least one train of a SAFETY SYSTEM needed for the current operating MODE.
- The event has caused **VISIBLE DAMAGE** to a SAFETY SYSTEM component or structure needed for the current operating MODE.

[Insert #3 here]

Table C-6 Hazardous Events

- EXPLOSION
- FIRE
- HIGH WINDS or tornado strike
- Internal or external FLOODING event
- Seismic event (earthquake)
- Other events with similar hazard characteristics as determined by the Emergency Coordinator

MODE Applicability:

5 - Cold Shutdown, 6 - Refueling

Definition(s):

EXPLOSION - A rapid, violent and catastrophic failure of a piece of equipment due to combustion, chemical reaction or over pressurization. A release of steam (from high energy lines or components) or an electrical component failure (caused by short circuits, grounding, arcing, etc.) should not automatically be considered an explosion. Such events require a post-event inspection to determine if the attributes of an explosion are present.

FIRE - Combustion characterized by heat and light. Sources of smoke such as slipping drive belts or overheated electrical equipment do not constitute fires. Observation of flame is preferred but is NOT required if large quantities of smoke and heat are observed.

FLOODING - A condition where water is entering a room or area faster than installed equipment is capable of removal, resulting in a rise of water level within the room or area.

HIGH WINDS - Winds in excess of 40 mph (18 m/s) sustained, or 58 mph (26 m/s) gusting.

[Insert #4 here]

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

SAFETY SYSTEM - A system required for safe plant operation, cooling down the plant and/or placing it in the Cold Shutdown condition, including the ECCS. These are typically systems classified as safety-related (as defined in 10CFR50.2):

Those structures, systems and components that are relied upon to remain functional during and following design basis events to assure:

1. The integrity of the reactor coolant pressure boundary;
2. The capability to shut down the reactor and maintain it in a safe shutdown condition;
3. The capability to prevent or mitigate the consequences of accidents which could result in potential offsite exposures.

~~**VISIBLE DAMAGE** - Damage to a component or structure that is readily observable without measurements, testing, or analysis. The visual impact of the damage is sufficient to cause concern regarding the operability or reliability of the affected component or structure.~~

Basis:

- Annunciator 98D, OBE will illuminate if the seismic instrument detects ground motion in excess of the OBE threshold. OTO-SG-00001, Seismic Event provides the guidance for determining if an OBE earthquake threshold is exceeded and any required response actions (ref. 1).
- Internal FLOODING may be caused by events such as component failures, equipment misalignment, or outage activity mishaps (ref. 2).
- External flooding may be due to high rainfall. Callaway plant grade elevation is 840.0 ft. MSL. (ref. 3).
- Seismic Category I structures are analyzed to withstand a sustained, design wind velocity of at least 100 mph. (ref. 4).
- Areas containing functions and systems required for safe shutdown of the plant are identified by fire area (ref. 5).
- An explosion that degrades the performance of a SAFETY SYSTEM train or visibly damages a SAFETY SYSTEM component or structure would be classified under this EAL.

~~This IC addresses a hazardous event that causes damage to a SAFETY SYSTEM, or a structure containing SAFETY SYSTEM components, needed for the current operating MODE. This condition significantly reduces the margin to a loss or potential loss of a fission product barrier, and therefore represents an actual or potential substantial degradation of the level of safety of the plant.~~

~~The first conditional addresses damage to a SAFETY SYSTEM train that is in service/operation since indications for it will be readily available. The indications of degraded performance should be significant enough to cause concern regarding the operability or reliability of the SAFETY SYSTEM train.~~

~~The second conditional addresses damage to a SAFETY SYSTEM component that is not in service/operation or readily apparent through indications alone, or to a structure containing SAFETY SYSTEM components. Operators will make this determination based on the totality of available event and damage report information. This is intended to be a brief assessment not requiring lengthy analysis or quantification of the damage.~~

~~Escalation of the emergency classification level would be via IC CS1 or RS1.~~

[Insert #6 here]

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Callaway Basis Reference(s):**

1. OTO-SG-00001, Seismic Event
2. IPE Section 3.4.2.3 Results of the Vulnerability Screening
3. FSAR, Section 3.4 Water Level (Flood) Design Table 3.4-1 PMF, Groundwater, Reference, and Actual Plant Elevations
4. FSAR, Section 3.3.1.1 Design Wind Loadings
5. FSAR, Section 9.5.1 Fire Protection System
6. NEI 99-01, CA6

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: H – Hazards
Subcategory: 1 – Security
Initiating Condition: Confirmed SECURITY CONDITION or threat

EAL:**HU1.1 Unusual Event**

A SECURITY CONDITION that does **not** involve a HOSTILE ACTION as reported by the Security Shift Supervisor.

OR

Notification of a credible security threat directed at the site.

OR

A validated notification from the NRC providing information of an aircraft threat.

MODE Applicability:

All

Definition(s):

SECURITY CONDITION - Any security event as listed in the approved security contingency plan that constitutes a threat/compromise to site security, threat/risk to site personnel, or a potential degradation to the level of safety of the plant. A security condition does not involve a hostile action.

HOSTILE ACTION - An act toward Callaway or its personnel that includes the use of violent force to destroy equipment, take hostages, and/or intimidate the licensee to achieve an end. This includes attack by air, land, or water using guns, explosives, projectiles, vehicles, or other devices used to deliver destructive force. Other acts that satisfy the overall intent may be included. Hostile action should not be construed to include acts of civil disobedience or felonious acts that are not part of a concerted attack on Callaway. Non-terrorism-based EALs should be used to address such activities (i.e., this may include violent acts between individuals in the owner controlled area).

Basis:

The security shift supervision is defined as the Security Shift Supervisor.

This EAL is based on the Callaway Plant Security Plan and DBT (ref. 1).

This IC addresses events that pose a threat to plant personnel or SAFETY SYSTEM equipment, and thus represent a potential degradation in the level of plant safety. Security events which do not meet one of these EALs are adequately addressed by the requirements of 10 CFR 73.71 or 10 CFR 50.72. Security events assessed as HOSTILE ACTIONS are classifiable under ICs ~~HA1, HS1 and HG1.~~ **HA1 and HS1.**

Timely and accurate communications between Security Shift Supervision and the Control Room is essential for proper classification of a security-related event (ref. 2, 3, 4). Classification of these events will initiate appropriate threat-related notifications to plant personnel and Offsite Response Organizations.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

As time and conditions allow, these events require a heightened state of readiness by the plant staff and implementation of onsite protective measures (e.g., evacuation, dispersal or sheltering). The Site Area Emergency declaration will mobilize Offsite Response Organization (ORO) resources and have them available to develop and implement public protective actions in the unlikely event that the attack is successful in impairing multiple safety functions.

This IC does not apply to incidents that are accidental events, acts of civil disobedience, or otherwise are not a HOSTILE ACTION perpetrated by a HOSTILE FORCE. Examples include the crash of a small aircraft, shots from hunters, physical disputes between employees, etc. Reporting of these types of events is adequately addressed by other EALs, or the requirements of 10 CFR 73.71 or 10 CFR 50.72.

Emergency plans and implementing procedures are public documents; therefore, EALs should not incorporate Security-sensitive information. This includes information that may be advantageous to a potential adversary, such as the particulars concerning a specific threat or threat location. Security-sensitive information should be contained in non-public documents such as the Callaway Plant Security Plan and DBT (ref. 1).

Escalation of the emergency classification level would be via ~~IC HG1~~. ICs RG1, RG2, SG1, SG2, FG1, and CG1.

Callaway Basis Reference(s):

1. Callaway Plant Security Plan and DBT (Safeguards)
2. EIP-ZZ-SK001, Response to Security Threat
3. SDP-CP-00003, Security Contingency Events
4. OTO-SK-00001, Plant Security Event – Hostile Intrusion
5. OTO-SK-00002, Plant Security Event - Aircraft Threat
6. NEI 99-01, HS1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** H – Hazards**Subcategory:** 1 – Security**Initiating Condition:** HOSTILE ACTION resulting in loss of physical control of the facility**EAL:****HG1.1 General Emergency**

A HOSTILE ACTION is occurring or has occurred within the PROTECTED AREA as reported by the Security Shift Supervisor.

AND EITHER of the following has occurred:

- **Any** of the following safety functions cannot be controlled or maintained
 - Reactivity control.
 - Core cooling.
 - RCS heat removal.

OR

- Damage to spent fuel has occurred or is **IMMINENT**.

MODE Applicability:

All

Definition(s):

HOSTILE ACTION - An act toward Callaway or its personnel that includes the use of violent force to destroy equipment, take hostages, and/or intimidate the licensee to achieve an end. This includes attack by air, land, or water using guns, explosives, projectiles, vehicles, or other devices used to deliver destructive force. Other acts that satisfy the overall intent may be included. Hostile action should not be construed to include acts of civil disobedience or felonious acts that are not part of a concerted attack on Callaway. Non-terrorism-based EALs should be used to address such activities (i.e., this may include violent acts between individuals in the owner controlled area).

IMMINENT - The trajectory of events or conditions is such that an EAL will be met within a relatively short period of time regardless of mitigation or corrective actions.

PROTECTED AREA - An area encompassed by physical barriers and to which access is controlled. The Protected Area refers to the designated security area around the process buildings and is depicted in Drawing 8600-X-88100 Property-Site Layout, Owner Controlled Area and Surrounding Area.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Basis:**

The security shift supervision is defined as the Security Shift Supervisor.

This IC addresses an event in which a HOSTILE FORCE has taken physical control of the facility to the extent that the plant staff can no longer operate equipment necessary to maintain key safety functions. It also addresses a HOSTILE ACTION leading to a loss of physical control that results in actual or IMMINENT damage to spent fuel due to 1) damage to a spent fuel pool cooling system (e.g., pumps, heat exchangers, controls, etc.) or, 2) loss of spent fuel pool integrity such that sufficient water level cannot be maintained.

Timely and accurate communications between Security Shift Supervision and the Control Room is essential for proper classification of a security-related event (ref. 2, 3).

Security plans and terminology are based on the guidance provided by NEI 03-12, Template for the Security Plan, Training and Qualification Plan, Safeguards Contingency Plan and Independent Spent Fuel Storage Installation Security Program.

Emergency plans and implementing procedures are public documents; therefore, EALs should not incorporate Security-sensitive information. This includes information that may be advantageous to a potential adversary, such as the particulars concerning a specific threat or threat location. Security-sensitive information should be contained in non-public documents such as the Callaway Plant Security Plan & DBT (ref.1).

Callaway Basis Reference(s):

1. Callaway Plant Security Plan and DBT (Safeguards)
2. EIP-ZZ-SK001, Response to Security Threat
3. SDP-CP-00003, Security Contingency Events
4. OTO-SK-00001, Plant Security Event – Hostile Intrusion
5. OTO-SK-00002, Plant Security Event - Aircraft Threat
6. NEI 99-01, HG1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** S – System Malfunction**Subcategory:** 9 – Hazardous Event Affecting Safety Systems**Initiating Condition:** Hazardous event affecting a SAFETY SYSTEM needed for the current operating MODE**EAL:****SA9.1 Alert**The occurrence of **any** Table S-5 hazardous event**AND EITHER:**

- Event damage has caused indications of degraded performance in at least one train of a SAFETY SYSTEM needed for the current operating MODE.
- The event has caused **VISIBLE DAMAGE** to a SAFETY SYSTEM component or structure needed for the current operating MODE.

Table S-5 Hazardous Events

- EXPLOSION
- FIRE
- HIGH WINDS or tornado strike
- Internal or external FLOODING event
- Seismic event (earthquake)
- Other events with similar hazard characteristics as determined by the Emergency Coordinator

[Insert #7 here]

MODE Applicability:

1 - Power Operation, 2 - Startup, 3 - Hot Standby, 4 - Hot Shutdown

Definition(s):

EXPLOSION - A rapid, violent and catastrophic failure of a piece of equipment due to combustion, chemical reaction or over pressurization. A release of steam (from high energy lines or components) or an electrical component failure (caused by short circuits, grounding, arcing, etc.) should not automatically be considered an explosion. Such events require a post-event inspection to determine if the attributes of an explosion are present.

FIRE - Combustion characterized by heat and light. Sources of smoke such as slipping drive belts or overheated electrical equipment do not constitute fires. Observation of flame is preferred but is NOT required if large quantities of smoke and heat are observed.

FLOODING - A condition where water is entering a room or area faster than installed equipment is capable of removal, resulting in a rise of water level within the room or area.

HIGH WINDS - Winds in excess of 40 mph (18 m/s) sustained, or 58 mph (26 m/s) gusting.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

SAFETY SYSTEM - A system required for safe plant operation, cooling down the plant and/or placing it in the Cold Shutdown condition, including the ECCS. These are typically systems classified as safety-related (as defined in 10CFR50.2):

Those structures, systems and components that are relied upon to remain functional during and following design basis events to assure:

1. The integrity of the reactor coolant pressure boundary;
2. The capability to shut down the reactor and maintain it in a safe shutdown condition;
3. The capability to prevent or mitigate the consequences of accidents which could result in potential offsite exposures.

~~**VISIBLE DAMAGE** - Damage to a component or structure that is readily observable without measurements, testing, or analysis. The visual impact of the damage is sufficient to cause concern regarding the operability or reliability of the affected component or structure.~~

Basis:

- Annunciator 98D, OBE will illuminate if the seismic instrument detects ground motion in excess of the OBE threshold. OTO-SG-00001, Seismic Event provides the guidance for determining if an OBE earthquake threshold is exceeded and any required response actions (ref. 1).
- Internal FLOODING may be caused by events such as component failures, equipment misalignment, or outage activity mishaps (ref. 2).
- External flooding may be due to high lake level. Callaway plant grade elevation is 840.0 ft. MSL. (ref. 3).
- Seismic Category I structures are analyzed to withstand a sustained, design wind velocity of at least 100 mph. (ref. 4).
- Areas containing functions and systems required for safe shutdown of the plant are identified by fire area (ref. 5).
- An explosion that degrades the performance of a SAFETY SYSTEM train or visibly damages a SAFETY SYSTEM component or structure would be classified under this EAL.

A **single** FAULTED steam generator would NOT require declaration per this EAL. Technical Specification Bases 3.7.4 explains that two intact Steam Generators are required for cooldown of the RCS and a third Steam Generator is assumed to be RUPTURED. If more than one Steam Generator is FAULTED, then this EAL is applicable.

~~This IC addresses a hazardous event that causes damage to a SAFETY SYSTEM, or a structure containing SAFETY SYSTEM components, needed for the current operating MODE. This condition significantly reduces the margin to a loss or potential loss of a fission product barrier, and therefore represents an actual or potential substantial degradation of the level of safety of the plant.~~

~~The first condition addresses damage to a SAFETY SYSTEM train that is in service/operation since indications for it will be readily available. The indications of degraded performance should be significant enough to cause concern regarding the operability or reliability of the SAFETY SYSTEM train.~~

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT~~**Attachment 1 - Emergency Action Level Technical Bases**~~

~~The second condition addresses damage to a SAFETY SYSTEM component that is not in service/operation or readily apparent through indications alone, or to a structure containing SAFETY SYSTEM components. Operators will make this determination based on the totality of available event and damage report information. This is intended to be a brief assessment not requiring lengthy analysis or quantification of the damage.~~

~~Escalation of the emergency classification level would be via IC FS1 or RS1.~~

Callaway Basis Reference(s):

1. OTO-SG-00001, Seismic Event
2. IPE Section 3.4.2.3 Results of the Vulnerability Screening
3. FSAR, Section 3.4 Water Level (Flood) Design Table 3.4-1 PMF, Groundwater, Reference, and Actual Plant Elevations
4. FSAR, Section 3.3.1.1 Design Wind Loadings
5. FSAR, Section 9.5.1 Fire Protection System
6. NEI 99-01, SA9

Insert #1:

Loss of Safety Function (LOSF) – A LOSF exists when, assuming no concurrent single failure, a safety function assumed in the accident analysis cannot be performed. For the purpose of the Safety Function Determination Program, a LOSF may exist when a support system is INOPERABLE, AND:

- a) A required system redundant to the system supported by the INOPERABLE support system is also INOPERABLE; OR
- b) A required system redundant to the system in turn supported by the INOPERABLE supported system is also INOPERABLE; OR
- c) A required system redundant to the support system for the supported systems (a) and (b) above is also INOPERABLE.

Insert #2

Visible Damage - Damage to a SAFETY SYSTEM train that is readily observable without measurements, testing, or analysis. The visual impact of the damage is sufficient to cause concern regarding the operability or reliability of the affected SAFETY SYSTEM train.

Insert #3

CA6.1 Alert

The occurrence of **any** Table C-6 hazardous event

AND

Event damage has caused indication of degraded performance on one train of a SAFETY SYSTEM needed for the current operating MODE

AND EITHER:

- Event damage has caused indications of degraded performance in a second train of a SAFETY SYSTEM needed for the current operating MODE.
- Event damage has resulted in **VISIBLE DAMAGE** to a second train of a SAFETY SYSTEM needed for the current operating MODE.

(Notes 11, 12)

Note 11: If the hazardous event only results in **VISIBLE DAMAGE**, with no indication of degraded performance to at least one train of a SAFETY SYSTEM, then this emergency classification is not warranted.

Note 12: This EAL is applicable when a Table C-6, Hazardous Events, causes a **LOSS OF SAFETY FUNCTION** on a SAFETY SYSTEM required for the current operating MODE.

Insert #4

LOSS OF SAFETY FUNCTION (LOSF) – A LOSF exists when, assuming no concurrent single failure, a safety function assumed in the accident analysis cannot be performed. For the purpose of the Safety Function Determination Program, a LOSF may exist when a support system is INOPERABLE, AND:

- a) A required system redundant to the system supported by the INOPERABLE support system is also INOPERABLE; OR
- b) A required system redundant to the system in turn supported by the INOPERABLE supported system is also INOPERABLE; OR
- c) A required system redundant to the support system for the supported systems (a) and (b) above is also INOPERABLE.

Insert #5

VISIBLE DAMAGE - Damage to a SAFETY SYSTEM train that is readily observable without measurements, testing, or analysis. The visual impact of the damage is sufficient to cause concern regarding the operability or reliability of the affected SAFETY SYSTEM train.

Insert #6

This IC addresses a hazardous event that causes damage to SAFETY SYSTEMS needed for the current operating mode. In order to provide the appropriate context for consideration of an ALERT classification, the hazardous event must have caused indications of degraded SAFETY SYSTEM performance in one train, and there must be either indications of performance issues with the second SAFETY SYSTEM train or VISIBLE DAMAGE to the second train such that the potential exists for this second SAFETY SYSTEM train to have performance issues. In other words, in order for this EAL to be classified, the hazardous event must occur, at least one SAFETY SYSTEM train must have indications of degraded performance, and the second SAFETY SYSTEM train must have indications of degraded performance or VISIBLE DAMAGE such that the potential exists for performance issues. Note that this second SAFETY SYSTEM train is from the same SAFETY SYSTEM that has indications of degraded performance; commercial nuclear power plants are designed to be able to support single system issues without compromising public health and safety from radiological events.

Indications of degraded performance addresses damage to a SAFETY SYSTEM train that is in service/operation since indications for it will be readily available. The indications of degraded performance should be significant enough to cause concern regarding the operability or reliability of the SAFETY SYSTEM train.

Operators will make a determination of VISIBLE DAMAGE based on the totality of available event and damage report information. This is intended to be a brief assessment not requiring lengthy analysis or quantification of the damage. This VISIBLE DAMAGE should be significant enough to cause concern regarding the operability or reliability of the SAFETY SYSTEM train.

Escalation of the emergency classification level would be via ICs CS1 or RS1.

Insert #7

SA9.1

Alert

The occurrence of **any** Table S-5 hazardous event

AND

Event damage has caused indication of degraded performance on one train of a SAFETY SYSTEM needed for the current operating MODE

AND EITHER:

- Event damage has caused indications of degraded performance in a second train of a SAFETY SYSTEM needed for the current operating MODE.
- Event damage has resulted in **VISIBLE DAMAGE** to a second train of a SAFETY SYSTEM needed for the current operating MODE.

(Notes 11, 12)

Note 11: If the hazardous event only results in **VISIBLE DAMAGE**, with no indication of degraded performance to at least one train of a SAFETY SYSTEM, then this emergency classification is not warranted.

Note 12: This EAL is applicable when a Table S-5 Hazardous Events causes a **LOSS OF SAFETY FUNCTION** on a SAFETY SYSTEM required for the current operating MODE.

Insert #8

LOSS OF SAFETY FUNCTION (LOSF) – A LOSF exists when, assuming no concurrent single failure, a safety function assumed in the accident analysis cannot be performed. For the purpose of the Safety Function Determination Program, a LOSF may exist when a support system is **INOPERABLE**, AND:

- a) A required system redundant to the system supported by the **INOPERABLE** support system is also **INOPERABLE**; OR
- b) A required system redundant to the system in turn supported by the **INOPERABLE** supported system is also **INOPERABLE**; OR
- c) A required system redundant to the support system for the supported systems (a) and (b) above is also **INOPERABLE**.

Insert #9

VISIBLE DAMAGE - Damage to a SAFETY SYSTEM train that is readily observable without measurements, testing, or analysis. The visual impact of the damage is sufficient to cause concern regarding the operability or reliability of the affected SAFETY SYSTEM train.

Insert #10

This IC addresses a hazardous event that causes damage to SAFETY SYSTEMS needed for the current operating mode. In order to provide the appropriate context for consideration of an ALERT classification, the hazardous event must have caused indications of degraded SAFETY SYSTEM performance in one train, and there must be either indications of performance issues with the second SAFETY SYSTEM train or VISIBLE DAMAGE to the second train such that the potential exists for this second SAFETY SYSTEM train to have performance issues. In other words, in order for this EAL to be classified, the hazardous event must occur, at least one SAFETY SYSTEM train must have indications of degraded performance, and the second SAFETY SYSTEM train must have indications of degraded performance or VISIBLE DAMAGE such that the potential exists for performance issues. Note that this second SAFETY SYSTEM train is from the same SAFETY SYSTEM that has indications of degraded performance; commercial nuclear power plants are designed to be able to support single system issues without compromising public health and safety from radiological events.

Indications of degraded performance addresses damage to a SAFETY SYSTEM train that is in service/operation since indications for it will be readily available. The indications of degraded performance should be significant enough to cause concern regarding the operability or reliability of the SAFETY SYSTEM train.

Operators will make a determination of VISIBLE DAMAGE based on the totality of available event and damage report information. This is intended to be a brief assessment not requiring lengthy analysis or quantification of the damage. This VISIBLE DAMAGE should be significant enough to cause concern regarding the operability or reliability of the SAFETY SYSTEM train.

Escalation of the emergency classification level would be via ICs FS1 or RS1.

Attachment 3 to ULNRC-06433

EIP-ZZ-00101 Addendum 2,
"Emergency Action Level Technical Bases Document,"
Proposed Revision 016
(Clean Copy)

(239 pages)



Callaway
Energy Center

EIP-ZZ-00101 ADDENDUM 2

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

MAJOR Revision 016

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**TABLE OF CONTENTS**

Section	Page Number
1.0 PURPOSE	6
2.0 DISCUSSION	6
2.1. Background	6
2.2. Fission Product Barriers	7
2.3. Fission Product Barrier Classification Criteria	7
2.4. EAL Organization	8
2.5. Technical Bases Information	10
2.6. Operating MODE Applicability (ref. 4.1.8)	11
3.0 GUIDANCE ON MAKING EMERGENCY CLASSIFICATIONS	12
3.1. General Considerations	12
3.1.1. Classification Timeliness	12
3.1.2. Valid Indications	12
3.1.3. Imminent Conditions	13
3.1.4. Planned vs. Unplanned Events	13
3.1.5. Classification Based on Analysis	13
3.1.6. Emergency Coordinator Judgment	13
3.2. Classification Methodology	14
3.2.1. Classification of Multiple Events and Conditions	14
3.2.2. Consideration of MODE Changes During Classification	14
3.2.3. Classification of Imminent Conditions	15
3.2.4. Emergency Classification Level Upgrading and Downgrading	15
3.2.5. Classification of Short-Lived Events	15
3.2.6. Classification of Transient Conditions	16
3.2.7. After-the-Fact Discovery of an Emergency Event or Condition	17
3.2.8. Retraction of an Emergency Declaration	17
4.0 REFERENCES	18
4.1. Developmental	18
4.2. Implementing	18
5.0 DEFINITIONS, ACRONYMS, & ABBREVIATIONS	19
5.1. Definitions (ref. 4.1.1 except as noted)	19
5.2. Abbreviations/Acronyms	23
6.0 CALLAWAY-TO-NEI 99-01 REV. 6 EAL CROSS-REFERENCE	25
7.0 ATTACHMENTS	26

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**TABLE OF CONTENTS**

Section	Page Number
8.0 SUMMARY OF CHANGES.....	26
ATTACHMENT 1 - Emergency Action Level Technical Bases	31
Category R – Abnormal Rad Release / Rad Effluent.....	31
RU1.1 Unusual Event.....	32
RU1.2 Unusual Event.....	34
RA1.1 Alert.....	36
RA1.2 Alert.....	38
RA1.3 Alert.....	40
RA1.4 Alert.....	42
RS1.1 Site Area Emergency.....	44
RS1.2 Site Area Emergency.....	46
RS1.3 Site Area Emergency.....	48
RG1.1 General Emergency.....	50
RG1.2 General Emergency.....	52
RG1.3 General Emergency.....	54
RU2.1 Unusual Event.....	56
RA2.1 Alert.....	58
RA2.2 Alert.....	59
RA2.3 Alert.....	61
RS2.1 Site Area Emergency.....	62
RG2.1 General Emergency.....	63
RA3.1 Alert.....	64
RA3.2 Alert.....	65
Category E – Independent Spent Fuel Storage Installation (ISFSI)	67
EU1.1 Unusual Event.....	68
Category C – Cold Shutdown / Refueling System Malfunction	70
CU1.1 Unusual Event.....	71
CU1.2 Unusual Event.....	73
CA1.1 Alert.....	75
CA1.2 Alert.....	77
CS1.1 Site Area Emergency.....	79
CS1.2 Site Area Emergency.....	81
CS1.3 Site Area Emergency.....	83
CG1.1 General Emergency.....	86
CG1.2 General Emergency.....	90
CU2.1 Unusual Event.....	94
CA2.1 Alert.....	97
CU3.1 Unusual Event.....	99

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**TABLE OF CONTENTS**

Section	Page Number
CU3.2 Unusual Event	101
CA3.1 Alert.....	103
CU4.1 Unusual Event	106
CU5.1 Unusual Event	108
CA6.1 Alert.....	111
Category H – Hazards and Other Conditions Affecting Plant Safety	114
HU1.1 Unusual Event	115
HA1.1 Alert.....	117
HS1.1 Site Area Emergency.....	119
HU2.1 Unusual Event	121
HU3.1 Unusual Event	123
HU3.2 Unusual Event	124
HU3.3 Unusual Event	126
HU3.4 Unusual Event	127
HU4.1 Unusual Event	128
HU4.2 Unusual Event	131
HU4.3 Unusual Event	134
HU4.4 Unusual Event	135
HA5.1 Alert.....	136
HA6.1 Alert.....	138
HS6.1 Site Area Emergency.....	139
HU7.1 Unusual Event	141
HA7.1 Alert.....	142
HS7.1 Site Area Emergency.....	144
HG7.1 General Emergency	146
Category S – System Malfunction	148
SU1.1 Unusual Event	150
SA1.1 Alert.....	152
SS1.1 Site Area Emergency.....	155
SG1.1 General Emergency	157
SG1.2 General Emergency	159
SS2.1 Site Area Emergency.....	162
SU3.1 Unusual Event	164
SA3.1 Alert.....	166
SU4.1 Unusual Event	168
SU5.1 Unusual Event	169
SU6.1 Unusual Event	171
SU6.2 Unusual Event	174
SA6.1 Alert.....	177

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**TABLE OF CONTENTS**

Section	Page Number
SS6.1 Site Area Emergency.....	179
SU7.1 Unusual Event	181
SU8.1 Unusual Event	184
SA9.1 Alert.....	186
Category F – Fission Product Barrier Degradation.....	189
FA1.1 Alert.....	191
FS1.1 Site Area Emergency.....	192
FG1.1 General Emergency.....	193
ATTACHMENT 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases	194

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

1.0 PURPOSE

This document provides an explanation and rationale for each Emergency Action Level (EAL). Decision-makers responsible for implementation of EIP-ZZ-00101, Classification of Emergencies, should use this document as a technical reference in support of EAL interpretation. This information may assist the Emergency Coordinator in making classifications, particularly those involving judgment or multiple events. The basis information may also be useful in training and for explaining event classifications to offsite officials.

The expectation is that emergency classifications are to be made as soon as conditions are present and recognizable for the classification, but within 15 minutes or less in all cases of conditions present. Use of this document for assistance is not intended to delay the emergency classification.

Because the information in a basis document can affect emergency classification decision-making (e.g., the Emergency Coordinator refers to it during an event), the NRC staff expects that changes to the basis document will be evaluated in accordance with the provisions of 10 CFR 50.54(q). Additionally, changes to plant AOPs and EOPs that may impact EAL bases shall be evaluated in accordance with the provisions of 10 CFR 50.54(q).

2.0 DISCUSSION

2.1. Background

EALs are the plant-specific indications, conditions or instrument readings that are utilized to classify emergency conditions defined in the Callaway Plant Radiological Emergency Response Plan (RERP).

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

2.2. Fission Product Barriers

Fission product barrier thresholds represent threats to the defense in depth design concept that precludes the release of radioactive fission products to the environment. This concept relies on multiple physical barriers, any one of which, if maintained intact, precludes the release of significant amounts of radioactive fission products to the environment.

Many of the EALs derived from the NEI methodology are fission product barrier threshold based. That is, the conditions that define the EALs are based upon thresholds that represent the loss or potential loss of one or more of the three fission product barriers. "Loss" and "Potential Loss" signify the relative damage and threat of damage to the barrier. A "Loss" threshold means the barrier no longer assures containment of radioactive materials. A "Potential Loss" threshold implies an increased probability of barrier loss and decreased certainty of maintaining the barrier.

The primary fission product barriers are:

- A. **Fuel Clad (FC):** The Fuel Clad Barrier consists of the cladding material that contains the fuel pellets.
- B. **Reactor Coolant System (RCS):** The RCS Barrier includes the RCS primary side and its connections up to and including the pressurizer safety and relief valves, and other connections up to and including the primary isolation valves.
- C. **Containment (CMT):** The Containment Barrier includes the containment building and connections up to and including the outermost containment isolation valves. This barrier also includes the main steam, feedwater, and blowdown line extensions outside the containment building up to and including the outermost secondary side isolation valve. Containment Barrier thresholds are used as criteria for escalation of the ECL from Alert to a Site Area Emergency or a General Emergency.

2.3. Fission Product Barrier Classification Criteria

The following criteria are the bases for event classification related to fission product barrier loss or potential loss:

Alert:

Any loss or any potential loss of either Fuel Clad or RCS barrier

Site Area Emergency:

Loss or potential loss of any two barriers

General Emergency:

Loss of any two barriers and loss or potential loss of the third barrier

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

2.4. EAL Organization

The Callaway EAL scheme includes the following features:

- Division of the EAL set into three broad groups:
 - EALs applicable under all conditions – This group would be reviewed by the EAL-user any time emergency classification is considered.
 - EALs applicable only under hot operating MODES – This group would only be reviewed by the EAL-user when the plant is in Hot Shutdown, Hot Standby, Startup, or Power Operation MODE.
 - EALs applicable only under cold operating MODES – This group would only be reviewed by the EAL-user when the plant is in Cold Shutdown, Refueling or Defueled MODE.

The purpose of the groups is to avoid review of hot condition EALs when the plant is in a cold condition and avoid review of cold condition EALs when the plant is in a hot condition. This approach significantly minimizes the total number of EALs that must be reviewed by the EAL-user for a given plant condition, reduces EAL-user reading burden and, thereby, speeds identification of the EAL that applies to the emergency.

- Within each group, assignment of EALs to categories and subcategories:

Category and subcategory titles are selected to represent conditions that are operationally significant to the EAL-user. The Callaway EAL categories are aligned to and represent the NEI 99-01 "Recognition Categories." Subcategories are used in the Callaway scheme as necessary to further divide the EALs of a category into logical sets of possible emergency classification thresholds. The Callaway EAL categories and subcategories are listed below.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

EAL Groups, Categories and Subcategories

EAL Group / Category	EAL Subcategory
All Conditions:	
R – Abnormal Rad Levels / Rad Effluent	1 – Radiological Effluent 2 – Irradiated Fuel Event 3 – Area Radiation Levels
E – ISFSI	1 – Confinement Boundary
H – Hazards and Other Conditions Affecting Plant Safety	1 – Security 2 – Seismic Event 3 – Natural or Technological Hazard 4 – Fire 5 – Hazardous Gases 6 – Control Room Evacuation 7 – Emergency Coordinator Judgment
Hot Conditions:	
S – System Malfunction	1 – Loss of Emergency AC Power 2 – Loss of Vital DC Power 3 – Loss of Control Room Indications 4 – RCS Activity 5 – RCS Leakage 6 – RTS Failure 7 – Loss of Communications 8 – Containment Isolation Failure 9 – Hazardous Event Affecting Safety Systems
F – Fission Product Barrier Degradation	None
Cold Conditions:	
C – Cold Shutdown / Refueling System Malfunction	1 – RCS Level 2 – Loss of Emergency AC Power 3 – RCS Temperature 4 – Loss of Vital DC Power 5 – Loss of Communications 6 – Hazardous Event Affecting Safety Systems

The primary tool for determining the emergency classification level is the EAL Classification Matrix. The user of the EAL Classification Matrix may (but is not required to) consult the EAL Technical Bases Document in order to obtain additional information concerning the EALs under classification consideration. The user should consult Section 3.0 and Attachments 1 & 2 of this document for such information.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

2.5. Technical Bases Information

EAL technical bases are provided in Attachment 1 for each EAL according to EAL group (All, Hot, Cold), EAL category (R, C, H, S, E and F) and EAL subcategory. A summary explanation of each category and subcategory is given at the beginning of the technical bases discussions of the EALs included in the category. For each EAL, the following information is provided:

Category Letter & Title

Subcategory Number & Title

Initiating Condition (IC)

Site-specific description of the generic IC given in NEI 99-01, Rev. 6.

EAL Identifier (enclosed in rectangle)

Each EAL is assigned a unique identifier to support accurate communication of the emergency classification to onsite and offsite personnel. Four characters define each EAL identifier:

1. First character (letter): Corresponds to the EAL category as described above (R, C, H, S, E or F)
2. Second character (letter): The emergency classification (G, S, A or U)
G = General Emergency
S = Site Area Emergency
A = Alert
U = Unusual Event
3. Third character (number): Subcategory number within the given category. Subcategories are sequentially numbered beginning with the number one (1). If a category does not have a subcategory, this character is assigned the number one (1).
4. Fourth character (number): The numerical sequence of the EAL within the EAL subcategory. If the subcategory has only one EAL, it is given the number one (1).

Classification (enclosed in rectangle):

Unusual Event (U), Alert (A), Site Area Emergency (S) or General Emergency (G).

EAL (enclosed in rectangle)

Exact wording of the EAL as it appears in the EAL Classification Matrix.

MODE Applicability

One or more of the following plant operating conditions comprise the MODE to which each EAL is applicable: 1 - Power Operation, 2 - Startup, 3 - Hot Standby, 4 - Hot Shutdown, 5 - Cold Shutdown, 6 - Refueling, D - Defueled, or Any. (See Section 2.6 for operating MODE definitions).

Definitions:

If the EAL wording contains a defined term, the definition of the term is included in this section. These definitions can also be found in Section 5.1.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Basis:

A Plant-Specific basis section that provides Callaway-relevant information concerning the EAL. This is followed by a Generic basis section that provides a description of the rationale for the EAL as provided in NEI 99-01 Rev. 6.

Callaway Basis Reference(s):

Site-specific source documentation from which the EAL is derived.

2.6. Operating MODE Applicability (ref. 4.1.8)

1 Power Operation

$K_{\text{eff}} \geq 0.99$ and reactor thermal power $> 5\%$.

2 Startup

$K_{\text{eff}} \geq 0.99$ and reactor thermal power $\leq 5\%$.

3 Hot Standby

$K_{\text{eff}} < 0.99$ and average coolant temperature $\geq 350^\circ\text{F}$.

4 Hot Shutdown

$K_{\text{eff}} < 0.99$ and average coolant temperature $350^\circ\text{F} > T_{\text{avg}} > 200^\circ\text{F}$ and at least 53 of 54 reactor vessel head closure bolts fully tensioned.

5 Cold Shutdown

$K_{\text{eff}} < 0.99$ and average coolant temperature $\leq 200^\circ\text{F}$.

6 Refueling

Two or more reactor vessel head closure bolts are less than fully tensioned.

D Defueled

All fuel assemblies have been removed from Containment and placed in the spent fuel pit and the SFP transfer canal gate valve is closed.

The MODE in effect at the time that an event or condition occurred, and prior to any plant or operator response, is the MODE that determines whether or not an IC is applicable. If an event or condition occurs, and results in a MODE change before the emergency is declared, the emergency classification level is still based on the MODE that existed at the time that the event or condition was initiated (and not when it was declared). Once a different MODE is reached, any new event or condition, not related to the original event or condition, requiring emergency classification should be evaluated against the ICs and EALs applicable to the operating MODE at the time of the new event or condition. For events that occur in Cold Shutdown or Refueling, escalation is via EALs that are applicable in the Cold Shutdown or Refueling MODES, even if Hot Shutdown (or a higher MODE) is entered during the subsequent plant response. In particular, the fission product barrier EALs are applicable only to events that initiate in the Hot Shutdown MODE or higher.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

3.0 GUIDANCE ON MAKING EMERGENCY CLASSIFICATIONS

3.1. General Considerations

When making an emergency classification, the Emergency Coordinator must consider all information having a bearing on the proper assessment of an Initiating Condition (IC). This includes the Emergency Action Level (EAL) plus the associated Operating MODE Applicability, Notes, and the informing basis information. In the Recognition Category F matrices, EALs are based on loss or potential loss of Fission Product Barrier Thresholds.

3.1.1. Classification Timeliness

NRC regulations require the licensee to establish and maintain the capability to assess, classify, and declare an emergency condition within 15 minutes after the availability of indications to plant operators that an emergency action level has been exceeded and to promptly declare the emergency condition as soon as possible following identification of the appropriate emergency classification level. The NRC staff has provided guidance on implementing this requirement in NSIR/DPR-ISG-01, "Interim Staff Guidance, Emergency Planning for Nuclear Power Plants" (ref. 4.1.11).

Time based EALs should be evaluated upon first indication of the conditions. If someone is working to mitigate the condition in less than the time required, the declaration can wait to see if they are successful within the time constraints. If there is indication that the threshold will be exceeded for the time period, the declaration should immediately be declared, regardless of the time remaining. In the case of leaks, the exceeded threshold will take some additional period of time to lower and must be taken into account.

When assessing an EAL that specifies a time duration for the off-normal condition, the "clock" for the EAL time duration runs concurrently with the emergency classification process "clock."

3.1.2. Valid Indications

All emergency classification assessments shall be based upon valid indications, reports or conditions. A valid indication, report, or condition, is one that has been verified through appropriate means such that there is no doubt regarding the indicator's operability, the condition's existence, or the report's accuracy. For example, verification could be accomplished through an instrument channel check, response on related or redundant indicators, or direct observation by plant personnel. The validation of indications should be completed in a manner that supports timely emergency declaration.

An indication, report, or condition is considered to be valid when it is verified by (1) an instrument channel check, or (2) indications on related or redundant indicators, or (3) by direct observation by plant personnel, such that doubt related to the indicator's operability, the condition's existence, or the report's accuracy is removed. Implicit in this definition is the need for timely assessment.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**3.1.3. Imminent Conditions**

For ICs and EALs that have a stipulated time duration (e.g., 15 minutes, 30 minutes, etc.), the Emergency Coordinator should not wait until the applicable time has elapsed, but should declare the event as soon as it is determined that the condition has exceeded, or will likely exceed, the applicable time. If an ongoing radiological release is detected and the release start time is unknown, it should be assumed that the release duration specified in the IC/EAL has been exceeded, absent data to the contrary.

3.1.4. Planned vs. Unplanned Events

A planned work activity that results in an expected event or condition which meets or exceeds an EAL does not warrant an emergency declaration provided that: 1) the activity proceeds as planned, and 2) the plant remains within the limits imposed by the operating license. Such activities include planned work to test, manipulate, repair, maintain or modify a system or component. In these cases, the controls associated with the planning, preparation and execution of the work will ensure that compliance is maintained with all aspects of the operating license provided that the activity proceeds and concludes as expected. Events or conditions of this type may be subject to the reporting requirements of 10 CFR 50.72 (ref. 4.1.4).

3.1.5. Classification Based on Analysis

The assessment of some EALs is based on the results of analyses that are necessary to ascertain whether a specific EAL threshold has been exceeded (e.g., dose assessments, chemistry sampling, RCS leak rate calculation, etc.). For these EALs, the EAL wording or the associated basis discussion will identify the necessary analysis. In these cases, the 15-minute declaration period starts with the availability of the analysis results that show the threshold to be exceeded (i.e., this is the time that the EAL information is first available). The NRC expects licensees to establish the capability to initiate and complete EAL-related analyses within a reasonable period of time (e.g., maintain the necessary expertise on-shift).

3.1.6. Emergency Coordinator Judgment

While the EALs have been developed to address a full spectrum of possible events and conditions which may warrant emergency classification, a provision for classification based on operator/management experience and judgment is still necessary. The NEI 99-01 EAL scheme provides the Emergency Coordinator with the ability to classify events and conditions based upon judgment using EALs that are consistent with the Emergency Classification Level (ECL) definitions (refer to Category H). The Emergency Coordinator will need to determine if the effects or consequences of the event or condition reasonably meet or exceed a particular ECL definition. A similar provision is incorporated in the Fission Product Barrier Tables; judgment may be used to determine the status of a fission product barrier.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

3.2. Classification Methodology

To make an emergency classification, the user will compare an event or condition (i.e., the relevant plant indications and reports) to an EAL(s) and determine if the EAL has been met or exceeded. The evaluation of an EAL must be consistent with the related Operating MODE Applicability and Notes. If an EAL has been met or exceeded, the associated IC is likewise met, the emergency classification process “clock” starts, and the ECL must be declared in accordance with plant procedures no later than 15 minutes after the process “clock” started.

When assessing an EAL that specifies a time duration for the off-normal condition, the “clock” for the EAL time duration runs concurrently with the emergency classification process “clock.” For a full discussion of this timing requirement, refer to NSIR/DPR-ISG-01 (ref. 4.1.11).

3.2.1. Classification of Multiple Events and Conditions

When multiple emergency events or conditions are present, the user will identify all met or exceeded EALs. The highest applicable ECL identified during this review is declared. For example:

- If an Alert EAL and a Site Area Emergency EAL are met, a Site Area Emergency should be declared and the Alert noted in facility logs.

There is no “additive” effect from multiple EALs meeting the same ECL. For example:

- If two Alert EALs are met, one of the Alerts should be declared and the other Alert should be noted in the facility logs.

Related guidance concerning classification of rapidly escalating events or conditions is provided in Regulatory Issue Summary (RIS) 2007-02, Clarification of NRC Guidance for Emergency Notifications During Quickly Changing Events (ref. 4.1.2).

3.2.2. Consideration of MODE Changes During Classification

The MODE in effect at the time that an event or condition occurred, and prior to any plant or operator response, is the MODE that determines whether or not an IC is applicable. If an event or condition occurs, and results in a MODE change before the emergency is declared, the emergency classification level is still based on the MODE that existed at the time that the event or condition was initiated (and not when it was declared). Once a different MODE is reached, any new event or condition, not related to the original event or condition, requiring emergency classification should be evaluated against the ICs and EALs applicable to the operating MODE at the time of the new event or condition.

For events that occur in Cold Shutdown or Refueling, escalation is via EALs that are applicable in the Cold Shutdown or Refueling MODES, even if Hot Shutdown (or a higher MODE) is entered during the subsequent plant response. In particular, the fission product barrier EALs are applicable only to events that initiate in the Hot Shutdown MODE or higher.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

3.2.3. Classification of Imminent Conditions

Although EALs provide specific thresholds, the Emergency Coordinator must remain alert to events or conditions that could lead to meeting or exceeding an EAL within a relatively short period of time (i.e., a change in the ECL is IMMINENT). If, in the judgment of the Emergency Coordinator, meeting an EAL is IMMINENT, the emergency classification should be made as if the EAL has been met. While applicable to all emergency classification levels, this approach is particularly important at the higher emergency classification levels since it provides additional time for implementation of protective measures.

3.2.4. Emergency Classification Level Upgrading and Downgrading

An ECL may be downgraded when the event or condition that meets the highest IC and EAL no longer exists, and other site-specific downgrading requirements are met. If downgrading the ECL is deemed appropriate, the new ECL would then be based on a lower applicable IC(s) and EAL(s). The ECL may also simply be terminated.

As noted above, guidance concerning classification of rapidly escalating events or conditions is provided in RIS 2007-02 (ref. 4.1.2).

3.2.5. Classification of Short-Lived Events

Event-based ICs and EALs define a variety of specific occurrences that have potential or actual safety significance. By their nature, some of these events may be short-lived and, thus, over before the emergency classification assessment can be completed. If an event occurs that meets or exceeds an EAL, the associated ECL must be declared regardless of its continued presence at the time of declaration. Examples of such events include an earthquake or a failure of the reactor protection system to automatically trip the reactor followed by a successful manual trip.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

3.2.6. Classification of Transient Conditions

Many of the ICs and/or EALs employ time-based criteria. These criteria will require that the IC/EAL conditions be present for a defined period of time before an emergency declaration is warranted. In cases where no time-based criterion is specified, it is recognized that some transient conditions may cause an EAL to be met for a brief period of time (e.g., a few seconds to a few minutes). The following guidance should be applied to the classification of these conditions.

EAL Momentarily Met During Expected Plant Response - In instances where an EAL is briefly met during an expected (normal) plant response, an emergency declaration is not warranted provided that associated systems and components are operating as expected, and operator actions are performed in accordance with procedures.

EAL Momentarily Met But The Condition Is Corrected Prior To An Emergency Declaration – If an operator takes prompt manual action to address a condition, and the action is successful in correcting the condition prior to the emergency declaration, then the applicable EAL is not considered met and the associated emergency declaration is not required. For illustrative purposes, consider the following example:

- An ATWS occurs and the high pressure ECCS systems fail to automatically start. RPV level rapidly decreases and the plant enters an inadequate core cooling condition (a potential loss of both the fuel clad and RCS barriers). If an operator manually starts a high pressure ECCS system in accordance with an EOP step and clears the inadequate core cooling condition prior to an emergency declaration, then the classification should be based on the ATWS only.

It is important to stress that the 15-minute emergency classification assessment period (process clock) is not a “grace period” during which a classification may be delayed to allow the performance of a corrective action that would obviate the need to classify the event. Emergency classification assessments must be deliberate and timely, with no undue delays. The provision discussed above addresses only those rapidly evolving situations when an operator is able to take a successful corrective action prior to the Emergency Coordinator completing the review and steps necessary to make the emergency declaration. This provision is included to ensure that any public protective actions resulting from the emergency classification are truly warranted by the plant conditions.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**3.2.7. After-the-Fact Discovery of an Emergency Event or Condition**

In some cases, an EAL may be met but the emergency classification was not made at the time of the event or condition. This situation can occur when personnel discover that an event or condition existed which met an EAL, but no emergency was declared, and the event or condition no longer exists at the time of discovery. This may be due to the event or condition not being recognized at the time or an error that was made in the emergency classification process.

In these cases, no emergency declaration is warranted; however, the guidance contained in NUREG-1022 (ref. 4.1.3) is applicable. Specifically, the event should be reported to the NRC in accordance with 10 CFR 50.72 (ref. 4.1.4) within one hour of the discovery of the undeclared event or condition. The licensee should also notify appropriate State and local agencies.

3.2.8. Retraction of an Emergency Declaration

Guidance on the retraction of an emergency declaration reported to the NRC is discussed in NUREG-1022 (ref. 4.1.3).

-END OF SECTION-

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**4.0 REFERENCES****4.1. Developmental**

- 4.1.1. NEI 99-01 Revision 6, Methodology for the Development of Emergency Action Levels for Non-Passive Reactors, ADAMS Accession Number ML12326A805
- 4.1.2. RIS 2007-02 Clarification of NRC Guidance for Emergency Notifications During Quickly Changing Events, February 2, 2007.
- 4.1.3. NUREG-1022 Event Reporting Guidelines: 10CFR50.72 and 50.73
- 4.1.4. 10 CFR 50.72 Immediate Notification Requirements for Operating Nuclear Power Reactors
- 4.1.5. 10 CFR 50.73 License Event Report System
- 4.1.6. Drawing 8600-X-88100 Property-Site Layout Owner Controlled Area and Surrounding Area
- 4.1.7. Callaway FSAR Figure 1.2-44 Plant Area Layout
- 4.1.8. Technical Specifications Table 1.1-1 MODES
- 4.1.9. OSP-GT-00003 Containment Closure
- 4.1.10. Procedure Writers Manual Callaway Plant Procedure Writers Manual
- 4.1.11. NSIR/DPR-ISG-01 Interim Staff Guidance, Emergency Planning for Nuclear Power Plants
- 4.1.12. Callaway Plant Radiological Emergency Response Plan Emergency Plan (RERP)
- 4.1.13. OTG-ZZ-00007 Refueling Preparation, Performance and Recovery
- 4.1.14. APA-ZZ-00520, Reporting Requirements and Responsibilities

4.2. Implementing

- 4.2.1. EIP-ZZ-00101 Classification of Emergencies
- 4.2.2. NEI 99-01 Rev. 6 to Callaway EAL Comparison Matrix
- 4.2.3. Callaway EAL Matrix
- 4.2.4. CR 201702763, NOS Insight – EP Risk Significant Planning Standard Performance Upper Tier Cause Evaluation Needed

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

5.0 DEFINITIONS, ACRONYMS, & ABBREVIATIONS

5.1. Definitions (ref. 4.1.1 except as noted)

Selected terms used in Initiating Condition and Emergency Action Level statements are set in all capital letters (e.g., ALL CAPS). These words are defined terms that have specific meanings as used in this document. The definitions of these terms are provided below.

Alert - Events are in process, or have occurred, which involve an actual or potential substantial degradation of the level of safety of the plant or a security event that involves probable life threatening risk to site personnel or damage to site equipment because of hostile action. Any releases are expected to be small fractions of the EPA Protective Action Guideline exposure levels.

Confinement Boundary - The barrier(s) between spent fuel and the environment once the spent fuel is processed for dry storage. As applied to the Callaway ISFSI, the CONFINEMENT BOUNDARY is defined to be the Multi-Purpose Canister (MPC).

Containment Closure - The procedurally defined actions taken to secure containment and its associated structures, systems, and components as a functional barrier to fission product release under shutdown conditions.

As applied to Callaway, Containment Closure is established when the requirements of OSP-GT-00003 Containment Closure are met. (ref. 4.1.9)

Emergency Action Level - A pre-determined, site-specific, observable threshold for an Initiating Condition that, when met or exceeded, places the plant in a given emergency classification level.

Emergency Classification Level - One of a set of names or titles established by the US Nuclear Regulatory Commission (NRC) for grouping off-normal events or conditions according to (1) potential or actual effects or consequences, and (2) resulting onsite and offsite response actions. The emergency classification levels, in ascending order of severity, are: Unusual Event (UE), Alert, Site Area Emergency (SAE) and General Emergency (GE).

EPA PAGs - Environment Protection Agency Protective Action Guidelines. The EPA PAGs are expressed in terms of dose commitment: 1 Rem TEDE or 5 Rem CDE Thyroid. Actual or projected offsite exposures in excess of the EPA PAGs requires Callaway to recommend protective actions for the general public to offsite planning agencies.

Explosion - A rapid, violent and catastrophic failure of a piece of equipment due to combustion, chemical reaction or overpressurization. A release of steam (from high energy lines or components) or an electrical component failure (caused by short circuits, grounding, arcing, etc.) should not automatically be considered an explosion. Such events require a post-event inspection to determine if the attributes of an explosion are present.

Faulted - The term applied to a steam generator that has a steam leak on the secondary side of sufficient size to cause an uncontrolled drop in steam generator pressure or the steam generator to become completely depressurized.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Fire - Combustion characterized by heat and light. Sources of smoke such as slipping drive belts or overheated electrical equipment do not constitute fires. Observation of flame is preferred but is NOT required if large quantities of smoke and heat are observed.

Fission Product Barrier Threshold - A pre-determined, site-specific, observable threshold indicating the loss or potential loss of a fission product barrier.

Flooding - A condition where water is entering a room or area faster than installed equipment is capable of removal, resulting in a rise of water level within the room or area.

General Emergency - Events are in process or have occurred which involve actual or imminent substantial core degradation or melting with potential for loss of containment integrity or hostile actions that result in an actual loss of physical control of the facility. Releases can be reasonably expected to exceed EPA Protective Action Guideline exposure levels offsite for more than the immediate site area.

High Winds - Winds in excess of 40 mph (18 m/s) sustained, or 58 mph (26 m/s) gusting.

Hostage - A person(s) held as leverage against the station to ensure that demands will be met by the station.

Hostile Action - An act toward Callaway or its personnel that includes the use of violent force to destroy equipment, take hostages, and/or intimidate the licensee to achieve an end. This includes attack by air, land, or water using guns, explosives, projectiles, vehicles, or other devices used to deliver destructive force. Other acts that satisfy the overall intent may be included. Hostile action should not be construed to include acts of civil disobedience or felonious acts that are not part of a concerted attack on Callaway. Non-terrorism-based EALs should be used to address such activities (i.e., this may include violent acts between individuals in the owner controlled area).

Hostile Force - One or more individuals who are engaged in a determined assault, overtly or by stealth and deception, equipped with suitable weapons capable of killing, maiming, or causing destruction.

Imminent - The trajectory of events or conditions is such that an EAL will be met within a relatively short period of time regardless of mitigation or corrective actions.

Impede(d) - Personnel access to a room or area is hindered to an extent that extraordinary measures are necessary to facilitate entry of personnel into the affected room/area (e.g., requiring use of protective equipment, such as SCBAs, that is not routinely employed).

Independent Spent Fuel Storage Installation (ISFSI) - A complex that is designed and constructed for the interim storage of spent nuclear fuel and other radioactive materials associated with spent fuel storage.

Initiating Condition - An event or condition that aligns with the definition of one of the four emergency classification levels by virtue of the potential or actual effects or consequences.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Loss of Safety Function (LOSF) – A LOSF exists when, assuming no concurrent single failure, a safety function assumed in the accident analysis cannot be performed. For the purpose of the Safety Function Determination Program, a LOSF may exist when a support system is INOPERABLE, AND:

- a) A required system redundant to the system supported by the INOPERABLE support system is also INOPERABLE; OR
- b) A required system redundant to the system in turn supported by the INOPERABLE supported system is also INOPERABLE; OR
- c) A required system redundant to the support system for the supported systems (a) and (b) above is also INOPERABLE.

Maintain - Take appropriate action to hold the value of an identified parameter within specified limits.

Owner Controlled Area (OCA) - The fenced area contiguous to the Protected Area, designated by AmerenUE (Callaway Plant) to be controlled for security purposes (ref 4.1.6).

Projectile - An object directed toward a Nuclear Power Plant that could cause concern for its continued operability, reliability, or personnel safety.

Protected Area (PA) - An area encompassed by physical barriers and to which access is controlled. The Protected Area refers to the designated security area around the process buildings and is depicted in Drawing 8600-X-88100 Property-Site Layout, Owner Controlled Area and Surrounding Area (ref. 4.1.7).

RCS Intact - The RCS should be considered intact when the RCS pressure boundary is in its normal condition for the Cold Shutdown MODE of operation (e.g., no freeze seals or nozzle dams). The RCS is capable of being placed in an intact condition by Operator Action, i.e., pressurized to support natural circulation cooling.

Reduced Inventory - Plant condition when fuel is in the reactor vessel and Reactor Coolant System level is lower than 3 feet below the Reactor Vessel flange (< 64.0 in.) (ref. 4.1.13).

Refueling Pathway - The reactor refueling cavity, spent fuel pool and fuel transfer canal comprise the refueling pathway.

Restore - Take the appropriate action required to return the value of an identified parameter to the applicable limits.

Ruptured - The condition of a steam generator in which primary-to-secondary leakage is of sufficient magnitude to require a safety injection.

Safety System - A system required for safe plant operation, cooling down the plant and/or placing it in the Cold Shutdown condition, including the ECCS. These are typically systems classified as safety-related (as defined in 10CFR50.2):

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Those structures, systems and components that are relied upon to remain functional during and following design basis events to assure:

- 1) The integrity of the reactor coolant pressure boundary;
- 2) The capability to shut down the reactor and maintain it in a safe shutdown condition;
- 3) The capability to prevent or mitigate the consequences of accidents which could result in potential offsite exposures.

Security Condition - Any security event as listed in the approved security contingency plan that constitutes a threat/compromise to site security, threat/risk to site personnel, or a potential degradation to the level of safety of the plant. A security condition does not involve a hostile action.

Site Area Emergency - Events are in process or have occurred which involve actual or likely major failures of plant functions needed for protection of the public or hostile actions that result in intentional damage or malicious acts; (1) toward site personnel or equipment that could lead to the likely failure of or; (2) that prevent effective access to equipment needed for the protection of the public. Any releases are not expected to result in exposure levels which exceed EPA Protective Action Guidelines exposure levels beyond the site boundary.

Site Boundary - Exclusion Area Boundary is a synonymous term for Site Boundary. The Exclusion Area is defined as the area that encompasses the land surrounding the Plant to a radius of 1,200 meters (3,937 feet) from the midpoint of the Unit 1 Reactor Building and the canceled Unit 2 Reactor Building. Control of access to this is by virtue of ownership and in accordance with 10CFR100 (ref. 4.1.12).

Unisolable - An open or breached system line that cannot be isolated, remotely or locally.

Unplanned - A parameter change or an event that is not 1) the result of an intended evolution or 2) an expected plant response to a transient. The cause of the parameter change or event may be known or unknown.

Unusual Event - Events are in process or have occurred which indicate a potential degradation in the level of safety of the plant or indicate a security threat to facility protection has been initiated. No releases of radioactive material requiring offsite response or monitoring are expected unless further degradation of safety systems occurs.

Valid - An indication, report, or condition, is considered to be valid when it is verified by (1) an instrument channel check, or (2) indications on related or redundant indicators, or (3) by direct observation by plant personnel, such that doubt related to the indicator's operability, the condition's existence, or the report's accuracy is removed. Implicit in this definition is the need for timely assessment.

Visible Damage - Damage to a SAFETY SYSTEM train that is readily observable without measurements, testing, or analysis. The visual impact of the damage is sufficient to cause concern regarding the operability or reliability of the affected SAFETY SYSTEM train.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

5.2. Abbreviations/Acronyms

°F	Degrees Fahrenheit
°	Degrees
AC	Alternating Current
ATWS	Anticipated Transient Without Scram
Callaway	Callaway Energy Center
CDE	Committed Dose Equivalent
CFR	Code of Federal Regulations
CMT	Containment
CSFST	Critical Safety Function Status Tree
DBA	Design Basis Accident
DBT	Design Bases Threat
DC	Direct Current
EAL	Emergency Action Level
ECCS	Emergency Core Cooling System
ECL	Emergency Classification Level
EOF	Emergency Operations Facility
EOP	Emergency Operating Procedure
EPA	Environmental Protection Agency
EPIP	Emergency Plan Implementing Procedure
ERG	Emergency Response Guideline
ESF	Engineered Safety Feature
ESW	Essential Service Water
FAA	Federal Aviation Administration
FBI	Federal Bureau of Investigation
FEMA	Federal Emergency Management Agency
FSAR	Final Safety Analysis Report
GE	General Emergency
IC	Initiating Condition
IPEEE	Individual Plant Examination of External Events (Generic Letter 88-20)
K_{eff}	Effective Neutron Multiplication Factor
LCO	Limiting Condition of Operation
LER	Licensee Event Report
LOCA	Loss of Coolant Accident
LWR	Light Water Reactor
MPC	Maximum Permissible Concentration/Multi-Purpose Canister
mR, mRem, mrem, mREM	milli-Roentgen Equivalent Man
MSL	Main Steam Line
MW	Megawatt
NEI	Nuclear Energy Institute

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

NESP	National Environmental Studies Project
NPP	Nuclear Power Plant
NRC	Nuclear Regulatory Commission
NSSS	Nuclear Steam Supply System
NORAD	North American Aerospace Defense Command
(NO)UE	Notification of Unusual Event
OBE	Operating Basis Earthquake
OCA	Owner Controlled Area
ODCM	Offsite Dose Calculation Manual
ORO	Offsite Response Organization
OTO	Off-Normal Operating Procedure
PA	Protected Area
PAG	Protective Action Guideline
PRA/PSA	Probabilistic Risk Assessment / Probabilistic Safety Assessment
PWR	Pressurized Water Reactor
PSIG	Pounds per Square Inch Gauge
R	Roentgen
RCC	Reactor Control Console
RCS	Reactor Coolant System
Rem, rem, REM	Roentgen Equivalent Man
RETS	Radiological Effluent Technical Specifications
RPS	Reactor Protection System
R(P)V	Reactor (Pressure) Vessel
RVLIS	Reactor Vessel Level Indicating System
SAR	Safety Analysis Report
SBO	Station Blackout
SCBA	Self-Contained Breathing Apparatus
SG	Steam Generator
SI	Safety Injection
SPDS	Safety Parameter Display System
SRO	Senior Reactor Operator
SSF	Safe Shutdown Facility
TEDE	Total Effective Dose Equivalent
TOAF	Top of Active Fuel
TSC	Technical Support Center
WOG	Westinghouse Owners Group

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

6.0 CALLAWAY-TO-NEI 99-01 REV. 6 EAL CROSS-REFERENCE

This cross-reference is provided to facilitate association and location of a Callaway EAL within the NEI 99-01 IC/EAL identification scheme. Further information regarding the development of the Callaway EALs based on the NEI guidance can be found in the EAL Comparison Matrix.

Callaway	NEI 99-01 Rev. 6	
EAL	IC	Example EAL
RU1.1	AU1	1, 2
RU1.2	AU1	3
RU2.1	AU2	1
RA1.1	AA1	1
RA1.2	AA1	2
RA1.3	AA1	3
RA1.4	AA1	4
RA2.1	AA2	1
RA2.2	AA2	2
RA2.3	AA2	3
RA3.1	AA3	1
RA3.2	AA3	2
RS1.1	AS1	1
RS1.2	AS1	2
RS1.3	AS1	3
RS2.1	AS2	1
RG1.1	AG1	1
RG1.2	AG1	2
RG1.3	AG1	3
RG2.1	AG2	1
CU1.1	CU1	1
CU1.2	CU1	2
CU2.1	CU2	1
CU3.1	CU3	1
CU3.2	CU3	2
CU4.1	CU4	1

Callaway	NEI 99-01 Rev. 6	
EAL	IC	Example EAL
CU5.1	CU5	1, 2, 3
CA1.1	CA1	1
CA1.2	CA1	2
CA2.1	CA2	1
CA3.1	CA3	1, 2
CA6.1	CA6	1
CS1.1	CS1	1
CS1.2	CS1	2
CS1.3	CS1	3
CG1.1	CG1	1
CG1.2	CG1	2
FA1.1	FA1	1
FS1.1	FS1	1
FG1.1	FG1	1
HU1.1	HU1	1, 2, 3
HU2.1	HU2	1
HU3.1	HU3	1
HU3.2	HU3	2
HU3.3	HU3	3
HU3.4	HU3	4
HU4.1	HU4	1
HU4.2	HU4	2
HU4.3	HU4	3
HU4.4	HU4	4
HU7.1	HU7	1
HA1.1	HA1	1, 2

Callaway	NEI 99-01 Rev. 6	
EAL	IC	Example EAL
HA5.1	HA5	1
HA6.1	HA6	1
HA7.1	HA7	1
HS1.1	HS1	1
HS6.1	HS6	1
HS7.1	HS7	1
HG7.1	HG7	1
SU1.1	SU1	1
SU3.1	SU2	1
SU4.1	SU3	2
SU5.1	SU4	1, 2, 3
SU6.1	SU5	1
SU6.2	SU5	2
SU7.1	SU6	1, 2, 3
SU8.1	SU7	1, 2
SA1.1	SA1	1
SA3.1	SA2	1
SA6.1	SA5	1
SA9.1	SA9	1
SS1.1	SS1	1
SS2.1	SS8	1
SS6.1	SS5	1
SG1.1	SG1	1
SG1.2	SG8	1
EU1.1	E-HU1	1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

7.0 ATTACHMENTS

7.1. Attachment 1, Emergency Action Level Technical Bases

7.2. Attachment 2, Fission Product Barrier Loss / Potential Loss Matrix and Bases

8.0 SUMMARY OF CHANGES

Page(s)	Section or Step Number	Description
21 22 112 187	Definitions CA6.1 Def. SA9.1 Def	<p>Changed the definition of Visible Damage to: "Damage to a SAFETY SYSTEM train that is readily observable without measurements, testing, or analysis. The visual impact of the damage is sufficient to cause concern regarding the operability or reliability of the affected SAFETY SYSTEM train." to help clarify the intent of visible damage.</p> <p>Added the following Definition: " Loss of Safety Function (LOSF) – A LOSF exists when, assuming no concurrent single failure, a safety function assumed in the accident analysis cannot be performed. For the purpose of the Safety Function Determination Program, a LOSF may exist when a support system is INOPERABLE, AND:</p> <ul style="list-style-type: none"> • A required system redundant to the system supported by the INOPERABLE support system is also INOPERABLE; OR • A required system redundant to the system in turn supported by the INOPERABLE supported system is also INOPERABLE; OR • A required system redundant to the support system for the supported systems in bullets 1 and 2 above is also INOPERABLE."
25	6.0	Deleted HG1.1 from the Callaway to NEI cross reference chart.
69	EU1.1 Basis	Removed reference to HG1 from last sentence of basis.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Page(s)	Section or Step Number	Description
111 & 186	CA6.1 & SA9.1	<p>Reworded the EAL to better address the intent. The new wording reads: "The occurrence of any Table C-6 (S-5) hazardous event AND Event damage has caused indication of degraded performance on train of a SAFETY SYSTEM needed for the current operating MODE AND EITHER:</p> <ul style="list-style-type: none"> • Event damage has caused indications of degraded performance in a second train of a SAFETY SYSTEM needed for the current operating MODE. • Event damage has resulted in VISIBLE DAMAGE to a second train of a SAFETY SYSTEM needed for the current operating MODE. <p>(Notes 11, 12)"</p> <p>And along with the revised EAL text, the following notes were also added: Note 11: If the hazardous event only results in VISIBLE DAMAGE, with no indication of degraded performance to at least one train of a SAFETY SYSTEM, then this emergency classification is not warranted. Note 12: This EAL is applicable when a Table C-6 (S-5), Hazardous Events, causes a LOSS OF SAFETY FUNCTION on a SAFETY SYSTEM required for the current operating MODE."</p>
113	CA6.1 Basis	<p>Removed the existing basis text following the bulleted steps and replaced with the following: "This IC addresses a hazardous event that causes damage to SAFETY SYSTEMS needed for the current operating mode. In order to provide the appropriate context for consideration of an ALERT classification, the hazardous event must have caused indications of degraded SAFETY SYSTEM performance in one train, and there must be either indications of performance issues with the second SAFETY SYSTEM train or VISIBLE DAMAGE to the second train such that the potential exists for this second SAFETY SYSTEM train to have performance issues. In other words, in order for this EAL to be classified, the hazardous event must occur, at least one SAFETY SYSTEM train must have indications of degraded performance, and the second SAFETY SYSTEM train must have indications of degraded performance or VISIBLE DAMAGE such that the potential exists for performance issues. Note that this second SAFETY SYSTEM train is from the same SAFETY SYSTEM that has indications of degraded performance; commercial nuclear power plants are designed to be able to support single system issues without compromising public health and safety from radiological events. Indications of degraded performance addresses damage to a SAFETY SYSTEM train that is in service/operation since indications for it will be readily available. The indications of degraded performance should be significant enough to cause concern regarding the operability or reliability of the SAFETY SYSTEM train. Operators will make a determination of VISIBLE DAMAGE based on the totality of available event and damage report information. This is intended to be a brief assessment not requiring lengthy analysis or quantification of the damage. This VISIBLE DAMAGE should be significant enough to cause concern regarding the operability or reliability of the SAFETY SYSTEM train. Escalation of the emergency classification level would be via ICs CS1 or RS1." This was done to help clarify when the EAL should be called.</p>
115	HU1.1 Basis	Removed reference to HG1 from classifying HOSTILE ACTIONS..
120	HS1.1 Basis	Removed reference to HG1 and added all other General Emergency ICs.
	Old HG1.1	Deleted HG1.1 and associated reference material from bases.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Page(s)	Section or Step Number	Description
188	SA9.1 Basis	<p>Removed the existing basis text following the paragraph about a single faulted generator, and replaced with the following:</p> <p>"This IC addresses a hazardous event that causes damage to SAFETY SYSTEMS needed for the current operating mode. In order to provide the appropriate context for consideration of an ALERT classification, the hazardous event must have caused indications of degraded SAFETY SYSTEM performance in one train, and there must be either indications of performance issues with the second SAFETY SYSTEM train or VISIBLE DAMAGE to the second train such that the potential exists for this second SAFETY SYSTEM train to have performance issues. In other words, in order for this EAL to be classified, the hazardous event must occur, at least one SAFETY SYSTEM train must have indications of degraded performance, and the second SAFETY SYSTEM train must have indications of degraded performance or VISIBLE DAMAGE such that the potential exists for performance issues. Note that this second SAFETY SYSTEM train is from the same SAFETY SYSTEM that has indications of degraded performance; commercial nuclear power plants are designed to be able to support single system issues without compromising public health and safety from radiological events.</p> <p>Indications of degraded performance addresses damage to a SAFETY SYSTEM train that is in service/operation since indications for it will be readily available. The indications of degraded performance should be significant enough to cause concern regarding the operability or reliability of the SAFETY SYSTEM train.</p> <p>Operators will make a determination of VISIBLE DAMAGE based on the totality of available event and damage report information. This is intended to be a brief assessment not requiring lengthy analysis or quantification of the damage. This VISIBLE DAMAGE should be significant enough to cause concern regarding the operability or reliability of the SAFETY SYSTEM train.</p> <p>Escalation of the emergency classification level would be via ICs FS1 or RS1."</p> <p>This was done to help clarify when the EAL should be called.</p>

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

This page intentionally left blank

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

This page intentionally left blank

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category R – Abnormal Rad Release / Rad Effluent**

EAL Group: ANY (EALs in this category are applicable in All, Hot or Cold plant conditions.)

Many EALs are based on actual or potential degradation of fission product barriers because of the elevated potential for offsite radioactivity release. Degradation of fission product barriers though is not always apparent via non-radiological symptoms. Therefore, direct indication of elevated radiological effluents or area radiation levels are appropriate symptoms for emergency classification.

At lower levels, abnormal radioactivity releases may be indicative of a failure of containment systems or precursors to more significant releases. At higher release rates, offsite radiological conditions may result which require offsite protective actions. Elevated area radiation levels in plant may also be indicative of the failure of containment systems or preclude access to plant vital equipment necessary to ensure plant safety.

Events of this category pertain to the following subcategories:

1. Radiological Effluent

Direct indication of effluent radiation monitoring systems provides a rapid assessment mechanism to determine releases in excess of classifiable limits. Projected offsite doses, actual offsite field measurements or measured release rates via sampling indicate doses or dose rates above classifiable limits.

2. Irradiated Fuel Event

Conditions indicative of a loss of adequate shielding or damage to irradiated fuel may preclude access to vital plant areas or result in radiological releases that warrant emergency classification.

3. Area Radiation Levels

Sustained general area radiation levels which may preclude access to areas requiring continuous occupancy also warrant emergency classification.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** R – Abnormal Rad Levels / Rad Effluent**Subcategory:** 1 – Radiological Effluent**Initiating Condition:** Release of gaseous or liquid radioactivity greater than 2 times the ODCM limits for 60 minutes or longer**EAL:****RU1.1 Unusual Event**Reading on **any** Table R-1 effluent radiation monitor > column "UE" for ≥ 60 min.*(Notes 1, 2, 3)**Note 1:* The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.*Note 2:* If an ongoing release is detected and the release start time is unknown, assume that the release duration has exceeded the specified time limit.*Note 3:* If the effluent flow past an effluent monitor is known to have stopped, indicating that the release path is isolated, the effluent monitor reading is no longer VALID for classification purposes.

Table R-1 Effluent Monitor Classification Thresholds						
Release Point		Monitor	GE	SAE	Alert	UE
Gaseous	Unit Vent	GT-RE-21B	6.59E+7 $\mu\text{Ci/sec}$	6.59E+6 $\mu\text{Ci/sec}$	6.59E+5 $\mu\text{Ci/sec}$	2 X Hi-Hi alarm
	ASD Monitors (A/B/C/D)	AB-RE-111/112/ 113/114	12 mR/hr	1.2 mR/hr	----	----
	TD AFW Steam Discharge	FC-RE-385	163 mR/hr	16.3 mR/hr	1.6 mR/hr	----
	Radwaste Bldg Vent	GH-RE-10B	----	----	----	2 X Hi-Hi alarm
Liquid	Liquid Radwaste Discharge	HB-RE-18	----	----	----	2 X Hi-Hi alarm

MODE Applicability:

All

Definition(s):

None

Basis:

The column "UE" gaseous and liquid release values in Table R-1 represent two times the appropriate ODCM release rate limits associated with the specified monitors (ref. 1, 2, 3).

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

The effluent monitor Hi-Hi alarm setpoints correspond to the Hi-Hi alarm (red) setpoint as displayed on RM-11.

The Hi-Hi alarm value setpoints are available by examining channel 9 on the RM-23.

The RM-11 Channel Number 213 is utilized for the Unit Vent (GT-RE-21B) reading for Table R-1. This channel is read out in $\mu\text{Ci}/\text{sec}$ while all others are read out in $\mu\text{Ci}/\text{ml}$.

This IC addresses a potential decrease in the level of safety of the plant as indicated by a low-level radiological release that exceeds regulatory commitments for an extended period of time (e.g., an uncontrolled release). It includes any gaseous or liquid radiological release, monitored or un-monitored, including those for which a radioactivity discharge permit is normally prepared.

Nuclear power plants incorporate design features intended to control the release of radioactive effluents to the environment. Further, there are administrative controls established to prevent unintentional releases, and to control and monitor intentional releases. The occurrence of an extended, uncontrolled radioactive release to the environment is indicative of degradation in these features and/or controls.

Radiological effluent EALs are also included to provide a basis for classifying events and conditions that cannot be readily or appropriately classified on the basis of plant conditions alone. The inclusion of both plant condition and radiological effluent EALs more fully addresses the spectrum of possible accident events and conditions.

Classification based on effluent monitor readings assumes that a release path to the environment is established. If the effluent flow past an effluent monitor is known to have stopped due to actions to isolate the release path, then the effluent monitor reading is no longer valid for classification purposes.

Releases should not be prorated or averaged. For example, a release exceeding 4 times release limits for 30 minutes does not meet the EAL.

This EAL addresses normally occurring continuous radioactivity releases from monitored gaseous or liquid effluent pathways.

Escalation of the emergency classification level would be via IC RA1.

Callaway Basis Reference(s):

1. APA-ZZ-01003, Callaway Plant Offsite Dose Calculation Manual Section 2.2.3
2. FSAR Section 16.11.1.3, Radioactive Effluent Monitoring Instrumentation LCO
3. EPCI 1402, EAL Table R-1 Calculations
4. NEI 99-01, AU1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** R – Abnormal Rad Levels / Rad Effluent**Subcategory:** 1 – Radiological Effluent**Initiating Condition:** Release of gaseous or liquid radioactivity greater than 2 times the ODCM limits for 60 minutes or longer.**EAL:****RU1.2 Unusual Event**

Sample analysis for a gaseous or liquid release indicates a concentration or release rate
 $> 2 \times$ ODCM limits for ≥ 60 min.

(Notes 1, 2)

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

Note 2: If an ongoing release is detected and the release start time is unknown, assume that the release duration has exceeded the specified time limit.

MODE Applicability:

All

Definition(s):

None

Basis:

This IC addresses a potential decrease in the level of safety of the plant as indicated by a low-level radiological release that exceeds regulatory commitments for an extended period of time (e.g., an uncontrolled release). It includes any gaseous or liquid radiological release, monitored or un-monitored, including those for which a radioactivity discharge permit is normally prepared.

This EAL addresses uncontrolled gaseous or liquid releases that are detected by sample analyses or environmental surveys, particularly on unmonitored pathways (e.g., spills of radioactive liquids into storm drains, heat exchanger leakage in river water systems, etc.).

Nuclear power plants incorporate design features intended to control the release of radioactive effluents to the environment. Further, there are administrative controls established to prevent unintentional releases, and to control and monitor intentional releases. The occurrence of an extended, uncontrolled radioactive release to the environment is indicative of degradation in these features and/or controls.

Radiological effluent EALs are also included to provide a basis for classifying events and conditions that cannot be readily or appropriately classified on the basis of plant conditions alone. The inclusion of both plant condition and radiological effluent EALs more fully addresses the spectrum of possible accident events and conditions.

Releases should not be prorated or averaged. For example, a release exceeding 4 times release limits for 30 minutes does not meet the EAL.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

All water runoff from the plant eventually flows into Logan Creek and then to the Missouri River. If radioactive liquid flows offsite, begin hourly grab samples at the Portland River Sample Location and analyze for tritium and gamma spectrum. Send results to the Dose Assessment Technician or Dose Assessment Coordinator for evaluation.

Escalation of the emergency classification level would be via IC RA1.

Callaway Basis Reference(s):

1. APA-ZZ-01003, Callaway Plant Offsite Dose Calculation Manual Section 2.2.3
2. NEI 99-01, AU1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** R – Abnormal Rad Levels / Rad Effluent**Subcategory:** 1 – Radiological Effluent**Initiating Condition:** Release of gaseous or liquid radioactivity resulting in offsite dose greater than 10 mrem TEDE or 50 mrem thyroid CDE**EAL:****RA1.1 Alert**Reading on **any** Table R-1 effluent radiation monitor > column "ALERT" for ≥ 15 min.

(Notes 1, 2, 3, 4)

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.*Note 2:* If an ongoing release is detected and the release start time is unknown, assume that the release duration has exceeded the specified time limit.*Note 3:* If the effluent flow past an effluent monitor is known to have stopped, indicating that the release path is isolated, the effluent monitor reading is no longer VALID for classification purposes.*Note 4:* The pre-calculated effluent monitor values presented in EALs RA1.1, RS1.1 and RG1.1 should be used for emergency classification assessments until the results from a dose assessment using actual meteorology are available.

Table R-1 Effluent Monitor Classification Thresholds						
Release Point		Monitor	GE	SAE	Alert	UE
Gaseous	Unit Vent	GT-RE-21B	6.59E+7 $\mu\text{Ci/sec}$	6.59E+6 $\mu\text{Ci/sec}$	6.59E+5 $\mu\text{Ci/sec}$	2 X Hi-Hi alarm
	ASD Monitors (A/B/C/D)	AB-RE-111/112/ 113/114	12 mR/hr	1.2 mR/hr	----	----
	TD AFW Steam Discharge	FC-RE-385	163 mR/hr	16.3 mR/hr	1.6 mR/hr	----
	Radwaste Bldg Vent	GH-RE-10B	----	----	----	2 X Hi-Hi alarm
Liquid	Liquid Radwaste Discharge	HB-RE-18	----	----	----	2 X Hi-Hi alarm

MODE Applicability:

All

Definition(s):

None

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Basis:**

This EAL address gaseous radioactivity releases, that for whatever reason, cause effluent radiation monitor readings corresponding to site boundary doses that exceed either:

- 10 mRem TEDE
- 50 mRem CDE Thyroid

Classification based on effluent monitor readings assumes that a release path to the environment is established. If the effluent flow past an effluent monitor is known to have stopped due to actions to isolate the release path, then the effluent monitor reading is no longer valid for classification purposes.

To clarify Note 4, if a threshold value is met in Table R-1 for a classification, there is a 15 minute time limit to make the classification (RA1.1). If Dose Assessment (URI/RASCAL) is available it should be used instead (RA1.2) since it is more accurate than the values in Table R-1. However the Dose Assessment personnel must be able to calculate results within 15 minutes of the Table R-1 value being exceeded OR the classification should be made using Table R-1 (RA1.1).

The RM-11 Channel Number 213 is utilized for the Unit Vent (GT-RE-21B) reading for Table R-1. This channel is read out in $\mu\text{Ci/sec}$ while all others are read out in $\mu\text{Ci/ml}$.

The column "ALERT" gaseous effluent release values in Table R-1 correspond to calculated doses of 1% (10% of the SAE thresholds) of the EPA Protective Action Guidelines (TEDE or CDE Thyroid) (ref. 1).

This IC addresses a release of gaseous or liquid radioactivity that results in projected or actual offsite doses greater than or equal to 1% of the EPA Protective Action Guides (PAGs). It includes both monitored and un-monitored releases. Releases of this magnitude represent an actual or potential substantial degradation of the level of safety of the plant as indicated by a radiological release that significantly exceeds regulatory limits (e.g., a significant uncontrolled release).

Radiological effluent EALs are also included to provide a basis for classifying events and conditions that cannot be readily or appropriately classified on the basis of plant conditions alone. The inclusion of both plant condition and radiological effluent EALs more fully addresses the spectrum of possible accident events and conditions.

The TEDE dose is set at 1% of the EPA PAG of 1,000 mrem while the 50 mrem thyroid CDE was established in consideration of the 1:5 ratio of the EPA PAG for TEDE and thyroid CDE.

Escalation of the emergency classification level would be via IC RS1.

Callaway Basis Reference(s):

1. EPCI 1402, EAL Table R-1 Calculations
2. NEI 99-01, AA1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** R – Abnormal Rad Levels / Rad Effluent**Subcategory:** 1 – Radiological Effluent**Initiating Condition:** Release of gaseous or liquid radioactivity resulting in offsite dose greater than 10 mrem TEDE or 50 mrem thyroid CDE**EAL:****RA1.2 Alert**

Dose assessment using actual meteorology indicates doses > 10 mrem TEDE or 50 mrem thyroid CDE at or beyond the SITE BOUNDARY.

MODE Applicability:

All

Definition(s):

SITE BOUNDARY - Exclusion Area Boundary is a synonymous term for Site Boundary. The Exclusion Area is defined as the area that encompasses the land surrounding the Plant to a radius of 1,200 meters (3,937 feet) from the midpoint of the Unit 1 Reactor Building and the canceled Unit 2 Reactor Building. Control of access to this is by virtue of ownership and in accordance with 10CFR100.

Basis:

Dose assessments are performed by computer-based method (ref. 1, 2).

This IC is used based on results from the Unified RASCAL Interface software (URI) regardless of the input source. This value is in mrem TEDE or thyroid CDE.

This IC addresses a release of gaseous or liquid radioactivity that results in projected or actual offsite doses greater than or equal to 1% of the EPA Protective Action Guides (PAGs). It includes both monitored and un-monitored releases. Releases of this magnitude represent an actual or potential substantial degradation of the level of safety of the plant as indicated by a radiological release that significantly exceeds regulatory limits (e.g., a significant uncontrolled release).

Radiological effluent EALs are also included to provide a basis for classifying events and conditions that cannot be readily or appropriately classified on the basis of plant conditions alone. The inclusion of both plant condition and radiological effluent EALs more fully addresses the spectrum of possible accident events and conditions.

The TEDE dose is set at 1% of the EPA PAG of 1,000 mrem while the 50 mrem thyroid CDE was established in consideration of the 1:5 ratio of the EPA PAG for TEDE and thyroid CDE.

Classification based on effluent monitor readings assumes that a release path to the environment is established. If the effluent flow past an effluent monitor is known to have stopped due to actions to isolate the release path, then the effluent monitor reading is no longer valid for classification purposes.

Escalation of the emergency classification level would be via IC RS1.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Callaway Basis Reference(s):**

1. EIP-ZZ-01211, Accident Dose Assessment
2. EPCI 1402, EAL Table R-1 Calculations
3. NEI 99-01, AA1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** R – Abnormal Rad Levels / Rad Effluent**Subcategory:** 1 – Radiological Effluent**Initiating Condition:** Release of gaseous or liquid radioactivity resulting in offsite dose greater than 10 mrem TEDE or 50 mrem thyroid CDE.**EAL:****RA1.3 Alert**

Analysis of a liquid effluent sample indicates a concentration or release rate that would result in doses > 10 mrem TEDE or 50 mrem thyroid CDE at or beyond the SITE BOUNDARY for 60 min. of exposure.

(Notes 1, 2)

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

Note 2: If an ongoing release is detected and the release start time is unknown, assume that the release duration has exceeded the specified time limit.

MODE Applicability:

All

Definition(s):

SITE BOUNDARY - Exclusion Area Boundary is a synonymous term for Site Boundary. The Exclusion Area is defined as the area that encompasses the land surrounding the Plant to a radius of 1,200 meters (3,937 feet) from the midpoint of the Unit 1 Reactor Building and the canceled Unit 2 Reactor Building. Control of access to this is by virtue of ownership and in accordance with 10CFR100.

Basis:

Dose assessments based on liquid releases are performed per Offsite Dose Calculation Manual (ref. 1).

This IC is based on liquid sample analysis by the Count Room.

This IC addresses a release of gaseous or liquid radioactivity that results in projected or actual offsite doses greater than or equal to 1% of the EPA Protective Action Guides (PAGs). It includes both monitored and un-monitored releases. Releases of this magnitude represent an actual or potential substantial degradation of the level of safety of the plant as indicated by a radiological release that significantly exceeds regulatory limits (e.g., a significant uncontrolled release).

Radiological effluent EALs are also included to provide a basis for classifying events and conditions that cannot be readily or appropriately classified on the basis of plant conditions alone. The inclusion of both plant condition and radiological effluent EALs more fully addresses the spectrum of possible accident events and conditions.

The TEDE dose is set at 1% of the EPA PAG of 1,000 mrem while the 50 mrem thyroid CDE was established in consideration of the 1:5 ratio of the EPA PAG for TEDE and thyroid CDE.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Classification based on effluent monitor readings assumes that a release path to the environment is established. If the effluent flow past an effluent monitor is known to have stopped due to actions to isolate the release path, then the effluent monitor reading is no longer valid for classification purposes.

All water runoff from the plant eventually flows into Logan Creek and then to the Missouri River. If radioactive liquid flows offsite, begin hourly grab samples at the Portland River Sample Location and analyze for tritium and gamma spectrum. Send results to the Dose Assessment Technician or Dose Assessment Coordinator for evaluation.

Escalation of the emergency classification level would be via IC RS1.

Callaway Basis Reference(s):

1. APA-ZZ-01003, Callaway Plant Offsite Dose Calculation Manual Section 2.2.3
2. NEI 99-01, AA1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

Category: R – Abnormal Rad Levels / Rad Effluent

Subcategory: 1 – Radiological Effluent

Initiating Condition: Release of gaseous or liquid radioactivity resulting in offsite dose greater than 10 mrem TEDE or 50 mrem thyroid CDE.

EAL:

RA1.4 Alert

Field survey results indicate **EITHER** of the following at or beyond the SITE BOUNDARY:

- Closed window dose rates > 10 mR/hr expected to continue for ≥ 60 min.
- Analyses of field survey samples indicate thyroid CDE > 50 mrem for 60 min. of inhalation.

(Notes 1, 2)

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

Note 2: If an ongoing release is detected and the release start time is unknown, assume that the release duration has exceeded the specified time limit.

MODE Applicability:

All

Definition(s):

SITE BOUNDARY - Exclusion Area Boundary is a synonymous term for Site Boundary. The Exclusion Area is defined as the area that encompasses the land surrounding the Plant to a radius of 1,200 meters (3,937 feet) from the midpoint of the Unit 1 Reactor Building and the canceled Unit 2 Reactor Building. Control of access to this is by virtue of ownership and in accordance with 10CFR100.

Basis:

EIP-ZZ-00211, Field Monitoring provides guidance for emergency or post-accident radiological environmental monitoring (ref. 1).

This IC is based solely on field monitoring team results **without** performing calculations using the Unified RASCAL Interface software (URI).

The closed window value is in mR/hr. The analysis of field survey samples is in mrem thyroid CDE for 60 minutes.

This IC addresses a release of gaseous or liquid radioactivity that results in projected or actual offsite doses greater than or equal to 1% of the EPA Protective Action Guides (PAGs). It includes both monitored and un-monitored releases. Releases of this magnitude represent an actual or potential substantial degradation of the level of safety of the plant as indicated by a radiological release that significantly exceeds regulatory limits (e.g., a significant uncontrolled release).

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Radiological effluent EALs are also included to provide a basis for classifying events and conditions that cannot be readily or appropriately classified on the basis of plant conditions alone. The inclusion of both plant condition and radiological effluent EALs more fully addresses the spectrum of possible accident events and conditions.

The TEDE dose is set at 1% of the EPA PAG of 1,000 mrem while the 50 mrem thyroid CDE was established in consideration of the 1:5 ratio of the EPA PAG for TEDE and thyroid CDE.

Classification based on effluent monitor readings assumes that a release path to the environment is established. If the effluent flow past an effluent monitor is known to have stopped due to actions to isolate the release path, then the effluent monitor reading is no longer valid for classification purposes.

Escalation of the emergency classification level would be via IC RS1.

Callaway Basis Reference(s):

1. EIP-ZZ-00211, Field Monitoring
2. NEI 99-01, AA1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** R – Abnormal Rad Levels / Rad Effluent**Subcategory:** 1 – Radiological Effluent**Initiating Condition:** Release of gaseous radioactivity resulting in offsite dose greater than 100 mrem TEDE or 500 mrem thyroid CDE**EAL:****RS1.1 Site Area Emergency**Reading on **any** Table R-1 effluent radiation monitor > column "SAE" for ≥ 15 min.

(Notes 1, 2, 3, 4)

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.*Note 2:* If an ongoing release is detected and the release start time is unknown, assume that the release duration has exceeded the specified time limit.*Note 3:* If the effluent flow past an effluent monitor is known to have stopped, indicating that the release path is isolated, the effluent monitor reading is no longer VALID for classification purposes.*Note 4:* The pre-calculated effluent monitor values presented in EALs RA1.1, RS1.1 and RG1.1 should be used for emergency classification assessments until the results from a dose assessment using actual meteorology are available.

Table R-1 Effluent Monitor Classification Thresholds						
Release Point		Monitor	GE	SAE	Alert	UE
Gaseous	Unit Vent	GT-RE-21B	6.59E+7 $\mu\text{Ci/sec}$	6.59E+6 $\mu\text{Ci/sec}$	6.59E+5 $\mu\text{Ci/sec}$	2 X Hi-Hi alarm
	ASD Monitors (A/B/C/D)	AB-RE-111/112/ 113/114	12 mR/hr	1.2 mR/hr	----	----
	TD AFW Steam Discharge	FC-RE-385	163 mR/hr	16.3 mR/hr	1.6 mR/hr	----
	Radwaste Bldg Vent	GH-RE-10B	----	----	----	2 X Hi-Hi alarm
Liquid	Liquid Radwaste Discharge	HB-RE-18	----	----	----	2 X Hi-Hi alarm

MODE Applicability:

All

Definition(s):

None

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Basis:**

This EAL address gaseous radioactivity releases, that for whatever reason, cause effluent radiation monitor readings corresponding to site boundary doses that exceed either:

- 100 mRem TEDE
- 500 mRem CDE Thyroid

Classification based on effluent monitor readings assumes that a release path to the environment is established. If the effluent flow past an effluent monitor is known to have stopped due to actions to isolate the release path, then the effluent monitor reading is no longer valid for classification purposes.

To clarify Note 4, if a threshold value is met in Table R-1 for a classification, there is a 15 minute time limit to make the classification (RS1.1). If Dose Assessment (URI/RASCAL) is available it should be used instead (RS1.2) since it is more accurate than the values in Table R-1. However the Dose Assessment personnel must be able to calculate results within 15 minutes of the Table R-1 value being exceeded OR the classification should be made using Table R-1 (RS1.1).

The RM-11 Channel Number 213 is utilized for the Unit Vent (GT-RE-21B) reading for Table R-1. This channel is read out in $\mu\text{Ci}/\text{sec}$ while all others are read out in $\mu\text{Ci}/\text{ml}$.

The column "SAE" gaseous effluent release value in Table R-1 corresponds to calculated doses of 10% of the EPA Protective Action Guidelines (TEDE or CDE Thyroid) (ref. 1).

This IC addresses a release of gaseous radioactivity that results in projected or actual offsite doses greater than or equal to 10% of the EPA Protective Action Guides (PAGs). It includes both monitored and un-monitored releases. Releases of this magnitude are associated with the failure of plant systems needed for the protection of the public.

Radiological effluent EALs are also included to provide a basis for classifying events and conditions that cannot be readily or appropriately classified on the basis of plant conditions alone. The inclusion of both plant condition and radiological effluent EALs more fully addresses the spectrum of possible accident events and conditions.

The TEDE dose is set at 10% of the EPA PAG of 1,000 mrem while the 500 mrem thyroid CDE was established in consideration of the 1:5 ratio of the EPA PAG for TEDE and thyroid CDE.

Escalation of the emergency classification level would be via IC RG1.

Callaway Basis Reference(s):

1. EPCI 1402, EAL Table R-1 Calculations
2. NEI 99-01, AS1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

Category:R – Abnormal Rad Levels / Rad Effluent

Subcategory: 1 – Radiological Effluent

Initiating Condition: Release of gaseous radioactivity resulting in offsite dose greater than 100 mrem TEDE or 500 mrem thyroid CDE

EAL:

RS1.2 Site Area Emergency

Dose assessment using actual meteorology indicates doses > 100 mrem TEDE or 500 mrem thyroid CDE at or beyond the SITE BOUNDARY.

MODE Applicability:

All

Definition(s):

SITE BOUNDARY - Exclusion Area Boundary is a synonymous term for Site Boundary. The Exclusion Area is defined as the area that encompasses the land surrounding the Plant to a radius of 1,200 meters (3,937 feet) from the midpoint of the Unit 1 Reactor Building and the canceled Unit 2 Reactor Building. Control of access to this is by virtue of ownership and in accordance with 10CFR100.

Basis:

Dose assessments are performed by computer-based method (ref. 1, 2)

This IC is used based on results from the Unified RASCAL Interface software (URI) regardless of the input source. This value is in mrem TEDE or thyroid CDE.

This IC addresses a release of gaseous radioactivity that results in projected or actual offsite doses greater than or equal to 10% of the EPA Protective Action Guides (PAGs). It includes both monitored and un-monitored releases. Releases of this magnitude are associated with the failure of plant systems needed for the protection of the public.

Radiological effluent EALs are also included to provide a basis for classifying events and conditions that cannot be readily or appropriately classified on the basis of plant conditions alone. The inclusion of both plant condition and radiological effluent EALs more fully addresses the spectrum of possible accident events and conditions.

The TEDE dose is set at 10% of the EPA PAG of 1,000 mrem while the 500 mrem thyroid CDE was established in consideration of the 1:5 ratio of the EPA PAG for TEDE and thyroid CDE.

Classification based on effluent monitor readings assumes that a release path to the environment is established. If the effluent flow past an effluent monitor is known to have stopped due to actions to isolate the release path, then the effluent monitor reading is no longer valid for classification purposes.

Escalation of the emergency classification level would be via IC RG1.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

Callaway Basis Reference(s):

1. EIP-ZZ-01211, Accident Dose Assessment
2. EPCI 1402, EAL Table R-1 Calculations
3. NEI 99-01, AS1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

Category: R – Abnormal Rad Levels / Rad Effluent

Subcategory: 1 – Radiological Effluent

Initiating Condition: Release of gaseous radioactivity resulting in offsite dose greater than 100 mrem TEDE or 500 mrem thyroid CDE

EAL:

RS1.3 Site Area Emergency

Field survey results indicate **EITHER** of the following at or beyond the SITE BOUNDARY:

- Closed window dose rates > 100 mR/hr expected to continue for ≥ 60 min.
- Analyses of field survey samples indicate thyroid CDE > 500 mrem for 60 min. of inhalation.

(Notes 1, 2)

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

Note 2: If an ongoing release is detected and the release start time is unknown, assume that the release duration has exceeded the specified time limit.

MODE Applicability:

All

Definition(s):

SITE BOUNDARY - Exclusion Area Boundary is a synonymous term for Site Boundary. The Exclusion Area is defined as the area that encompasses the land surrounding the Plant to a radius of 1,200 meters (3,937 feet) from the midpoint of the Unit 1 Reactor Building and the canceled Unit 2 Reactor Building. Control of access to this is by virtue of ownership and in accordance with 10CFR100.

Basis:

EIP-ZZ-00211, Field Monitoring provides guidance for emergency or post-accident radiological environmental monitoring (ref. 1).

This IC is based solely on field monitoring team results **without** performing calculations using the Unified RASCAL Interface software (URI).

The closed window value is in mR/hr. The analysis of field survey samples is in mrem thyroid CDE for 60 minutes.

This IC addresses a release of gaseous radioactivity that results in projected or actual offsite doses greater than or equal to 10% of the EPA Protective Action Guides (PAGs). It includes both monitored and un-monitored releases. Releases of this magnitude are associated with the failure of plant systems needed for the protection of the public.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Radiological effluent EALs are also included to provide a basis for classifying events and conditions that cannot be readily or appropriately classified on the basis of plant conditions alone. The inclusion of both plant condition and radiological effluent EALs more fully addresses the spectrum of possible accident events and conditions.

The TEDE dose is set at 10% of the EPA PAG of 1,000 mrem while the 500 mrem thyroid CDE was established in consideration of the 1:5 ratio of the EPA PAG for TEDE and thyroid CDE.

Escalation of the emergency classification level would be via IC RG1.

Callaway Basis Reference(s):

1. EIP-ZZ-00211, Field Monitoring
2. NEI 99-01, AS1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** R – Abnormal Rad Levels / Rad Effluent**Subcategory:** 1 – Radiological Effluent**Initiating Condition:** Release of gaseous radioactivity resulting in offsite dose greater than 1,000 mrem TEDE or 5,000 mrem thyroid CDE**EAL:****RG1.1 General Emergency**Reading on **any** Table R-1 effluent radiation monitor > column "GE" for ≥ 15 min.

(Notes 1, 2, 3, 4)

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.*Note 2:* If an ongoing release is detected and the release start time is unknown, assume that the release duration has exceeded the specified time limit.*Note 3:* If the effluent flow past an effluent monitor is known to have stopped, indicating that the release path is isolated, the effluent monitor reading is no longer VALID for classification purposes.*Note 4:* The pre-calculated effluent monitor values presented in EALs RA1.1, RS1.1 and RG1.1 should be used for emergency classification assessments until the results from a dose assessment using actual meteorology are available.

Table R-1 Effluent Monitor Classification Thresholds						
Release Point		Monitor	GE	SAE	Alert	UE
Gaseous	Unit Vent	GT-RE-21B	6.59E+7 $\mu\text{Ci/sec}$	6.59E+6 $\mu\text{Ci/sec}$	6.59E+5 $\mu\text{Ci/sec}$	2 X Hi-Hi alarm
	ASD Monitors (A/B/C/D)	AB-RE-111/112/ 113/114	12 mR/hr	1.2 mR/hr	----	----
	TD AFW Steam Discharge	FC-RE-385	163 mR/hr	16.3 mR/hr	1.6 mR/hr	----
	Radwaste Bldg Vent	GH-RE-10B	----	----	----	2 X Hi-Hi alarm
Liquid	Liquid Radwaste Discharge	HB-RE-18	----	----	----	2 X Hi-Hi alarm

MODE Applicability:

All

Definition(s):

None

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Basis:**

This EAL address gaseous radioactivity releases, that for whatever reason, cause effluent radiation monitor readings corresponding to site boundary doses that exceed either:

- 1000 mRem TEDE
- 5000 mRem CDE Thyroid

Classification based on effluent monitor readings assumes that a release path to the environment is established. If the effluent flow past an effluent monitor is known to have stopped due to actions to isolate the release path, then the effluent monitor reading is no longer valid for classification purposes.

To clarify Note 4, if a threshold value is met in Table R-1 for a classification, there is a 15 minute time limit to make the classification (RG1.1). If Dose Assessment (URI/RASCAL) is available it should be used instead (RG1.2) since it is more accurate than the values in Table R-1. However the Dose Assessment personnel must be able to calculate results within 15 minutes of the Table R-1 value being exceeded OR the classification should be made using Table R-1 (RG1.1).

The RM-11 Channel Number 213 is utilized for the Unit Vent (GT-RE-21B) reading for Table R-1. This channel is read out in $\mu\text{Ci}/\text{sec}$ while all others are read out in $\mu\text{Ci}/\text{ml}$.

The column "GE" gaseous effluent release values in Table R-1 correspond to calculated doses of 100% of the EPA Protective Action Guidelines (TEDE or CDE Thyroid) (ref. 1).

This IC addresses a release of gaseous radioactivity that results in projected or actual offsite doses greater than or equal to the EPA Protective Action Guides (PAGs). It includes both monitored and un-monitored releases. Releases of this magnitude will require implementation of protective actions for the public.

Radiological effluent EALs are also included to provide a basis for classifying events and conditions that cannot be readily or appropriately classified on the basis of plant conditions alone. The inclusion of both plant condition and radiological effluent EALs more fully addresses the spectrum of possible accident events and conditions.

The TEDE dose is set at the EPA PAG of 1,000 mrem while the 5,000 mrem thyroid CDE was established in consideration of the 1:5 ratio of the EPA PAG for TEDE and thyroid CDE.

Callaway Basis Reference(s):

1. EPCI 1402, EAL Table R-1 Calculations
2. NEI 99-01, AG1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: R – Abnormal Rad Levels / Rad Effluent
Subcategory: 1 – Radiological Effluent
Initiating Condition: Release of gaseous radioactivity resulting in offsite dose greater than 1,000 mrem TEDE or 5,000 mrem thyroid CDE

EAL:**RG1.2 General Emergency**

Dose assessment using actual meteorology indicates doses > 1,000 mrem TEDE or 5,000 mrem thyroid CDE at or beyond the SITE BOUNDARY.

MODE Applicability:

All

Definition(s):

SITE BOUNDARY - Exclusion Area Boundary is a synonymous term for Site Boundary. The Exclusion Area is defined as the area that encompasses the land surrounding the Plant to a radius of 1,200 meters (3,937 feet) from the midpoint of the Unit 1 Reactor Building and the canceled Unit 2 Reactor Building. Control of access to this is by virtue of ownership and in accordance with 10CFR100.

Basis:

Dose assessments are performed by computer-based method (ref. 1, 2)

This IC is used based on results from the Unified RASCAL Interface software (URI) regardless of the input source. This value is in mrem TEDE or thyroid CDE.

This IC addresses a release of gaseous radioactivity that results in projected or actual offsite doses greater than or equal to the EPA Protective Action Guides (PAGs). It includes both monitored and un-monitored releases. Releases of this magnitude will require implementation of protective actions for the public.

Radiological effluent EALs are also included to provide a basis for classifying events and conditions that cannot be readily or appropriately classified on the basis of plant conditions alone. The inclusion of both plant condition and radiological effluent EALs more fully addresses the spectrum of possible accident events and conditions.

The TEDE dose is set at the EPA PAG of 1,000 mrem while the 5,000 mrem thyroid CDE was established in consideration of the 1:5 ratio of the EPA PAG for TEDE and thyroid CDE.

Classification based on effluent monitor readings assumes that a release path to the environment is established. If the effluent flow past an effluent monitor is known to have stopped due to actions to isolate the release path, then the effluent monitor reading is no longer valid for classification purposes.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Callaway Basis Reference(s):**

1. EIP-ZZ-01211, Accident Dose Assessment
2. EPCI 1402, EAL Table R-1 Calculations
3. NEI 99-01, AG1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** R – Abnormal Rad Levels / Rad Effluent**Subcategory:** 1 – Radiological Effluent**Initiating Condition:** Release of gaseous radioactivity resulting in offsite dose greater than 1,000 mrem TEDE or 5,000 mrem thyroid CDE**EAL:****RG1.3 General Emergency**Field survey results indicate **EITHER** of the following at or beyond the SITE BOUNDARY:

- Closed window dose rates > 1,000 mR/hr expected to continue for ≥ 60 min.
- Analyses of field survey samples indicate thyroid CDE > 5,000 mrem for 60 min. of inhalation.

(Notes 1, 2)

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

Note 2: If an ongoing release is detected and the release start time is unknown, assume that the release duration has exceeded the specified time limit.

MODE Applicability:

All

Definition(s):

SITE BOUNDARY - Exclusion Area Boundary is a synonymous term for Site Boundary. The Exclusion Area is defined as the area that encompasses the land surrounding the Plant to a radius of 1,200 meters (3,937 feet) from the midpoint of the Unit 1 Reactor Building and the canceled Unit 2 Reactor Building. Control of access to this is by virtue of ownership and in accordance with 10CFR100.

Basis:

EIP-ZZ-00211, Field Monitoring provides guidance for emergency or post-accident radiological environmental monitoring (ref. 1).

This IC is based solely on field monitoring team results **without** performing calculations using the Unified RASCAL Interface software (URI).

The closed window value is in mR/hr. The analysis of field survey samples is in mrem thyroid CDE for 60 minutes.

This IC addresses a release of gaseous radioactivity that results in projected or actual offsite doses greater than or equal to the EPA Protective Action Guides (PAGs). It includes both monitored and un-monitored releases. Releases of this magnitude will require implementation of protective actions for the public.

Radiological effluent EALs are also included to provide a basis for classifying events and conditions that cannot be readily or appropriately classified on the basis of plant conditions alone. The inclusion of both plant condition and radiological effluent EALs more fully addresses the spectrum of possible accident events and conditions.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

The TEDE dose is set at the EPA PAG of 1,000 mrem while the 5,000 mrem thyroid CDE was established in consideration of the 1:5 ratio of the EPA PAG for TEDE and thyroid CDE.

Callaway Basis Reference(s):

1. EIP-ZZ-00211, Field Monitoring
2. NEI 99-01, AG1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: R – Abnormal Rad Levels / Rad Effluent

Subcategory: 2 – Irradiated Fuel Event

Initiating Condition: Unplanned loss of water level above irradiated fuel

EAL:

RU2.1 Unusual Event

UNPLANNED water level drop in the REFUELING PATHWAY as indicated by low water level alarm or indication (EC LI-0039A, EC LI-0039B, local observation of SFP level).

AND

UNPLANNED rise in corresponding area radiation levels as indicated by **any** Table R-2 radiation monitors.

Table R-2 Fuel Building & Containment Area Radiation Monitors**Fuel Building:**

- SD-RE-34, Cask Handle Area Radiation
- SD-RE-35, New Fuel Storage Area Radiation
- SD-RE-36, New Fuel Storage Area Radiation
- SD-RE-37, Fuel Pool Bridge Crane Radiation
- SD-RE-38, Spent Fuel Pool Area Radiation

Containment:

- SD RE 40, Personnel Access Hatch Area
- SD RE 41, Manipulator Crane Radiation Monitor
- SD RE 42, Containment Building Radiation
- GT RE 59 Containment High Area Radiation Monitor
- GT RE 60 Containment High Area Radiation Monitor

MODE Applicability:

All

Definition(s):

UNPLANNED - A parameter change or an event that is not 1) the result of an intended evolution or 2) an expected plant response to a transient. The cause of the parameter change or event may be known or unknown.

REFUELING PATHWAY - The reactor refueling cavity, spent fuel pool and fuel transfer canal comprise the refueling pathway.

Basis:

The low water level alarm in this EAL refers to the Spent Fuel Pool (SFP) low level alarm (Annunciator 76D, SFP LEV HI LO) (ref. 1). During the fuel transfer phase of refueling operations, the fuel transfer canal is normally in communication with the spent fuel pool and the refueling pool in the Containment is in communication with the fuel transfer canal when the fuel transfer tube is open. A lowering in water level in the SFP, fuel transfer canal or refueling pool is therefore sensed by the SFP low level alarm. Neither the refueling pool nor the fuel transfer canal is equipped with a low level alarm (ref. 1). The SFP level is remotely monitored by level indicator EC LI-0039A. The level switch initiates high and low level annunciators

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Technical Specification 3.7.15 (ref. 2) requires at least 23 ft. of water above the Spent Fuel Pool storage racks. Technical Specification 3.9.7 (ref. 3) requires at least 23 ft. of water above the Reactor Vessel flange in the refueling pool. During refueling, this maintains sufficient water level in the fuel transfer canal, refueling pool, and SFP to retain iodine fission product activity in the water in the event of a fuel handling accident.

The Table R-2 radiation monitors are those expected to see increase area radiation levels as a result of a loss of REFUELING PATHWAY inventory (ref. 1). Increasing radiation indications on these monitors in the absence of indications of decreasing REFUELING CAVITY level are not classifiable under this EAL.

When the spent fuel pool and reactor cavity are connected, there could exist the possibility of uncovering irradiated fuel. Therefore, this EAL is applicable for conditions in which irradiated fuel is being transferred to and from the reactor vessel and spent fuel pool.

This IC addresses a decrease in water level above irradiated fuel sufficient to cause elevated radiation levels. This condition could be a precursor to a more serious event and is also indicative of a minor loss in the ability to control radiation levels within the plant. It is therefore a potential degradation in the level of safety of the plant.

A water level decrease will be primarily determined by indications from available level instrumentation. Other sources of level indications may include reports from plant personnel (e.g., from a refueling crew) or video camera observations (if available). A significant drop in the water level may also cause an increase in the radiation levels of adjacent areas that can be detected by monitors in those locations.

The effects of planned evolutions should be considered. For example, a refueling bridge area radiation monitor reading may increase due to planned evolutions such as lifting of the reactor vessel head or movement of a fuel assembly. Note that this EAL is applicable only in cases where the elevated reading is due to an unplanned loss of water level.

A drop in water level above irradiated fuel within the reactor vessel may be classified in accordance Recognition Category C during the Cold Shutdown and Refueling MODES.

Escalation of the emergency classification level would be via IC RA2.

Callaway Basis Reference(s):

1. OTO-EC-00001, Loss of Spent Fuel Pool/Refuel Pool Level
2. Technical Specification 3.7.15, Fuel Storage Pool Water Level
3. Technical Specification 3.9.7, Refueling Pool Water Level
4. NEI 99-01, AU2

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** R – Abnormal Rad Levels / Rad Effluent**Subcategory:** 2 – Irradiated Fuel Event**Initiating Condition:** Significant lowering of water level above, or damage to, irradiated fuel**EAL:****RA2.1 Alert**

Uncovery of irradiated fuel in the REFUELING PATHWAY.

MODE Applicability:

All

Definition(s):*REFUELING PATHWAY* - The reactor refueling cavity, spent fuel pool and fuel transfer canal comprise the refueling pathway.**Basis:**

This IC addresses events that have caused imminent or actual damage to an irradiated fuel assembly, or a significant lowering of water level within the spent fuel pool. These events present radiological safety challenges to plant personnel and are precursors to a release of radioactivity to the environment. As such, they represent an actual or potential substantial degradation of the level of safety of the plant.

This EAL escalates from RU2.1 in that the loss of level, in the affected portion of the REFUELING PATHWAY, is of sufficient magnitude to have resulted in uncovery of irradiated fuel. Indications of irradiated fuel uncovery may include direct or indirect visual observation (e.g., reports from personnel or camera images), as well as significant changes in water and radiation levels, or other plant parameters. Computational aids may also be used (e.g., a boil-off curve). Classification of an event using this EAL should be based on the totality of available indications, reports and observations.

While an area radiation monitor could detect an increase in a dose rate due to a lowering of water level in some portion of the REFUELING PATHWAY, the reading may not be a reliable indication of whether or not the fuel is actually uncovery. To the degree possible, readings should be considered in combination with other available indications of inventory loss.

A drop in water level above irradiated fuel within the reactor vessel may require classification in accordance Recognition Category C during the Cold Shutdown and Refueling MODES.

Escalation of the emergency classification level would be via IC RS1.

Callaway Basis Reference(s):

1. OTO-EC-00001, Loss of Spent Fuel Pool/Refuel Pool Level
2. NEI 99-01, AA2

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** R – Abnormal Rad Levels / Rad Effluent**Subcategory:** 2 – Irradiated Fuel Event**Initiating Condition:** Significant lowering of water level above, or damage to, irradiated fuel**EAL:****RA2.2 Alert**

Damage to irradiated fuel resulting in a release of radioactivity from the fuel as indicated by **any** of the following:

- Hi-Hi Alarm on Fuel Building exhaust monitors (GG-RE-27 or 28).
- Manipulator crane radiation monitor (SD-RE-41) >100 mR/hr.
- Fuel Pool Bridge Crane OR Spent Fuel Pool Area radiation monitor (SD-RE-37 or 38) > 30 mR/hr.

MODE Applicability:

All

Definition(s):

None

Basis:

The specified radiation monitors are those expected to see increase area radiation levels as a result of damage to irradiated fuel (ref. 1, 2).

The bases for the SFP ventilation radiation Hi-Hi alarm and the SFP and containment area radiation readings are a spent fuel handling accident (ref. 2, 3). In the Fuel Handling Building, a fuel assembly could be dropped in the fuel transfer canal or in the SFP. Should a fuel assembly be dropped in the fuel transfer canal or in the SFP and release radioactivity above a prescribed level, the fuel handling building ventilation monitors sound an alarm, alerting personnel to the problem (ref. 1, 2, 3, 4).

This IC addresses events that have caused imminent or actual damage to an irradiated fuel assembly, or a significant lowering of water level within the spent fuel pool. These events present radiological safety challenges to plant personnel and are precursors to a release of radioactivity to the environment. As such, they represent an actual or potential substantial degradation of the level of safety of the plant.

This EAL applies to irradiated fuel that is licensed for dry storage up to the point that the loaded storage cask is sealed. Once sealed, damage to a loaded cask causing loss of the CONFINEMENT BOUNDARY is classified in accordance with EU1.1. Cask is sealed when welding is complete.

Escalation of the emergency would be based on either Recognition Category R or C ICs.

Escalation of the emergency classification level would be via IC RS1.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Callaway Basis Reference(s):**

1. OTO-EC-00001, Loss of Spent Fuel Pool/Refuel Pool Level
2. OTO-KE-00001, Fuel Handling Accident
3. Calc. EPCI 98-01, Emergency Action Level Bases
4. Calc. HPCI 05-02, Gaseous and Liquid Radiation Monitor Setpoints
5. NEI 99-01, AA2

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: R – Abnormal Rad Levels / Rad Effluent
Subcategory: 2 – Irradiated Fuel Event
Initiating Condition: Significant lowering of water level above, or damage to, irradiated fuel
EAL:

RA2.3 Alert

Lowering of spent fuel pool level to 120" as indicated on EC-LI-0059A or EC-LI-0060A.

MODE Applicability:

All

Definition(s):

None

Basis:

Post-Fukushima order EA-12-051 (ref. 1) required the installation of reliable SFP level indication capable of identifying normal level (Level 1), SFP level 10 ft. above the top of the fuel racks (Level 2) and SFP level at the top of the fuel racks (Level 3).

For Callaway Plant SFP Level 2 is plant elevation 2031 ft. 1.25 in. (~9 ft. 11 in. above the top of the spent fuel racks) as indicated by 120" on EC-LI-0059A in the Auxiliary Building Hallway 2026. Backup indication is also available on EC-LI-0060A in the Auxiliary Building hallway 2026.

This IC addresses events that have caused imminent or actual damage to an irradiated fuel assembly, or a significant lowering of water level within the spent fuel pool. These events present radiological safety challenges to plant personnel and are precursors to a release of radioactivity to the environment. As such, they represent an actual or potential substantial degradation of the level of safety of the plant.

Escalation of the emergency would be based on either Recognition Category R or C ICs.

Spent fuel pool water level at this value is within the lower end of the level range necessary to prevent significant dose consequences from direct gamma radiation to personnel performing operations in the vicinity of the spent fuel pool. This condition reflects a significant loss of spent fuel pool water inventory and thus it is also a precursor to a loss of the ability to adequately cool the irradiated fuel assemblies stored in the pool.

Escalation of the emergency classification level would be via IC RS2.

Callaway Basis Reference(s):

1. NRC EA-12-51, Issuance of Order to Modify Licenses with Regard to Reliable Spent Fuel Pool Instrumentation
2. SFPIS Mod Overview for EP
3. NEI 99-01, AA2

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: R – Abnormal Rad Levels / Rad Effluent
Subcategory: 2 – Irradiated Fuel Event
Initiating Condition: Spent fuel pool level at the top of the fuel racks
EAL:

RS2.1 Site Area Emergency

Lowering of spent fuel pool level to 12" as indicated on EC-LI-0059A or EC-LI-0060A.

MODE Applicability:

All

Definition(s):

None

Basis:

Post-Fukushima order EA-12-051 (ref. 1) required the installation of reliable SFP level indication capable of identifying normal level (Level 1), SFP level 10 ft. above the top of the fuel racks (Level 2) and SFP level at the top of the fuel racks (Level 3).

For Callaway Plant SFP Level 3 has been set at a plant elevation 2022 ft. 1.25 in. (~11 in. above the top of the spent fuel racks) as indicated by 12" on EC-LI-0059A in the Auxiliary Building Hallway 2026. Backup indication is also available on EC-LI-0060A in the Auxiliary Building hallway 2026.

This EAL addresses a significant loss of spent fuel pool inventory control and makeup capability leading to IMMINENT fuel damage. This condition entails major failures of plant functions needed for protection of the public and thus warrant a Site Area Emergency declaration.

It is recognized that this IC would likely not be met until well after another Site Area Emergency IC was met; however, it is included to provide classification diversity.

Escalation of the emergency classification level would be via IC RG1 or RG2.

Callaway Basis Reference(s):

1. NRC EA-12-51, Issuance of Order to Modify Licenses with Regard to Reliable Spent Fuel Pool Instrumentation
2. SFPIS Mod Overview for EP
3. NEI 99-01, AS2

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: R – Abnormal Rad Levels / Rad Effluent

Subcategory: 2 – Irradiated Fuel Event

Initiating Condition: Spent fuel pool level cannot be restored to at least the top of the fuel racks for 60 minutes or longer

EAL:**RG2.1 General Emergency**

Spent fuel pool level cannot be restored to at least 12" as indicated on EC-LI-0059A or EC-LI-0060A for ≥ 60 min.

(Note 1)

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

MODE Applicability:

All

Definition(s):

None

Basis:

Post-Fukushima order EA-12-051 (ref. 1) required the installation of reliable SFP level indication capable of identifying normal level (Level 1), SFP level 10 ft. above the top of the fuel racks (Level 2) and SFP level at the top of the fuel racks (Level 3).

For Callaway Plant SFP Level 3 has been set at a plant elevation 2022 ft. 1.25 in. (~11 in. above the top of the spent fuel racks) as indicated by 12" on EC-LI-0059A in the Auxiliary Building Hallway 2026. Backup indication is also available on EC-LI-0060A in the Auxiliary Building hallway 2026.

This EAL addresses a significant loss of spent fuel pool inventory control and makeup capability leading to a prolonged uncover of spent fuel. This condition will lead to fuel damage and a radiological release to the environment.

It is recognized that this IC would likely not be met until well after another General Emergency IC was met; however, it is included to provide classification diversity.

Callaway Basis Reference(s):

1. NRC EA-12-51, Issuance of Order to Modify Licenses with Regard to Reliable Spent Fuel Pool Instrumentation
2. SFPIS Mod Overview for EP
3. NEI 99-01, AG2

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** R – Abnormal Rad Levels / Rad Effluent**Subcategory:** 3 – Area Radiation Levels**Initiating Condition:** Radiation levels that IMPEDE access to equipment necessary for normal plant operations, cooldown or shutdown**EAL:****RA3.1 Alert**Dose rates > 15 mR/hr in **EITHER** of the following areas:

- Control Room (SD-RE-33).
- Central Alarm Station (by survey).

MODE Applicability:

All

Definition(s):

None

Basis:

Areas that meet this threshold include the Control Room and the Central Alarm Station (CAS). SD-RE-33 monitors the Control room for area radiation (ref. 1). The CAS is included in this EAL because of its' importance to permitting access to areas required to assure safe plant operations.

There is no permanently installed CAS area radiation monitors that may be used to assess this EAL threshold. Therefore this threshold must be assessed via local radiation survey for the CAS (ref. 1).

This IC addresses elevated radiation levels in certain plant rooms/areas sufficient to preclude or impede personnel from performing actions necessary to maintain normal plant operation, or to perform a normal plant cooldown and shutdown. As such, it represents an actual or potential substantial degradation of the level of safety of the plant. The Emergency Coordinator should consider the cause of the increased radiation levels and determine if another IC may be applicable.

Escalation of the emergency classification level would be via Recognition Category R, C or F ICs.

Callaway Basis Reference(s):

1. FSAR Section 12.3, Table 12.3-2, Area Radiation Monitors
2. NEI 99-01, AA3

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** R – Abnormal Rad Levels / Rad Effluent**Subcategory:** 3 – Area Radiation Levels**Initiating Condition:** Radiation levels that IMPEDE access to equipment necessary for normal plant operations, cooldown or shutdown**EAL:****RA3.2 Alert**

An UNPLANNED event results in radiation levels that prohibit or IMPEDE access to **EITHER** of the following: *(Note 5)*

- North Electrical Penetration Room. *(Room 1410)*
- South Electrical Penetration Room. *(Room 1409)*

Note 5: If the equipment in the listed room or area was already inoperable or out-of-service before the event occurred, then no emergency classification is warranted.

MODE Applicability:

4 – Hot Shutdown

Definition(s):

IMPEDE(D) - Personnel access to a room or area is hindered to an extent that extraordinary measures are necessary to facilitate entry of personnel into the affected room/area (e.g., requiring use of protective equipment, such as SCBAs, that is not routinely employed).

UNPLANNED - A parameter change or an event that is not 1) the result of an intended evolution or 2) an expected plant response to a transient. The cause of the parameter change or event may be known or unknown.

Basis:

The only rooms/areas external to the Control Room that require access to perform field actions consistent with the above criteria for Callaway are the North and South Electrical Penetration Rooms when in MODE 4 to support isolating SI accumulators and placing RHR in service for RCS cooldown to Cold Shutdown (ref. 1, 2, 3). The equipment required is:

For SI Accumulators:

- NG01BGF3, FDR BKR TO EPHV8808A SI ACC A OUT ISO, *(Room 1410)*
- NG02BGF3, FDR BKR TO EPHV8808B SI ACC B OUT ISO, *(Room 1409)*
- NG01BGF2, FDR BKR TO EPHV8808C SI ACC C OUT ISO, *(Room 1410)*
- NG02BHF2, FDR BKR TO EPHV8808D SI ACC D OUT ISO, *(Room 1409)*

For "A" RHR:

- NG02BCF2, FDR BKR TO BBPV8702A RCS LOOP 1 HOT LEG TO RHR PMPS ISO, *(Room 1409)*
- NG01BEF2, FDR BKR TO EJHV8701A A RHR PMP SUCT FROM RCS HOT LEG 1 ISO, *(Room 1410)*

For "B" RHR:

- NG02BBF3, FDR BKR TO BBPV8702B RCS LOOP 4 HOT LEG TO RHR PMPS ISO, *(Room 1409)*
- NG01BDF3, FDR BKR TO EJHV8701B B RHR PMP SUCT FROM RCS HOT LEG 4 ISO, *(Room 1410)*

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

This IC addresses elevated radiation levels in certain plant rooms/areas sufficient to preclude or impede personnel from performing actions necessary to maintain normal plant operation, or to perform a normal plant cooldown and shutdown. As such, it represents an actual or potential substantial degradation of the level of safety of the plant. The Emergency Coordinator should consider the cause of the increased radiation levels and determine if another IC may be applicable.

Alert declaration is warranted if entry into the affected room/area is, or may be, procedurally required during the plant operating MODE in effect at the time of the elevated radiation levels. The emergency classification is not contingent upon whether entry is actually necessary at the time of the increased radiation levels. Access should be considered as **IMPEDED** if extraordinary measures are necessary to facilitate entry of personnel into the affected room/area (e.g., installing temporary shielding, requiring use of non-routine protective equipment, requesting an extension in dose limits beyond normal administrative limits).

An emergency declaration is not warranted if any of the following conditions apply:

- The plant is NOT in MODE 4.
- The increased radiation levels are a result of a planned activity that includes compensatory measures which address the temporary inaccessibility of a room or area (e.g., radiography, spent filter or resin transfer, etc.).
- The action for which room/area entry is required is of an administrative or record keeping nature (e.g., normal rounds or routine inspections).
- The access control measures are of a conservative or precautionary nature, and would not actually prevent or impede a required action.

Escalation of the emergency classification level would be via Recognition Category R, C or F ICs.

Callaway Basis Reference(s):

1. OTG-ZZ-00006 Addendum 06, Securing Safety Injection Accumulators
2. OTN-EJ-00001 Addendum 3, Placing A RHR Train In Service for RCS Cooldown
3. OTN-EJ-00001 Addendum 4, Placing B RHR Train In Service for RCS Cooldown
4. NEI 99-01, AA3

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category E – Independent Spent Fuel Storage Installation (ISFSI)**

EAL Group: Any (EALs in this category are applicable to All, Hot, or Cold plant conditions.)

An independent spent fuel storage installation (ISFSI) is a facility that is designed and constructed for the interim storage of spent nuclear fuel and other radioactive materials associated with spent fuel storage. A significant amount of the radioactive material contained within a canister must escape its packaging and enter the biosphere for there to be a significant environmental effect resulting from an accident involving the dry storage of spent nuclear fuel.

An Unusual Event is declared on the basis of the occurrence of an event of sufficient magnitude that a loaded cask confinement boundary is damaged or violated.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

Category: E – Independent Spent Fuel Storage Installation (ISFSI)
Subcategory: 1 – Confinement Boundary
Initiating Condition: Damage to a loaded cask CONFINEMENT BOUNDARY
EAL:

EU1.1 Unusual Event

Damage to a loaded cask CONFINEMENT BOUNDARY as indicated by an on-contact radiation reading > **EITHER** of the following:

- 60 mrem/hr (gamma + neutron) on the top of the closure lid of the Overpack/VVM.
- 7,000 mrem/hr (gamma + neutron) on the side of the Transfer Cask.

MODE Applicability:

All

Definition(s):

CONFINEMENT BOUNDARY - The barrier(s) between spent fuel and the environment once the spent fuel is processed for dry storage. As applied to the Callaway ISFSI, the CONFINEMENT BOUNDARY is defined to be the Multi-Purpose Canister (MPC).

OVERPACK – For the HI-Storm UMAX, the term OVERPACK is synonymous with the term VVM.

TRANSFER CASK – Containers designed to contain the MPC during and after loading of spent fuel assemblies, and prior to and during unloading and to transfer the MPC to or from the overpack/VVM

VERTICAL VENTILATED MODULE (VVM) – A subterranean type overpack which receives and contains the sealed MPC for interim storage at the ISFSI. The VVM supports the MPC in a vertical orientation and provide gamma and neutron shielding and also provides air flow through cooling passages to promote heat transfer from the MPC to the environs.

Basis:

Confinement boundary is established at Callaway when the Multi-Purpose Canister welding is complete.

Overpacks/VVM casks receive and contain the sealed MPCs for interim storage in the ISFSI. They provide gamma and neutron shielding, and provide for ventilated air flow to promote heat transfer from the MPC to the environs. The term overpack/VVM does not include the transfer cask (ref. 1).

The values shown represents 2 times the limits specified in the ISFSI Certificate of Compliance Technical Specification 5.3.4 for radiation external to either a loaded MPC overpack/VVM or transfer cask (ref. 1).

This IC addresses an event that results in damage to the CONFINEMENT BOUNDARY of a storage cask containing spent fuel. It applies to irradiated fuel that is licensed for dry storage beginning at the point that the loaded storage cask is sealed. The issues of concern are the creation of a potential or actual release path to the environment, degradation of one or more fuel assemblies due to environmental factors, and configuration changes which could cause challenges in removing the cask or fuel from storage. The cask is sealed when the welding is complete.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

The existence of “damage” is determined by radiological survey. The technical specification multiple of “2 times”, which is also used in Recognition Category R IC RU1, is used here to distinguish between non-emergency and emergency conditions. The emphasis for this classification is the degradation in the level of safety of the spent fuel cask and not the magnitude of the associated dose or dose rate. It is recognized that in the case of extreme damage to a loaded cask, the fact that the “on-contact” dose rate limit is exceeded may be determined based on measurement of a dose rate at some distance from the cask.

Security-related events for ISFSIs are covered under **IC HSI**.

Callaway Basis Reference(s):

1. Certificate of Compliance No. 1040 Appendix A Technical Specifications for the HI-STORM UMAX Canister Storage System
2. NEI 99-01, E-HU1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category C – Cold Shutdown / Refueling System Malfunction**

EAL Group: Cold Conditions (RCS temperature $\leq 200^{\circ}\text{F}$); EALs in this category are applicable only in one or more cold operating MODES.

Category C EALs are directly associated with Cold Shutdown or refueling system safety functions. Given the variability of plant configurations (e.g., systems out-of-service for maintenance, containment open, reduced AC power redundancy, time since shutdown) during these periods, the consequences of any given initiating event can vary greatly. For example, a loss of decay heat removal capability that occurs at the end of an extended outage has less significance than a similar loss occurring during the first week after shutdown. Compounding these events is the likelihood that instrumentation necessary for assessment may also be inoperable. The Cold Shutdown and refueling system malfunction EALs are based on performance capability to the extent possible with consideration given to RCS integrity, containment closure, and fuel clad integrity for the applicable operating MODES (5 - Cold Shutdown, 6 - Refueling, D – Defueled).

The events of this category pertain to the following subcategories:

1. RCS Level

RCS water level is directly related to the status of adequate core cooling and, therefore, fuel clad integrity.

2. Loss of Emergency AC Power

Loss of emergency plant electrical power can compromise plant safety system operability including decay heat removal and emergency core cooling systems which may be necessary to ensure fission product barrier integrity. This category includes loss of onsite and offsite power sources for 4.16KV AC emergency buses.

3. RCS Temperature

Uncontrolled or inadvertent temperature or pressure increases are indicative of a potential loss of safety functions.

4. Loss of Vital DC Power

Loss of emergency plant electrical power can compromise plant safety system operability including decay heat removal and emergency core cooling systems which may be necessary to ensure fission product barrier integrity. This category includes loss of power to or degraded voltage on the 125V DC vital buses.

5. Loss of Communications

Certain events that degrade plant operator ability to effectively communicate with essential personnel within or external to the plant warrant emergency classification.

6. Hazardous Event Affecting Safety Systems

Certain hazardous natural and technological events may result in VISIBLE DAMAGE to or degraded performance of safety systems warranting classification.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** C – Cold Shutdown / Refueling System Malfunction**Subcategory:** 1 – RCS Level**Initiating Condition:** UNPLANNED loss of RCS inventory for 15 minutes or longer**EAL:****CU1.1 Unusual Event**UNPLANNED loss of reactor coolant results in RCS water level less than a required lower limit for ≥ 15 min.*(Note 1)**Note 1:* The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.**MODE Applicability:**

5 - Cold Shutdown, 6 - Refueling

Definition(s):*UNPLANNED* - A parameter change or an event that is not 1) the result of an intended evolution or 2) an expected plant response to a transient. The cause of the parameter change or event may be known or unknown.**Basis:**

With the plant in Cold Shutdown, RCS water level is normally maintained above the pressurizer low level setpoint of 17% (ref. 1). However, if RCS level is being controlled below the pressurizer low level setpoint, or if level is being maintained in a designated band in the reactor vessel it is the inability to maintain level above the low end of the designated control band due to a loss of inventory resulting from a leak in the RCS that is the concern.

With the plant in Refueling MODE, RCS water level is normally maintained at or above the reactor vessel flange (Technical Specification 3.9.7 requires at least 23 ft. of water above the top of the reactor vessel flange in the refueling cavity during refueling operations) (ref. 2).

The Plant Computer System Display called Refuel Level Indications (turn on code RLI) is available to assist in monitoring important parameters crucial to RCS draining operations (ref. 3).

This IC addresses the inability to restore and maintain water level to a required minimum level. This condition is considered to be a potential degradation of the level of safety of the plant.

Refueling evolutions that decrease RCS water inventory are carefully planned and controlled. An UNPLANNED event that results in water level decreasing below a procedurally required limit warrants the declaration of an Unusual Event due to the reduced water inventory that is available to keep the core covered.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

This EAL recognizes that the minimum required RCS level can change several times during the course of a refueling outage as different plant configurations and system lineups are implemented. This EAL is met if the minimum RCS level, specified for the current plant conditions, cannot be maintained for 15 minutes or longer.

The 15-minute threshold duration allows sufficient time for prompt operator actions to restore and maintain the expected water level. This criterion excludes transient conditions causing a brief lowering of water level.

Continued loss of RCS inventory may result in escalation to the Alert emergency classification level via either IC CA1 or CA3.

Callaway Basis Reference(s):

1. FR-I.2, Response to Low Pressurizer Level
2. OTN-BB-00002, Reactor Coolant System Draining
3. Technical Specification 3.9.7, Refueling Pool Water Level
4. NEI 99-01, CU1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** C – Cold Shutdown / Refueling System Malfunction**Subcategory:** 1 – RCS Level**Initiating Condition:** UNPLANNED loss of RCS inventory for 15 minutes or longer**EAL:****CU1.2 Unusual Event**

RCS water level cannot be monitored

AND EITHER

- UNPLANNED increase in **any** Table C-1 sump/tank level due to loss of RCS inventory.
- Visual observation of UNISOLABLE RCS leakage.

Table C-1 Sumps / Tanks

- Containment Sumps
- Containment Normal Sumps
- Containment Instrument Sump
- PRT
- RCDT
- Auxiliary Building Sump

MODE Applicability:

5 - Cold Shutdown, 6 - Refueling

Definition(s):

RCS INTACT - The RCS should be considered intact when the RCS pressure boundary is in its normal condition for the Cold Shutdown MODE of operation (e.g., no freeze seals or nozzle dams). The RCS is capable of being placed in an intact condition by Operator Action, i.e., pressurized to support natural circulation cooling.

UNISOLABLE - An open or breached system line that cannot be isolated, remotely or locally.

UNPLANNED - A parameter change or an event that is not 1) the result of an intended evolution or 2) an expected plant response to a transient. The cause of the parameter change or event may be known or unknown.

Basis:

In Cold Shutdown MODE, the RCS will normally be intact and standard RCS level monitoring means are available.

In the Refuel MODE, the RCS is NOT intact and RPV level may be monitored by different means, including the ability to monitor level visually.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

In this EAL, all water level indication is unavailable and the RCS inventory loss must be detected by indirect leakage indications. Level increases must be evaluated against other potential sources of leakage such as cooling water sources inside the containment to ensure they are indicative of RCS leakage. If the make-up rate to the RCS unexplainably rises above the pre-established rate, a loss of RCS inventory may be occurring even if the source of the leakage cannot be immediately identified. Visual observation of leakage from systems connected to the RCS that cannot be isolated could also be indicative of a loss of RCS inventory (ref. 1, 2).

The Plant Computer System Display called Refuel Level Indications (turn on code RLI) is available to assist in monitoring important parameters crucial to RCS draining operations (ref. 3).

This IC addresses a loss of the ability to monitor RCS level concurrent with indications of coolant leakage. This condition is considered to be a potential degradation of the level of safety of the plant.

Refueling evolutions that decrease RCS water inventory are carefully planned and controlled. An UNPLANNED event that results in water level decreasing below a procedurally required limit warrants the declaration of an Unusual Event due to the reduced water inventory that is available to keep the core covered.

This EAL addresses a condition where all means to determine level have been lost. In this condition, operators may determine that an inventory loss is occurring by observing changes in sump and/or tank levels (Table C-1). Sump and/or tank level changes must be evaluated against other potential sources of water flow to ensure they are indicative of leakage from the RCS.

Continued loss of RCS inventory may result in escalation to the Alert emergency classification level via either IC CA1 or CA3.

Callaway Basis Reference(s):

1. OTO-BB-00003, R014, Excess RCS Leakage
2. OSP-BB-00009, RCS Inventory Balance
3. OTN-BB-00002, Reactor Coolant System Draining
4. NEI 99-01, CU1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** C – Cold Shutdown / Refueling System Malfunction**Subcategory:** 1 – RCS Level**Initiating Condition:** Loss of RCS inventory**EAL:****CA1.1 Alert**

Loss of RCS inventory as indicated by Reactor Vessel level < bottom of RCS hot leg ID (RVLIS Pumps Off < 73%).

MODE Applicability:

5 - Cold Shutdown, 6 - Refueling

Definition(s):

None

Basis:

When Reactor Vessel water level lowers to 2013.29 ft. (ref. 1), the inside diameter (ID) of the bottom of the RCS hot leg penetration is uncovered. The elevation of the bottom of the RCS hot leg penetration can be monitored only by RVLIS. (Note that this threshold is the loop penetration at the Reactor Vessel not the low point of the loop.) (ref. 3) When RVLIS is out of service, classification should be based on CA1.2 if RCS inventory cannot be monitored.

The RVLIS Pumps Off threshold has been determined as follows (ref. 1, 2):

Elevation of bottom of Reactor Vessel (ft) A	1987.150
Elevation of bottom ID of RCS hot leg penetration (ft) B	2013.290
Hot leg penetration (above vessel bottom) C = B - A (ft)	26.140
Height of vessel D (ft)	41.245
RVLIS indication corresponding to the top of the core: $H = 100 \times C / D$ (%)	63.377
RVLIS overall channel accuracy: $OCA = 7.48\% + (0.0104 \times H) + 0.81\%$	---
OCA at H (%)	8.949
Bottom ID of RCS loop, including channel uncertainties: $H + OCA$ (%)	72.327
Rounded upward to nearest 1% (RVLIS range is 0 - 120% in 2% increments)	73

The threshold was chosen because level indication may be lost (RVLIS is normally inoperable in Refueling MODE (ref. 2)) and loss of suction to decay heat removal systems has occurred. The inability to restore and maintain level after reaching this setpoint infers a failure of the RCS barrier.

This IC addresses conditions that are precursors to a loss of the ability to adequately cool irradiated fuel (i.e., a precursor to a challenge to the fuel clad barrier). This condition represents a potential substantial reduction in the level of plant safety.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

For this EAL, a lowering of RCS water level below the specified level indicates that operator actions have not been successful in restoring and maintaining RCS water level. The heat-up rate of the coolant will increase as the available water inventory is reduced. A continuing decrease in water level will lead to core uncover.

Although related, this EAL is concerned with the loss of RCS inventory and not the potential concurrent effects on systems needed for decay heat removal (e.g., loss of a Decay Heat Removal suction point). An increase in RCS temperature caused by a loss of decay heat removal capability is evaluated under IC CA3.

If RCS water level continues to lower, then escalation to Site Area Emergency would be via IC CS1.

Callaway Basis Reference(s):

1. OOA-BB-00003, Refuel Level Indications
2. Calculation No. BB-177 (387.1 - CAL RVLIS Setpoints)
3. OTN-BB-00002, Reactor Coolant System Draining
4. NEI 99-01, CA1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** C – Cold Shutdown / Refueling System Malfunction**Subcategory:** 1 – RCS Level**Initiating Condition:** Loss of RCS inventory**EAL:****CA1.2 Alert**RCS water level cannot be monitored for ≥ 15 min. (*Note 1*)**AND EITHER**

- UNPLANNED increase in **any** Table C-1 Sump / Tank level.
- Visual observation of UNISOLABLE RCS leakage.

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

Table C-1 Sumps / Tanks

- | |
|--|
| <ul style="list-style-type: none"> • Containment Sumps • Containment Normal Sumps • Containment Instrument Sump • PRT • RCDT • Auxiliary Building Sump |
|--|

MODE Applicability:

5 - Cold Shutdown, 6 – Refueling

Definition(s):

RCS INTACT - The RCS should be considered intact when the RCS pressure boundary is in its normal condition for the Cold Shutdown MODE of operation (e.g., no freeze seals or nozzle dams). The RCS is capable of being placed in an intact condition by Operator Action, i.e., pressurized to support natural circulation cooling.

UNISOLABLE - An open or breached system line that cannot be isolated, remotely or locally.

UNPLANNED - A parameter change or an event that is not 1) the result of an intended evolution or 2) an expected plant response to a transient. The cause of the parameter change or event may be known or unknown.

Basis:

In Cold Shutdown MODE, the RCS will normally be intact and standard RCS level monitoring means are available.

In the Refuel MODE, the RCS is NOT intact and RPV level may be monitored by different means, including the ability to monitor level visually.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

In this EAL, all RCS water level indication would be unavailable for greater than 15 minutes, and the RCS inventory loss must be detected by indirect leakage indications (Table C-1). Surveillance procedures provide instructions for calculating primary system leak rate by manual or computer-based water inventory balances. Level increases must be evaluated against other potential sources of leakage such as cooling water sources inside the containment to ensure they are indicative of RCS leakage. If the make-up rate to the RCS unexplainably rises above the pre-established rate, a loss of RCS inventory may be occurring even if the source of the leakage cannot be immediately identified. Visual observation of leakage from systems connected to the RCS that cannot be isolated could also be indicative of a loss of RCS inventory (ref. 1, 2).

The Plant Computer System Display called Refuel Level Indications (turn on code RLI) is available to assist in monitoring important parameters crucial to RCS draining operations (ref. 3).

This IC addresses conditions that are precursors to a loss of the ability to adequately cool irradiated fuel (i.e., a precursor to a challenge to the fuel clad barrier). This condition represents a potential substantial reduction in the level of plant safety.

For this EAL, the inability to monitor RCS level may be caused by instrumentation and/or power failures, or water level dropping below the range of available instrumentation. If water level cannot be monitored, operators may determine that an inventory loss is occurring by observing changes in sump and/or tank levels. Sump and/or tank level changes must be evaluated against other potential sources of water flow to ensure they are indicative of leakage from the RCS.

The 15-minute duration for the loss of level indication was chosen because it is half of the EAL duration specified in IC CS1.

If the RCS inventory level continues to lower, then escalation to Site Area Emergency would be via IC CS1.

Callaway Basis Reference(s):

1. OTO-BB-00003-R014, Excess RCS Leakage
2. OSP-BB-00009, RCS Inventory Balance
3. OTN-BB-00002, Reactor Coolant System Draining
4. NEI 99-01, CA1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** C – Cold Shutdown / Refueling System Malfunction**Subcategory:** 1 – RCS Level**Initiating Condition:** Loss of RCS inventory affecting core decay heat removal capability**EAL:****CS1.1 Site Area Emergency**With CONTAINMENT CLOSURE **not** established, RVLIS Pumps Off < 72%.**MODE Applicability:**

5 - Cold Shutdown, 6 - Refueling

Definition(s):

CONTAINMENT CLOSURE - The procedurally defined conditions or actions taken to secure Primary or Secondary Containment and its associated structures, systems, and components as a functional barrier to fission product release under shutdown conditions.

As applied to Callaway, Containment Closure is established when the requirements of OSP-GT-00003, Containment Closure are met.

Basis:

When Reactor Vessel water level lowers to 2012.79 ft. (ref. 1), water level is six inches below the bottom of the RCS hot leg penetration. When Reactor Vessel water level drops significantly below the bottom of the RCS hot leg penetration, all sources of RCS injection have failed or are incapable of making up for the inventory loss. Six inches below the bottom of the RCS hot leg penetration can be monitored only by RVLIS. Level monitoring instruments BB LI-53A/B and Computer Point BBL0053BB cannot sense level changes in the Reactor Vessel below the RCS loop hot leg penetration. The Plant Computer System Display called Refuel Level Indications (turn on code RLI) is available to assist in monitoring important parameters crucial to RCS draining operations (ref. 3). When RVLIS is out of service, classification should be based on CS1.3 if RCS inventory cannot be monitored.

The RVLIS Pumps Off threshold has been determined as follows (ref. 1, 2):

Elevation of bottom of Reactor Vessel (ft) A	1987.150
Elevation of bottom ID of RCS hot leg penetration (ft) B	2013.290
Six inches below hot leg penetration (above vessel bottom) C = B - A - 0.5 (ft)	25.640
Height of vessel D (ft)	41.245
RVLIS indication corresponding to the top of the core: H = 100 x C / D (%)	62.165
RVLIS overall channel accuracy: OCA = 7.48% + (0.0104 x H) + 0.81%	---
OCA at H (%)	8.937
Six inches below Bottom ID of RCS loop, including channel uncertainties: H + OCA (%)	71.102
Rounded upward to nearest 1% (RVLIS range is 0 - 120% in 2% increments)	72

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Under the conditions specified by this EAL, continued lowering of Reactor Vessel water level is indicative of a loss of inventory control. Inventory loss may be due to a vessel breach, RCS pressure boundary leakage or continued boiling in the Reactor Vessel. The magnitude of this loss of water indicates that makeup systems have not been effective and may not be capable of preventing further RCS or Reactor Vessel water level drop and potential core uncover. The inability to restore and maintain level after reaching this setpoint infers a failure of the RCS barrier and Potential Loss of the Fuel Clad barrier.

The status of Containment closure is tracked if plant conditions change that could raise the risk of a fission product release as a result of a loss of decay heat removal (ref. 4).

This IC addresses a significant and prolonged loss of reactor vessel/RCS inventory control and makeup capability leading to IMMINENT fuel damage. The lost inventory may be due to a RCS component failure, a loss of configuration control or prolonged boiling of reactor coolant. These conditions entail major failures of plant functions needed for protection of the public and thus warrant a Site Area Emergency declaration.

Following an extended loss of core decay heat removal and inventory makeup, decay heat will cause reactor coolant boiling and a further reduction in reactor vessel level. If RCS level cannot be restored, fuel damage is probable.

Outage/shutdown contingency plans typically provide for re-establishing or verifying CONTAINMENT CLOSURE following a loss of heat removal or RCS inventory control functions. The difference in the specified RCS/reactor vessel levels of EALs CS1.1 and CS1.2 reflect the fact that with CONTAINMENT CLOSURE established, there is a lower probability of a fission product release to the environment.

This EAL addresses concerns raised by Generic Letter 88-17, Loss of Decay Heat Removal; SECY 91-283, Evaluation of Shutdown and Low Power Risk Issues; NUREG-1449, Shutdown and Low-Power Operation at Commercial Nuclear Power Plants in the United States; and NUMARC 91-06, Guidelines for Industry Actions to Assess Shutdown Management.

Escalation of the emergency classification level would be via IC CG1 or RG1.

Callaway Basis Reference(s):

1. OOA-BB-00003, Refuel Level Indications
2. Calculation No. BB-177, (387.1 - CAL RVLIS Setpoints)
3. OTN-BB-00002, Reactor Coolant System Draining
4. OSP-GT-00003, Containment Closure
5. NEI 99-01, CS1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** C – Cold Shutdown / Refueling System Malfunction**Subcategory:** 1 – RCS Level**Initiating Condition:** Loss of RCS inventory affecting core decay heat removal capability**EAL:****CS1.2 Site Area Emergency**

With CONTAINMENT CLOSURE established, RVLIS Pumps Off < 65% (Top of Fuel).

MODE Applicability:

5 - Cold Shutdown, 6 - Refueling

Definition(s):

CONTAINMENT CLOSURE - The procedurally defined conditions or actions taken to secure Primary or Secondary Containment and its associated structures, systems, and components as a functional barrier to fission product release under shutdown conditions.

As applied to Callaway, Containment Closure is established when the requirements of OSP-GT-00003, Containment Closure are met.

Basis:

When Reactor Vessel water level drops below RVLIS Pumps Off indication of 65% (2010.29 ft.), core uncover is about to occur. The Plant Computer System Display called Refuel Level Indications (turn on code RLI) is available to assist in monitoring important parameters crucial to RCS draining operations (ref. 3). When RVLIS is out of service, classification should be based on CS1.3 if RCS inventory cannot be monitored.

The RVLIS Pumps Off threshold has been determined as follows (ref. 1, 2):

Elevation of bottom of Reactor Vessel (ft) A	1987.150
Elevation of top of fuel (ft) B	2010.290
Height of top of core (above vessel bottom) C = B - A (ft)	23.140
Height of vessel D (ft)	41.245
RVLIS indication corresponding to the top of the core: $H = 100 \times C / D$ (%)	56.104
RVLIS overall channel accuracy: $OCA = 7.48\% + (0.0104 \times H) + 0.81\%$	—
OCA at H (%)	8.873
Top of core, including channel uncertainties: $H + OCA$ (%)	64.977
Rounded upward to nearest 1% (RVLIS range is 0 - 120% in 2% increments)	65

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Under the conditions specified by this EAL, continued lowering of Reactor Vessel water level is indicative of a loss of inventory control. Inventory loss may be due to a vessel breach, RCS pressure boundary leakage or continued boiling in the Reactor Vessel. The magnitude of this loss of water indicates that makeup systems have not been effective and may not be capable of preventing further RCS or Reactor Vessel water level drop and potential core uncover. The inability to restore and maintain level after reaching this setpoint infers a failure of the RCS barrier and Potential Loss of the Fuel Clad barrier.

The status of Containment closure is tracked if plant conditions change that could raise the risk of a fission product release as a result of a loss of decay heat removal (ref. 4).

This IC addresses a significant and prolonged loss of reactor vessel/RCS inventory control and makeup capability leading to IMMINENT fuel damage. The lost inventory may be due to a RCS component failure, a loss of configuration control or prolonged boiling of reactor coolant. These conditions entail major failures of plant functions needed for protection of the public and thus warrant a Site Area Emergency declaration.

Following an extended loss of core decay heat removal and inventory makeup, decay heat will cause reactor coolant boiling and a further reduction in reactor vessel level. If RCS level cannot be restored, fuel damage is probable.

Outage/shutdown contingency plans typically provide for re-establishing or verifying CONTAINMENT CLOSURE following a loss of heat removal or RCS inventory control functions. The difference in the specified RCS/reactor vessel levels of EALs CS1.1 and CS1.2 reflect the fact that with CONTAINMENT CLOSURE established, there is a lower probability of a fission product release to the environment.

This EAL addresses concerns raised by Generic Letter 88-17, Loss of Decay Heat Removal; SECY 91-283, Evaluation of Shutdown and Low Power Risk Issues; NUREG-1449, Shutdown and Low-Power Operation at Commercial Nuclear Power Plants in the United States; and NUMARC 91-06, Guidelines for Industry Actions to Assess Shutdown Management.

Escalation of the emergency classification level would be via IC CG1 or RG1.

Callaway Basis Reference(s):

1. OOA-BB-00003, Refuel Level Indications
2. Calculation No. BB-177, (387.1 - CAL RVLIS Setpoints)
3. OTN-BB-00002, Reactor Coolant System Draining
4. OSP-GT-00003, Containment Closure
5. NEI 99-01, CS1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** C – Cold Shutdown / Refueling System Malfunction**Subcategory:** 1 – RCS Level**Initiating Condition:** Loss of RCS inventory affecting core decay heat removal capability**EAL:****CS1.3 Site Area Emergency**RCS water level cannot be monitored for ≥ 30 min. (*Note 1*)**AND**Core uncover is indicated by **any** of the following:

- UNPLANNED increase in **any** Table C-1 sump/tank level of sufficient magnitude to indicate core uncover.
- Manipulator crane radiation monitor SD-RE-41 $> 10,000$ mR/hr.
- Erratic Source Range Monitor indication.

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

Table C-1 Sumps / Tanks

- | |
|--|
| <ul style="list-style-type: none"> • Containment Sumps • Containment Normal Sumps • Containment Instrument Sump • PRT • RCDT • Auxiliary Building Sump |
|--|

MODE Applicability:

5 - Cold Shutdown, 6 – Refueling

Definition(s):

RCS INTACT - The RCS should be considered intact when the RCS pressure boundary is in its normal condition for the Cold Shutdown MODE of operation (e.g., no freeze seals or nozzle dams). The RCS is capable of being placed in an intact condition by Operator Action, i.e., pressurized to support natural circulation cooling.

UNPLANNED - A parameter change or an event that is not 1) the result of an intended evolution or 2) an expected plant response to a transient. The cause of the parameter change or event may be known or unknown.

Basis:

In Cold Shutdown MODE, the RCS will normally be intact and standard RCS level monitoring means are available.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

In the Refueling MODE, the RCS is not intact and RPV level may be monitored by different means, including the ability to monitor level visually.

In this EAL, all RCS water level indication would be unavailable for greater than 30 minutes, and the RCS inventory loss must be detected by indirect leakage indications (Table C-1). Surveillance procedures provide instructions for calculating primary system leak rate by manual or computer-based water inventory balances. Level increases must be evaluated against other potential sources of leakage such as cooling water sources inside the containment to ensure they are indicative of RCS leakage. If the make-up rate to the RCS unexplainably rises above the pre-established rate, a loss of RCS inventory may be occurring even if the source of the leakage cannot be immediately identified. Visual observation of leakage from systems connected to the RCS that cannot be isolated could also be indicative of a loss of RCS inventory (ref. 1, 2).

The Plant Computer System Display called Refuel Level Indications (turn on code RLI) is available to assist in monitoring important parameters crucial to RCS draining operations (ref. 3).

The Reactor Vessel inventory loss may be detected by the manipulator crane radiation monitor or erratic Source Range Monitor indication. As water level in the Reactor Vessel lowers, the dose rate above the core will rise. The dose rate due to this core shine should result in up-scaled manipulator crane radiation monitor (SD-RE-41) indication (ref. 4, 5, 6).

Post-TMI accident studies indicated that the installed PWR nuclear instrumentation will operate erratically when the core is uncovered and that this should be used as a tool for making such determinations (ref. 7, 8).

This IC addresses a significant and prolonged loss of RCS inventory control and makeup capability leading to IMMINENT fuel damage. The lost inventory may be due to a RCS component failure, a loss of configuration control or prolonged boiling of reactor coolant. These conditions entail major failures of plant functions needed for protection of the public and thus warrant a Site Area Emergency declaration.

Following an extended loss of core decay heat removal and inventory makeup, decay heat will cause reactor coolant boiling and a further reduction in reactor vessel level. If RCS level cannot be restored, fuel damage is probable.

The 30-minute criterion is tied to a readily recognizable event start time (i.e., the total loss of ability to monitor level), and allows sufficient time to monitor, assess and correlate reactor and plant conditions to determine if core uncover has actually occurred (i.e., to account for various accident progression and instrumentation uncertainties). It also allows sufficient time for performance of actions to terminate leakage, recover inventory control/makeup equipment and/or restore level monitoring.

The inability to monitor RCS level may be caused by instrumentation and/or power failures, or water level dropping below the range of available instrumentation. If water level cannot be monitored, operators may determine that an inventory loss is occurring by observing changes in sump and/or tank levels. Sump and/or tank level changes must be evaluated against other potential sources of water flow to ensure they are indicative of leakage from the RCS.

This EAL addresses concerns raised by Generic Letter 88-17, Loss of Decay Heat Removal; SECY 91-283, Evaluation of Shutdown and Low Power Risk Issues; NUREG-1449, Shutdown and Low-Power Operation at Commercial Nuclear Power Plants in the United States; and NUMARC 91-06, Guidelines for Industry Actions to Assess Shutdown Management.

Escalation of the emergency classification level would be via IC CG1 or RG1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Callaway Basis Reference(s):**

1. OTO-BB-00003-R014, Excess RCS Leakage
2. OSP-BB-00009, RCS Inventory Balance
3. OTN-BB-00002, Reactor Coolant System Draining
4. FSAR, Section 12.3.3.4
5. FSAR, Table 12.3-2
6. Calc. No. HPCI -0701, SD-RE-41 Response to Core Uncovery in Refueling MODE
7. Severe Accident Management Guidance Technical Basis Report, Volume 1: Candidate High-Level Actions and Their Effects, pgs. 2-18, 2-19
8. Nuclear Safety Analysis Center (NSAC), 1980, "Analysis of Three Mile Island - Unit 2 Accident," NSAC-1
9. NEI 99-01, CS1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** C – Cold Shutdown / Refueling System Malfunction**Subcategory:** 1 – RCS Level**Initiating Condition:** Loss of RCS inventory affecting fuel clad integrity with containment challenged**EAL:****CG1.1 General Emergency**RVLIS Pumps Off < 65% (Top of Fuel) for ≥ 30 min. (Note 1)**AND****Any** Containment Challenge indication, Table C-2.

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

Note 6: If CONTAINMENT CLOSURE is re-established prior to exceeding the 30-minute time limit, declaration of a General Emergency is not required.

Table C-2 Containment Challenge Indications

- CONTAINMENT CLOSURE **not** established (Note 6)
- Containment hydrogen concentration $\geq 4\%$
- Unplanned rise in Containment pressure

MODE Applicability:

5 – Cold Shutdown, 6 – Refueling

Definition(s):

CONTAINMENT CLOSURE - The procedurally defined conditions or actions taken to secure Primary or Secondary Containment and its associated structures, systems, and components as a functional barrier to fission product release under shutdown conditions.

As applied to Callaway, Containment Closure is established when the requirements of OSP-GT-00003 Containment Closure are met.

Basis:

When Reactor Vessel water level drops below RVLIS Pumps Off indication of 65% (2010.29 ft.), core uncover is about to occur. The Plant Computer System Display called Refuel Level Indications (turn on code RLI) is available to assist in monitoring important parameters crucial to RCS draining operations (ref. 3). When RVLIS is out of service, classification should be based on CG1.2 if RCS inventory cannot be monitored.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

The RVLIS Pumps Off threshold has been determined as follows (ref. 1, 2):

Elevation of bottom of Reactor Vessel (ft) A	1987.150
Elevation of top of fuel (ft) B	2010.290
Height of top of core (above vessel bottom) C = B - A (ft)	23.140
Height of vessel D (ft)	41.245
RVLIS indication corresponding to the top of the core: $H = 100 \times C / D$ (%)	56.104
RVLIS overall channel accuracy: $OCA = 7.48\% + (0.0104 \times H) + 0.81\%$	—
OCA at H (%)	8.873
Top of core, including channel uncertainties: $H + OCA$ (%)	64.977
Rounded upward to nearest 1% (RVLIS range is 0 - 120% in 2% increments)	65

Three conditions are associated with a challenge to Containment integrity:

1. CONTAINMENT CLOSURE not established - The status of Containment closure is tracked if plant conditions change that could raise the risk of a fission product release as a result of a loss of decay heat removal (ref. 4). If containment closure is re-established prior to exceeding the 30 minute core uncover time limit then escalation to GE would not occur.
2. Containment hydrogen $\geq 4\%$ - The 4% hydrogen concentration threshold is generally considered the lower limit for hydrogen deflagrations. Callaway is equipped with a Hydrogen Control System (HCS) which serves to limit or reduce combustible gas concentrations in the Containment. The HCS is an engineered safety feature with redundant hydrogen recombiners, hydrogen mixing system, hydrogen monitoring subsystem, and a backup hydrogen purge subsystem. The HCS is designed to maintain the Containment hydrogen concentration below 4% by volume (ref. 5). Two Containment hydrogen monitors (GS AI-10 and GS AI-19) with a range of 0% to 10% provide indication on Control Room Panel RL020 and Emergency Response Facilities Information System (ERFIS) (ref. 6, 7). The hydrogen monitors require a 2 hour warmup period when starting from the OFF position and 15 minutes when starting from STANDBY (ref. 8, 9).
3. UNPLANNED rise in Containment pressure - An unplanned pressure rise in containment while in Cold Shutdown or Refueling MODES can threaten Containment Closure capability and thus Containment potentially cannot be relied upon as a barrier to fission product release (ref. 4).

Under the conditions specified by this EAL, continued lowering of Reactor Vessel water level is indicative of a loss of inventory control with a challenge to the Containment. Inventory loss may be due to a vessel breach, RCS pressure boundary leakage or continued boiling in the Reactor Vessel. The magnitude of this loss of water indicates that makeup systems have not been effective and may not be capable of preventing further RCS or Reactor Vessel water level drop and potential core uncover. The inability to restore and maintain level inventory within 30 minutes after reaching this condition in combination with a Containment challenge infers a failure of the RCS barrier, Loss of the Fuel Clad barrier and a Potential Loss of Containment.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

This IC addresses the inability to restore and maintain reactor vessel level above the top of active fuel with containment challenged. This condition represents actual or IMMINENT substantial core degradation or melting with potential for loss of containment integrity. Releases can be reasonably expected to exceed EPA PAG exposure levels offsite for more than the immediate site area.

Following an extended loss of core decay heat removal and inventory makeup, decay heat will cause reactor coolant boiling and a further reduction in reactor vessel level. If RCS level cannot be restored, fuel damage is probable.

With CONTAINMENT CLOSURE not established, there is a high potential for a direct and unmonitored release of radioactivity to the environment. If CONTAINMENT CLOSURE is re-established prior to exceeding the 30-minute time limit, then declaration of a General Emergency is not required.

The existence of an explosive mixture means, at a minimum, that the containment atmospheric hydrogen concentration is sufficient to support a hydrogen burn (i.e., at the lower deflagration limit). A hydrogen burn will raise containment pressure and could result in collateral equipment damage leading to a loss of containment integrity. It therefore represents a challenge to Containment integrity.

In the early stages of a core uncover event, it is unlikely that hydrogen buildup due to a core uncover could result in an explosive gas mixture in containment. If all installed hydrogen gas monitors are out-of-service during an event leading to fuel cladding damage, it may not be possible to obtain a containment hydrogen gas concentration reading as ambient conditions within the containment will preclude personnel access. During periods when installed containment hydrogen gas monitors are out-of-service, operators may use the other listed indications to assess whether or not containment is challenged (*Table C-2, Containment Challenge Indications*).

The 30-minute criterion is tied to a readily recognizable event start time (i.e., the total loss of ability to monitor level), and allows sufficient time to monitor, assess and correlate reactor and plant conditions to determine if core uncover has actually occurred (i.e., to account for various accident progression and instrumentation uncertainties). It also allows sufficient time for performance of actions to terminate leakage, recover inventory control/makeup equipment and/or restore level monitoring.

The inability to monitor RCS level may be caused by instrumentation and/or power failures, or water level dropping below the range of available instrumentation. If water level cannot be monitored, operators may determine that an inventory loss is occurring by observing changes in sump and/or tank levels. Sump and/or tank level changes must be evaluated against other potential sources of water flow to ensure they are indicative of leakage from the RCS.

This EAL addresses concerns raised by Generic Letter 88-17, Loss of Decay Heat Removal; SECY 91-283, Evaluation of Shutdown and Low Power Risk Issues; NUREG-1449, Shutdown and Low-Power Operation at Commercial Nuclear Power Plants in the United States; and NUMARC 91-06, Guidelines for Industry Actions to Assess Shutdown Management.

Callaway Basis Reference(s):

1. OOA-BB-00003, Refuel Level Indications
2. Calculation No. BB-177, (387.1 - CAL RVLIS Setpoints)
3. OTN-BB-00002, Reactor Coolant System Draining
4. OSP-GT-00003, Containment Closure

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

5. FSAR, Section 6.2.5
6. FSAR, Table 7A-3 (Sheet 31)
7. Technical Specifications 3.3.3
8. OTN-GS-00001, Containment Hydrogen Control System
9. Calc No. 392.2 XX-95 Callaway Containment Parameters EOP Action Values, Setpoint ID T101 & T102
10. NEI 99-01, CS1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** C – Cold Shutdown / Refueling System Malfunction**Subcategory:** 1 – RCS Level**Initiating Condition:** Loss of RCS inventory affecting fuel clad integrity with containment challenged**EAL:****CG1.2 General Emergency**RCS level **cannot** be monitored for ≥ 30 min. (*Note 1*)**AND**Core uncover is indicated by **any** of the following:

- UNPLANNED increase in **any** Table C-1 sump/tank level of sufficient magnitude to indicate core uncover.
- Manipulator crane radiation monitor SD-RE-41 $> 10,000$ mR/hr.
- Erratic Source Range Monitor indication.

AND**Any** Containment Challenge indication, Table C-2.

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

Note 6: If CONTAINMENT CLOSURE is re-established prior to exceeding the 30-minute time limit, declaration of a General Emergency is not required.

Table C-1 Sumps / Tanks

- Containment Sumps
- Containment Normal Sumps
- Containment Instrument Sump
- PRT
- RCDT
- Auxiliary Building Sump

Table C-2 Containment Challenge Indications

- CONTAINMENT CLOSURE **not** established (*Note 6*)
- Containment hydrogen concentration $\geq 4\%$
- Unplanned rise in Containment pressure

MODE Applicability:

5 - Cold Shutdown, 6 – Refueling

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Definition(s):**

CONTAINMENT CLOSURE - The procedurally defined conditions or actions taken to secure Primary or Secondary Containment and its associated structures, systems, and components as a functional barrier to fission product release under shutdown conditions.

As applied to Callaway, Containment Closure is established when the requirements of OSP-GT-00003 Containment Closure are met.

RCS INTACT - The RCS should be considered intact when the RCS pressure boundary is in its normal condition for the Cold Shutdown MODE of operation (e.g., no freeze seals or nozzle dams). The RCS is capable of being placed in an intact condition by Operator Action, i.e., pressurized to support natural circulation cooling.

UNPLANNED - A parameter change or an event that is not 1) the result of an intended evolution or 2) an expected plant response to a transient. The cause of the parameter change or event may be known or unknown.

Basis:

In Cold Shutdown MODE, the RCS will normally be intact and standard RCS level monitoring means are available.

In the Refueling MODE, the RCS is not intact and RPV level may be monitored by different means, including the ability to monitor level visually.

In this EAL, all RCS water level indication would be unavailable for greater than 30 minutes, and the RCS inventory loss must be detected by indirect leakage indications (Table C-1). Surveillance procedures provide instructions for calculating primary system leak rate by manual or computer-based water inventory balances. Level increases must be evaluated against other potential sources of leakage such as cooling water sources inside the containment to ensure they are indicative of RCS leakage. If the make-up rate to the RCS unexplainably rises above the pre-established rate, a loss of RCS inventory may be occurring even if the source of the leakage cannot be immediately identified. Visual observation of leakage from systems connected to the RCS that cannot be isolated could also be indicative of a loss of RCS inventory (ref. 1, 2).

The Plant Computer System Display called Refuel Level Indications (turn on code RLI) is available to assist in monitoring important parameters crucial to RCS draining operations (ref. 3).

The Reactor Vessel inventory loss may be detected by the manipulator crane radiation monitor or erratic Source Range Monitor indication. As water level in the Reactor Vessel lowers, the dose rate above the core will rise. The dose rate due to this core shine should result in up-scaled manipulator crane radiation monitor (SD-RE-41) indication (ref. 4, 5, 6).

Post-TMI accident studies indicated that the installed PWR nuclear instrumentation will operate erratically when the core is uncovered and that this should be used as a tool for making such determinations (ref. 7, 8).

Three conditions are associated with a challenge to Containment integrity:

1. *CONTAINMENT CLOSURE* not established - The status of Containment closure is tracked if plant conditions change that could raise the risk of a fission product release as a result of a loss of decay heat removal (ref. 15). If containment closure is re-established prior to exceeding the 30 minute core uncover time limit then escalation to GE would not occur.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

2. Containment hydrogen $\geq 4\%$ - The 4% hydrogen concentration threshold is generally considered the lower limit for hydrogen deflagrations. Callaway is equipped with a Hydrogen Control System (HCS) which serves to limit or reduce combustible gas concentrations in the Containment. The HCS is an engineered safety feature with redundant hydrogen recombiners, hydrogen mixing system, hydrogen monitoring subsystem, and a backup hydrogen purge subsystem. The HCS is designed to maintain the Containment hydrogen concentration below 4% by volume (ref. 9). Two Containment hydrogen monitors (GS AI-10 and GS AI-19) with a range of 0% to 10% provide indication on Control Room Panel RL020 and ERFIS (ref. 10, 11). The hydrogen monitors require a 2 hour warmup period when starting from the OFF position and 15 minutes when starting from STANDBY (ref. 12, 13).
3. UNPLANNED rise in Containment pressure - An unplanned pressure rise in containment while in Cold Shutdown or Refueling MODES can threaten Containment Closure capability and thus Containment potentially cannot be relied upon as a barrier to fission product release (ref. 15).

This IC addresses the inability to restore and maintain reactor vessel level above the top of active fuel with containment challenged. This condition represents actual or IMMINENT substantial core degradation or melting with potential for loss of containment integrity. Releases can be reasonably expected to exceed EPA PAG exposure levels offsite for more than the immediate site area.

Following an extended loss of core decay heat removal and inventory makeup, decay heat will cause reactor coolant boiling and a further reduction in reactor vessel level. If RCS level cannot be restored, fuel damage is probable.

With CONTAINMENT CLOSURE not established, there is a high potential for a direct and unmonitored release of radioactivity to the environment. If CONTAINMENT CLOSURE is re-established prior to exceeding the 30-minute time limit, then declaration of a General Emergency is not required.

The existence of an explosive mixture means, at a minimum, that the containment atmospheric hydrogen concentration is sufficient to support a hydrogen burn (i.e., at the lower deflagration limit). A hydrogen burn will raise containment pressure and could result in collateral equipment damage leading to a loss of containment integrity. It therefore represents a challenge to Containment integrity.

In the early stages of a core uncover event, it is unlikely that hydrogen buildup due to a core uncover could result in an explosive gas mixture in containment. If all installed hydrogen gas monitors are out-of-service during an event leading to fuel cladding damage, it may not be possible to obtain a containment hydrogen gas concentration reading as ambient conditions within the containment will preclude personnel access. During periods when installed containment hydrogen gas monitors are out-of-service, operators may use the other listed indications to assess whether or not containment is challenged. (*Table C-2, Containment Challenge Indications*).

The 30-minute criterion is tied to a readily recognizable event start time (i.e., the total loss of ability to monitor level), and allows sufficient time to monitor, assess and correlate reactor and plant conditions to determine if core uncover has actually occurred (i.e., to account for various accident progression and instrumentation uncertainties). It also allows sufficient time for performance of actions to terminate leakage, recover inventory control/makeup equipment and/or restore level monitoring.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

The inability to monitor RCS level may be caused by instrumentation and/or power failures, or water level dropping below the range of available instrumentation. If water level cannot be monitored, operators may determine that an inventory loss is occurring by observing changes in sump and/or tank levels. Sump and/or tank level changes must be evaluated against other potential sources of water flow to ensure they are indicative of leakage from the RCS.

This EAL addresses concerns raised by Generic Letter 88-17, Loss of Decay Heat Removal; SECY 91-283, Evaluation of Shutdown and Low Power Risk Issues; NUREG-1449, Shutdown and Low-Power Operation at Commercial Nuclear Power Plants in the United States; and NUMARC 91-06, Guidelines for Industry Actions to Assess Shutdown Management.

Callaway Basis Reference(s):

1. OTO-BB-00003-R014, Excess RCS Leakage
2. OSP-BB-00009, RCS Inventory Balance
3. OTN-BB-00002, Reactor Coolant System Draining
4. FSAR, Section 12.3.3.4
5. FSAR, Table 12.3-2
6. Calc. No. HPCI -0701, SD-RE-41 Response to Core Uncovery in Refueling MODE
7. Severe Accident Management Guidance Technical Basis Report, Volume 1: Candidate High-Level Actions and Their Effects, pgs. 2-18, 2-19
8. Nuclear Safety Analysis Center (NSAC), 1980, "Analysis of Three Mile Island - Unit 2 Accident," NSAC-1
9. FSAR, Section 6.2.5
10. FSAR, Table 7A-3 (Sheet 31)
11. Technical Specifications 3.3.3
12. OTN-GS-00001, Containment Hydrogen Control System
13. Calc No. 392.2 XX-95 Callaway Containment Parameters EOP Action Values, Setpoint ID T101 & T102
14. OSP-GT-00003, Containment Closure
15. NEI 99-01, CG1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** C – Cold Shutdown / Refueling System Malfunction**Subcategory:** 2 – Loss of Emergency AC Power**Initiating Condition:** Loss of all but one AC power source to emergency buses for 15 minutes or longer**EAL:****CU2.1 Unusual Event**

AC power capability, Table C-3, to emergency 4.16KV buses NB01 and NB02 reduced to a single power source for ≥ 15 min. *(Note 1)*

AND

Any additional single power source failure will result in loss of **all** AC power to SAFETY SYSTEMS.

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

Table C-3 AC Power Sources**Offsite:**

- Safeguards XFMR A or B via ESF LTC XFMR XNB01
- Startup XFMR XMR01 via ESF LTC XFMR XNB02
- Main XFMR XMA01 backfed via UAT XFMR XMA02
(in-service)
- Alternate Emergency Power Supply
(in-service or stand-by alignment)

Onsite:

- EDG NE01
- EDG NE02

MODE Applicability:

5 - Cold Shutdown, 6 – Refueling, D – Defueled

Definition(s):

SAFETY SYSTEM - A system required for safe plant operation, cooling down the plant and/or placing it in the Cold Shutdown condition, including the ECCS. These are typically systems classified as safety-related (as defined in 10CFR50.2):

Those structures, systems and components that are relied upon to remain functional during and following design basis events to assure:

1. The integrity of the reactor coolant pressure boundary;
2. The capability to shut down the reactor and maintain it in a safe shutdown condition;
3. The capability to prevent or mitigate the consequences of accidents which could result in potential offsite exposures.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

Basis:

For emergency classification purposes, “capability” means that an offsite AC power source(s) is available to the emergency buses and can be aligned within 15 minutes, whether or not the buses are powered from it.

The criteria for Standby Alignment is that the source can be supplying the station with power within 15 minutes. Obviously the Main Transformer could not be aligned for backfeed in 15 minutes during normal power operations. But, in an outage, and if already aligned for backfeed, the Main Transformer could be supplying power to the station within 15 minutes, and credit could be taken for it. The same applies for the Alternate Energy Power System (AEPS). Timed control room actions have shown that Callaway can supply power from AEPS to the station in approximately 9 minutes, if AEPS is aligned in standby. If AEPS cannot be aligned to a bus within 15 minutes, then it is not considered a capable AC power source.

The condition indicated by this EAL is the degradation of the offsite and onsite power sources such that any additional single failure would result in a loss of all AC power to the emergency buses.

4.16KV buses NB01 and NB02 are the emergency (essential) buses. NB01 supplies power to Load Group 1 (Red Train) safety related loads and NB02 supplies power to Load Group 2 (Yellow Train) safety related loads. Each bus has two sources of offsite power. One source is from 13.8 KV safeguards transformer A or B via ESF Load Tap Changing (LTC) transformer XNB01 and the other source is from the startup transformer XMR01 via ESF LTC transformer XNB02. Transformer XNB01 is the normal supply to bus NB01; XNB02 is the normal supply to bus NB02 (ref. 1, 2, 3).

In addition, NB01 and NB02 each have an emergency diesel generator which supply electrical power to the bus automatically in the event that the preferred source becomes unavailable (ref. 1).

Another method to obtain offsite power is by backfeeding the emergency buses through the main transformer XMA01 and unit auxiliary transformer XMR02. This is only done during Cold Shutdown unless nuclear safety considerations require it to be done during hot shutdown when no other power sources are available (ref. 4).

An additional source of offsite power is the Alternate Emergency Power Supply (AEPS). AEPS consists of Co-op Power or AEPS Diesel Generators. Credit can be taken for this source only if it can be aligned within 15 minutes.

This cold condition EAL is equivalent to the hot condition EAL SA1.1.

This IC describes a significant degradation of offsite and onsite AC power sources such that any additional single failure would result in a loss of all AC power to SAFETY SYSTEMS. In this condition, the sole AC power source may be powering one, or more than one, train of safety-related equipment.

When in the Cold Shutdown, refueling, or defueled MODE, this condition is not classified as an Alert because of the increased time available to restore another power source to service. Additional time is available due to the reduced core decay heat load, and the lower temperatures and pressures in various plant systems. Thus, when in these MODES, this condition is considered to be a potential degradation of the level of safety of the plant.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

An “AC power source” is a source recognized in AOPs and EOPs, and capable of supplying required power to an essential bus. Some examples of this condition are presented below.

- A loss of all offsite power with a concurrent failure of all but one emergency power source (e.g., an onsite diesel generator).
- A loss of all offsite power and loss of all emergency power sources (e.g., onsite diesel generators) with a single train of emergency buses being back-fed from the unit main generator.
- A loss of emergency power sources (e.g., onsite diesel generators) with a single train of emergency buses being back-fed from an offsite power source.

Fifteen minutes was selected as a threshold to exclude transient or momentary losses of power.

The subsequent loss of the remaining single power source would escalate the event to an Alert in accordance with IC CA2.

Callaway Basis Reference(s):

1. E-21001(Q) Main Single Line Diagram (Electrical Distribution Diagram)
2. FSAR Site Addenda, Section 8.2.1.2
3. FSAR, Section 8.3.1
4. OTS-MA-00001-R011, Main Step-Up Transformer Backfeed - IPTE
5. NEI 99-01, CU2

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: C – Cold Shutdown / Refueling System Malfunction

Subcategory: 2 – Loss of Emergency AC Power

Initiating Condition: Loss of **all** offsite and **all** onsite AC power to emergency buses for 15 minutes or longer

EAL:**CA2.1 Alert**

Loss of **all** offsite and **all** onsite AC power capability, Table C-3, to emergency 4.16KV buses NB01 and NB02 for ≥ 15 min. (*Note 1*)

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

Table C-3 AC Power Sources**Offsite:**

- Safeguards XFMR A or B via ESF LTC XFMR XNB01
- Startup XFMR XMR01 via ESF LTC XFMR XNB02
- Main XFMR XMA01 backfed via UAT XFMR XMA02 (*in-service*)
- Alternate Emergency Power Supply (*in-service or stand-by alignment*)

Onsite:

- EDG NE01
- EDG NE02

MODE Applicability:

5 – Cold Shutdown, 6 – Refueling, D – Defueled

Basis:

For emergency classification purposes, “capability” means that an offsite AC power source(s) is available to the emergency buses, and is aligned within 15 minutes.

If AEPS is not aligned to a bus within 15 minutes, then it is not considered a capable AC power source.

The criteria for Standby Alignment is that the source can be supplying the station with power within 15 minutes. Obviously the Main Transformer could not be aligned for backfeed in 15 minutes during normal power operations. But, in an outage, and if already aligned for backfeed, the Main Transformer could be supplying power to the station within 15 minutes, and credit could be taken for it. The same applies for AEPS. Timed control room actions have shown that Callaway can supply power from AEPS to the station in approximately 9 minutes, if AEPS is aligned in standby.

The emergency 4.16KV AC System provides the power requirements for operation and safe shutdown of the plant. The essential switchgear are buses NB01 and NB02 (ref. 1).

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

4.16KV buses NB01 and NB02 are the emergency (essential) buses. NB01 supplies power to Load Group 1 (Red Train) safety related loads and NB02 supplies power to Load Group 2 (Yellow Train) safety related loads. Each bus has two sources of offsite power. One source is from 13.8 KV safeguards transformer A or B via ESF Load Tap Changing (LTC) transformer XNB01 and the other source is from the startup transformer XMR01 via ESF LTC transformer XNB02. Transformer XNB01 is the normal supply to bus NB01; XNB02 is the normal supply to bus NB02 (ref. 1, 2, 3).

In addition, NB01 and NB02 each have an emergency diesel generator which supply electrical power to the bus automatically in the event that the preferred source becomes unavailable (ref. 1).

Another method to obtain offsite power is by backfeeding the emergency buses through the main transformer XMA01 and unit auxiliary transformer XMR02. This is only done during Cold Shutdown unless nuclear safety considerations require it to be done during hot shutdown when no other power sources are available (ref. 4).

An additional source of offsite power is the Alternate Emergency Power Supply (AEPS). AEPS consists of Co-op Power or AEPS diesel generators. Credit can be taken for this source only if it can be aligned within 15 minutes.

This cold condition EAL is equivalent to the hot condition loss of all offsite AC power EAL SS1.1.

This IC addresses a total loss of AC power that compromises the performance of all SAFETY SYSTEMS requiring electric power including those necessary for emergency core cooling, containment heat removal/pressure control, spent fuel heat removal and the ultimate heat sink.

When in the Cold Shutdown, refueling, or defueled MODE, this condition is not classified as a Site Area Emergency because of the increased time available to restore an emergency bus to service. Additional time is available due to the reduced core decay heat load, and the lower temperatures and pressures in various plant systems. Thus, when in these MODES, this condition represents an actual or potential substantial degradation of the level of safety of the plant.

Fifteen minutes was selected as a threshold to exclude transient or momentary power losses.

Escalation of the emergency classification level would be via IC CS1 or RS1.

Callaway Basis Reference(s):

1. E-21001(Q) Main Single Line Diagram (Electrical Distribution Diagram)
2. FSAR Site Addenda, Section 8.2.1.2
3. FSAR, Section 8.3.1
4. OTS-MA-00001-R011, Main Step-Up Transformer Backfeed - IPTE
5. NEI 99-01, CA2

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** C – Cold Shutdown / Refueling System Malfunction**Subcategory:** 3 – RCS Temperature**Initiating Condition:** UNPLANNED increase in RCS temperature**EAL:****CU3.1 Unusual Event**

UNPLANNED increase in RCS temperature to > 200°F.

*(Note 10)**Note 10:* Begin monitoring hot condition EALs concurrently for any new event or condition not related to the loss of decay heat removal.**MODE Applicability:**

5 - Cold Shutdown, 6 - Refueling

Definition(s):

RCS INTACT - The RCS should be considered intact when the RCS pressure boundary is in its normal condition for the Cold Shutdown MODE of operation (e.g., no freeze seals or nozzle dams). The RCS is capable of being placed in an intact condition by Operator Action, i.e., pressurized to support natural circulation cooling.

UNPLANNED - A parameter change or an event that is not 1) the result of an intended evolution or 2) an expected plant response to a transient. The cause of the parameter change or event may be known or unknown.

Basis:

Several instruments are capable of providing indication of RCS temperature with respect to the Technical Specification Cold Shutdown temperature limit (200°F, ref. 1). These include core exit thermocouples (T/Cs) and Wide Range hot leg temperature indications. Plant computer screens are available for monitoring heatup and cooldown (e.g., MODE3, HEATU, COOLD, MODE4, ACCUM, and RHR). The most limiting temperature indication should be used. For example, the highest valid reading temperature indication should be used (ref. 2, 3, 4).

In the absence of reliable RCS temperature indication caused by a loss of decay heat removal capability, classification should be based on EAL CU3.2 should RCS level indication be subsequently lost.

This IC addresses an UNPLANNED increase in RCS temperature above the Technical Specification Cold Shutdown temperature limit and represents a potential degradation of the level of safety of the plant. If the RCS is not intact and CONTAINMENT CLOSURE is not established during this event, the Emergency Coordinator should also refer to IC CA3.

A momentary UNPLANNED excursion above the Technical Specification Cold Shutdown temperature limit when the heat removal function is available **DOES NOT** warrant a classification.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

This EAL involves a loss of decay heat removal capability, or an addition of heat to the RCS in excess of that which can currently be removed, such that reactor coolant temperature cannot be maintained below the Cold Shutdown temperature limit specified in Technical Specifications. During this condition, there is no immediate threat of fuel damage because the core decay heat load has been reduced since the cessation of power operation.

During an outage, the level in the reactor vessel will normally be maintained at or above the reactor vessel flange. Refueling evolutions that lower water level below the reactor vessel flange are carefully planned and controlled. A loss of forced decay heat removal at reduced inventory may result in a rapid increase in reactor coolant temperature depending on the time after shutdown.

Escalation to Alert would be via IC CA1 based on an inventory loss or IC CA3 based on exceeding plant configuration-specific time criteria.

Callaway Basis Reference(s):

1. Callaway Technical Specifications, Table 1.1-1
2. OTG-ZZ-00001, Plant Heatup Cold Shutdown to Hot Standby
3. OSP-BB-00007, RCS Heatup and Cooldown Limitations, Note before Section 6.1 and Attachment 2
4. FSAR, Section 7.2.2.3.2
5. NEI 99-01, CU3

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** C – Cold Shutdown / Refueling System Malfunction**Subcategory:** 3 – RCS Temperature**Initiating Condition:** UNPLANNED increase in RCS temperature**EAL:****CU3.2 Unusual Event**Loss of **all** RCS temperature and RCS level indication for ≥ 15 min.*(Note 1)**Note 1:* The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.**MODE Applicability:**

5 - Cold Shutdown, 6 - Refueling

Definition(s):

None

Basis:

Reactor Vessel water level is normally monitored using the following instruments (ref. 2):

- RCS Loop level indications):
 - Indicators on RL018:
 - BB LI-53A, RCS (LOOP 1) HOT LEG LEV
 - BB LI-53B, RCS (LOOP 4) HOT LEG LEV
 - Computer points:
 - BBL0053A, RCS LOOP 1 HOT LEG LEVEL
 - BBL0053B, RCS LOOP 4 HOT LEG LEVEL
 - BBL053BB, RCS LOOP LEVEL – CTMT VENTED
- RVLIS BB LI-1311, BB LI-1312, BB LI-1321, and BB LI-1322 (if in service) (ref. 3, 4)
- Visual observation (if vessel head is removed) (ref. 5)

The Plant Computer System Display called Refuel Level Indications (turn on code RLI) is available to assist in monitoring important parameters crucial to RCS draining operations (ref. 3).

Several instruments are capable of providing indication of RCS temperature with respect to the Technical Specification Cold Shutdown temperature limit (200°F, ref. 1). These include core exit thermocouples (T/Cs) and Wide Range hot leg temperature indications. Plant computer screens are available for monitoring heatup and cooldown (e.g., MODE3, HEATU, COOLD, MODE4, ACCUM, and RHR). The most limiting temperature indication should be used. For example, the highest valid reading temperature indication should be used (ref. 6, 7, 8).

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

This EAL addresses the inability to determine RCS temperature and level, and represents a potential degradation of the level of safety of the plant. If the RCS is not intact and CONTAINMENT CLOSURE is not established during this event, the Emergency Coordinator should also refer to IC CA3.

This EAL reflects a condition where there has been a significant loss of instrumentation capability necessary to monitor RCS conditions and operators would be unable to monitor key parameters necessary to assure core decay heat removal. During this condition, there is no immediate threat of fuel damage because the core decay heat load has been reduced since the cessation of power operation.

Fifteen minutes was selected as a threshold to exclude transient or momentary losses of indication.

Escalation to Alert would be via IC CA1 based on an inventory loss or IC CA3 based on exceeding plant configuration-specific time criteria.

Callaway Basis Reference(s):

1. Callaway Technical Specifications Table 1.1-1
2. OOA-BB-00003, Refuel Level Indications
3. OTN-BB-00002, Reactor Coolant System Draining
4. FSAR, Section 18.2.13.2
5. OTS-KE-00018, Draining the Refueling Pool
6. OTG-ZZ-00001, Plant Heatup Cold Shutdown to Hot Standby
7. OSP-BB-00007, RCS Heatup and Cooldown Limitations, Note before Section 6.1 and Attachment 2
8. FSAR, Section 7.2.2.3.2
9. NEI 99-01, CU3

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** C – Cold Shutdown / Refueling System Malfunction**Subcategory:** 3 – RCS Temperature**Initiating Condition:** Inability to maintain plant in Cold Shutdown**EAL:****CA3.1 Alert**UNPLANNED increase in RCS temperature to > 200°F for > Table C-4 duration. *(Notes 1, 10)***OR**UNPLANNED RCS pressure increase > 10 psig. *(This EAL does not apply during water-solid plant conditions)**Note 1:* The Emergency Coordinator should declare the event promptly upon determining that the applicable time has been exceeded, or will likely be exceeded.*Note 10:* Begin monitoring hot condition EALs concurrently for any new event or condition not related to the loss of decay heat removal.**Table C-4 RCS Heat-up Duration Thresholds**

RCS Status	CONTAINMENT CLOSURE Status	Heat-up Duration
RCS INTACT (but not REDUCED INVENTORY)	N/A	60 min.*
RCS Not INTACT OR REDUCED INVENTORY	established	20 min.*
	not established	0 min.
* If an RCS heat removal system is in operation within this time frame and RCS temperature is being reduced, the EAL is not applicable.		

MODE Applicability:

5 - Cold Shutdown, 6 - Refueling

Definition(s):**CONTAINMENT CLOSURE** - The procedurally defined conditions or actions taken to secure Primary or Secondary Containment and its associated structures, systems, and components as a functional barrier to fission product release under shutdown conditions.

As applied to Callaway, Containment Closure is established when the requirements of OSP-GT-00003 Containment Closure are met.

RCS INTACT - The RCS should be considered intact when the RCS pressure boundary is in its normal condition for the Cold Shutdown MODE of operation (e.g., no freeze seals or nozzle dams). The RCS is capable of being placed in an intact condition by Operator Action, i.e., pressurized to support natural circulation cooling.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

UNPLANNED - A parameter change or an event that is not 1) the result of an intended evolution or 2) an expected plant response to a transient. The cause of the parameter change or event may be known or unknown.

REDUCED INVENTORY - Plant condition when fuel is in the reactor vessel and Reactor Coolant System level is lower than 3 feet below the Reactor Vessel flange (< 64.0 in.).

Basis:

Several instruments are capable of providing indication of RCS temperature with respect to the Technical Specification Cold Shutdown temperature limit (200°F, ref. 1). These include core exit thermocouples (T/Cs) and Wide Range hot leg temperature indications. Plant computer screens are available for monitoring heatup and cooldown (e.g., MODE3, HEATU, COOLD, MODE4, ACCUM, and RHR). The most limiting temperature indication should be used. For example, the highest valid reading temperature indication should be used (ref. 2, 3, 4).

RCS pressure instrument BB PI-403A is capable of measuring pressure to less than 10 psig (ref. 5).

In the absence of reliable RCS temperature indication caused by the loss of decay heat removal capability, classification should be based on the RCS pressure increase criteria when the RCS is intact in MODE 5 or based on time to boil data when in MODE 6 or the RCS is not intact in MODE 5.

This IC addresses conditions involving a loss of decay heat removal capability or an addition of heat to the RCS in excess of that which can currently be removed. Either condition represents an actual or potential substantial degradation of the level of safety of the plant.

A momentary UNPLANNED excursion above the Technical Specification Cold Shutdown temperature limit when the heat removal function is available **DOES NOT** warrant a classification.

The RCS Heat-up Duration Thresholds table addresses an increase in RCS temperature when CONTAINMENT CLOSURE is established but the RCS is not intact, or RCS inventory is reduced (e.g., mid-loop operation). The 20-minute criterion was included to allow time for operator action to address the temperature increase.

The RCS Heat-up Duration Thresholds table also addresses an increase in RCS temperature with the RCS intact. The status of CONTAINMENT CLOSURE is not crucial in this condition since the intact RCS is providing a high pressure barrier to a fission product release. The 60-minute time frame should allow sufficient time to address the temperature increase without a substantial degradation in plant safety.

Finally, in the case where there is an increase in RCS temperature, the RCS is not intact or is at reduced inventory, and CONTAINMENT CLOSURE is not established, no heat-up duration is allowed (i.e., 0 minutes). This is because 1) the evaporated reactor coolant may be released directly into the containment atmosphere and subsequently to the environment, and 2) there is reduced reactor coolant inventory above the top of irradiated fuel.

The RCS pressure increase threshold provides a pressure-based indication of RCS heat-up in the absence of RCS temperature monitoring capability.

Escalation of the emergency classification level would be via IC CS1 or RS1.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Callaway Basis Reference(s):**

1. Callaway Technical Specifications, Table 1.1-1
2. OTG-ZZ-00001, Plant Heatup Cold Shutdown to Hot Standby
3. OSP-BB-00007, RCS Heatup and Cooldown Limitations, Note before Section 6.1 and Attachment 2
4. FSAR, Section 7.2.2.3.2
5. OTG-ZZ-00006, Plant Cooldown Hot Standby To Cold Shutdown
6. NEI 99-01, CA3

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** C – Cold Shutdown / Refueling System Malfunction**Subcategory:** 4 – Loss of Vital DC Power**Initiating Condition:** Loss of Vital DC power for 15 minutes or longer**EAL:****CU4.1 Unusual Event**

< 107 VDC bus voltage indications on Technical Specification **required** 125 VDC buses for
 ≥ 15 min.
(Note 1)

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

MODE Applicability:

5 - Cold Shutdown, 6 - Refueling

Definition(s):

None

Basis:

The purpose of this EAL is to recognize a loss of DC power compromising the ability to monitor and control the removal of decay heat during Cold Shutdown or refueling operations. This EAL is intended to be anticipatory in as much as the operating crew may not have necessary indication and control of equipment needed to respond to the loss. The fifteen minute interval is intended to exclude transient or momentary power losses.

As used in this EAL, “required” means the vital DC buses necessary to support operation of the in-service, or operable, train or trains of SAFETY SYSTEM equipment. For example, if Train A is out-of-service (inoperable) for scheduled outage maintenance work and Train B is in-service (operable), then a loss of Vital DC power affecting Train B (NK02 or NK04) would require the declaration of an Unusual Event. A loss of Vital DC power to Train A would not warrant an emergency classification.

The vital DC buses are the following 125 VDC Class 1E buses (ref. 1):

Division 1:	Division 2:
NK01	NK02
NK03	NK04

There are four battery banks (NK11, NK12, NK13 and NK14) that supplement the output of the battery chargers. They supply DC power to the distribution buses when AC power to the chargers is lost or when transient loads exceed the 300 amp capacity of the battery chargers.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Due to the load distribution on each of the 125VDC buses, the four batteries for each bus do not have the same rating. All four of the 125VDC buses supply inverters for 120VAC NN bus power as well as control power for various safety related systems. NK01 and NK04 supply additional DC loads such as diesel field flashing, breaker control power, main control board power and emergency lighting. These loads are not supplied by the other two buses, NK02 and NK03. For this reason, batteries NK11 and NK14 require additional capacity. Each battery is designed to have sufficient stored energy to supply the required emergency loads for 240 minutes following a loss of AC power (station blackout) (ref. 2, 3, 4).

Minimum DC bus voltage is 107.0 VDC (ref. 4, 5). Bus voltage may be obtained from the following instruments (ref. 6):

- NK EI-1 (NK01)
- NK EI-2 (NK02)
- NK EI-3 (NK03)
- NK EI-4 (NK04)

This EAL is the cold condition equivalent of the hot condition loss of DC power EAL SS2.1.

This IC addresses a loss of vital DC power which compromises the ability to monitor and control operable SAFETY SYSTEMS when the plant is in the Cold Shutdown or refueling MODE. In these MODES, the core decay heat load has been significantly reduced, and coolant system temperatures and pressures are lower; these conditions increase the time available to restore a vital DC bus to service. Thus, this condition is considered to be a potential degradation of the level of safety of the plant.

Fifteen minutes was selected as a threshold to exclude transient or momentary power losses.

Depending upon the event, escalation of the emergency classification level would be via IC CA1 or CA3, or an IC in Recognition Category R.

Callaway Basis Reference(s):

1. E-21010(Q), DC Single Line Diagram
2. FSAR, Tables 8.3-1, -2, -3
3. FSAR, Section 8.3.2
4. Calculation NK-10, NK System DC Voltage Drop
5. FSAR, Table 8.3A-1 III.B
6. ECA-0.0, Loss of All AC Power
7. NEI 99-01, CU4

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** C – Cold Shutdown / Refueling System Malfunction**Subcategory:** 5 – Loss of Communications**Initiating Condition:** Loss of **all** onsite or offsite communications capabilities**EAL:****CU5.1 Unusual Event**Loss of **all** Table C-5 onsite communication methods.**OR**Loss of **all** Table C-5 ORO communication methods.**OR**Loss of **all** Table C-5 NRC communication methods.

Table C-5 Communication Methods			
System	Onsite	ORO	NRC
Gaitronics	X		
Plant Radios	X		
Plant Emergency Dedicated Phones	X		
Plant Telephone System	X	X	X
ENS (Red Phone) Line		X	X
Back-Up Radio System		X	
Sentry Notification System		X	

MODE Applicability:

5 - Cold Shutdown, 6 - Refueling, D – Defueled

Definition(s):

OFFSITE RESPONSE ORGANIZATIONS (ORO) - The State of Missouri (SEMA/MIAC), Callaway County 911/EOC, Gasconade County 911/EOC, Montgomery County 911/EOC and Osage County 911/EOC.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Basis:**

Onsite/offsite communications include one or more of the systems listed in Table C-5 (ref. 1, 2).

1. Gaitronics system

The Gaitronics system provides six separate independent communication channels--one general page, one Control Room page and four party lines. Communication between parties within the plant can be easily and quickly established by using the general page channel. Communication between parties in the plant and the Control Room can be easily and quickly established using the Control Room page channel. The party line channel is normally used after the page call is completed. As many as four party lines may communicate simultaneously. The portion of the PA system connecting the fuel transfer area in the Containment, the spent fuel area and new fuel handling area in the fuel building, and the control room can be isolated from the remainder of the PA system from the control room. This permits extended use of the fuel handling communications system without disruption to the remainder of the system.

2. Plant Radios

A six channel 800 MHZ trunked radio system for overall plant site area coverage reaches out as far as the intake structure. This two-way radio system provides communications for operating purposes with plant radio-equipped vehicles and plant hand-held portable radios. These systems are for use during normal operation or during a plant emergency. This radio system is available on the Control Room radio consoles, on the security radio consoles, on the EOF radio console, and the TSC radio console. This system is also in the field monitoring team vehicles and is used to communicate during emergencies.

3. Plant Emergency Dedicated Phones

Three independent telephone systems are available for communications between the Emergency Response Facilities: the Technical Assessment Bridge Line, the Dose Assessment Bridge Line and the Emergency Management Bridge Line. Each system operates independently from the other systems and allows for conference calls between the members of that bridge line group

4. Plant telephone system

The telephone system consists of digital automatic switchboard (DPBX) equipment and telephone stations. The DPBX is provided with redundant processors for reliability. The telephone stations are located throughout the power block, in the main control room, in the various buildings around the site, in the security building, and in the service building where the administrative offices are located. For emergency use, unlisted telephone numbers are provided for direct access to the outside local public telephone system. Company provided cell phones **ARE** considered part of the Plant Telephone System. The FLEX response satellite phones are in place for beyond design basis accidents and **ARE NOT** considered part of the Plant Telephone System.

5. ENS (Red Phone) line

The NRC Emergency Notification System (ENS) is an FTS telephone used for official communications with NRC Headquarters. The NRC Headquarters has the capability to patch into the NRC Regional offices. The primary purpose of this phone is to provide a reliable method for the initial notification of the NRC and to maintain continuous communications with the NRC after initial notification. ENS telephones are located in the Control Room, TSC and EOF.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**6. Back-Up Radio System (BURS)

The Back-up Radio System is a communication link between the Callaway Plant and offsite emergency response agencies. The primary use of this system is the back-up notification of offsite agencies and the coordination of offsite activities during a radiological emergency. The system uses 800 MHz radios. There are radio control base units in the Plant Control Room, TSC and EOF, as well as each county EOC and the State EOC. The backup to this system is the commercial touchtone telephone system. Notifications may also be initiated through the Callaway County/City of Fulton EOC via the Security radio.

7. Sentry Notification System

A computerized notification system linked between the Callaway Plant, the State Emergency Management Agency and the four (4) EPZ risk counties. It allows the Communicator to fill out a notification form on screen and transmit the data simultaneously. Notifications on Sentry can be initiated from the Control Room, the Emergency Operations Facility (EOF), or the Technical Support Center (TSC).

This EAL is the cold condition equivalent of the hot condition EAL SU7.1.

This IC addresses a significant loss of on-site or offsite communications capabilities. While not a direct challenge to plant or personnel safety, this event warrants prompt notifications to OROs and the NRC.

This IC should be assessed only when extraordinary means are being utilized to make communications possible (e.g., use of non-plant, privately owned equipment, relaying of on-site information via individuals or multiple radio transmission points, individuals being sent to offsite locations, etc.).

The first EAL condition addresses a total loss of the communications methods used in support of routine plant operations.

The second EAL condition addresses a total loss of the communications methods used to notify all OROs of an emergency declaration.

The third EAL addresses a total loss of the communications methods used to notify the NRC of an emergency declaration.

Callaway Basis Reference(s):

1. Callaway Plant Radiological Emergency Response Plan (RERP), Section 7.2
2. FSAR, Section 9.5.2
3. NEI 99-01, CU5

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: C – Cold Shutdown / Refueling System Malfunction
Subcategory: 6 – Hazardous Event Affecting Safety Systems
Initiating Condition: Hazardous event affecting a SAFETY SYSTEM needed for the current operating MODE

EAL:**CA6.1 Alert**

The occurrence of **any** Table C-6 hazardous event

AND

Event damage has caused indication of degraded performance on one train of a SAFETY SYSTEM needed for the current operating MODE

AND EITHER:

- Event damage has caused indications of degraded performance in a second train of a SAFETY SYSTEM needed for the current operating MODE.
- Event damage has resulted in **VISIBLE DAMAGE** to a second train of a SAFETY SYSTEM needed for the current operating MODE.

(Notes 11, 12)

Note 11: If the hazardous event only results in **VISIBLE DAMAGE**, with no indication of degraded performance to at least one train of a SAFETY SYSTEM, then this emergency classification is not warranted.

Note 12: This EAL is applicable when a Table C-6, Hazardous Events, causes a **LOSS OF SAFETY FUNCTION** on a SAFETY SYSTEM required for the current operating MODE.

Table C-6 Hazardous Events

- EXPLOSION
- FIRE
- HIGH WINDS or tornado strike
- Internal or external FLOODING event
- Seismic event (earthquake)
- Other events with similar hazard characteristics as determined by the Emergency Coordinator

MODE Applicability:

5 - Cold Shutdown, 6 - Refueling

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

Definition(s):

EXPLOSION - A rapid, violent and catastrophic failure of a piece of equipment due to combustion, chemical reaction or over pressurization. A release of steam (from high energy lines or components) or an electrical component failure (caused by short circuits, grounding, arcing, etc.) should not automatically be considered an explosion. Such events require a post-event inspection to determine if the attributes of an explosion are present.

FIRE - Combustion characterized by heat and light. Sources of smoke such as slipping drive belts or overheated electrical equipment do not constitute fires. Observation of flame is preferred but is NOT required if large quantities of smoke and heat are observed.

FLOODING - A condition where water is entering a room or area faster than installed equipment is capable of removal, resulting in a rise of water level within the room or area.

HIGH WINDS - Winds in excess of 40 mph (18 m/s) sustained, or 58 mph (26 m/s) gusting.

LOSS OF SAFETY FUNCTION (LOSF) – A LOSF exists when, assuming no concurrent single failure, a safety function assumed in the accident analysis cannot be performed. For the purpose of the Safety Function Determination Program, a LOSF may exist when a support system is INOPERABLE, AND:

- a) A required system redundant to the system supported by the INOPERABLE support system is also INOPERABLE; OR
- b) A required system redundant to the system in turn supported by the INOPERABLE supported system is also INOPERABLE; OR
- c) A required system redundant to the support system for the supported systems (a) and (b) above is also INOPERABLE.

SAFETY SYSTEM - A system required for safe plant operation, cooling down the plant and/or placing it in the Cold Shutdown condition, including the ECCS. These are typically systems classified as safety-related (as defined in 10CFR50.2):

Those structures, systems and components that are relied upon to remain functional during and following design basis events to assure:

1. The integrity of the reactor coolant pressure boundary;
2. The capability to shut down the reactor and maintain it in a safe shutdown condition;
3. The capability to prevent or mitigate the consequences of accidents which could result in potential offsite exposures.

VISIBLE DAMAGE - Damage to a SAFETY SYSTEM train that is readily observable without measurements, testing, or analysis. The visual impact of the damage is sufficient to cause concern regarding the operability or reliability of the affected SAFETY SYSTEM train.

Basis:

- Annunciator 98D, OBE will illuminate if the seismic instrument detects ground motion in excess of the OBE threshold. OTO-SG-00001, Seismic Event provides the guidance for determining if an OBE earthquake threshold is exceeded and any required response actions (ref. 1).
- Internal FLOODING may be caused by events such as component failures, equipment misalignment, or outage activity mishaps (ref. 2).

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

- External flooding may be due to high rainfall. Callaway plant grade elevation is 840.0 ft. MSL. (ref. 3).
- Seismic Category I structures are analyzed to withstand a sustained, design wind velocity of at least 100 mph. (ref. 4).
- Areas containing functions and systems required for safe shutdown of the plant are identified by fire area (ref. 5).
- An explosion that degrades the performance of a SAFETY SYSTEM train or visibly damages a SAFETY SYSTEM component or structure would be classified under this EAL.

This IC addresses a hazardous event that causes damage to SAFETY SYSTEMS needed for the current operating mode. In order to provide the appropriate context for consideration of an ALERT classification, the hazardous event must have caused indications of degraded SAFETY SYSTEM performance in one train, and there must be either indications of performance issues with the second SAFETY SYSTEM train or VISIBLE DAMAGE to the second train such that the potential exists for this second SAFETY SYSTEM train to have performance issues. In other words, in order for this EAL to be classified, the hazardous event must occur, at least one SAFETY SYSTEM train must have indications of degraded performance, and the second SAFETY SYSTEM train must have indications of degraded performance or VISIBLE DAMAGE such that the potential exists for performance issues. Note that this second SAFETY SYSTEM train is from the same SAFETY SYSTEM that has indications of degraded performance; commercial nuclear power plants are designed to be able to support single system issues without compromising public health and safety from radiological events.

Indications of degraded performance addresses damage to a SAFETY SYSTEM train that is in service/operation since indications for it will be readily available. The indications of degraded performance should be significant enough to cause concern regarding the operability or reliability of the SAFETY SYSTEM train.

Operators will make a determination of VISIBLE DAMAGE based on the totality of available event and damage report information. This is intended to be a brief assessment not requiring lengthy analysis or quantification of the damage. This VISIBLE DAMAGE should be significant enough to cause concern regarding the operability or reliability of the SAFETY SYSTEM train.

Escalation of the emergency classification level would be via ICs CS1 or RS1.

Callaway Basis Reference(s):

1. OTO-SG-00001, Seismic Event
2. IPE Section 3.4.2.3 Results of the Vulnerability Screening
3. FSAR, Section 3.4 Water Level (Flood) Design Table 3.4-1 PMF, Groundwater, Reference, and Actual Plant Elevations
4. FSAR, Section 3.3.1.1 Design Wind Loadings
5. FSAR, Section 9.5.1 Fire Protection System
6. NEI 99-01, CA6

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category H – Hazards and Other Conditions Affecting Plant Safety**

EAL Group: ANY (EALs in this category are applicable to any plant condition, hot or cold.)

Hazards are non-plant, system-related events that can directly or indirectly affect plant operation, reactor plant safety or personnel safety.

1. Security

Unauthorized entry attempts into the Protected Area, bomb threats, sabotage attempts, and actual security compromises threatening loss of physical control of the plant.

2. Seismic Event

Natural events such as earthquakes have potential to cause plant structure or equipment damage of sufficient magnitude to threaten personnel or plant safety.

3. Natural or Technology Hazard

Other natural and non-naturally occurring events that can cause damage to plant facilities include tornados, FLOODING, hazardous material releases and events restricting site access warranting classification.

4. Fire

Fires can pose significant hazards to personnel and reactor safety. Appropriate for classification are fires within the site Protected Area or which may affect operability of equipment needed for safe shutdown

5. Hazardous Gases

Non-naturally occurring events that can cause damage to plant facilities and include toxic, corrosive, asphyxiant or flammable gas leaks.

6. Control Room Evacuation

Events that are indicative of loss of Control Room habitability. If the Control Room must be evacuated, additional support for monitoring and controlling plant functions is necessary through the emergency response facilities.

7. Emergency Coordinator Judgment

The EALs defined in other categories specify the predetermined symptoms or events that are indicative of emergency or potential emergency conditions and thus warrant classification. While these EALs have been developed to address the full spectrum of possible emergency conditions which may warrant classification and subsequent implementation of the Emergency Plan, a provision for classification of emergencies based on operator/management experience and judgment is still necessary. The EALs of this category provide the Emergency Coordinator the latitude to classify emergency conditions consistent with the established classification criteria based upon Emergency Coordinator judgment.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: H – Hazards
Subcategory: 1 – Security
Initiating Condition: Confirmed SECURITY CONDITION or threat

EAL:**HU1.1 Unusual Event**

A SECURITY CONDITION that does **not** involve a HOSTILE ACTION as reported by the Security Shift Supervisor.

OR

Notification of a credible security threat directed at the site.

OR

A validated notification from the NRC providing information of an aircraft threat.

MODE Applicability:

All

Definition(s):

SECURITY CONDITION - Any security event as listed in the approved security contingency plan that constitutes a threat/compromise to site security, threat/risk to site personnel, or a potential degradation to the level of safety of the plant. A security condition does not involve a hostile action.

HOSTILE ACTION - An act toward Callaway or its personnel that includes the use of violent force to destroy equipment, take hostages, and/or intimidate the licensee to achieve an end. This includes attack by air, land, or water using guns, explosives, projectiles, vehicles, or other devices used to deliver destructive force. Other acts that satisfy the overall intent may be included. Hostile action should not be construed to include acts of civil disobedience or felonious acts that are not part of a concerted attack on Callaway. Non-terrorism-based EALs should be used to address such activities (i.e., this may include violent acts between individuals in the owner controlled area).

Basis:

The security shift supervision is defined as the Security Shift Supervisor.

This EAL is based on the Callaway Plant Security Plan and DBT (ref. 1).

This IC addresses events that pose a threat to plant personnel or SAFETY SYSTEM equipment, and thus represent a potential degradation in the level of plant safety. Security events which do not meet one of these EALs are adequately addressed by the requirements of 10 CFR 73.71 or 10 CFR 50.72. Security events assessed as HOSTILE ACTIONS are classifiable under **ICs HA1, and HS1.**

Timely and accurate communications between Security Shift Supervision and the Control Room is essential for proper classification of a security-related event (ref. 2, 3, 4). Classification of these events will initiate appropriate threat-related notifications to plant personnel and Offsite Response Organizations.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Security plans and terminology are based on the guidance provided by NEI 03-12, Template for the Security Plan, Training and Qualification Plan, Safeguards Contingency Plan.

The first threshold references the Shift Security Supervisor because these are the individuals trained to confirm that a security event is occurring or has occurred. Training on security event confirmation and classification is controlled due to the nature of Safeguards and 10 CFR 2.39 information.

The second threshold addresses the receipt of a credible security threat. The credibility of the threat is assessed in accordance with the Callaway Plant Security Plan and DBT.

The third threshold addresses the threat from the impact of an aircraft on the plant. The NRC Headquarters Operations Officer (HOO) will communicate to the licensee if the threat involves an aircraft. The status and size of the plane may also be provided by NORAD through the NRC. Validation of the threat is performed in accordance with the Callaway Plant Security Plan and DBT (ref. 1).

Emergency plans and implementing procedures are public documents; therefore, EALs should not incorporate Security-sensitive information. This includes information that may be advantageous to a potential adversary, such as the particulars concerning a specific threat or threat location. Security-sensitive information should be contained in non-public documents such as the Callaway Plant Security Plan and DBT (ref. 1).

Escalation of the emergency classification level would be via IC HA1.

Callaway Basis Reference(s):

1. Callaway Plant Security Plan and DBT (Safeguards)
2. EIP-ZZ-SK001, Response to Security Threat
3. SDP-CP-00003, Security Contingency Events
4. OTO-SK-00002, Plant Security Event - Aircraft Threat
5. NEI 99-01, HU1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** H – Hazards**Subcategory:** 1 – Security**Initiating Condition:** HOSTILE ACTION within the OWNER CONTROLLED AREA or airborne attack threat within 30 minutes**EAL:****HA1.1 Alert**

A HOSTILE ACTION is occurring or has occurred within the OWNER CONTROLLED AREA as reported by the Security Shift Supervisor.

OR

A validated notification from NRC of an aircraft attack threat within 30 min. of the site.

MODE Applicability:

All

Definition(s):

HOSTILE ACTION - An act toward Callaway or its personnel that includes the use of violent force to destroy equipment, take hostages, and/or intimidate the licensee to achieve an end. This includes attack by air, land, or water using guns, explosives, projectiles, vehicles, or other devices used to deliver destructive force. Other acts that satisfy the overall intent may be included. Hostile action should not be construed to include acts of civil disobedience or felonious acts that are not part of a concerted attack on Callaway. Non-terrorism-based EALs should be used to address such activities (i.e., this may include violent acts between individuals in the owner controlled area).

OWNER CONTROLLED AREA - Area outside the PROTECTED AREA fence that immediately surrounds the plant. Access to this area is generally restricted to those entering on official business.

Basis:

The security shift supervision is defined as the Security Shift Supervisor.

This IC addresses the occurrence of a HOSTILE ACTION within the OWNER CONTROLLED AREA or notification of an aircraft attack threat. This event will require rapid response and assistance due to the possibility of the attack progressing to the PROTECTED AREA, or the need to prepare the plant and staff for a potential aircraft impact.

Timely and accurate communications between the Security Shift Supervisor and the Control Room is essential for proper classification of a security-related event (ref. 2, 3, 4).

Security plans and terminology are based on the guidance provided by NEI 03-12, Template for the Security Plan, Training and Qualification Plan, Safeguards Contingency Plan.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

As time and conditions allow, these events require a heightened state of readiness by the plant staff and implementation of onsite protective measures (e.g., evacuation, dispersal or sheltering). The Alert declaration will also heighten the awareness of Offsite Response Organizations (OROs), allowing them to be better prepared should it be necessary to consider further actions.

This IC does not apply to incidents that are accidental events, acts of civil disobedience, or otherwise are not a HOSTILE ACTION perpetrated by a HOSTILE FORCE. Examples include the crash of a small aircraft, shots from hunters, physical disputes between employees, etc. Reporting of these types of events is adequately addressed by other EALs, or the requirements of 10 CFR 73.71 or 10 CFR 50.72.

The first threshold is applicable for any HOSTILE ACTION occurring, or that has occurred, in the OWNER CONTROLLED AREA.

The second threshold addresses the threat from the impact of an aircraft on the plant, and the anticipated arrival time is within 30 minutes. The intent of this EAL is to ensure that threat-related notifications are made in a timely manner so that plant personnel and OROs are in a heightened state of readiness. This EAL is met when the threat-related information has been validated in accordance with site-specific security procedures.

The NRC Headquarters Operations Officer (HOO) will communicate to the licensee if the threat involves an aircraft. The status and size of the plane may be provided by NORAD through the NRC.

In some cases, it may not be readily apparent if an aircraft impact within the OWNER CONTROLLED AREA was intentional (i.e., a HOSTILE ACTION). It is expected, although not certain, that notification by an appropriate Federal agency to the site would clarify this point. In this case, the appropriate federal agency is intended to be NORAD, FBI, FAA or NRC. The emergency declaration, including one based on other ICs/EALs, should not be unduly delayed while awaiting notification by a Federal agency.

Emergency plans and implementing procedures are public documents; therefore, EALs should not incorporate Security-sensitive information. This includes information that may be advantageous to a potential adversary, such as the particulars concerning a specific threat or threat location. Security-sensitive information should be contained in non-public documents such as the Callaway Plant Security Plan and DBT (ref. 1).

Callaway Basis Reference(s):

1. Callaway Plant Security Plan and DBT (Safeguards)
2. EIP-ZZ-SK001, Response to Security Threat
3. SDP-CP-00003, Security Contingency Events
4. OTO-SK-00002, Plant Security Event - Aircraft Threat
5. NEI 99-01, HA1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** H – Hazards**Subcategory:** 1 – Security**Initiating Condition:** HOSTILE ACTION within the PROTECTED AREA**EAL:****HS1.1 Site Area Emergency**

A HOSTILE ACTION is occurring or has occurred within the PROTECTED AREA as reported by the Security Shift Supervisor.

MODE Applicability:

All

Definition(s):

HOSTILE ACTION - An act toward Callaway or its personnel that includes the use of violent force to destroy equipment, take hostages, and/or intimidate the licensee to achieve an end. This includes attack by air, land, or water using guns, explosives, projectiles, vehicles, or other devices used to deliver destructive force. Other acts that satisfy the overall intent may be included. Hostile action should not be construed to include acts of civil disobedience or felonious acts that are not part of a concerted attack on Callaway. Non-terrorism-based EALs should be used to address such activities (i.e., this may include violent acts between individuals in the owner controlled area).

PROTECTED AREA - An area encompassed by physical barriers and to which access is controlled. The Protected Area refers to the designated security area around the process buildings and is depicted in Drawing 8600-X-88100 Property-Site Layout, Owner Controlled Area and Surrounding Area.

Basis:

The security shift supervision is defined as the Security Shift Supervisor.

These individuals are the designated on-site personnel qualified and trained to confirm that a security event is occurring or has occurred. Training on security event classification confirmation is closely controlled due to the strict secrecy controls placed on the Callaway Plant Security Plan and DBT (Safeguards) information. (ref. 1)

This IC addresses the occurrence of a HOSTILE ACTION within the PROTECTED AREA. This event will require rapid response and assistance due to the possibility for damage to plant equipment.

Timely and accurate communications between Security Shift Supervision and the Control Room is essential for proper classification of a security-related event (ref. 2, 3, 4 5).

Security plans and terminology are based on the guidance provided by NEI 03-12, Template for the Security Plan, Training and Qualification Plan, Safeguards Contingency Plan.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

As time and conditions allow, these events require a heightened state of readiness by the plant staff and implementation of onsite protective measures (e.g., evacuation, dispersal or sheltering). The Site Area Emergency declaration will mobilize Offsite Response Organization (ORO) resources and have them available to develop and implement public protective actions in the unlikely event that the attack is successful in impairing multiple safety functions.

This IC does not apply to incidents that are accidental events, acts of civil disobedience, or otherwise are not a HOSTILE ACTION perpetrated by a HOSTILE FORCE. Examples include the crash of a small aircraft, shots from hunters, physical disputes between employees, etc. Reporting of these types of events is adequately addressed by other EALs, or the requirements of 10 CFR 73.71 or 10 CFR 50.72.

Emergency plans and implementing procedures are public documents; therefore, EALs should not incorporate Security-sensitive information. This includes information that may be advantageous to a potential adversary, such as the particulars concerning a specific threat or threat location. Security-sensitive information should be contained in non-public documents such as the Callaway Plant Security Plan and DBT (ref. 1).

Escalation of the emergency classification level would be via ICs RG1, RG2, SG1, SG2, FG1, and CG1.

Callaway Basis Reference(s):

1. Callaway Plant Security Plan and DBT (Safeguards)
2. EIP-ZZ-SK001, Response to Security Threat
3. SDP-CP-00003, Security Contingency Events
4. OTO-SK-00001, Plant Security Event – Hostile Intrusion
5. OTO-SK-00002, Plant Security Event - Aircraft Threat
6. NEI 99-01, HS1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

Category: H – Hazards and Other Conditions Affecting Plant Safety
Subcategory: 2 – Seismic Event
Initiating Condition: Seismic event greater than OBE level

EAL:

HU2.1	Unusual Event
Seismic event > OBE as indicated by Seismic Activity, Annunciator 98D.	

MODE Applicability:

All

Definition(s):

None

Basis:

Annunciator 98D, OBE will illuminate if the seismic instrument detects ground motion in excess of the OBE threshold (ref. 4).

Seismic Event verification with external sources should not be necessary during or following an OBE. Earthquakes of this magnitude should be readily felt by on-site personnel and recognized as a seismic event. Shift Manager or Emergency Coordinator may seek external verification if deemed appropriate (e.g., a call to the USGS, check internet news sources, etc.); however, the verification action must not preclude a timely emergency declaration.

To avoid inappropriate emergency classification resulting from spurious actuation of the seismic instrumentation or felt motion not attributable to seismic activity, an offsite agency like the USGS, National Earthquake Information Center (NEIC) can confirm that an earthquake has occurred in the area of the plant. Such confirmation should not, however, preclude a timely emergency declaration based on receipt of the OBE alarm. The NEIC can be contacted by calling **(303) 273-8500**. Select **option #1** and inform the analyst you wish to confirm recent seismic activity in the vicinity of Callaway. Alternatively, near real-time seismic activity can be accessed via the NEIC website:

<http://earthquake.usgs.gov/>

Additional actions after EAL declaration:

When the seismic recorder indicates that the OBE has been exceeded, as verified by ETP-SG-00001, the reactor must be shut down and remain shut down until inspection of the facility shows that no damage has been incurred which would jeopardize safe operation of the facility or until such damage is repaired. Callaway was designed such that, for ground motion less than the OBE, those features of the plant necessary for continued operation without undue risk to the health and safety of the public will remain functional. Any ground motion in excess of this results in an uncertainty as to the extent of the damage which must be resolved before continued operation can be considered safe (ref. 1). Ground motion of this magnitude is unmistakably a “felt” earthquake.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

OTO-SG-00001, Seismic Event provides the guidance for determining if the OBE earthquake threshold is exceeded and any required response actions. (ref. 2)

This IC addresses a seismic event that results in accelerations at the plant site greater than those specified for an Operating Basis Earthquake (OBE). An earthquake greater than an OBE but less than a Safe Shutdown Earthquake (SSE) should have no significant impact on safety-related systems, structures and components; however, some time may be required for the plant staff to ascertain the actual post-event condition of the plant (e.g., performs walk-downs and post-event inspections). Given the time necessary to perform walk-downs and inspections, and fully understand any impacts, this event represents a potential degradation of the level of safety of the plant.

Depending upon the plant MODE at the time of the event, escalation of the emergency classification level would be via IC CA6 or SA9.

Callaway Basis Reference(s):

1. FSAR Section 3.7(B).1.1 Design Response Spectra
2. OTO-SG-00001, Seismic Event
3. NEI 99-01, HU2
4. FSAR Table 16.3-3, Seismic Monitoring Instrumentation

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: H – Hazards and Other Conditions Affecting Plant Safety

Subcategory: 3 – Natural or Technology Hazard

Initiating Condition: Hazardous event

EAL:**HU3.1 Unusual Event**

A tornado strike within the PROTECTED AREA.

MODE Applicability:

All

Definition(s):

PROTECTED AREA - An area encompassed by physical barriers and to which access is controlled. The Protected Area refers to the designated security area around the process buildings and is depicted in Drawing 8600-X-88100 Property-Site Layout, Owner Controlled Area and Surrounding Area.

Basis:

Response actions associated with a tornado onsite is provided in OTO-ZZ-00012 Severe Weather (ref. 1).

If damage is confirmed visually or by other in-plant indications, the event may be escalated to an Alert under EAL CA6.1 or SA9.1.

A tornado striking (touching down) within the PROTECTED AREA warrants declaration of an Unusual Event regardless of the measured wind speed at the meteorological tower. A tornado is defined as a violently rotating column of air in contact with the ground and extending from the base of a thunderstorm.

This IC addresses hazardous events that are considered to represent a potential degradation of the level of safety of the plant.

EAL HU3.1 addresses a tornado striking (touching down) within the PROTECTED AREA.

Escalation of the emergency classification level would be based on ICs in Recognition Categories R, F, S or C.

Callaway Basis Reference(s):

1. OTO-ZZ-00012, Severe Weather
2. NEI 99-01, HU3

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** H – Hazards and Other Conditions Affecting Plant Safety**Subcategory:** 3 – Natural or Technology Hazard**Initiating Condition:** Hazardous event**EAL:****HU3.2 Unusual Event**

Internal room or area FLOODING of a magnitude sufficient to require manual or automatic electrical isolation of a SAFETY SYSTEM component needed for the current operating MODE.

MODE Applicability:

All

Definition(s):

FLOODING - A condition where water is entering a room or area faster than installed equipment is capable of removal, resulting in a rise of water level within the room or area.

SAFETY SYSTEM - A system required for safe plant operation, cooling down the plant and/or placing it in the Cold Shutdown condition, including the ECCS. These are typically systems classified as safety-related (as defined in 10CFR50.2):

Those structures, systems and components that are relied upon to remain functional during and following design basis events to assure:

1. The integrity of the reactor coolant pressure boundary;
2. The capability to shut down the reactor and maintain it in a safe shutdown condition;
3. The capability to prevent or mitigate the consequences of accidents which could result in potential offsite exposures.

Basis:

Refer to EAL CA6.1 or SA9.1 for internal or external flooding affecting one or more SAFETY SYSTEM trains.

This IC addresses hazardous events that are considered to represent a potential degradation of the level of safety of the plant.

This EAL addresses FLOODING of a building room or area that results in operators isolating power to a SAFETY SYSTEM component due to water level or other wetting concerns. Classification is also required if the water level or related wetting causes an automatic isolation of a SAFETY SYSTEM component from its power source (e.g., a breaker or relay trip). To warrant classification, operability of the affected component must be required by Technical Specifications for the current operating MODE.

Escalation of the emergency classification level would be based on ICs in Recognition Categories R, F, S or C.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

Callaway Basis Reference(s):

1. IPE Section 3.4.2.3 Results of the Vulnerability Screening
2. NEI 99-01, HU3

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: H – Hazards and Other Conditions Affecting Plant Safety

Subcategory: 3 – Natural or Technology Hazard

Initiating Condition: Hazardous event

EAL:**HU3.3 Unusual Event**

Movement of personnel within the PROTECTED AREA is IMPEDED due to an offsite event involving hazardous materials (e.g., an offsite chemical spill or toxic gas release).

MODE Applicability:

All

Definition(s):

IMPEDE(D) - Personnel access to a room or area is hindered to an extent that extraordinary measures are necessary to facilitate entry of personnel into the affected room/area (e.g., requiring use of protective equipment, such as SCBAs, that is not routinely employed).

PROTECTED AREA - An area encompassed by physical barriers and to which access is controlled. The Protected Area refers to the designated security area around the process buildings and is depicted in Drawing 8600-X-88100 Property-Site Layout, Owner Controlled Area and Surrounding Area.

Basis:

As used here, the term "offsite" is meant to be areas external to the Callaway PROTECTED AREA.

This IC addresses hazardous events that are considered to represent a potential degradation of the level of safety of the plant.

This EAL addresses a hazardous materials event originating at an offsite location and of sufficient magnitude to impede the movement of personnel within the PROTECTED AREA.

The process of flushing chemicals to the sump at the Circ and Service Water building is in a normal plant operations area, but since it is a **planned maintenance** activity it is **excluded** provided the process was controlled. That means looking at extra ventilation and barrier tape to control access. Then as long as the process by which the gasses are being generated is controlled (not expanding beyond the boundary set), is short in duration, and we are able to monitor the atmosphere at the boundary we should be outside the EAL threshold. If we lose control of the process and as a result we had to evacuate part of the Protected Area, then that could meet the IC for HU3.3.

Escalation of the emergency classification level would be based on ICs in Recognition Categories R, F, S or C.

Callaway Basis Reference(s):

1. NEI 99-01, HU3

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: H – Hazards and Other Conditions Affecting Plant Safety

Subcategory: 3 – Natural or Technology Hazard

Initiating Condition: Hazardous event

EAL:**HU3.4 Unusual Event**

A hazardous event that results in on-site conditions sufficient to prohibit the plant staff from accessing the site via personal vehicles.

(Note 7)

Note 7: This EAL does not apply to routine traffic impediments such as fog, snow, ice, or vehicle breakdowns or accidents.

MODE Applicability:

All

Definition(s):

None

Basis:

This IC addresses hazardous events that are considered to represent a potential degradation of the level of safety of the plant.

This EAL addresses a hazardous event that causes an on-site impediment to vehicle movement and significant enough to prohibit the plant staff from accessing the site using personal vehicles. Examples of such an event include site FLOODING caused by a hurricane, heavy rains, up-river water releases, dam failure, etc., or an on-site train derailment blocking the access road.

This EAL is not intended apply to routine impediments such as fog, snow, ice, or vehicle breakdowns or accidents, but rather to more significant conditions such as the Hurricane Andrew strike on Turkey Point in 1992, the flooding around the Cooper Station during the Midwest floods of 1993, or the flooding around Ft. Calhoun Station in 2011.

If **ALL** access roads to the plant are impassable, and local authorities are no longer clearing roads, this EAL applies.

Escalation of the emergency classification level would be based on ICs in Recognition Categories R, F, S or C.

Callaway Basis Reference(s):

1. NEI 99-01, HU3

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** H – Hazards and Other Conditions Affecting Plant Safety**Subcategory:** 4 – Fire**Initiating Condition:** FIRE potentially degrading the level of safety of the plant**EAL:****HU4.1 Unusual Event**

A FIRE is **not** extinguished within 15 min. of **any** of the following FIRE detection indications:
(Note 1)

- Report from the field (i.e., visual observation).
- Receipt of multiple (more than 1) fire alarms or indications.
- Field verification of a single fire alarm.

AND

The FIRE is located within **any** Table H-1 area.

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

Table H-1 Fire Areas

- Area 5
- Auxiliary Building
- Aux Feedwater Pump Rooms
- Containment
- Control Building/Communications Corridor
- Diesel Generator Building
- ESW Pumphouse
- Fuel Building
- RWST
- UHS Cooling Tower

MODE Applicability:

All

Definition(s):

FIRE - Combustion characterized by heat and light. Sources of smoke such as slipping drive belts or overheated electrical equipment do not constitute fires. Observation of flame is preferred but is NOT required if large quantities of smoke and heat are observed.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

Basis:

The 15 minute requirement begins with a credible notification that a fire is occurring, or receipt of multiple valid fire detection system alarms or field validation of a single fire alarm. The alarm is to be validated using available Control Room indications or alarms to prove that it is not spurious, or by reports from the field. Actual field reports must be made within the 15 minute time limit or a classification must be made. If a fire is verified to be occurring by field report, the 15 minute time limit is from the original receipt of the fire detection alarm.

Table H-1 Fire Areas are based on FSAR Section 5.4A.2 System Required to Go From Hot Standby to Cold Shutdown. Table H-1 Fire Areas include those structures containing functions and systems required for safe shutdown of the plant (SAFETY SYSTEMS) (ref. 1). The Laundry Decon Facility is NOT part of the Aux Building.

This IC addresses the magnitude and extent of FIRES that may be indicative of a potential degradation of the level of safety of the plant.

For EAL HU4.1 the intent of the 15-minute duration is to size the FIRE and to discriminate against small FIRES that are readily extinguished (e.g., smoldering waste paper basket). In addition to alarms, other indications of a FIRE could be a drop in fire main pressure, automatic activation of a suppression system, etc.

The Shift Manager needs to ask some specific questions to ensure they have the information needed to evaluate the situation.

- Is there visible flame?
- Are there copious quantities of smoke still being generated?

A smoked component (subject to overheating) should show blackened areas or signs that the component itself had been very hot (e.g., paint peeling). It can be expected to generate some lower level of smoke. If there is so much smoke present that entry to inspect the component is not possible without an SCBA, that would probably be an indication that a fire existed and determine if EAL HA5.1 is applicable (MODE 4 only). If a breaker truly suffered a fault local to the breaker, the damage and fire ball would be such that consideration of the Hazardous Event EAL SA9.1 would be recommended, if a required Safety System was affected.

In the case of a fire alarm in Containment, OTA-KC-01008 states that at the discretion of the Shift Manager/Operating Supervisor, either:

- INSPECT detectors for operation AND INSPECT the Reactor Building for the presence of smoke/fire,
- OR**
- INSPECT other containments parameters available in the Control Room, such as other detection zones, containment temperature or equipment failure, for evidence of a fire.

Other items to monitor would be Containment Radiation Monitors such as GTRE0031 and GTRE0032 for loss of flow due to filters plugging. The important thing is to make the initial declaration timely with respect to the time of the initial indication. In all cases, document the indications considered for the decision made. If indications of failing safety related equipment are attributable to the fire, consider Hazardous Event EAL SA9.1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Upon receipt, operators will take prompt actions to confirm the validity of an initial fire alarm, indication, or report. For EAL assessment purposes, the emergency declaration clock starts at the time that the initial alarm, indication, or report was received, and not the time that a subsequent verification action was performed. Similarly, the fire duration clock also starts at the time of receipt of the initial alarm, indication or report.

Depending upon the plant MODE at the time of the event, escalation of the emergency classification level would be via IC CA6 or SA9.

Callaway Basis Reference(s):

1. FSAR, Section 5.4A.2 System Required to Go From Hot Standby to Cold Shutdown
2. NEI 99-01, HU4

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** H – Hazards and Other Conditions Affecting Plant Safety**Subcategory:** 4 – Fire**Initiating Condition:** FIRE potentially degrading the level of safety of the plant**EAL:****HU4.2 Unusual Event**Receipt of a single fire alarm (i.e., **no** other indications of a FIRE).**AND**The fire alarm is indicating a FIRE within **any** Table H-1 area.**AND**The existence of a FIRE is **not** verified within 30 min. of alarm receipt.*(Note 1)**Note 1:* The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.**Table H-1 Fire Areas**

- Area 5
- Auxiliary Building
- Aux Feedwater Pump Rooms
- Containment
- Control Building/Communications Corridor
- Diesel Generator Building
- ESW Pumphouse
- Fuel Building
- RWST
- UHS Cooling Tower

MODE Applicability:

All

Definition(s):*FIRE* - Combustion characterized by heat and light. Sources of smoke such as slipping drive belts or overheated electrical equipment do not constitute fires. Observation of flame is preferred but is NOT required if large quantities of smoke and heat are observed.**Basis:**

The 30 minute requirement begins upon receipt of a single valid fire detection system alarm. The alarm is to be validated using available Control Room indications or alarms to prove that it is not spurious, or by reports from the field. Actual field reports must be made within the 30 minute time limit or a classification must be made. If a fire is verified to be occurring by field report, classification shall be made based on EAL HU4.1.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

Table H-1 Fire Areas are based on FSAR Section 5.4A.2 System Required to Go From Hot Standby to Cold Shutdown. Table H-1 Fire Areas include those structures containing functions and systems required for safe shutdown of the plant (SAFETY SYSTEMS) (ref. 1). The Laundry Decon Facility is NOT part of the Aux Building.

This IC addresses the magnitude and extent of FIRES that may be indicative of a potential degradation of the level of safety of the plant.

This EAL addresses receipt of a single fire alarm, and the existence of a FIRE is not verified (i.e., proved or disproved) within 30-minutes of the alarm. Upon receipt, operators will take prompt actions to confirm the validity of a single fire alarm. For EAL assessment purposes, the 30-minute clock starts at the time that the initial alarm was received, and not the time that a subsequent verification action was performed.

A single fire alarm, absent other indication(s) of a FIRE, may be indicative of equipment failure or a spurious activation, and not an actual FIRE. For this reason, additional time is allowed to verify the validity of the alarm. The 30-minute period is a reasonable amount of time to determine if an actual FIRE exists; however, after that time, and absent information to the contrary, it is assumed that an actual FIRE is in progress.

If an actual FIRE is verified by a report from the field, then HU4.1 is immediately applicable, and the emergency must be declared if the FIRE is not extinguished within 15-minutes of the report. If the alarm is verified to be due to an equipment failure or a spurious activation, and this verification occurs within 30-minutes of the receipt of the alarm, then this EAL is not applicable and no emergency declaration is warranted.

The Shift Manager needs to ask some specific questions to ensure they have the information needed to evaluate the situation.

- Is there visible flame?
- Are there copious quantities of smoke still being generated?

A smoked component (subject to overheating) should show blackened areas or signs that the component itself had been very hot (e.g., paint peeling). It can be expected to generate some lower level of smoke. If there is so much smoke present that entry to inspect the component is not possible without an SCBA, that would probably be an indication that a fire existed and determine if EAL HA5.1 is applicable (MODE 4 only). If a breaker truly suffered a fault local to the breaker, the damage and fire ball would be such that consideration of the Hazardous Event EAL SA9.1 would be recommended, if a required Safety System was affected.

In the case of a fire alarm in Containment, OTA-KC-01008 states that at the discretion of the Shift Manager/Operating Supervisor, either:

- INSPECT detectors for operation AND INSPECT the Reactor Building for the presence of smoke/fire,
- OR**
- INSPECT other containments parameters available in the Control Room, such as other detection zones, containment temperature or equipment failure, for evidence of a fire.

Other items to monitor would be Containment Radiation Monitors such as GTRE0031 and GTRE0032 for loss of flow due to filters plugging. The important thing is to make the initial declaration timely with respect to the time of the initial indication. In all cases, document the indications considered for the decision made. If indications of failing safety related equipment are attributable to the fire, consider Hazardous Event EAL SA9.1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Basis-Related Requirements from 10 CFR 50**

10 CFR 50 Appendix A, Criterion 3 states in part:

"Structures, systems, and components important to safety shall be designed and located to minimize, consistent with other safety requirements, the probability and effect of fires and explosions."

10 CFR 50.48 Fire Protection states under (2) (iii) "The means to limit fire damage to structures, systems, or components important to safety so that the capability to shut down the plant safely is ensured."

NFPA 805 Section 1.3.1 states "The Nuclear Safety Goal is to provide reasonable assurance that a fire during any plant operational mode and plant configuration will not prevent the plant from achieving and maintaining the fuel in a safe and stable condition."

In addition, NFPA 805 Section 4.2.3.3, requires, among other considerations, the use of 1-hour fire barriers for the enclosure of cable and equipment and associated non-safety circuits of one redundant train. As used in HU4.2, the 30-minutes to verify a single alarm is well within this worst-case 1-hour time period.

Depending upon the plant MODE at the time of the event, escalation of the emergency classification level would be via IC CA6 or SA9.

Callaway Basis Reference(s):

1. FSAR, Section 5.4A.2 System Required to Go From Hot Standby to Cold Shutdown
2. NEI 99-01, HU4

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: H – Hazards and Other Conditions Affecting Plant Safety
Subcategory: 4 – Fire
Initiating Condition: FIRE potentially degrading the level of safety of the plant

EAL:**HU4.3 Unusual Event**

A FIRE within the plant PROTECTED AREA **not** extinguished within 60 min. of the initial report, alarm or indication.

(Note 1)

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

MODE Applicability:

All

Definition(s):

FIRE - Combustion characterized by heat and light. Sources of smoke such as slipping drive belts or overheated electrical equipment do not constitute fires. Observation of flame is preferred but is NOT required if large quantities of smoke and heat are observed.

PROTECTED AREA - An area encompassed by physical barriers and to which access is controlled. The Protected Area refers to the designated security area around the process buildings and is depicted in Drawing 8600-X-88100 Property-Site Layout, Owner Controlled Area and Surrounding Area.

Basis:

This IC addresses the magnitude and extent of FIRES that may be indicative of a potential degradation of the level of safety of the plant.

In addition to a FIRE addressed by EAL HU4.1 or HU4.2, a FIRE within the plant PROTECTED AREA not extinguished within 60-minutes may also potentially degrade the level of plant safety.

Depending upon the plant MODE at the time of the event, escalation of the emergency classification level would be via IC CA6 or SA9.

Callaway Basis Reference(s):

1. NEI 99-01, HU4

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: H – Hazards and Other Conditions Affecting Plant Safety

Subcategory: 4 – Fire

Initiating Condition: FIRE potentially degrading the level of safety of the plant

EAL:**HU4.4 Unusual Event**

A FIRE within the plant PROTECTED AREA that requires firefighting support by an offsite fire response agency to extinguish.

MODE Applicability:

All

Definition(s):

FIRE - Combustion characterized by heat and light. Sources of smoke such as slipping drive belts or overheated electrical equipment do not constitute fires. Observation of flame is preferred but is NOT required if large quantities of smoke and heat are observed.

PROTECTED AREA - An area encompassed by physical barriers and to which access is controlled. The Protected Area refers to the designated security area around the process buildings and is depicted in Drawing 8600-X-88100 Property-Site Layout, Owner Controlled Area and Surrounding Area.

Basis:

This IC addresses the magnitude and extent of FIRES that may be indicative of a potential degradation of the level of safety of the plant.

If a FIRE within the plant PROTECTED AREA is of sufficient size to require a response by an offsite firefighting agency (e.g., a local town Fire Department), then the level of plant safety is potentially degraded. The dispatch of an offsite firefighting agency to the site requires an emergency declaration only if it is needed to actively support firefighting efforts because the fire is beyond the capability of the Fire Brigade to extinguish. Declaration is **NOT** necessary if the agency resources are placed on stand-by, or supporting post-extinguishment recovery or investigation actions.

Depending upon the plant MODE at the time of the event, escalation of the emergency classification level would be via IC CA6 or SA9.

Callaway Basis Reference(s):

1. NEI 99-01, HU4

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: H – Hazards and Other Conditions Affecting Plant Safety
Subcategory: 5 – Hazardous Gases
Initiating Condition: Gaseous release IMPEDING access to equipment necessary for normal plant operations, cooldown or shutdown

EAL:**HA5.1 Alert**

Release of a toxic, corrosive, asphyxiant or flammable gas that prohibits or IMPEDES access to **EITHER** of the following: *(Note 5)*

- North Electrical Penetration Room. *(Room 1410)*
- South Electrical Penetration Room. *(Room 1409)*

Note 5: If the equipment in the listed room or area was already inoperable or out-of-service before the event occurred, then no emergency classification is warranted.

MODE Applicability:

4 – Hot Shutdown

Definition(s):

IMPEDE(D) - Personnel access to a room or area is hindered to an extent that extraordinary measures are necessary to facilitate entry of personnel into the affected room/area (e.g., requiring use of protective equipment, such as SCBAs, that is not routinely employed).

Basis:

The only rooms/areas external to the Control Room that require access to perform field actions consistent with the above criteria for Callaway are the North and South Electrical Penetration Rooms when in MODE 4 to support isolating SI accumulators and placing RHR in service for RCS cooldown to Cold Shutdown (ref. 1, 2, 3). The equipment required is:

For SI Accumulators:

- NG01BGF3, FDR BKR TO EPHV8808A SI ACC A OUT ISO, *(Room 1410)*
- NG02BGF3, FDR BKR TO EPHV8808B SI ACC B OUT ISO, *(Room 1409)*
- NG01BGF2, FDR BKR TO EPHV8808C SI ACC C OUT ISO, *(Room 1410)*
- NG02BHF2, FDR BKR TO EPHV8808D SI ACC D OUT ISO, *(Room 1409)*

For "A" RHR:

- NG02BCF2, FDR BKR TO BBPV8702A RCS LOOP 1 HOT LEG TO RHR PMPS ISO, *(Room 1409)*
- NG01BEF2, FDR BKR TO EJHV8701A A RHR PMP SUCT FROM RCS HOT LEG 1 ISO, *(Room 1410)*

For "B" RHR:

- NG02BBF3, FDR BKR TO BBPV8702B RCS LOOP 4 HOT LEG TO RHR PMPS ISO, *(Room 1409)*
- NG01BDF3, FDR BKR TO EJHV8701B B RHR PMP SUCT FROM RCS HOT LEG 4 ISO, *(Room 1410)*

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

This IC addresses an event involving a release of a hazardous gas that precludes or impedes access to equipment necessary to maintain normal plant operation, or required for a normal plant cooldown and shutdown. This condition represents an actual or potential substantial degradation of the level of safety of the plant.

An Alert declaration is warranted if entry into the affected room/area is, or may be, procedurally required during the plant operating MODE in effect at the time of the gaseous release. The emergency classification is not contingent upon whether entry is actually necessary at the time of the release

Evaluation of the IC and EAL do not require atmospheric sampling; it only requires the Emergency Coordinator's judgment that the gas concentration in the affected room/area is sufficient to preclude or significantly impede procedurally required access. This judgment may be based on a variety of factors including an existing job hazard analysis, report of ill effects on personnel, advice from a subject matter expert or operating experience with the same or similar hazards. Access should be considered as impeded if extraordinary measures are necessary to facilitate entry of personnel into the affected room/area (e.g., requiring use of protective equipment, such as SCBAs, that is not routinely employed).

An emergency declaration is not warranted if any of the following conditions apply:

- The plant is NOT in MODE 4.
- The gas release is a planned activity that includes compensatory measures which address the temporary inaccessibility of a room or area (e.g., fire suppression system testing).
- The action for which room/area entry is required is of an administrative or record keeping nature (e.g., normal rounds or routine inspections).
- The access control measures are of a conservative or precautionary nature, and would not actually prevent or impede a required action.

An asphyxiant is a gas capable of reducing the level of oxygen in the body to dangerous levels. Most commonly, asphyxiants work by merely displacing air in an enclosed environment. This reduces the concentration of oxygen below the normal level of around 19%, which can lead to breathing difficulties, unconsciousness or even death.

This EAL **DOES NOT** apply to firefighting activities that automatically or manually activate a fire suppression system in an area.

Escalation of the emergency classification level would be via Recognition Category R, C or F ICs.

Callaway Basis Reference(s):

1. OTG-ZZ-00006 Addendum 06, Securing Safety Injection Accumulators
2. OTN-EJ-00001 Addendum 3, Placing A RHR Train In Service For RCS Cooldown
3. OTN-EJ-00001 Addendum 4, Placing B RHR Train In Service For RCS Cooldown
4. NEI 99-01, AA3

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: H – Hazards and Other Conditions Affecting Plant Safety
Subcategory: 6 – Control Room Evacuation
Initiating Condition: Control Room evacuation resulting in transfer of plant control to alternate locations

EAL:**HA6.1 Alert**

An event has resulted in plant control being transferred from the Control Room to the Auxiliary Shutdown Panel (ASP).

MODE Applicability:

All

Definition(s):

None

Basis:

The Shift Manager (SM) determines if the Control Room is uninhabitable and requires evacuation. Control Room inhabitability may be caused by fire, dense smoke, noxious fumes, bomb threat in or adjacent to the Control Room, or other life threatening conditions. OTO-ZZ-00001 Control Room Inaccessibility, provides the instructions for tripping the unit, and maintaining RCS inventory and Hot Shutdown conditions from outside the Control Room (Ref. 1).

For the purpose of this EAL, the 15 minute clock starts after determination that Control Room evacuation is necessary, not when OTO-ZZ-00001 Control Room Inaccessibility, is entered.

Inability to establish plant control from outside the Control Room escalates this event to a Site Area Emergency per EAL HS6.1.

This IC addresses an evacuation of the Control Room that results in transfer of plant control to alternate locations outside the Control Room. The loss of the ability to control the plant from the Control Room is considered to be a potential substantial degradation in the level of plant safety.

Following a Control Room evacuation, control of the plant will be transferred to alternate shutdown locations. The necessity to control a plant shutdown from outside the Control Room, in addition to responding to the event that required the evacuation of the Control Room, will present challenges to plant operators and other on-shift personnel. Activation of the ERO and emergency response facilities will assist in responding to these challenges.

Escalation of the emergency classification level would be via IC HS6.

Callaway Basis Reference(s):

1. OTO-ZZ-00001, Control Room Inaccessibility
2. NEI 99-01, HA6

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: H – Hazards and Other Conditions Affecting Plant Safety
Subcategory: 6 – Control Room Evacuation
Initiating Condition: Inability to control a key safety function from outside the Control Room
EAL:

HS6.1 Site Area Emergency

An event has resulted in plant control being transferred from the Control Room to the Auxiliary Shutdown Panel (ASP).

AND

Control of **any** of the following key safety functions is **not** re-established within 15 min.:

(Note 1)

- Reactivity (MODE 1, 2, and 3 **only**).
- Core Cooling.
- RCS heat removal.

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

MODE Applicability:

1 - Power Operation, 2 - Startup, 3 - Hot Standby, 4 – Hot Shutdown, 5 – Cold Shutdown, 6 – Refueling

Definition(s):

None

Basis:

For the purpose of this EAL the 15 minute clock, to re-establish control of key safety functions, starts when the last licensed operator leaves the Control Room.

The Shift Manager (SM) determines if the Control Room is uninhabitable and requires evacuation. Control Room inhabitability may be caused by fire, dense smoke, noxious fumes, bomb threat in or adjacent to the Control Room, or other life threatening conditions. OTO-ZZ-00001, Control Room Inaccessibility, provides the instructions for tripping the unit, and maintaining RCS inventory and Hot Shutdown conditions from outside the Control Room (Ref. 1, 2).

The intent of this EAL is to capture events in which control of the plant cannot be reestablished in a timely manner. The time interval is based on how quickly control must be reestablished without core uncover and/or core damage. The determination of whether or not control is established from outside the Control Room is based on Emergency Coordinator judgment. The Emergency Coordinator is expected to make a reasonable, informed judgment that control of the plant from outside the Control Room cannot be established within the fifteen minute interval.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

Once the Control Room is evacuated, the objective is to establish control of important plant equipment and maintain knowledge of important plant parameters in a timely manner. Primary emphasis should be placed on components and instruments that supply protection for and information about safety functions. Typically, these safety functions are reactivity control (ability to shut down the reactor and maintain it shutdown), RCS inventory (ability to cool the core), and secondary heat removal (ability to maintain a heat sink).

This IC addresses an evacuation of the Control Room that results in transfer of plant control to alternate locations, and the control of a key safety function cannot be reestablished in a timely manner. The failure to gain control of a key safety function following a transfer of plant control to alternate locations is a precursor to a challenge to one or more fission product barriers within a relatively short period of time.

The determination of whether or not "control" is established at the remote safe shutdown location(s) is based on Emergency Coordinator judgment. The Emergency Coordinator is expected to make a reasonable, informed judgment within 15 minutes whether or not the operating staff has control of key safety functions from the remote safe shutdown location(s).

Escalation of the emergency classification level would be via IC FG1 or CG1.

Callaway Basis Reference(s):

1. OTO-ZZ-00001, Control Room Inaccessibility
2. OTS-ZZ-00001, Cooldown from Outside the Control Room
3. NEI 99-01, HS6

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: H – Hazards and Other Conditions Affecting Plant Safety
Subcategory: 7 – Emergency Coordinator Judgment
Initiating Condition: Other conditions existing that in the judgment of the Emergency Coordinator warrant declaration of a UE

EAL:**HU7.1 Unusual Event**

Other conditions exist which in the judgment of the Emergency Coordinator indicate that events are in progress or have occurred which indicate a potential degradation of the level of safety of the plant or indicate a security threat to facility protection has been initiated. No releases of radioactive material requiring offsite response or monitoring are expected unless further degradation of SAFETY SYSTEMS occurs.

MODE Applicability:

All

Definition(s):

None

Basis:

The Emergency Coordinator is the designated onsite individual having the responsibility and authority for implementing the Callaway Radiological Emergency Response Plan (ref. 1). The Shift Manager (SM) initially acts in the capacity of the Emergency Coordinator and takes actions as outlined in the Emergency Plan implementing procedures (ref. 2). If required by the emergency classification or if deemed appropriate by the Emergency Coordinator, emergency response personnel are notified and instructed to report to their emergency response locations. In this manner, the individual usually in charge of activities in the Control Room is responsible for initiating the necessary emergency response, but Plant Management is expected to manage the emergency response as soon as available to do so in anticipation of the possible wide-ranging responsibilities associated with managing a major emergency.

This IC addresses unanticipated conditions not addressed explicitly elsewhere but that warrant declaration of an emergency because conditions exist which are believed by the Emergency Coordinator to fall under the emergency classification level description for an Unusual Event.

Callaway Basis Reference(s):

1. Callaway Radiological Emergency Response Plan, Section 5.2.1, Emergency Coordinator
2. Callaway Radiological Emergency Response Plan, Section 5.1.1, Shift Manager
3. NEI 99-01, HU7

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: H – Hazards and Other Conditions Affecting Plant Safety
Subcategory: 7 – Emergency Coordinator Judgment
Initiating Condition: Other conditions exist that in the judgment of the Emergency Coordinator warrant declaration of an Alert

EAL:**HA7.1 Alert**

Other conditions exist which, in the judgment of the Emergency Coordinator, indicate that events are in progress or have occurred which involve an actual or potential substantial degradation of the level of safety of the plant or a security event that involves probable life threatening risk to site personnel or damage to site equipment because of HOSTILE ACTION. Any releases are expected to be limited to small fractions of the EPA Protective Action Guideline exposure levels.

MODE Applicability:

All

Definition(s):

HOSTILE ACTION - An act toward Callaway or its personnel that includes the use of violent force to destroy equipment, take hostages, and/or intimidate the licensee to achieve an end. This includes attack by air, land, or water using guns, explosives, projectiles, vehicles, or other devices used to deliver destructive force. Other acts that satisfy the overall intent may be included. Hostile action should not be construed to include acts of civil disobedience or felonious acts that are not part of a concerted attack on Callaway. Non-terrorism-based EALs should be used to address such activities (i.e., this may include violent acts between individuals in the owner controlled area).

Basis:

The Emergency Coordinator is the designated onsite individual having the responsibility and authority for implementing the Callaway Radiological Emergency Response Plan (ref. 1). The Shift Manager (SM) initially acts in the capacity of the Emergency Coordinator and takes actions as outlined in the Emergency Plan implementing procedures (ref. 2). If required by the emergency classification or if deemed appropriate by the Emergency Coordinator, emergency response personnel are notified and instructed to report to their emergency response locations. In this manner, the individual usually in charge of activities in the Control Room is responsible for initiating the necessary emergency response, but Plant Management is expected to manage the emergency response as soon as available to do so in anticipation of the possible wide-ranging responsibilities associated with managing a major emergency.

This IC addresses unanticipated conditions not addressed explicitly elsewhere but that warrant declaration of an emergency because conditions exist which are believed by the Emergency Coordinator to fall under the emergency classification level description for an Alert.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Callaway Basis Reference(s):**

1. Callaway Radiological Emergency Response Plan, section 5.2.1 Emergency Coordinator
2. Callaway Radiological Emergency Response Plan, section 5.1.1 Shift Manager
3. NEI 99-01, HA7

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

Category: H – Hazards and Other Conditions Affecting Plant Safety

Subcategory: 7 – Emergency Coordinator Judgment

Initiating Condition: Other conditions existing that in the judgment of the Emergency Coordinator warrant declaration of a Site Area Emergency

EAL:

HS7.1 Site Area Emergency

Other conditions exist which in the judgment of the Emergency Coordinator indicate that events are in progress or have occurred which involve actual or likely major failures of plant functions needed for protection of the public or HOSTILE ACTION that results in intentional damage or malicious acts, (1) toward site personnel or equipment that could lead to the likely failure of or, (2) that prevent effective access to equipment needed for the protection of the public. Any releases are not expected to result in exposure levels which exceed EPA Protective Action Guideline exposure levels beyond the SITE BOUNDARY.

MODE Applicability:

All

Definition(s):

HOSTILE ACTION - An act toward Callaway or its personnel that includes the use of violent force to destroy equipment, take hostages, and/or intimidate the licensee to achieve an end. This includes attack by air, land, or water using guns, explosives, projectiles, vehicles, or other devices used to deliver destructive force. Other acts that satisfy the overall intent may be included. Hostile action should not be construed to include acts of civil disobedience or felonious acts that are not part of a concerted attack on Callaway. Non-terrorism-based EALs should be used to address such activities (i.e., this may include violent acts between individuals in the owner controlled area)

Basis:

The Emergency Coordinator is the designated onsite individual having the responsibility and authority for implementing the Callaway Radiological Emergency Response Plan (ref. 1). The Shift Manager (SM) initially acts in the capacity of the Emergency Coordinator and takes actions as outlined in the Emergency Plan implementing procedures (ref. 2). If required by the emergency classification or if deemed appropriate by the Emergency Coordinator, emergency response personnel are notified and instructed to report to their emergency response locations. In this manner, the individual usually in charge of activities in the Control Room is responsible for initiating the necessary emergency response, but Plant Management is expected to manage the emergency response as soon as available to do so in anticipation of the possible wide-ranging responsibilities associated with managing a major emergency.

This IC addresses unanticipated conditions not addressed explicitly elsewhere but that warrant declaration of an emergency because conditions exist which are believed by the Emergency Coordinator to fall under the emergency classification level description for a Site Area Emergency.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Callaway Basis Reference(s):**

1. Callaway Radiological Emergency Response Plan, Section 5.2.1 Emergency Coordinator
2. Callaway Radiological Emergency Response Plan, Section 5.1.1 Shift Manager
3. NEI 99-01, HS7

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

Category: H – Hazards and Other Conditions Affecting Plant Safety

Subcategory: 7 – Emergency Coordinator Judgment

Initiating Condition: Other conditions exist which in the judgment of the Emergency Coordinator warrant declaration of a General Emergency

EAL:

HG7.1 General Emergency

Other conditions exist which in the judgment of the Emergency Coordinator indicate that events are in progress or have occurred which involve actual or IMMINENT substantial core degradation or melting with potential for loss of containment integrity or HOSTILE ACTION that results in an actual loss of physical control of the facility. Releases can be reasonably expected to exceed EPA Protective Action Guideline exposure levels offsite for more than the immediate site area.

MODE Applicability:

All

Definition(s):

HOSTILE ACTION - An act toward Callaway or its personnel that includes the use of violent force to destroy equipment, take hostages, and/or intimidate the licensee to achieve an end. This includes attack by air, land, or water using guns, explosives, projectiles, vehicles, or other devices used to deliver destructive force. Other acts that satisfy the overall intent may be included. Hostile action should not be construed to include acts of civil disobedience or felonious acts that are not part of a concerted attack on Callaway. Non-terrorism-based EALs should be used to address such activities (i.e., this may include violent acts between individuals in the owner controlled area).

IMMINENT - The trajectory of events or conditions is such that an EAL will be met within a relatively short period of time regardless of mitigation or corrective actions.

Basis:

The Emergency Coordinator is the designated onsite individual having the responsibility and authority for implementing the Callaway Radiological Emergency Response Plan (ref. 1). The Shift Manager (SM) initially acts in the capacity of the Emergency Coordinator and takes actions as outlined in the Emergency Plan implementing procedures (ref. 2). If required by the emergency classification or if deemed appropriate by the Emergency Coordinator, emergency response personnel are notified and instructed to report to their emergency response locations. In this manner, the individual usually in charge of activities in the Control Room is responsible for initiating the necessary emergency response, but Plant Management is expected to manage the emergency response as soon as available to do so in anticipation of the possible wide-ranging responsibilities associated with managing a major emergency.

Releases can reasonably be expected to exceed EPA PAG plume exposure levels outside the Site Boundary.

This IC addresses unanticipated conditions not addressed explicitly elsewhere but that warrant declaration of an emergency because conditions exist which are believed by the Emergency Coordinator to fall under the emergency classification level description for a General Emergency.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Callaway Basis Reference(s):**

1. Callaway Radiological Emergency Response Plan, Section 5.2.1 Emergency Coordinator
2. Callaway Radiological Emergency Response Plan, Section 5.1.1 Shift Manager
3. NEI 99-01, HG7

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category S – System Malfunction**

EAL Group: Hot Conditions (RCS temperature > 200°F); EALs in this category are applicable only in one or more hot operating MODES.

Numerous system-related equipment failure events that warrant emergency classification have been identified in this category. They may pose actual or potential threats to plant safety.

The events of this category pertain to the following subcategories:

1. Loss of Emergency AC Power

Loss of emergency electrical power can compromise plant safety system operability including decay heat removal and emergency core cooling systems which may be necessary to ensure fission product barrier integrity. This category includes loss of onsite and offsite sources for 4.16KV AC emergency buses.

2. Loss of Vital DC Power

Loss of emergency electrical power can compromise plant safety system operability including decay heat removal and emergency core cooling systems which may be necessary to ensure fission product barrier integrity. This category includes loss of vital plant 125 VDC power sources.

3. Loss of Control Room Indications

Certain events that degrade plant operator ability to effectively assess plant conditions within the plant warrant emergency classification. Losses of indicators are in this subcategory.

4. RCS Activity

During normal operation, reactor coolant fission product activity is very low. Small concentrations of fission products in the coolant are primarily from the fission of tramp uranium in the fuel clad or minor perforations in the clad itself. Any significant increase from these base-line levels (2% - 5% clad failures) is indicative of fuel failures and is covered under the Fission Product Barrier Degradation category. However, lesser amounts of clad damage may result in coolant activity exceeding Technical Specification limits. These fission products will be circulated with the reactor coolant and can be detected by coolant sampling.

5. RCS Leakage

The reactor vessel provides a volume for the coolant that covers the reactor core. The reactor pressure vessel and associated pressure piping (reactor coolant system) together provide a barrier to limit the release of radioactive material should the reactor fuel clad integrity fail. Excessive RCS leakage greater than Technical Specification limits indicates potential pipe cracks that may propagate to an extent threatening fuel clad, RCS and containment integrity.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**6. RTS Failure

This subcategory includes events related to failure of the Reactor Trip System (RTS) to initiate and complete reactor trips. In the plant licensing basis, postulated failures of the RTS to complete a reactor trip comprise a specific set of analyzed events referred to as Anticipated Transient Without Scram (ATWS) events. For EAL classification, however, ATWS is intended to mean any trip failure event that does not achieve reactor shutdown. If RTS actuation fails to assure reactor shutdown, positive control of reactivity is at risk and could cause a threat to fuel clad, RCS and containment integrity.

7. Loss of Communications

Certain events that degrade plant operator ability to effectively communicate with essential personnel within or external to the plant warrant emergency classification.

8. Containment Failure

Failure of containment isolation capability (under conditions in which the containment is not currently challenged) warrants emergency classification. Failure of containment pressure control capability also warrants emergency classification.

9. Hazardous Event Affecting Safety Systems

Various natural and technological events that result in degraded plant safety system performance or significant VISIBLE DAMAGE warrant emergency classification under this subcategory.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** S – System Malfunction**Subcategory:** 1 – Loss of Emergency AC Power**Initiating Condition:** Loss of **all** offsite AC power capability to emergency buses for 15 minutes or longer**EAL:****SU1.1 Unusual Event**Loss of **all** offsite AC power capability, Table S-1, to emergency 4.16KV buses NB01 and NB02 for ≥ 15 min.*(Note 1)**Note 1:* The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.**Table S-1 AC Power Sources****Offsite:**

- Safeguards XFMR A or B via ESF LTC XFMR XNB01
- Startup XFMR XMR01 via ESF LTC XFMR XNB02
- Main XFMR XMA01 backfed via UAT XFMR XMA02
(in-service)
- Alternate Emergency Power Supply
(in-service or stand-by alignment)

Onsite:

- EDG NE01
- EDG NE02

MODE Applicability:

1 - Power Operation, 2 - Startup, 3 - Hot Standby, 4 - Hot Shutdown

Definition(s):

None

Basis:

For emergency classification purposes, “capability” means that one of the Table S-1 “offsite” sources remains available and can be aligned within 15 minutes.

The criteria here is that the source can be supplying the station with power within 15 minutes. Obviously the Main Transformer could not be aligned for backfeed in 15 minutes during normal power operations. But, in an outage, and if already aligned for backfeed, the Main Transformer could be supplying power to the station within 15 minutes, and credit could be taken for it. The same applies for AEPS. Timed control room actions have shown that Callaway can supply power from AEPS to the station in approximately 9 minutes, if AEPS is aligned in standby. If AEPS cannot be aligned to a bus within 15 minutes, then it is not considered a capable AC power source.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

The 4.16KV AC System provides the power requirements for operation and safe shutdown of the plant. The essential switchgear are buses NB01 and NB02 (ref. 1).

NB01 supplies power to Load Group 1 (Red Train) safety related loads and NB02 supplies power to Load Group 2 (Yellow Train) safety related loads. Each bus has two sources of offsite power. One source is from 13.8 KV safeguards transformer A or B via ESF Load Tap Changing (LTC) transformer XNB01 and the other source is from the startup transformer XMR01 via ESF LTC transformer XNB02. Transformer XNB01 is the normal supply to bus NB01; XNB02 is the normal supply to bus NB02 (ref. 1, 2 3).

Another method to obtain offsite power is by backfeeding the emergency buses through the main transformer XMA01 and unit auxiliary transformer XMR02. However, this is only done during Cold Shutdown unless nuclear safety considerations require it to be done during hot shutdown when no other power sources are available (ref. 4).

An additional source of offsite power is the Alternate Emergency Power Supply (AEPS). AEPS consists of Co-op Power or AEPS diesel generators. Credit can be taken for this source only if it can be aligned within 15 minutes.

This IC addresses a prolonged loss of offsite power. The loss of offsite power sources renders the plant more vulnerable to a complete loss of power to AC emergency buses. This condition represents a potential reduction in the level of safety of the plant.

Fifteen minutes was selected as a threshold to exclude transient or momentary losses of offsite power.

Escalation of the emergency classification level would be via IC SA1.

Callaway Basis Reference(s):

1. E-21001(Q) Main Single Line Diagram (Electrical Distribution Diagram)
2. FSAR Site Addenda Section 8.2.1.2
3. FSAR, Section 8.3.1
4. OTS-MA-00001-R011, Main Step-Up Transformer Backfeed – IPTE
5. NEI 99-01, SU1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** S – System Malfunction**Subcategory:** 1 – Loss of Emergency AC Power**Initiating Condition:** Loss of **all but one** AC power source to emergency buses for 15 minutes or longer**EAL:****SA1.1 Alert**

AC power capability, Table S-1, to emergency 4.16KV buses NB01 and NB02 reduced to a single power source for ≥ 15 min. (*Note 1*)

AND

Any additional single power source failure will result in loss of **all** AC power to SAFETY SYSTEMS.

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

Table S-1 AC Power Sources**Offsite:**

- Safeguards XFMR A or B via ESF LTC XFMR XNB01
- Startup XFMR XMR01 via ESF LTC XFMR XNB02
- Main XFMR XMA01 backfed via UAT XFMR XMA02 (*in-service*)
- Alternate Emergency Power Supply (*in-service or stand-by alignment*)

Onsite:

- EDG NE01
- EDG NE02

MODE Applicability:

1 - Power Operation, 2 - Startup, 3 - Hot Standby, 4 - Hot Shutdown

Definition(s):

SAFETY SYSTEM - A system required for safe plant operation, cooling down the plant and/or placing it in the Cold Shutdown condition, including the ECCS. These are typically systems classified as safety-related (as defined in 10CFR50.2):

Those structures, systems and components that are relied upon to remain functional during and following design basis events to assure:

1. The integrity of the reactor coolant pressure boundary;
2. The capability to shut down the reactor and maintain it in a safe shutdown condition;
3. The capability to prevent or mitigate the consequences of accidents which could result in potential offsite exposures.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Basis:**

For emergency classification purposes, “capability” means that one of the Table S-1 “offsite” sources remains available and can be aligned within 15 minutes.

If AEPS cannot be aligned to a bus within 15 minutes, then it is not considered a capable AC power source.

The criteria here is that the source can be supplying the station with power within 15 minutes. Obviously the Main Transformer could not be aligned for backfeed in 15 minutes during normal power operations. But, in an outage, and if already aligned for backfeed, the Main Transformer could be supplying power to the station within 15 minutes, and credit could be taken for it. The same applies for AEPS. Timed control room actions have shown that Callaway can supply power from AEPS to the station in approximately 9 minutes, if AEPS is aligned in standby.

The 4.16KV AC System provides the power requirements for operation and safe shutdown of the plant. The essential switchgear are buses NB01 and NB02 (ref. 1).

NB01 supplies power to Load Group 1 (Red Train) safety related loads and NB02 supplies power to Load Group 2 (Yellow Train) safety related loads. Each bus has two sources of offsite power. One source is from 13.8 KV safeguards transformer A or B via ESF Load Tap Changing (LTC) transformer XNB01 and the other source is from the startup transformer XMR01 via ESF LTC transformer XNB02. Transformer XNB01 is the normal supply to bus NB01; XNB02 is the normal supply to bus NB02 (ref. 1, 2 3).

Another method to obtain offsite power is by backfeeding the emergency buses through the main transformer XMA01 and unit auxiliary transformer XMR02. However, this is only done during Cold Shutdown unless nuclear safety considerations require it to be done during hot shutdown when no other power sources are available (ref. 4).

An additional source of offsite power is the Alternate Emergency Power Supply (AEPS). AEPS consists of Co-op Power or AEPS diesel generators. Credit can be taken for this source only if it can be aligned within 15 minutes.

If the capability of a second source of emergency bus power is not restored within 15 minutes, an Alert is declared under this EAL.

This IC describes a significant degradation of offsite and onsite AC power sources such that any additional single failure would result in a loss of all AC power to SAFETY SYSTEMS. In this condition, the sole AC power source may be powering one, or more than one, train of safety-related equipment. This IC provides an escalation path from IC SU1.

An “AC power source” is a source recognized in AOPs and EOPs, and capable of supplying required power to an emergency bus. Some examples of this condition are presented below.

- A loss of all offsite power with a concurrent failure of all but one emergency power source (e.g., an onsite diesel generator).
- A loss of all offsite power and loss of all emergency power sources (e.g., onsite diesel generators) with a single train of emergency buses being back-fed from the unit main generator.
- A loss of emergency power sources (e.g., onsite diesel generators) with a single train of emergency buses being fed from an offsite power source.

Fifteen minutes was selected as a threshold to exclude transient or momentary losses of power.

Escalation of the emergency classification level would be via IC SS1.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Callaway Basis Reference(s):**

1. E-21001(Q) Main Single Line Diagram (Electrical Distribution Diagram)
2. FSAR, Site Addenda Section 8.2.1.2
3. FSAR, Section 8.3.1
4. OTS-MA-00001-R011, Main Step-Up Transformer Backfeed – IPTE
5. NEI 99-01, SA1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** S – System Malfunction**Subcategory:** 1 – Loss of Emergency AC Power**Initiating Condition:** Loss of **all** offsite power and **all** onsite AC power to emergency buses for 15 minutes or longer**EAL:****SS1.1 Site Area Emergency**Loss of **all** offsite and **all** onsite AC power to emergency 4.16KV buses NB01 and NB02 for ≥ 15 min.*(Note 1)**Note 1:* The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.**MODE Applicability:**

1 - Power Operation, 2 - Startup, 3 - Hot Standby, 4 - Hot Shutdown

Definition(s):

None

Basis:

For this emergency classification this means NB01 and NB02 are deenergized for greater than or equal to 15 minutes.

The 4.16KV AC System provides the power requirements for operation and safe shutdown of the plant. The essential switchgear are buses NB01 and NB02 (ref. 1).

NB01 supplies power to Load Group 1 (Red Train) safety related loads and NB02 supplies power to Load Group 2 (Yellow Train) safety related loads. Each bus has two sources of offsite power. One source is from 13.8 KV safeguards transformer A or B via ESF Load Tap Changing (LTC) transformer XNB01 and the other source is from the startup transformer XMR01 via ESF LTC transformer XNB02. Transformer XNB01 is the normal supply to bus NB01; XNB02 is the normal supply to bus NB02 (ref. 1, 2 3).

In addition, NB01 and NB02 each have an emergency diesel generator (onsite power supply) which supply electrical power to the bus automatically in the event that the preferred source becomes unavailable (ref. 1).

Another method to obtain offsite power is by backfeeding the emergency buses through the main transformer XMA01 and unit auxiliary transformer XMR02. However, this is only done during Cold Shutdown unless nuclear safety considerations require it to be done during hot shutdown when no other power sources are available (ref. 4).

Additional sources of offsite power are available from diesel generators such as the Alternate Emergency Power System (AEPS) or portable generation sources. AEPS consists of Co-op Power or AEPS diesel generators. Credit can be taken for these sources only if they are capable of carrying an NB bus and are aligned within 15 minutes. (ref. 5).

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

The interval begins when both offsite and onsite AC power capability are lost.

This IC addresses a total loss of AC power that compromises the performance of all SAFETY SYSTEMS requiring electric power including those necessary for emergency core cooling, containment heat removal/pressure control, spent fuel heat removal and the ultimate heat sink. In addition, fission product barrier monitoring capabilities may be degraded under these conditions. This IC represents a condition that involves actual or likely major failures of plant functions needed for the protection of the public.

Fifteen minutes was selected as a threshold to exclude transient or momentary power losses.

Escalation of the emergency classification level would be via ICs RG1, FG1 or SG1.

Callaway Basis Reference(s):

1. E-21001(Q) Main Single Line Diagram (Electrical Distribution Diagram)
2. FSAR, Site Addenda Section 8.2.1.2
3. FSAR, Section 8.3.1
4. OTS-MA-00001-R011, Main Step-Up Transformer Backfeed - IPTE
5. ECA-0.0, Loss of All AC Power
6. NEI 99-01, SS1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: S – System Malfunction
Subcategory: 1 – Loss of Emergency AC Power
Initiating Condition: Prolonged loss of **all** offsite and **all** onsite AC power to emergency buses

EAL:**SG1.1 General Emergency**

Loss of **all** offsite and **all** onsite AC power to emergency 4.16KV buses NB01 and NB02

AND EITHER:

- Restoration of at least one emergency bus in < 4 hours is **not** likely. *(Note 1)*
- CSFST Core Cooling RED Path conditions met.

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

MODE Applicability:

1 - Power Operation, 2 - Startup, 3 - Hot Standby, 4 - Hot Shutdown

Definition(s):

None

Basis:

This EAL is indicated by the extended loss of all offsite and onsite AC power capability to 4.16KV emergency buses NB01 and NB02 either for greater than the Callaway Station Blackout (SBO) coping analysis time (4 hrs.) (ref. 1, 2) or that has resulted in indications of an actual loss of adequate core cooling. Indication of continuing core cooling degradation is manifested by CSFST Core Cooling RED PATH conditions being met. (ref. 3).

The 4.16KV AC System provides the power requirements for operation and safe shutdown of the plant. The essential switchgear are buses NB01 and NB02 (ref. 1).

NB01 supplies power to Load Group 1 (Red Train) safety related loads and NB02 supplies power to Load Group 2 (Yellow Train) safety related loads. Each bus has two sources of offsite power. One source is from 13.8 KV safeguards transformer A or B via ESF Load Tap Changing (LTC) transformer XNB01 and the other source is from the startup transformer XMR01 via ESF LTC transformer XNB02. Transformer XNB01 is the normal supply to bus NB01; XNB02 is the normal supply to bus NB02 (ref. 4, 5 6).

In addition, NB01 and NB02 each have an emergency diesel generator (onsite power supply) which supply electrical power to the bus automatically in the event that the preferred source becomes unavailable (ref. 4).

Another method to obtain offsite power is by backfeeding the emergency buses through the main transformer XMA01 and unit auxiliary transformer XMR02. However, this is only done during Cold Shutdown unless nuclear safety considerations require it to be done during hot shutdown when no other power sources are available (ref. 7).

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Additional sources of offsite power are available from diesel generators such as the Alternate Emergency Power System (AEPS) or portable generation sources. AEPS consists of Co-op Power or AEPS diesel generators. Credit can be taken for these sources only if they are capable of carrying an NB bus and it can be aligned within 4 hours. (ref. 8).

Four hours is the station blackout coping time (ref 1, 2).

Indication of continuing core cooling degradation must be based on fission product barrier monitoring with particular emphasis on Emergency Coordinator judgment as it relates to imminent Loss of fission product barriers and degraded ability to monitor fission product barriers. Indication of continuing core cooling degradation is manifested by CSFST Core Cooling **RED PATH** conditions being met (ref. 3).

This IC addresses a prolonged loss of all power sources to AC emergency buses. A loss of all AC power compromises the performance of all SAFETY SYSTEMS requiring electric power including those necessary for emergency core cooling, containment heat removal/pressure control, spent fuel heat removal and the ultimate heat sink. A prolonged loss of these buses will lead to a loss of one or more fission product barriers. In addition, fission product barrier monitoring capabilities may be degraded under these conditions.

The EAL should require declaration of a General Emergency prior to meeting the thresholds for IC FG1. This will allow additional time for implementation of offsite protective actions.

Escalation of the emergency classification from Site Area Emergency will occur if it is projected that power cannot be restored to at least one AC emergency bus by the end of the analyzed station blackout coping period. Beyond this time, plant responses and event trajectory are subject to greater uncertainty, and there is an increased likelihood of challenges to multiple fission product barriers.

The estimate for restoring at least one emergency bus should be based on a realistic appraisal of the situation. Mitigation actions with a low probability of success should not be used as a basis for delaying a classification upgrade. The goal is to maximize the time available to prepare for, and implement, protective actions for the public.

The EAL will also require a General Emergency declaration if the loss of AC power results in parameters that indicate an inability to adequately remove decay heat from the core.

Callaway Basis Reference(s):

1. FSAR, Section 8.3A.5
2. BO-01, Station Blackout (SBO) Coping Duration, sh 1
3. CSF-1, Critical Safety Function Status Trees (CSFST) Figure 2, Core Cooling
4. E-21001(Q) Main Single Line Diagram (Electrical Distribution Diagram)
5. FSAR, Site Addenda Section 8.2.1.2
6. FSAR, Section 8.3.1
7. OTS-MA-00001-R011, Main Step-Up Transformer Backfeed – IPTE
8. ECA-0.0, Loss of All AC Power
9. NEI 99-01, SG1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: S – System Malfunction
Subcategory: 1 – Loss of Emergency AC Power
Initiating Condition: Loss of **all** AC and vital DC power sources for 15 minutes or longer

EAL:**SG1.2 General Emergency**

Loss of **all** offsite and **all** onsite AC power to emergency 4.16KV buses NB01 and NB02 for ≥ 15 min.

AND

Loss of **all** 125 VDC power based on battery bus voltage indications < 107 VDC on **all** vital DC buses NK01, NK03 (Division 1) and NK02, NK04 (Division 2) for ≥ 15 min.

(Note 1)

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

MODE Applicability:

1 - Power Operation, 2 - Startup, 3 - Hot Standby, 4 - Hot Shutdown

Definition(s):

None

Basis:

For this emergency classification this means NB01 and NB02 are deenergized for greater than or equal to 15 minutes.

This EAL is indicated by the loss of all offsite and onsite emergency AC power capability to 4.16KV emergency buses NB01 and NB02 for greater than 15 minutes in combination with degraded vital DC power voltage. This EAL addresses operating experience from the March 2011 accident at Fukushima Daiichi.

The 4.16KV AC System provides the power requirements for operation and safe shutdown of the plant. The essential switchgear are buses NB01 and NB02 (ref. 1).

NB01 supplies power to Load Group 1 (Red Train) safety related loads and NB02 supplies power to Load Group 2 (Yellow Train) safety related loads. Each bus has two sources of offsite power. One source is from 13.8 KV safeguards transformer A or B via ESF Load Tap Changing (LTC) transformer XNB01 and the other source is from the startup transformer XMR01 via ESF LTC transformer XNB02. Transformer XNB01 is the normal supply to bus NB01; XNB02 is the normal supply to bus NB02 (ref. 1, 2 3).

In addition, NB01 and NB02 each have an emergency diesel generator (onsite power supply) which supply electrical power to the bus automatically in the event that the preferred source becomes unavailable (ref. 1).

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

Another method to obtain offsite power is by backfeeding the emergency buses through the main transformer XMA01 and unit auxiliary transformer XMR02. However, this is only done during Cold Shutdown unless nuclear safety considerations require it to be done during hot shutdown when no other power sources are available (ref. 4).

Additional sources of offsite power are available from diesel generators such as the Alternate Emergency Power System (AEPS) or portable generation sources. AEPS consists of Co-op Power or AEPS diesel generators. Credit can be taken for these sources only if they are capable of carrying an NB bus and it can be aligned within 15 minutes. (ref. 5).

The vital DC buses are the following 125 VDC Class 1E buses (ref. 6):

Division 1:	Division 2:
NK01	NK02
NK03	NK04

There are four battery banks, (NK11, NK12, NK13 and NK14) that supplement the output of the battery chargers. They supply DC power to the distribution buses when AC power to the chargers is lost or when transient loads exceed the 300 amp capacity of the battery chargers.

Due to the load distribution on each of the 125VDC buses, the four battery banks for each bus do not have the same rating. All four of the 125VDC buses supply inverters for 120VAC NN bus power as well as control power for various safety related systems. NK01 and NK04 supply additional DC loads such as diesel field flashing, breaker control power, main control board power and emergency lighting. These loads are not supplied by the other two buses, NK02 and NK03. For this reason, batteries NK11 and NK14 require additional capacity. Each battery is designed to have sufficient stored energy to supply the required emergency loads for 240 minutes following a loss of AC power (station blackout) (ref. 8, 9, 10).

Minimum DC bus voltage is 107.0 VDC (ref. 9, 10). Bus voltage may be obtained from the following instruments (ref. 6):

- NK EI-1 (NK01)
- NK EI-2 (NK02)
- NK EI-3 (NK03)
- NK EI-4 (NK04)

This IC addresses a concurrent and prolonged loss of both emergency AC and Vital DC power. A loss of all emergency AC power compromises the performance of all SAFETY SYSTEMS requiring electric power including those necessary for emergency core cooling, containment heat removal/pressure control, spent fuel heat removal and the ultimate heat sink. A loss of vital DC power compromises the ability to monitor and control SAFETY SYSTEMS. A sustained loss of both emergency AC and vital DC power will lead to multiple challenges to fission product barriers.

Fifteen minutes was selected as a threshold to exclude transient or momentary power losses. The 15-minute emergency declaration clock begins at the point when **BOTH** EAL thresholds are met.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Callaway Basis Reference(s):**

1. E-21001(Q) Main Single Line Diagram (Electrical Distribution Diagram)
2. FSAR, Site Addenda Section 8.2.1.2
3. FSAR, Section 8.3.1
4. OTS-MA-00001-R011, Main Step-Up Transformer Backfeed – IPTE
5. ECA-0.0, Loss of All AC Power
6. E-21010(Q) DC Single Line Diagram
7. FSAR, Tables 8.3-1, -2, -3
8. FSAR, Section 8.3.2
9. Calculation NK-10, NK System DC Voltage Drop
10. FSAR, Table 8.3A-1 III.B
11. NEI 99-01, SG8

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** S – System Malfunction**Subcategory:** 2 – Loss of Vital DC Power**Initiating Condition:** Loss of **all** vital DC power for 15 minutes or longer**EAL:****SS2.1 Site Area Emergency**

Loss of **all** 125 VDC power based on battery bus voltage indications < 107 VDC on **all** vital DC buses NK01, NK03 (Division 1) and NK02, NK04 (Division 2) for ≥ 15 min.

(Note 1)

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

MODE Applicability:

1 - Power Operation, 2 - Startup, 3 - Hot Standby, 4 - Hot Shutdown

Definition(s):

None

Basis:

The vital DC buses are the following 125 VDC Class 1E buses (ref. 1):

Division 1:	Division 2:
NK01	NK02
NK03	NK04

There are four battery banks, (NK11, NK12, NK13 and NK14) that supplement the output of the battery chargers. They supply DC power to the distribution buses when AC power to the chargers is lost or when transient loads exceed the 300 amp capacity of the battery chargers.

Due to the load distribution on each of the 125VDC buses, the four battery banks for each bus do not have the same rating. All four of the 125VDC buses supply inverters for 120VAC NN bus power as well as control power for various safety related systems. NK01 and NK04 supply additional DC loads such as diesel field flashing, breaker control power, main control board power and emergency lighting. These loads are not supplied by the other two buses, NK02 and NK03. For this reason, batteries NK11 and NK14 require additional capacity. Each battery is designed to have sufficient stored energy to supply the required emergency loads for 240 minutes following a loss of AC power (station blackout) (ref. 2, 3, 4).

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Minimum DC bus voltage is 107.0 VDC (ref. 4, 5). Bus voltage may be obtained from the following instruments (ref. 6):

- NK EI-1 (NK01)
- NK EI-2 (NK02)
- NK EI-3 (NK03)
- NK EI-4 (NK04)

This IC addresses a loss of vital DC power which compromises the ability to monitor and control SAFETY SYSTEMS. In MODES above Cold Shutdown, this condition involves a major failure of plant functions needed for the protection of the public.

Fifteen minutes was selected as a threshold to exclude transient or momentary power losses.

Escalation of the emergency classification level would be via ICs RG1, FG1 or SG1.

Callaway Basis Reference(s):

1. E-21010(Q) DC Single Line Diagram
2. FSAR, Tables 8.3-1, -2, -3
3. FSAR, Section 8.3.2
4. Calculation NK-10, NK System DC Voltage Drop
5. FSAR, Table 8.3A-1 III.B
6. ECA-0.0, Loss of All AC Power
7. NEI 99-01, SS8

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** S – System Malfunction**Subcategory:** 3 – Loss of Control Room Indications**Initiating Condition:** UNPLANNED loss of Control Room indications for 15 minutes or longer**EAL:****SU3.1 Unusual Event**

An UNPLANNED event results in the inability to monitor one or more Table S-2 parameters from within the Control Room for ≥ 15 min.

(Note 1)

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

Table S-2 Safety System Parameters
<ul style="list-style-type: none"> • Reactor power • RCS level • RCS pressure • Core Exit T/C temperature • Level in at least one S/G • Auxiliary or emergency feedwater flow in at least one S/G

MODE Applicability:

1 - Power Operation, 2 - Startup, 3 - Hot Standby, 4 - Hot Shutdown

Definition(s):

UNPLANNED - A parameter change or an event that is not 1) the result of an intended evolution or 2) an expected plant response to a transient. The cause of the parameter change or event may be known or unknown.

Basis:

SAFETY SYSTEM parameters listed in Table S-2 are monitored in the Control Room through a combination of hard control panel indicators as well as computer based information systems. The Plant Computer, which displays SPDS required information, serves as a redundant compensatory indicator which may be utilized in lieu of normal Control Room indicators (ref. 1, 2).

This IC addresses the difficulty associated with monitoring normal plant conditions without the ability to obtain SAFETY SYSTEM parameters from within the Control Room. This condition is a precursor to a more significant event and represents a potential degradation in the level of safety of the plant.

As used in this EAL, an “inability to monitor” means that values for one or more of the listed parameters cannot be determined from within the Control Room. This situation would require a loss of **ALL** of the Control Room sources for the given parameter(s). For example, the reactor power level cannot be determined from any analog, digital and recorder source within the Control Room, or any loss of monitoring capabilities of feedwater flow to **ALL** Steam Generators.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

An event involving a loss of plant indications, annunciators and/or display systems is evaluated in accordance with 10 CFR 50.72 (and associated guidance in NUREG-1022) to determine if an NRC event report is required. The event would be reported if it significantly impaired the capability to perform emergency assessments. In particular, emergency assessments necessary to implement abnormal operating procedures, emergency operating procedures, and emergency plan implementing procedures addressing emergency classification, accident assessment, or protective action decision-making.

This EAL is focused on a selected subset of plant parameters associated with the key safety functions of reactivity control, core cooling and RCS heat removal. The loss of the ability to determine one or more of these parameters from within the Control Room is considered to be more significant than simply a reportable condition. In addition, if all indication sources for one or more of the listed parameters are lost, then the ability to determine the values of other SAFETY SYSTEM parameters may be impacted as well. For example, if the value for reactor vessel level cannot be determined from the indications and recorders on a main control board, the SPDS or the plant computer, the availability of other parameter values may be compromised as well.

Fifteen minutes was selected as a threshold to exclude transient or momentary losses of indication.

Escalation of the emergency classification level would be via IC SA3.

Callaway Basis Reference(s):

1. FSAR, Section 7.5 Safety-Related Display Instrumentation
2. OTO-RJ-00001, Loss of Plant Computer
3. NEI 99-01, SU2

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** S – System Malfunction**Subcategory:** 3 – Loss of Control Room Indications**Initiating Condition:** UNPLANNED loss of Control Room indications for 15 minutes or longer with a significant transient in progress**EAL:****SA3.1 Alert**

An UNPLANNED event results in the inability to monitor one or more Table S-2 parameters from within the Control Room for ≥ 15 min. *(Note 1)*

AND

Any significant transient is in progress, Table S-3.

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

Table S-2 Safety System Parameters

- Reactor power
- RCS level
- RCS pressure
- Core Exit T/C temperature
- Level in at least one S/G
- Auxiliary or emergency feedwater flow in at least one S/G

Table S-3 Significant Transients
(Automatically or manually initiated)

- Reactor trip
- Runback $\geq 25\%$ thermal power
- Electrical load rejection $> 25\%$ electrical load
- ECCS actuation

MODE Applicability:

1 - Power Operation, 2 - Startup, 3 - Hot Standby, 4 - Hot Shutdown

Definition(s):

UNPLANNED - A parameter change or an event that is not 1) the result of an intended evolution or 2) an expected plant response to a transient. The cause of the parameter change or event may be known or unknown.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Basis:**

SAFETY SYSTEM parameters listed in Table S-2 are monitored in the Control Room through a combination of hard control panel indicators as well as computer based information systems. The Plant Computer, which displays SPDS required information, serves as a redundant compensatory indicator which may be utilized in lieu of normal Control Room indicators (ref. 1, 2).

Significant transients are listed in Table S-3 and include response to automatic or manually initiated functions such as reactor trips, runbacks involving greater than or equal to 25% thermal power change, electrical load rejections of greater than 25% full electrical load or ECCS (SI) injection actuations.

This IC addresses the difficulty associated with monitoring rapidly changing plant conditions during a transient without the ability to obtain SAFETY SYSTEM parameters from within the Control Room. During this condition, the margin to a potential fission product barrier challenge is reduced. It thus represents a potential substantial degradation in the level of safety of the plant.

As used in this EAL, an "inability to monitor" means that values for one or more of the listed parameters cannot be determined from within the Control Room. This situation would require a loss of all of the Control Room sources for the given parameter(s). For example, the reactor power level cannot be determined from any analog, digital and recorder source within the Control Room.

An event involving a loss of plant indications, annunciators and/or display systems is evaluated in accordance with 10 CFR 50.72 (and associated guidance in NUREG-1022) to determine if an NRC event report is required. The event would be reported if it significantly impaired the capability to perform emergency assessments. In particular, emergency assessments necessary to implement abnormal operating procedures, emergency operating procedures, and emergency plan implementing procedures addressing emergency classification, accident assessment, or protective action decision-making.

This EAL is focused on a selected subset of plant parameters associated with the key safety functions of reactivity control, core cooling and RCS heat removal. The loss of the ability to determine one or more of these parameters from within the Control Room is considered to be more significant than simply a reportable condition. In addition, if all indication sources for one or more of the listed parameters are lost, then the ability to determine the values of other SAFETY SYSTEM parameters may be impacted as well. For example, if the value for reactor vessel level cannot be determined from the indications and recorders on a main control board, the SPDS or the plant computer, the availability of other parameter values may be compromised as well.

Fifteen minutes was selected as a threshold to exclude transient or momentary losses of indication.

Escalation of the emergency classification level would be via ICs FS1 or IC RS1.

Callaway Basis Reference(s):

1. FSAR, Section 7.5 Safety-Related Display Instrumentation
2. OTO-RJ-00001, Loss of Plant Computer
3. NEI 99-01 SA2

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** S – System Malfunction**Subcategory:** 4 – RCS Activity**Initiating Condition:** Reactor coolant activity greater than Technical Specification allowable limits**EAL:****SU4.1 Unusual Event**Sample analysis indicates RCS activity > Technical Specification 3.4.16 limits (*listed below*):

- > 60 $\mu\text{Ci/gm}$ Dose Equivalent I-131.
OR
- > 1.0 $\mu\text{Ci/gm}$ Dose Equivalent I-131 for a > 48 hr continuous period.
OR
- > 225 $\mu\text{Ci/gm}$ Dose Equivalent Xe-133 for a > 48 hr continuous period.

MODE Applicability:

1 - Power Operation, 2 - Startup, 3 - Hot Standby, 4 - Hot Shutdown

Definition(s):

None

Basis:

This EAL should be entered when the Shutdown Action Statement for Tech Spec 3.4.16 is applied. These values are:

- > 60 $\mu\text{Ci/gm}$ Dose Equivalent I-131.
OR
- > 1.0 $\mu\text{Ci/gm}$ Dose Equivalent I-131 for a > 48 hr continuous period.
OR
- > 225 $\mu\text{Ci/gm}$ Dose Equivalent Xe-133 for a > 48 hr continuous period.

(ref 1, 2)

This IC addresses a reactor coolant activity value that exceeds an allowable limit specified in Technical Specifications. This condition is a precursor to a more significant event and represents a potential degradation of the level of safety of the plant.

Escalation of the emergency classification level would be via ICs FA1 or the Recognition Category R ICs.

Callaway Basis Reference(s):

1. Callaway Technical Specifications 3.4.16 RCS Specific Activity
2. OTO-BB-00005, High Coolant Activity
3. NEI 99-01, SU3

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** S – System Malfunction**Subcategory:** 5 – RCS Leakage**Initiating Condition:** RCS leakage for 15 minutes or longer**EAL:****SU5.1 Unusual Event**RCS unidentified or pressure boundary leakage > 10 gpm for ≥ 15 min.**OR**RCS identified leakage > 25 gpm for ≥ 15 min.**OR**Leakage from the RCS to a location outside containment > 25 gpm for ≥ 15 min.*(Note 1)**Note 1:* The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.**MODE Applicability:**

1 - Power Operation, 2 - Startup, 3 - Hot Standby, 4 - Hot Shutdown

Definition(s):

None

Basis:

Manual or computer-based methods of performing an RCS inventory balance are normally used to determine RCS leakage. The Personal Computer (PC) is preferred method of calculating RCS leak rate. When the PC is used, plant status information and all calculations are generated by the Plant Process Computer. When the PC software is not available, procedural guidance is available to perform the manual RCS inventory balance (ref. 1).

Identified leakage includes

- Leakage such as that from pump seals or valve packing (except reactor coolant pump (RCP) seal water leakoff), that is captured and conducted to collection systems or a sump or collecting tank, or
- Leakage into the containment atmosphere from sources that are both specifically located and known either not to interfere with the operation of leakage detection systems or not to be pressure boundary leakage, or
- RCS leakage through a steam generator to the secondary system (ref. 2).

Unidentified leakage is all leakage (except RCP seal water leakoff) that is not identified leakage (ref. 2).

Pressure Boundary leakage is leakage (except SG tube leakage) through a nonisolable fault in an RCS component body, pipe wall, or vessel wall (ref. 2)

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

RCS leakage outside of the containment that is not considered identified or unidentified leakage per Technical Specifications includes leakage via interfacing systems such as RCS to the Component Cooling Water, or systems that directly see RCS pressure outside containment such as Chemical & Volume Control System, Nuclear Sampling system and Residual Heat Removal system (when in the shutdown cooling MODE) (ref. 3, 4)

Escalation of this EAL to the Alert level is via Category F, Fission Product Barrier Degradation, EAL FA1.1.

This IC addresses RCS leakage which may be a precursor to a more significant event. In this case, RCS leakage has been detected and operators, following applicable procedures, have been unable to promptly isolate the leak. This condition is considered to be a potential degradation of the level of safety of the plant.

The first and second EAL conditions are focused on a loss of mass from the RCS due to "unidentified leakage", "pressure boundary leakage" or "identified leakage" (as these leakage types are defined in the plant Technical Specifications). The third condition addresses an RCS mass loss caused by an UNISOLABLE leak through an interfacing system. These conditions thus apply to leakage into the containment, a secondary-side system (e.g., steam generator tube leakage) or a location outside of containment.

The leak rate values for each condition were selected because they are usually observable with normal Control Room indications. Lesser values typically require time-consuming calculations to determine (e.g., a mass balance calculation). The first condition uses a lower value that reflects the greater significance of unidentified or pressure boundary leakage.

The release of mass from the RCS due to the as-designed/expected operation of a relief valve does not warrant an emergency classification. An emergency classification would be required if a mass loss is caused by a relief valve that is not functioning as designed/expected (e.g., a relief valve sticks open and the line flow cannot be isolated).

The 15-minute threshold duration allows sufficient time for prompt operator actions to isolate the leakage, if possible. If the leak is isolated, the RCS barrier was never lost.

Escalation of the emergency classification level would be via ICs of Recognition Category R or F.

Callaway Basis Reference(s):

1. OSP-BB-00009, RCS Inventory Balance
2. Callaway Technical Specifications, Definitions Section 1.1
3. FSAR, Section 5.2.5.2.1 Intersystem Leakage
4. OTO-BB-00003-R014, Excess RCS Leakage
5. NEI 99-01, SU4

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** S – System Malfunction**Subcategory:** 6 – RTS Failure**Initiating Condition:** Automatic or manual trip fails to shut down the reactor**EAL:****SU6.1 Unusual Event**

An automatic trip did **not** shut down the reactor as indicated by reactor power $\geq 5\%$ after **any** RTS setpoint is exceeded.

AND

A subsequent automatic trip or manual trip action taken at the reactor control consoles (SB-HS-1 or SB-HS-42) is successful in shutting down the reactor as indicated by reactor power $< 5\%$.

(Note 8)

Note 8: A manual trip action is any operator action, or set of actions, which causes the control rods to be rapidly inserted into the core, and **does not** include manually driving in control rods or implementation of boron injection strategies.

MODE Applicability:

1 - Power Operation

Definition(s):

None

Basis:

The first condition of this EAL identifies the need to cease critical reactor operations by actuation of the automatic Reactor Trip System (RTS) trip function. A reactor trip is automatically initiated by the RTS when certain continuously monitored parameters exceed predetermined setpoints (ref. 1).

For the purposes of emergency classification, successful manual trip actions are those which can be quickly performed from the reactor control console; SB-HS-1 on Panel RL003 or SB-HS-42 on Panel RL006. Reactor shutdown achieved by use of other trip actions, such as opening PG19 and PG20 supply breakers, emergency boration or manually driving control rods, **do not** constitute a successful manual trip (ref. 4). A successful manual turbine trip that subsequently automatically trips the reactor **does** constitute a successful trip.

Following a successful reactor trip, rapid insertion of the control rods occurs. Nuclear power promptly drops to a fraction of the original power level and then decays to a level several decades less with a negative startup rate. The reactor power drop continues until reactor power reaches the point at which the influence of source neutrons on reactor power starts to be observable. A predictable post-trip response from an automatic reactor trip signal should therefore consist of a prompt drop in reactor power as sensed by the nuclear instrumentation and a lowering of power into the source range. A successful trip has therefore occurred when there is sufficient rod insertion from the trip of RTS to bring the reactor power below the immediate shutdown decay heat level of 5% (ref. 2, 3, 4).

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Following any automatic RTS trip signal, E-0 (ref. 2) and FR-S.1 (ref. 4) prescribe insertion of redundant manual trip signals to back up the automatic RTS trip function and ensure reactor shutdown is achieved. Even if the first subsequent manual trip signal inserts all control rods to the full-in position immediately after the initial failure of the automatic trip, the lowest level of classification that must be declared is an Unusual Event (ref. 4).

The ATWS Mitigation System Actuation Circuitry (AMSAC) logic will automatically initiate auxiliary feedwater and a turbine trip under conditions indicative of an Anticipated Transient Without Scram (ATWS) event (ref. 5).

In the event that the operator identifies a reactor trip is imminent and initiates a successful manual reactor trip before the automatic RTS trip setpoint is reached, no declaration is required. The successful manual trip of the reactor before it reaches its automatic trip setpoint or reactor trip signals caused by instrumentation channel failures do not lead to a potential fission product barrier loss. However, if subsequent manual reactor trip actions fail to reduce reactor power below 5%, the event escalates to the Alert under EAL SA6.1.

If by procedure, operator actions include the initiation of an immediate manual trip following receipt of an automatic trip signal and there are no clear indications that the automatic trip failed (such as a time delay following indications that a trip setpoint was exceeded), it may be difficult to determine if the reactor was shut down because of automatic trip or manual actions. If a subsequent review of the trip actuation indications reveals that the automatic trip did not cause the reactor to be shut down, then consideration should be given to evaluating the fuel for potential damage, and the reporting requirements of 50.72 should be considered for the transient event.

This IC addresses a failure of the RTS to initiate or complete an automatic or manual reactor trip that results in a reactor shutdown, and either a subsequent operator manual action taken at the reactor control consoles or an automatic trip is successful in shutting down the reactor. This event is a precursor to a more significant condition and thus represents a potential degradation of the level of safety of the plant.

Following the failure on an automatic reactor trip, operators will promptly initiate manual actions at the reactor control consoles to shut down the reactor (e.g., initiate a manual reactor trip). If these manual actions are successful in shutting down the reactor, core heat generation will quickly fall to a level within the capabilities of the plant's decay heat removal systems.

If an initial manual reactor trip is unsuccessful, operators will promptly take manual action at another location(s) on the reactor control consoles to shut down the reactor (e.g., initiate a manual reactor trip) using a different switch). Depending upon several factors, the initial or subsequent effort to manually trip the reactor, or a concurrent plant condition, may lead to the generation of an automatic reactor trip signal. If a subsequent manual or automatic trip is successful in shutting down the reactor, core heat generation will quickly fall to a level within the capabilities of the plant's decay heat removal systems.

A manual action at the reactor control consoles is any operator action, or set of actions, which causes the control rods to be rapidly inserted into the core (e.g., initiating a manual reactor trip). This action does not include manually driving in control rods or implementation of boron injection strategies. Actions taken at back-panels or other locations within the Control Room, or any location outside the Control Room, are not considered to be "at the reactor control consoles".

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

The plant response to the failure of an automatic or manual reactor trip will vary based upon several factors including the reactor power level prior to the event, availability of the condenser, performance of mitigation equipment and actions, other concurrent plant conditions, etc. If subsequent operator manual actions taken at the reactor control consoles are also unsuccessful in shutting down the reactor, then the emergency classification level will escalate to an Alert via IC SA6. Depending upon the plant response, escalation is also possible via IC FA1. Absent the plant conditions needed to meet either IC SA6 or FA1, an Unusual Event declaration is appropriate for this event.

A reactor shutdown is determined in accordance with applicable Emergency Operating Procedure criteria.

Should a reactor trip signal be generated as a result of plant work (e.g., RTS setpoint testing), the following classification guidance should be applied.

- If the signal causes a plant transient that should have included an automatic reactor trip and the RTS fails to automatically shut down the reactor, then this IC and the EALs are applicable, and should be evaluated.
- If the signal does not cause a plant transient and the trip failure is determined through other means (e.g., assessment of test results), then this IC and the EALs are not applicable and no classification is warranted.

Note 8 is a generic note applicable to the EAL's as approved by the NRC.

Callaway Basis Reference(s):

1. Callaway Technical Specifications, Section 3.3.1 Reactor Trip System (RTS) Instrumentation
2. E-0, Reactor Trip or Safety Injection
3. F-0, Critical Safety Function Status Trees - Subcriticality
4. FR-S.1, Response to Nuclear Power Generation/ATWS
5. FSAR, Section 7.7.1
6. NEI 99-01, SU5

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** S – System Malfunction**Subcategory:** 6 – RTS Failure**Initiating Condition:** Automatic or manual trip fails to shut down the reactor**EAL:****SU6.2 Unusual Event**

A manual trip did **not** shut down the reactor as indicated by reactor power $\geq 5\%$ after **any** manual trip action was initiated.

AND

A subsequent automatic trip or manual trip action taken at the reactor control consoles (SB-HS-1 or SB-HS-42) is successful in shutting down the reactor as indicated by reactor power $< 5\%$.

(Note 8)

Note 8: A manual trip action is any operator action, or set of actions, which causes the control rods to be rapidly inserted into the core, and **does not** include manually driving in control rods or implementation of boron injection strategies.

MODE Applicability:

1 - Power Operation

Definition(s):

None

Basis:

This EAL addresses a failure of a manually initiated trip in the absence of having exceeded an automatic RTS trip setpoint and a subsequent automatic or manual trip is successful in shutting down the reactor (reactor power $< 5\%$). (ref. 1).

For the purposes of emergency classification, successful manual trip actions are those which can be quickly performed from the reactor control console; SB-HS-1 on Panel RL003 or SB-HS-42 on Panel RL006. Reactor shutdown achieved by use of other trip actions, such as opening PG19 and PG20 supply breakers, emergency boration or manually driving control rods, **do not** constitute a successful manual trip (ref. 4). A successful manual turbine trip that subsequently automatically trips the reactor **does** constitute a successful trip.

Following a successful reactor trip, rapid insertion of the control rods occurs. Nuclear power promptly drops to a fraction of the original power level and then decays to a level several decades less with a negative startup rate. The reactor power drop continues until reactor power reaches the point at which the influence of source neutrons on reactor power starts to be observable. A predictable post-trip response from an automatic reactor trip signal should therefore consist of a prompt drop in reactor power as sensed by the nuclear instrumentation and a lowering of power into the source range. A successful trip has therefore occurred when there is sufficient rod insertion from the trip of RTS to bring the reactor power below the immediate shutdown decay heat level of 5% (ref. 2, 3, 4).

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

Following the failure of any manual trip signal, E-0 (ref. 2) and FR-S.1 (ref. 4) prescribe insertion of redundant manual trip signals to back up the RTS trip function and ensure reactor shutdown is achieved. Even if a subsequent automatic trip signal or the first subsequent manual trip signal inserts all control rods to the full-in position immediately after the initial failure of the manual trip, the lowest level of classification that must be declared is an Unusual Event (ref. 4).

The ATWS Mitigation System Actuation Circuitry (AMSAC) logic will automatically initiate auxiliary feedwater and a turbine trip under conditions indicative of an Anticipated Transient Without Scram (ATWS) event (ref. 5).

If both subsequent automatic and subsequent manual reactor trip actions in the Control Room fail to reduce reactor power below the power associated with the safety system design ($< 5\%$) following a failure of an initial manual trip, the event escalates to an Alert under EAL SA6.1.

This IC addresses a failure of the RTS to initiate or complete an automatic or manual reactor trip that results in a reactor shutdown, and either a subsequent operator manual action taken at the reactor control consoles or an automatic trip is successful in shutting down the reactor. This event is a precursor to a more significant condition and thus represents a potential degradation of the level of safety of the plant.

Following the failure on an automatic reactor trip, operators will promptly initiate manual actions at the reactor control consoles to shut down the reactor (e.g., initiate a manual reactor trip). If these manual actions are successful in shutting down the reactor, core heat generation will quickly fall to a level within the capabilities of the plant's decay heat removal systems.

If an initial manual reactor trip is unsuccessful, operators will promptly take manual action at another location(s) on the reactor control consoles to shut down the reactor (e.g., initiate a manual reactor trip) using a different switch. Depending upon several factors, the initial or subsequent effort to manually trip the reactor, or a concurrent plant condition, may lead to the generation of an automatic reactor trip signal. If a subsequent manual or automatic trip is successful in shutting down the reactor, core heat generation will quickly fall to a level within the capabilities of the plant's decay heat removal systems.

A manual action at the reactor control consoles is any operator action, or set of actions, which causes the control rods to be rapidly inserted into the core (e.g., initiating a manual reactor trip). This action does not include manually driving in control rods or implementation of boron injection strategies. Actions taken at back-panels or other locations within the Control Room, or any location outside the Control Room, are not considered to be "at the reactor control consoles".

The plant response to the failure of an automatic or manual reactor trip will vary based upon several factors including the reactor power level prior to the event, availability of the condenser, performance of mitigation equipment and actions, other concurrent plant conditions, etc. If subsequent operator manual actions taken at the reactor control consoles are also unsuccessful in shutting down the reactor, then the emergency classification level will escalate to an Alert via IC SA6. Depending upon the plant response, escalation is also possible via IC FA1. Absent the plant conditions needed to meet either IC SA6 or FA1, an Unusual Event declaration is appropriate for this event.

A reactor shutdown is determined in accordance with applicable Emergency Operating Procedure criteria.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Should a reactor trip signal be generated as a result of plant work (e.g., RTS setpoint testing), the following classification guidance should be applied.

- If the signal causes a plant transient that should have included an automatic reactor trip and the RPS fails to automatically shut down the reactor, then this IC and the EALs are applicable, and should be evaluated.
- If the signal does not cause a plant transient and the trip failure is determined through other means (e.g., assessment of test results), then this IC and the EALs are not applicable and no classification is warranted.

Note 8 is a generic note applicable to the EAL's as approved by the NRC.

Callaway Basis Reference(s):

1. Callaway Technical Specifications, Section 3.3.1 Reactor Trip System (RTS) Instrumentation
2. E-0, Reactor Trip or Safety Injection
3. F-0, Critical Safety Function Status Trees - Subcriticality
4. FR-S.1, Response to Nuclear Power Generation/ATWS
5. FSAR, Section 7.7.1
6. NEI 99-01, SU5

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** S – System Malfunction**Subcategory:** 2 – RTS Failure**Initiating Condition:** Automatic or manual trip fails to shut down the reactor and subsequent manual actions taken at the reactor control consoles are not successful in shutting down the reactor**EAL:****SA6.1 Alert**An automatic or manual trip fails to shut down the reactor as indicated by reactor power $\geq 5\%$.**AND**Manual trip actions taken at the reactor control console (SB-HS-1 or SB-HS-42) are **not** successful in shutting down the reactor as indicated by reactor power $\geq 5\%$.*(Note 8)**Note 8:* A manual trip action is any operator action, or set of actions, which causes the control rods to be rapidly inserted into the core, and **does not** include manually driving in control rods or implementation of boron injection strategies.**MODE Applicability:**

1 - Power Operation

Definition(s):

None

Basis:

If both subsequent automatic and subsequent manual reactor trip actions in the Control Room fail to reduce reactor power below the power associated with the safety system design ($< 5\%$) following a failure of an initial manual trip, the event has escalated to this EAL.

For the purposes of emergency classification, successful manual trip actions are those which can be quickly performed from the reactor control console; SB-HS-1 on Panel RL003 or SB-HS-42 on Panel RL006. Reactor shutdown achieved by use of other trip actions, such as opening PG19 and PG20 supply breakers, emergency boration or manually driving control rods, **do not** constitute a successful manual trip (ref. 4). A successful manual turbine trip that subsequently automatically trips the reactor **does** constitute a successful trip.

This EAL addresses any automatic or manual reactor trip signal that fails to shut down the reactor (reactor power $< 5\%$) followed by a subsequent manual trip that fails to shut down the reactor to an extent the reactor is producing energy in excess of the heat load for which the safety systems were designed (ref. 1).

The ATWS Mitigation System Actuation Circuitry (AMSAC) logic will automatically initiate auxiliary feedwater and a turbine trip under conditions indicative of an Anticipated Transient Without Scram (ATWS) event (ref. 5).

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

5% rated power is a minimum reading on the power range scale that indicates continued power production. It also approximates the decay heat which the shutdown systems were designed to remove and is indicative of a condition requiring immediate response to prevent subsequent core damage. Below 5%, plant response will be similar to that observed during a normal shutdown. Nuclear instrumentation can be used to determine if reactor power is greater than 5 % power (ref. 3, 4).

Escalation of this event to a Site Area Emergency would be under EAL SS6.1 or Emergency Coordinator judgment.

This IC addresses a failure of the RPS to initiate or complete an automatic or manual reactor trip that results in a reactor shutdown, and subsequent operator manual actions taken at the reactor control consoles to shut down the reactor are also unsuccessful. This condition represents an actual or potential substantial degradation of the level of safety of the plant. An emergency declaration is required even if the reactor is subsequently shutdown by an action taken away from the reactor control consoles since this event entails a significant failure of the RTS.

A manual action at the reactor control console is any operator action, or set of actions, which causes the control rods to be rapidly inserted into the core (e.g., initiating a manual reactor trip). This action does not include manually driving in control rods or implementation of boron injection strategies. If this action(s) is unsuccessful, operators would immediately pursue additional manual actions at locations away from the reactor control console (e.g., locally opening breakers). Actions taken at back panels or other locations within the Control Room, or any location outside the Control Room, are not considered to be "at the reactor control console".

The plant response to the failure of an automatic or manual reactor trip will vary based upon several factors including the reactor power level prior to the event, availability of the condenser, performance of mitigation equipment and actions, other concurrent plant conditions, etc. If the failure to shut down the reactor is prolonged enough to cause a challenge to the core cooling or RCS heat removal safety functions, the emergency classification level will escalate to a Site Area Emergency via IC SS6. Depending upon plant responses and symptoms, escalation is also possible via IC FS1. Absent the plant conditions needed to meet either IC SS6 or FS1, an Alert declaration is appropriate for this event.

It is recognized that plant responses or symptoms may also require an Alert declaration in accordance with the Recognition Category F ICs; however, this IC and EAL are included to ensure a timely emergency declaration.

A reactor shutdown is determined in accordance with applicable Emergency Operating Procedure criteria.

Note 8 is a generic note applicable to the EAL's as approved by the NRC.

Callaway Basis Reference(s):

1. Callaway Technical Specifications, Section 3.3.1 Reactor Trip System (RTS) Instrumentation
2. E-0, Reactor Trip or Safety Injection
3. F-0, Critical Safety Function Status Trees - Subcriticality
4. FR-S.1, Response to Nuclear Power Generation/ATWS
5. FSAR, Section 7.7.1
6. NEI 99-01, SA5

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: S – System Malfunction
Subcategory: 2 – RTS Failure
Initiating Condition: Inability to shut down the reactor causing a challenge to core cooling or RCS heat removal.

EAL:**SS6.1 Site Area Emergency**

An automatic or manual trip fails to shut down the reactor as indicated by reactor power $\geq 5\%$.

AND

All actions to shut down the reactor are **not** successful as indicated by reactor power $\geq 5\%$.

AND EITHER:

- CSFST Core Cooling RED Path conditions met.
- CSFST Heat Sink RED Path conditions met.

MODE Applicability:

1 - Power Operation

Definition(s):

None

Basis:

This EAL addresses the following:

- Any automatic reactor trip signal followed by a manual trip that fails to shut down the reactor to an extent the reactor is producing energy in excess of the heat load for which the safety systems were designed (EAL SA6.1), and
- Indications that either core cooling is extremely challenged or heat removal is extremely challenged.

The combination of failure of both front line and backup protection systems to function in response to a plant transient, along with the continued production of heat, poses a direct threat to the Fuel Clad and RCS barriers.

Reactor shutdown achieved by opening PG19 and PG20 supply breakers, emergency boration or manually driving control rods, are also credited as a successful manual trip provided reactor power can be reduced below 5% before indications of an extreme challenge to either core cooling or heat removal exist (ref. 1, 4).

5% rated power is a minimum reading on the power range scale that indicates continued power production. It also approximates the decay heat which the shutdown systems were designed to remove and is indicative of a condition requiring immediate response to prevent subsequent core damage. Below 5%, plant response will be similar to that observed during a normal shutdown. Nuclear instrumentation can be used to determine if reactor power is greater than 5 % power (ref. 1, 4).

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Indication of continuing core cooling degradation is manifested by CSFST Core Cooling **RED PATH** conditions being met (ref. 2).

Indication of inability to adequately remove heat from the RCS is manifested by CSFST Heat Sink **RED PATH** conditions being met (ref. 3).

This IC addresses a failure of the RPS to initiate or complete an automatic or manual reactor trip that results in a reactor shutdown, all subsequent operator actions to manually shutdown the reactor are unsuccessful, and continued power generation is challenging the capability to adequately remove heat from the core and/or the RCS. This condition will lead to fuel damage if additional mitigation actions are unsuccessful and thus warrants the declaration of a Site Area Emergency.

In some instances, the emergency classification resulting from this IC may be higher than that resulting from an assessment of the plant responses and symptoms against the Recognition Category F ICs. This is appropriate in that the Recognition Category F ICs do not address the additional threat posed by a failure to shut down the reactor. The inclusion of this IC ensures the timely declaration of a Site Area Emergency in response to prolonged failure to shut down the reactor.

A reactor shutdown is determined in accordance with applicable Emergency Operating Procedure criteria.

Escalation of the emergency classification level would be via IC RG1 or FG1.

Callaway Basis Reference(s):

1. CSF-1, Critical Safety Function Status Trees – Figure 1 Subcriticality
2. CSF-1, Critical Safety Function Status Tress – Figure 2 Core Cooling
3. CSF-1, Critical Safety Function Status Tress – Figure 3 Heat Sink
4. FR-S.1, Response to Nuclear Power Generation/ATWS
5. NEI 99-01, SS5

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** S – System Malfunction**Subcategory:** 7 – Loss of Communications**Initiating Condition:** Loss of **all** onsite or offsite communications capabilities**EAL:****SU7.1 Unusual Event**Loss of **all** Table S-4 onsite communication methods.**OR**Loss of **all** Table S-4 ORO communication methods.**OR**Loss of **all** Table S-4 NRC communication methods.

Table S-4 Communication Methods			
System	Onsite	ORO	NRC
Gaitronics	X		
Plant Radios	X		
Plant Emergency Dedicated Phones	X		
Plant Telephone System	X	X	X
ENS (Red Phone) Line		X	X
Back-Up Radio System		X	
Sentry Notification System		X	

MODE Applicability:

1 - Power Operation, 2 - Startup, 3 - Hot Standby, 4 - Hot Shutdown

Definition(s):

OFFSITE RESPONSE ORGANIZATIONS (ORO) - The State of Missouri (SEMA/MIAC), Callaway County 911/EOC, Gasconade County 911/EOC, Montgomery County 911/EOC and Osage County 911/EOC.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Basis:**

Onsite/offsite communications include one or more of the systems listed in Table S-4 (ref. 1, 2).

1. Gaitronics system

The Gaitronics system provides six separate independent communication channels--one general page, one Control Room page and four party lines. Communication between parties within the plant can be easily and quickly established by using the general page channel. Communication between parties in the plant and the Control Room can be easily and quickly established using the Control Room page channel. The party line channel is normally used after the page call is completed. As many as four party lines may communicate simultaneously. The portion of the PA system connecting the fuel transfer area in the Containment, the spent fuel area and new fuel handling area in the fuel building, and the control room can be isolated from the remainder of the PA system from the control room. This permits extended use of the fuel handling communications system without disruption to the remainder of the system.

2. Plant Radios

A six channel 800 MHZ trunked radio system for overall plant site area coverage reaches out as far as the intake structure. This two-way radio system provides communications for operating purposes with plant radio-equipped vehicles and plant hand-held portable radios. These systems are for use during normal operation or during a plant emergency. This radio system is available on the Control Room radio consoles, on the security radio consoles, on the EOF radio console, and the TSC radio console. This system is also in the field monitoring team vehicles and is used to communicate during emergencies.

3. Plant Emergency Dedicated Phones

Three independent telephone systems are available for communications between the Emergency Response Facilities: the Technical Assessment Bridge Line, the Dose Assessment Bridge Line and the Emergency Management Bridge Line. Each system operates independently from the other systems and allows for conference calls between the members of that bridge line group

4. Plant telephone system

The telephone system consists of digital automatic switchboard (DPBX) equipment and telephone stations. The DPBX is provided with redundant processors for reliability. The telephone stations are located throughout the power block, in the main control room, in the various buildings around the site, in the security building, and in the service building where the administrative offices are located. For emergency use, unlisted telephone numbers are provided for direct access to the outside local public telephone system. Company provided cell phones **ARE** considered part of the Plant Telephone System. The FLEX response satellite phones are in place for beyond design basis accidents and **ARE NOT** considered part of the Plant Telephone System.

5. ENS (Red Phone) line

The NRC Emergency Notification System (ENS) is an FTS telephone used for official communications with NRC Headquarters. The NRC Headquarters has the capability to patch into the NRC Regional offices. The primary purpose of this phone is to provide a reliable method for the initial notification of the NRC and to maintain continuous communications with the NRC after initial notification. ENS telephones are located in the Control Room, TSC and EOF.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**6. Back-Up Radio System (BURS)

The Back-up Radio System is a communication link between the Callaway Plant and offsite emergency response agencies. The primary use of this system is the backup notification of offsite agencies and the coordination of offsite activities during a radiological emergency. The system uses 800 MHz radios. There are radio control base units in the Plant Control Room, TSC and EOF, as well as each county EOC and the State EOC. The backup to this system is the commercial touchtone telephone system. Notifications may also be initiated through the Callaway County/City of Fulton EOC via the Security radio.

7. Sentry Notification System

A computerized notification system linked between the Callaway Plant, the State Emergency Management Agency and the four (4) EPZ risk counties. It allows the Communicator to fill out a notification form on screen and transmit the data simultaneously. Notifications on Sentry can be initiated from the Control Room, the Emergency Operations Facility (EOF), or the Technical Support Center (TSC).

This EAL is the hot condition equivalent of the cold condition EAL CU5.1.

This IC addresses a significant loss of on-site or offsite communications capabilities. While not a direct challenge to plant or personnel safety, this event warrants prompt notifications to OROs and the NRC.

This IC should be assessed only when extraordinary means are being utilized to make communications possible (e.g., use of non-plant, privately owned equipment, relaying of on-site information via individuals or multiple radio transmission points, individuals being sent to offsite locations, etc.).

The first EAL condition addresses a total loss of the communications methods used in support of routine plant operations.

The second EAL condition addresses a total loss of the communications methods used to notify all OROs of an emergency declaration.

The third EAL addresses a total loss of the communications methods used to notify the NRC of an emergency declaration.

Callaway Basis Reference(s):

1. Callaway Plant Radiological Emergency Response Plan (RERP), Section 7.2
2. FSAR, Section 9.5.2
3. NEI 99-01, SU6

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** S – System Malfunction**Subcategory:** 8 – Containment Failure**Initiating Condition:** Failure to isolate containment or loss of containment pressure control.**EAL:****SU8.1 Unusual Event****Any** penetration is not isolated within 15 min. of a **VALID** containment isolation signal.**OR**Containment pressure > 27 psig with < one full train of containment depressurization equipment operating per design for ≥ 15 min.*(Notes 1, 9)**Note 1:* The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.*Note 9:* One Containment Spray System train and one Containment Cooling System train comprise one full train of depressurization equipment.**MODE Applicability:**

1 - Power Operation, 2 - Startup, 3 - Hot Standby, 4 - Hot Shutdown

Definition(s):*VALID* - An indication, report, or condition, is considered to be valid when it is verified by (1) an instrument channel check, or (2) indications on related or redundant indicators, or (3) by direct observation by plant personnel, such that doubt related to the indicator's operability, the condition's existence, or the report's accuracy is removed. Implicit in this definition is the need for timely assessment.**Basis:**

This EAL addresses a failure of one or more containment penetrations to automatically isolate (close) when required by an actuation signal. It also addresses an event that results in high containment pressure with a concurrent failure of containment pressure control systems. Absent challenges to another fission product barrier, either condition represents potential degradation of the level of safety of the plant.

For the first condition, the containment isolation signal must be generated as the result of an off-normal/accident condition (e.g., a safety injection or high containment pressure); a failure resulting from testing or maintenance does not warrant classification. The determination of containment and penetration status – isolated or not isolated – should be made in accordance with the appropriate criteria contained in the plant AOPs and EOPs. The 15-minute criterion is included to allow operators time to manually isolate the required penetrations, if possible.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

The second condition addresses a condition where containment pressure is greater than the setpoint at which containment energy (heat) removal systems are designed to automatically actuate, and less than one full train of equipment is capable of operating per design. The 15-minute criterion is included to allow operators time to manually start equipment that may not have automatically started, if possible. The inability to start the required equipment indicates that containment heat removal/depressurization systems (e.g., containment spray system or containment cooling system) are either lost or performing in a degraded manner.

The Containment Spray System consists of two separate trains of equal capacity, each capable of meeting the design bases requirement. Each train includes a containment spray pump, spray headers, nozzles, valves, and piping. The refueling water storage tank (RWST) supplies borated water to the Containment Spray System during the injection phase of operation. In the recirculation MODE of operation, Containment Spray pump suction is transferred from the RWST to the Containment sumps (ref. 2).

The Containment Cooling System consists of two trains of Containment cooling, each of sufficient capacity to supply 100% of the design cooling requirement. Each train of two fan units is supplied with cooling water from a separate train of essential service water (ESW). Air is drawn into the coolers through the fan and discharged to the steam generator compartments, pressurizer compartment, and instrument tunnel, and outside the secondary shield in the lower areas of containment. During normal operation, all four fan units may be operating. In post-accident operation following an actuation signal, the Containment Cooling System fans are designed to start automatically in slow speed if not already running (ref. 3).

The Containment pressure Hi-3 setpoint (27 psig, ref. 4, 5, 6) is the pressure at which the equipment should actuate and begin performing its function. The design basis accident analyses and evaluations assume the loss of one Containment Spray System train and one Containment Cooling System train (ref. 7). Consistent with the design requirement, "one full train of depressurization equipment" is therefore defined to be the availability of one train of each system. If less than this equipment is operating and Containment pressure is above the actuation setpoint, the threshold is met.

This event would escalate to a Site Area Emergency in accordance with IC FS1 if there were a concurrent loss or potential loss of either the Fuel Clad or RCS fission product barriers.

Callaway Basis Reference(s):

1. FSAR, Section 6.2.2
2. FSAR, Section 6.2.2.1.2.1
3. FSAR, Section 6.2.2.2.2
4. CSF-1, Critical Safety Function Status Trees (CSFST) Figure 5, Containment
5. FR-Z.1, Response to High Containment Pressure
6. Technical Specifications, Table 3.3.2-1
7. Technical Specifications, B3.6.6
8. NEI 99-01, SU7

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** S – System Malfunction**Subcategory:** 9 – Hazardous Event Affecting Safety Systems**Initiating Condition:** Hazardous event affecting a SAFETY SYSTEM needed for the current operating MODE**EAL:****SA9.1 Alert**The occurrence of **any** Table S-5 hazardous event**AND**

Event damage has caused indication of degraded performance on one train of a SAFETY SYSTEM needed for the current operating MODE

AND EITHER:

- Event damage has caused indications of degraded performance in a second train of a SAFETY SYSTEM needed for the current operating MODE.
- Event damage has resulted in VISIBLE DAMAGE to a second train of a SAFETY SYSTEM needed for the current operating MODE.

(Notes 11, 12)

Note 11: If the hazardous event only results in VISIBLE DAMAGE, with no indication of degraded performance to at least one train of a SAFETY SYSTEM, then this emergency classification is not warranted.

Note 12: This EAL is applicable when a Table S-5 Hazardous Events causes a LOSS OF SAFETY FUNCTION on a SAFETY SYSTEM required for the current operating MODE.

Table S-5 Hazardous Events

- EXPLOSION
- FIRE
- HIGH WINDS or tornado strike
- Internal or external FLOODING event
- Seismic event (earthquake)
- Other events with similar hazard characteristics as determined by the Emergency Coordinator

MODE Applicability:

1 - Power Operation, 2 - Startup, 3 - Hot Standby, 4 - Hot Shutdown

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

Definition(s):

EXPLOSION - A rapid, violent and catastrophic failure of a piece of equipment due to combustion, chemical reaction or over pressurization. A release of steam (from high energy lines or components) or an electrical component failure (caused by short circuits, grounding, arcing, etc.) should not automatically be considered an explosion. Such events require a post-event inspection to determine if the attributes of an explosion are present.

FIRE - Combustion characterized by heat and light. Sources of smoke such as slipping drive belts or overheated electrical equipment do not constitute fires. Observation of flame is preferred but is NOT required if large quantities of smoke and heat are observed.

FLOODING - A condition where water is entering a room or area faster than installed equipment is capable of removal, resulting in a rise of water level within the room or area.

HIGH WINDS - Winds in excess of 40 mph (18 m/s) sustained, or 58 mph (26 m/s) gusting.

LOSS OF SAFETY FUNCTION (LOSF) - A LOSF exists when, assuming no concurrent single failure, a safety function assumed in the accident analysis cannot be performed. For the purpose of the Safety Function Determination Program, a LOSF may exist when a support system is INOPERABLE, AND:

- a) A required system redundant to the system supported by the INOPERABLE support system is also INOPERABLE; OR
- b) A required system redundant to the system in turn supported by the INOPERABLE supported system is also INOPERABLE; OR
- c) A required system redundant to the support system for the supported systems (a) and (b) above is also INOPERABLE.

SAFETY SYSTEM - A system required for safe plant operation, cooling down the plant and/or placing it in the Cold Shutdown condition, including the ECCS. These are typically systems classified as safety-related (as defined in 10CFR50.2):

Those structures, systems and components that are relied upon to remain functional during and following design basis events to assure:

1. The integrity of the reactor coolant pressure boundary;
2. The capability to shut down the reactor and maintain it in a safe shutdown condition;
3. The capability to prevent or mitigate the consequences of accidents which could result in potential offsite exposures.

VISIBLE DAMAGE - Damage to a SAFETY SYSTEM train that is readily observable without measurements, testing, or analysis. The visual impact of the damage is sufficient to cause concern regarding the operability or reliability of the affected SAFETY SYSTEM train.

Basis:

- Annunciator 98D, OBE will illuminate if the seismic instrument detects ground motion in excess of the OBE threshold. OTO-SG-00001, Seismic Event provides the guidance for determining if an OBE earthquake threshold is exceeded and any required response actions (ref. 1).
- Internal FLOODING may be caused by events such as component failures, equipment misalignment, or outage activity mishaps (ref. 2).
- External flooding may be due to high lake level. Callaway plant grade elevation is 840.0 ft. MSL. (ref. 3).

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

- Seismic Category I structures are analyzed to withstand a sustained, design wind velocity of at least 100 mph. (ref. 4).
- Areas containing functions and systems required for safe shutdown of the plant are identified by fire area (ref. 5).
- An explosion that degrades the performance of a SAFETY SYSTEM train or visibly damages a SAFETY SYSTEM component or structure would be classified under this EAL.

A **single** FAULTED steam generator would NOT require declaration per this EAL. Technical Specification Bases 3.7.4 explains that two intact Steam Generators are required for cooldown of the RCS and a third Steam Generator is assumed to be RUPTURED. If more than one Steam Generator is FAULTED, then this EAL is applicable.

This IC addresses a hazardous event that causes damage to SAFETY SYSTEMS needed for the current operating mode. In order to provide the appropriate context for consideration of an ALERT classification, the hazardous event must have caused indications of degraded SAFETY SYSTEM performance in one train, and there must be either indications of performance issues with the second SAFETY SYSTEM train or VISIBLE DAMAGE to the second train such that the potential exists for this second SAFETY SYSTEM train to have performance issues. In other words, in order for this EAL to be classified, the hazardous event must occur, at least one SAFETY SYSTEM train must have indications of degraded performance, and the second SAFETY SYSTEM train must have indications of degraded performance or VISIBLE DAMAGE such that the potential exists for performance issues. Note that this second SAFETY SYSTEM train is from the same SAFETY SYSTEM that has indications of degraded performance; commercial nuclear power plants are designed to be able to support single system issues without compromising public health and safety from radiological events.

Indications of degraded performance addresses damage to a SAFETY SYSTEM train that is in service/operation since indications for it will be readily available. The indications of degraded performance should be significant enough to cause concern regarding the operability or reliability of the SAFETY SYSTEM train.

Operators will make a determination of VISIBLE DAMAGE based on the totality of available event and damage report information. This is intended to be a brief assessment not requiring lengthy analysis or quantification of the damage. This VISIBLE DAMAGE should be significant enough to cause concern regarding the operability or reliability of the SAFETY SYSTEM train.

Escalation of the emergency classification level would be via ICs FS1 or RS1.

Callaway Basis Reference(s):

1. OTO-SG-00001, Seismic Event
2. IPE Section 3.4.2.3 Results of the Vulnerability Screening
3. FSAR, Section 3.4 Water Level (Flood) Design Table 3.4-1 PMF, Groundwater, Reference, and Actual Plant Elevations
4. FSAR, Section 3.3.1.1 Design Wind Loadings
5. FSAR, Section 9.5.1 Fire Protection System
6. NEI 99-01, SA9

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category F – Fission Product Barrier Degradation**

EAL Group: Hot Conditions (RCS temperature > 200°F); EALs in this category are applicable only in one or more hot operating MODES.

EALs in this category represent threats to the defense in depth design concept that precludes the release of highly radioactive fission products to the environment. This concept relies on multiple physical barriers any one of which, if maintained intact, precludes the release of significant amounts of radioactive fission products to the environment. The primary fission product barriers are:

- A. **Fuel Clad (FC)**: The Fuel Clad Barrier consists of the cladding material that contains the fuel pellets.
- B. **Reactor Coolant System (RCS)**: The RCS Barrier includes the RCS primary side and its connections up to and including the pressurizer safety and relief valves, and other connections up to and including the primary isolation valves.
- C. **Containment (CMT)**: The Containment Barrier includes the containment building and connections up to and including the outermost containment isolation valves. This barrier also includes the main steam, feedwater, and blowdown line extensions outside the containment building up to and including the outermost secondary side isolation valve. Containment Barrier thresholds are used as criteria for escalation of the ECL from Alert to a Site Area Emergency or a General Emergency.

The EALs in this category require evaluation of the loss and potential loss thresholds listed in the fission product barrier matrix of Table F-1 (Attachment 2). “Loss” and “Potential Loss” signify the relative damage and threat of damage to the barrier. “Loss” means the barrier no longer assures containment of radioactive materials. “Potential Loss” means integrity of the barrier is threatened and could be lost if conditions continue to degrade. The number of barriers that are lost or potentially lost and the following criteria determine the appropriate emergency classification level:

Alert:

Any loss or any potential loss of either Fuel Clad or RCS

Site Area Emergency:

Loss or potential loss of any two barriers

General Emergency:

Loss of any two barriers and loss or potential loss of third barrier

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 1 - Emergency Action Level Technical Bases

The logic used for emergency classification based on fission product barrier monitoring should reflect the following considerations:

- The Fuel Clad Barrier and the RCS Barrier are weighted more heavily than the Containment Barrier.
- Unusual Event ICs associated with RCS and Fuel Clad Barriers are addressed under System Malfunction ICs.
- For accident conditions involving a radiological release, evaluation of the fission product barrier thresholds will need to be performed in conjunction with dose assessments to ensure correct and timely escalation of the emergency classification. For example, an evaluation of the fission product barrier thresholds may result in a Site Area Emergency classification while a dose assessment may indicate that an EAL for General Emergency IC RG1 has been exceeded.
- The fission product barrier thresholds specified within a scheme reflect plant-specific Callaway design and operating characteristics.
- As used in this category, the term RCS leakage encompasses not just those types defined in Technical Specifications but also includes the loss of RCS mass to any location– inside the primary containment, an interfacing system, or outside of the primary containment. The release of liquid or steam mass from the RCS due to the as-designed/expected operation of a relief valve is not considered to be RCS leakage.
- At the Site Area Emergency level, EAL users should maintain cognizance of how far present conditions are from meeting a threshold that would require a General Emergency declaration. For example, if the Fuel Clad and RCS fission product barriers were both lost, then there should be frequent assessments of containment radioactive inventory and integrity. Alternatively, if both the Fuel Clad and RCS fission product barriers were potentially lost, the Emergency Coordinator would have more assurance that there was no immediate need to escalate to a General Emergency.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases**

Category: Fission Product Barrier Degradation

Subcategory: N/A

Initiating Condition: Any loss or any potential loss of either Fuel Clad or RCS

EAL:

FA1.1 Alert

Any loss or any potential loss of either Fuel Clad or RCS (Table F-1).

MODE Applicability:

1 - Power Operation, 2 - Startup, 3 - Hot Standby, 4 - Hot Shutdown

Definition(s):

None

Basis:

Fuel Clad, RCS and Containment comprise the fission product barriers. Table F-1 (Attachment 2) lists the fission product barrier thresholds, bases and references.

At the Alert classification level, Fuel Clad and RCS barriers are weighted more heavily than the Containment barrier. Unlike the Containment barrier, loss or potential loss of either the Fuel Clad or RCS barrier may result in the relocation of radioactive materials or degradation of core cooling capability. Note that the loss or potential loss of Containment barrier in combination with loss or potential loss of either Fuel Clad or RCS barrier results in declaration of a Site Area Emergency under EAL FS1.1.

Callaway Basis Reference(s):

1. NEI 99-01, FA1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** Fission Product Barrier Degradation**Subcategory:** N/A**Initiating Condition:** Loss or potential loss of **any** two barriers**EAL:****FS1.1 Site Area Emergency**Loss or potential loss of **any** two barriers (Table F-1).**MODE Applicability:**

1 - Power Operation, 2 - Startup, 3 - Hot Standby, 4 - Hot Shutdown

Definition(s):

None

Basis:

Fuel Clad, RCS and Containment comprise the fission product barriers. Table F-1 (Attachment 2) lists the fission product barrier thresholds, bases and references.

At the Site Area Emergency classification level, each barrier is weighted equally. A Site Area Emergency is therefore appropriate for any combination of the following conditions:

- One barrier loss and a second barrier loss (i.e., loss - loss)
- One barrier loss and a second barrier potential loss (i.e., loss - potential loss)
- One barrier potential loss and a second barrier potential loss (i.e., potential loss - potential loss)

At the Site Area Emergency classification level, the ability to dynamically assess the proximity of present conditions with respect to the threshold for a General Emergency is important. For example, the existence of Fuel Clad and RCS Barrier loss thresholds in addition to offsite dose assessments would require continual assessments of radioactive inventory and Containment integrity in anticipation of reaching a General Emergency classification. Alternatively, if both Fuel Clad and RCS potential loss thresholds existed, the Emergency Coordinator would have greater assurance that escalation to a General Emergency is less imminent.

Callaway Basis Reference(s):

1. NEI 99-01, FS1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 1 - Emergency Action Level Technical Bases****Category:** Fission Product Barrier Degradation**Subcategory:** N/A**Initiating Condition:** Loss of **any** two barriers and loss or potential loss of third barrier**EAL:****FG1.1 General Emergency**Loss of **any** two barriers.**AND**

Loss or potential loss of third barrier (Table F-1).

MODE Applicability:

1 - Power Operation, 2 - Startup, 3 - Hot Standby, 4 - Hot Shutdown

Definition(s):

None

Basis:

Fuel Clad, RCS and Containment comprise the fission product barriers. Table F-1 (Attachment 2) lists the fission product barrier thresholds, bases and references.

At the General Emergency classification level each barrier is weighted equally. A General Emergency is therefore appropriate for any combination of the following conditions:

- Loss of Fuel Clad, RCS and Containment barriers
- Loss of Fuel Clad and RCS barriers with potential loss of Containment barrier
- Loss of RCS and Containment barriers with potential loss of Fuel Clad barrier
- Loss of Fuel Clad and Containment barriers with potential loss of RCS barrier

Callaway Basis Reference(s):

1. NEI 99-01, FG1

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases

Introduction

Table F-1 lists the threshold conditions that define the Loss and Potential Loss of the three fission product barriers (Fuel Clad, Reactor Coolant System, and Containment). The table is structured so that each of the three barriers occupies adjacent columns. Each fission product barrier column is further divided into two columns; one for Loss thresholds and one for Potential Loss thresholds.

The first column of the table (to the left of the Fuel Clad Loss column) lists the categories (types) of fission product barrier thresholds. The fission product barrier categories are:

- A. RCS or SG Tube Leakage
- B. Inadequate Heat removal
- C. CMT Radiation / RCS Activity
- D. CMT Integrity or Bypass
- E. Emergency Coordinator Judgment

Each category occupies a row in Table F-1 thus forming a matrix defined by the categories. The intersection of each row with each Loss/Potential Loss column forms a cell in which one or more fission product barrier thresholds appear.

Thresholds are assigned sequential numbers within each Loss and Potential Loss column beginning with number one. In this manner, a threshold can be identified by its category title and number. For example, the first Fuel Clad barrier Loss in Category A would be assigned "FC Loss A.1," the third Containment barrier Potential Loss in Category C would be assigned "CMT P-Loss C.3," etc.

If a cell in Table F-1 contains more than one numbered threshold, each of the numbered thresholds, if exceeded, signifies a Loss or Potential Loss of the barrier. It is not necessary to exceed all of the thresholds in a category before declaring a barrier Loss/Potential Loss.

Subdivision of Table F-1 by category facilitates association of plant conditions to the applicable fission product barrier Loss and Potential Loss thresholds. This structure promotes a systematic approach to assessing the classification status of the fission product barriers.

When equipped with knowledge of plant conditions related to the fission product barriers, the EAL-user first scans down the category column of Table F-1, locates the likely category and then reads across the fission product barrier Loss and Potential Loss thresholds in that category to determine if a threshold has been exceeded. If a threshold has not been exceeded, the EAL-user proceeds to the next likely category and continues review of the thresholds in the new category.

If the EAL-user determines that any threshold has been exceeded, by definition, the barrier is lost or potentially lost – even if multiple thresholds in the same barrier column are exceeded, only that one barrier is lost or potentially lost. The EAL-user must examine each of the three fission product barriers to determine if other barrier thresholds in the category are lost or potentially lost. For example, if containment radiation is sufficiently high, a Loss of the Fuel Clad and RCS barriers and a Potential Loss of the Containment barrier can occur. Barrier Losses and Potential Losses are then applied to the algorithms given in EALs FG1.1, FS1.1, and FA1.1 to determine the appropriate emergency classification.

In the remainder of this Attachment, the Fuel Clad barrier threshold bases appear first, followed by the RCS barrier and finally the Containment barrier threshold bases. In each barrier, the bases are given according category Loss followed by category Potential Loss beginning with Category A, then B,..., E.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases

Table F-1 Fission Product Barrier Threshold Matrix

Category	Fuel Clad (FC) Barrier		Reactor Coolant System (RCS) Barrier		Containment (CMT) Barrier	
	Loss	Potential Loss	Loss	Potential Loss	Loss	Potential Loss
A RCS or SG Tube Leakage	None	None	1. An automatic or manual ECCS (SI) actuation required by EITHER: • UNISOLABLE RCS leakage • SG tube RUPTURE	1. Operation of a standby charging pump is required by EITHER: • UNISOLABLE RCS leakage • SG tube leakage 2. CSFST Integrity-RED Path conditions met	1. A leaking or RUPTURED SG is FAULTED outside of containment	None
B Inadequate Heat Removal	1. CSFST Core Cooling-RED Path conditions met	1. CSFST Core Cooling-OR Path conditions met 2. CSFST Heat Sink-RED Path conditions met AND Heat sink is required	None	1. CSFST Heat Sink-RED Path conditions met AND Heat sink is required	None	1. CSFST Core Cooling-RED Path conditions met AND Restoration procedures not effective within 15 min. (Note 1)
C CMT Radiation / RCS Activity	1. Containment radiation > 840 R/hr on GT-RE-59 (591) or GT-RE-60 (601) 2. Dose equivalent I-131 coolant activity > 300 µCi/cc 3. CVCS letdown radiation > 2.50E+01 µCi/ml on SJ-RE-01 (016)	None	1. Containment radiation > 59 R/hr on GT-RE-59 (591) or GT-RE-60 (601)	None	None	1. Containment radiation > 14,000 R/hr on GT-RE-59 (591) or GT-RE-60 (601)
D CMT Integrity or Bypass	None	None	None	None	1. Containment isolation is required AND EITHER: • Containment integrity has been lost based on Emergency Coordinator judgment • UNISOLABLE pathway from Containment to the environment exists 2. Indications of RCS leakage outside of Containment	1. CSFST Containment-RED Path conditions met 2. Containment hydrogen concentration ≥ 4% 3. Containment pressure > 27 psig with < one full train of depressurization equipment operating per design for ≥ 15 min. (Notes 1, 9)
E Judgment	1. Any condition in the opinion of the Emergency Coordinator that indicates loss of the fuel clad barrier	1. Any condition in the opinion of the Emergency Coordinator that indicates potential loss of the fuel clad barrier	1. Any condition in the opinion of the Emergency Coordinator that indicates loss of the RCS barrier	1. Any condition in the opinion of the Emergency Coordinator that indicates potential loss of the RCS barrier	1. Any condition in the opinion of the Emergency Coordinator that indicates loss of the Containment barrier	1. Any condition in the opinion of the Emergency Coordinator that indicates potential loss of the Containment barrier

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases****Barrier:** Fuel Clad**Category:** A. RCS or SG Tube Leakage**Degradation Threat:** Loss**Threshold:**

None.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases**

Barrier: Fuel Clad
Category: A. RCS or SG Tube Leakage
Degradation Threat: Potential Loss

Threshold:

None.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases****Barrier:** Fuel Clad**Category:** B. Inadequate Heat Removal**Degradation Threat:** Loss**Threshold:**

1. CSFST Core Cooling-**RED** Path conditions met.

Definition(s):

None

Basis:

Critical Safety Function Status Tree (CSFST) Core Cooling-RED path indicates significant core exit superheating and core uncover. The CSFSTs are normally monitored using the SPDS display on the Plant Computer (ref. 1).

This reading indicates temperatures within the core are sufficient to cause significant superheating of reactor coolant.

Callaway Basis Reference(s):

1. CSF-1 Critical Safety Function Status Trees
2. FR-C.1 Response to Inadequate Core Cooling
3. FR-C.2 Response to Degraded Core Cooling
4. NEI 99-01 Inadequate Heat Removal Fuel Clad Loss 2.A

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases

Barrier: Fuel Clad
Category: B. Inadequate Heat Removal
Degradation Threat: Potential Loss

Threshold:

1. CSFST Core Cooling-ORANGE Path conditions met.

Definition(s):

None

Basis:

Critical Safety Function Status Tree (CSFST) Core Cooling-ORANGE path indicates subcooling has been lost and that some fuel clad damage may potentially occur. The CSFSTs are normally monitored using the SPDS display on the Plant Computer (ref. 1).

This reading indicates a reduction in reactor vessel water level sufficient to allow the onset of heat-induced cladding damage.

Callaway Basis Reference(s):

1. CSF-1 Critical Safety Function Status Trees
2. FR-C.1 Response to Inadequate Core Cooling
3. FR-C.2 Response to Degraded Core Cooling
4. NEI 99-01 Inadequate Heat Removal Fuel Clad Loss 2.A

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases

Barrier: Fuel Clad
Category: B. Inadequate Heat Removal
Degradation Threat: Potential Loss

Threshold:

2. CSFST Heat Sink-**RED** Path conditions met.

AND

Heat sink is required.

Definition(s):

None

Basis:

In combination with RCS Potential Loss B.1, meeting this threshold results in a Site Area Emergency.

Critical Safety Function Status Tree (CSFST) Heat Sink-RED path indicates the heat sink function is under extreme challenge and that some fuel clad damage may potentially occur (ref. 1).

The CSFSTs are normally monitored using the SPDS display on the Plant Computer (ref. 1).

The phrase “and heat sink required” precludes the need for classification for conditions in which RCS pressure is less than SG pressure or Heat Sink-RED path entry was created through operator action directed by an EOP. For example, FR-H.1 is entered from CSFST Heat Sink-Red. Step 1 tells the operator to determine if heat sink is required by checking that RCS pressure is greater than any non-faulted SG pressure and either RCS temperature is greater than 350°F or RCS pressure is greater than 360 psig. If these conditions exist, Heat Sink is required. Otherwise, the operator is to either return to the procedure and step in effect and place RHR in service for heat removal. For large LOCA events inside the Containment, the SGs are moot because heat removal through the containment heat removal systems takes place. Therefore, Heat Sink Red should not be required and, should not be assessed for EAL classification because a LOCA event alone should not require higher than an Alert classification. (ref. 2).

This condition indicates an extreme challenge to the ability to remove RCS heat using the steam generators (i.e., loss of an effective secondary-side heat sink). This condition represents a potential loss of the Fuel Clad Barrier. In accordance with EOPs, there may be unusual accident conditions during which operators intentionally reduce the heat removal capability of the steam generators; during these conditions, classification using threshold is not warranted.

Callaway Basis Reference(s):

1. CSF-1 Critical Safety Function Status Trees Figure 3 Heat Sink
2. FR-H.1 Response to Loss of Secondary Heat Sink
3. NEI 99-01 Inadequate Heat Removal Fuel Clad Loss 2.B

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases**

Barrier: Fuel Clad
Category: C. CMT Radiation / RCS Activity
Degradation Threat: Loss

Threshold:

1. Containment radiation > 840 R/hr on GT-RE-59 (591) or GT-RE-60 (601).

Definition(s):

None

Basis:

Containment radiation monitor readings greater than 840 R/hr (ref. 1) indicate the release of reactor coolant, with elevated activity indicative of fuel damage, into the Containment. The reading is derived assuming the instantaneous release and dispersal of the reactor coolant noble gas and iodine inventory associated with a concentration of 300 $\mu\text{Ci/cc}$ dose equivalent I-131 into the Containment atmosphere. Reactor coolant concentrations of this magnitude are several times larger than the maximum concentrations (including iodine spiking) allowed within technical specifications and are therefore indicative of fuel damage (approximately 5% clad failure depending on core inventory and RCS volume).

Monitors used for this fission product barrier loss threshold are the Containment High Range Radiation Monitors GT-RE-59 (Panel RM-11 channel 591) and GT-RE-60 (Panel RM-11 channel 601). The threshold value of 840 R/hr is the HI-HI (RED) alarm setpoint (ref. 2).

The radiation monitor reading corresponds to an instantaneous release of all reactor coolant mass into the containment, assuming that reactor coolant activity equals 300 $\mu\text{Ci/gm}$ dose equivalent I-131. Reactor coolant activity above this level is greater than that expected for iodine spikes and corresponds to an approximate range of 2% to 5% fuel clad damage. Since this condition indicates that a significant amount of fuel clad damage has occurred, it represents a loss of the Fuel Clad Barrier.

The radiation monitor reading in this threshold is higher than that specified for RCS Barrier Loss threshold C.1 since it indicates a loss of both the Fuel Clad Barrier and the RCS Barrier. Note that a combination of the two monitor readings appropriately escalates the ECL to a Site Area Emergency.

Callaway Basis Reference(s):

1. EPCI-1701
2. OTA-SP-RM011 Radiation Monitor Control Panel RM-11
2. NEI 99-01 CMT Radiation / RCS Activity Fuel Clad Loss 3.A

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases**

Barrier: Fuel Clad
Category: C. CMT Radiation / RCS Activity
Degradation Threat: Loss

Threshold:

2. Dose equivalent I-131 coolant activity > 300 $\mu\text{Ci/cc}$.

Definition(s):

None

Basis:

Dose Equivalent Iodine (DEI) is determined by Chemistry procedure CDP-ZZ-08100, Post Accident Sampling Guidelines (ref. 1).

Elevated reactor coolant activity represents a potential degradation in the level of safety of the plant and a potential precursor of more serious problems. The threshold dose equivalent I-131 concentration is well above that expected for iodine spikes and corresponds to about 2% to 5% fuel clad damage. When reactor coolant activity reaches this level the Fuel Clad barrier is considered lost. (ref. 2).

This threshold indicates that RCS radioactivity concentration is greater than 300 $\mu\text{Ci/gm}$ dose equivalent I-131. Reactor coolant activity above this level is greater than that expected for iodine spikes and corresponds to an approximate range of 2% to 5% fuel clad damage. Since this condition indicates that a significant amount of fuel clad damage has occurred, it represents a loss of the Fuel Clad Barrier.

There is no Potential Loss threshold associated with RCS Activity / Containment Radiation.

Callaway Basis Reference(s):

1. CDP-ZZ-08100 Post Accident Sampling Guidelines
2. NEI 99-01 CMT Radiation / RCS Activity Fuel Clad Loss 3.B

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases**

Barrier: Fuel Clad
Category: C. CMT Radiation / RCS Activity
Degradation Threat: Loss

Threshold:

3. CVCS letdown radiation > 2.50E+01 $\mu\text{Ci/ml}$ on SJ-RE-01 (016).

Definition(s):

None

Basis:

The normal Chemical and Volume Control System (CVCS) charging and letdown flow path allows purification of the reactor coolant and control of the RCS volume while maintaining a continuous feed and bleed flow between the RCS and the CVCS. Reactor coolant is first "letdown" from the RCS through a regenerative heat exchanger, which minimizes heat losses from the RCS. Additional cooling takes place in a letdown heat exchanger that acts as the heat sink for the system. Downstream of the letdown heat exchanger pressure control valve and upstream of the mixed bed demineralizers, the letdown stream passes by radiation monitor SJ-RE-01, which will warn of fission products in the letdown coolant if a fuel element failure occurs. The monitor is located in the Primary Sample Sink Room.

The CVCS letdown monitor SJ-RE-01 provides indication in the Control Room on Panel RM-11 channel 016 with a range of 1.7E-03 to 1.7E+03 $\mu\text{Ci/ml}$ (ref. 2, 3). The HI-HI (RED) alarm is 5E0 + background + (background x 0.05) (ref. 4) and represents a total fuel clad failure in excess of 1% in 30 minutes (ref. 2, 3). Five times this alarm setpoint corresponds to approximately 5% fuel clad failure. 5% clad failure is also the basis for the coolant activity and Containment radiation Fuel Clad loss thresholds.

Callaway Basis Reference(s):

1. FSAR Section 9.3.4.2
2. FSAR Table 11.5-1
3. OTA-SP-RM011 Radiation Monitor Control Panel RM-11
4. HPCI-05-02 Gaseous and Liquid Radiation Monitor Setpoints Rev. 0, Note 11
5. NEI 99-01 Other Indications Fuel Clad Loss 5.A

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases****Barrier:** Fuel Clad**Category:** C. CMT Radiation / RCS Activity**Degradation Threat:** Potential Loss**Threshold:**

None.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases****Barrier:** Fuel Clad**Category:** D. CMT Integrity or Bypass**Degradation Threat:** Loss**Threshold:**

None.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases****Barrier:** Fuel Clad**Category:** D. CMT Integrity or Bypass**Degradation Threat:** Potential Loss**Threshold:**

None.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases****Barrier:** Fuel Clad**Category:** E. Emergency Coordinator Judgment**Degradation Threat:** Loss**Threshold:**

1. **Any** condition in the opinion of the Emergency Coordinator that indicates loss of the Fuel Clad barrier.

Definition(s):

None

Basis:

The Emergency Coordinator judgment threshold addresses any other factors relevant to determining if the Fuel Clad barrier is lost. Such a determination should include imminent barrier degradation, barrier monitoring capability and dominant accident sequences.

- Imminent barrier degradation exists if the degradation will likely occur within relatively short period of time based on a projection of current safety system performance. The term “imminent” refers to recognition of the inability to reach safety acceptance criteria before completion of all checks.
- Barrier monitoring capability is decreased if there is a loss or lack of reliable indicators. This assessment should include instrumentation operability concerns, readings from portable instrumentation and consideration of offsite monitoring results.
- Dominant accident sequences lead to degradation of all fission product barriers and likely entry to the EOPs. The Emergency Coordinator should be mindful of the Loss of AC power (Station Blackout) and ATWS EALs to assure timely emergency classification declarations.

This threshold addresses any other factors that are to be used by the Emergency Coordinator in determining whether the Fuel Clad barrier is lost.

Callaway Basis Reference(s):

1. NEI 99-01 Emergency Director Judgment Fuel Clad Loss 6.A

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases****Barrier:** Fuel Clad**Category:** E. Emergency Coordinator Judgment**Degradation Threat:** Potential Loss**Threshold:**

1. **Any** condition in the opinion of the Emergency Coordinator that indicates potential loss of the Fuel Clad barrier.

Basis:

The Emergency Coordinator judgment threshold addresses any other factors relevant to determining if the Fuel Clad barrier is potentially lost. Such a determination should include imminent barrier degradation, barrier monitoring capability and dominant accident sequences.

- Imminent barrier degradation exists if the degradation will likely occur within relatively short period of time based on a projection of current safety system performance. The term “imminent” refers to recognition of the inability to reach safety acceptance criteria before completion of all checks.
- Barrier monitoring capability is decreased if there is a loss or lack of reliable indicators. This assessment should include instrumentation operability concerns, readings from portable instrumentation and consideration of offsite monitoring results.
- Dominant accident sequences lead to degradation of all fission product barriers and likely entry to the EOPs. The Emergency Coordinator should be mindful of the Loss of AC power (Station Blackout) and ATWS EALs to assure timely emergency classification declarations.

This threshold addresses any other factors that are to be used by the Emergency Coordinator in determining whether the Fuel Clad barrier is potentially lost. The Emergency Coordinator should also consider whether or not to declare the barrier potentially lost in the event that barrier status cannot be monitored.

Callaway Basis Reference(s):

1. NEI 99-01 Emergency Director Judgment Potential Fuel Clad Loss 6.A

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases

Barrier: Reactor Coolant System
Category: A. RCS or SG Tube Leakage
Degradation Threat: Loss

Threshold:

1. An automatic or manual ECCS (SI) actuation required by **EITHER**:
 - UNISOLABLE RCS leakage.
 - SG tube RUPTURE.

Definition(s):

UNISOLABLE - An open or breached system line that cannot be isolated, remotely or locally.

RUPTURE - The condition of a steam generator in which primary-to-secondary leakage is of sufficient magnitude to require a safety injection.

Basis:

ECCS (SI) actuation is caused by (ref. 1):

- Pressurizer low pressure < 1849 psig
- Steamline low pressure < 615 psig
- Containment high pressure > 3.5 psig
- Manual

This threshold is based on an UNISOLABLE RCS leak of sufficient size to require an automatic or manual actuation of the Emergency Core Cooling System (ECCS). This condition clearly represents a loss of the RCS Barrier.

This threshold is applicable to unidentified and pressure boundary leakage, as well as identified leakage. It is also applicable to UNISOLABLE RCS leakage through an interfacing system. The mass loss may be into any location – inside containment, to the secondary-side (i.e., steam generator tube leakage) or outside of containment.

A steam generator with primary-to-secondary leakage of sufficient magnitude to require a safety injection is considered to be RUPTURED. If a RUPTURED steam generator is also FAULTED outside of containment, the declaration escalates to a Site Area Emergency since the Containment Barrier Loss threshold 1.A will also be met.

Callaway Basis Reference(s):

1. E-0 Reactor Trip or Safety Injection
2. E-3 Steam Generator Tube Rupture
3. NEI 99-01 RCS or SG Tube Leakage Reactor Coolant System Loss 1.A

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases**

Barrier: Reactor Coolant System

Category: A. RCS or SG Tube Leakage

Degradation Threat: Potential Loss

Threshold:

1. Operation of a standby charging pump is required by **EITHER**:
 - UNISOLABLE RCS leakage.
 - SG tube leakage.

Definition(s):

UNISOLABLE - An open or breached system line that cannot be isolated, remotely or locally.

Basis:

This threshold is based on the inability to maintain liquid inventory within the RCS by normal operation of the Chemical and Volume Control System (CVCS). The CVCS includes three charging pumps: one Normal Charging Pump with a design flow capacity of 130 gpm, and two centrifugal charging pumps each with a design flow capacity of 150 gpm (ref. 1). Approximately 12 gpm of charging flow bypasses the RCS due to leakage through the RCP seals; thus, the Normal Charging Pump can deliver $130 \text{ gpm} - 12 \text{ gpm} = 118 \text{ gpm}$ (rounded to 120 gpm for readability) (ref. 2). A second charging pump being required is indicative of a substantial RCS leak exceeding the capacity of one charging pump (120 gpm) in the normal charging MODE with letdown isolated.

This threshold is based on an UNISOLABLE RCS leak that results in the inability to maintain pressurizer level within specified limits by operation of a normally used charging (makeup) pump, but an ECCS (SI) actuation has not occurred. The threshold is met when an operating procedure, or operating crew supervision, directs that a standby charging (makeup) pump be placed in service, indicating a substantial RCS leak exceeding the capacity of one charging pump (120 gpm) in the normal charging MODE with letdown isolated, to restore and maintain pressurizer level.

This threshold is applicable to unidentified and pressure boundary leakage, as well as identified leakage. It is also applicable to UNISOLABLE RCS leakage through an interfacing system. The mass loss may be into any location – inside containment, to the secondary-side (i.e., steam generator tube leakage) or outside of containment.

If a leaking steam generator is also FAULTED outside of containment, the declaration escalates to a Site Area Emergency since the Containment Barrier Loss threshold 1.A will also be met.

Callaway Basis Reference(s):

1. FSAR, Table 9.3-9
2. FSAR, Section 9.3.4 Chemical and Volume Control System
3. E-3 Steam Generator Tube Rupture
4. NEI 99-01, RCS or SG Tube Leakage Reactor Coolant System Potential Loss 1.A

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases**

Barrier: Reactor Coolant System
Category: A. RCS or SG Tube Leakage
Degradation Threat: Potential Loss

Threshold:

2. CSFST Integrity-RED Path conditions met.

Definition(s):

None

Basis:

The "Potential Loss" threshold is defined by the CSFST Reactor Coolant Integrity - RED path. CSFST RCS Integrity - Red Path plant conditions and associated Pressurized Thermal Shock (PTS) Limit Curve A indicates an extreme challenge to the safety function when plant parameters are to the left of the limit curve following excessive RCS cooldown under pressure (ref. 1, 2).

This condition indicates an extreme challenge to the integrity of the RCS pressure boundary due to pressurized thermal shock – a transient that causes rapid RCS cooldown while the RCS is in MODE 3 or higher (i.e., hot and pressurized).

Callaway Basis Reference(s):

1. CSF-1, Critical Safety Function Status Trees Figure 4 Integrity and 4a Limit A Curve
2. FR-P.1, Response to Imminent Pressurized Thermal Shock Condition
3. NEI 99-01, RCS or SG Tube Leakage Reactor Coolant System Potential Loss 1.B

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases**

Barrier: Reactor Coolant System

Category: B. Inadequate Heat Removal

Degradation Threat: Loss

Threshold:

None.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases**

Barrier: Reactor Coolant System
Category: B. Inadequate Heat Removal
Degradation Threat: Potential Loss

Threshold:

1. CSFST Heat Sink-RED path conditions met.

AND

Heat sink is required.

Definition(s):

None

Basis:

In combination with FC Potential Loss B.2, meeting this threshold results in a Site Area Emergency.

Critical Safety Function Status Tree (CSFST) Heat Sink-RED path indicates the heat sink function is under extreme challenge and that some fuel clad damage may potentially occur (ref. 1).

The CSFSTs are normally monitored using the SPDS display on the Plant Computer (ref. 1).

The phrase "and heat sink required" precludes the need for classification for conditions in which RCS pressure is less than SG pressure or Heat Sink-RED path entry was created through operator action directed by an EOP. For example, FR-H.1 is entered from CSFST Heat Sink-Red. Step 1 tells the operator to determine if heat sink is required by checking that RCS pressure is greater than any non-faulted SG pressure and either RCS temperature is greater than 350°F or RCS pressure is greater than 360 psig. If these conditions exist, Heat Sink is required. Otherwise, the operator is to either return to the procedure and step in effect and place RHR in service for heat removal. For large LOCA events inside the Containment, the SGs are moot because heat removal through the containment heat removal systems takes place. Therefore, Heat Sink Red should not be required and, should not be assessed for EAL classification because a LOCA event alone should not require higher than an Alert classification. (ref. 2).

This condition indicates an extreme challenge to the ability to remove RCS heat using the steam generators (i.e., loss of an effective secondary-side heat sink). This condition represents a potential loss of the RCS Barrier. In accordance with EOPs, there may be unusual accident conditions during which operators intentionally reduce the heat removal capability of the steam generators; during these conditions, classification using threshold is not warranted.

Meeting this threshold results in a Site Area Emergency because this threshold is identical to Fuel Clad Barrier Potential Loss threshold B.2; both will be met. This condition warrants a Site Area Emergency declaration because inadequate RCS heat removal may result in fuel heat-up sufficient to damage the cladding and increase RCS pressure to the point where mass will be lost from the system.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases

Callaway Basis Reference(s):

1. CSF-1, Critical Safety Function Status Trees Figure 3 Heat Sink
2. FR-H.1, Response to Loss of Secondary Heat Sink
3. NEI 99-01, Inadequate Heat Removal RCS Loss 2.B

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases**

Barrier: Reactor Coolant System
Category: C. CMT Radiation/ RCS Activity
Degradation Threat: Loss

Threshold:

1. Containment radiation > 59 R/hr on GT-RE-59 (591) or GT-RE-60 (601).

Definition(s)

None

Basis:

Containment radiation monitor readings greater than 59 R/hr (ref. 1) indicate the release of reactor coolant to the Containment. The readings assume the instantaneous release and dispersal of the reactor coolant noble gas and iodine inventory associated with normal operating concentrations (i.e., within Technical Specifications) into the Containment atmosphere. Because of the very high fuel clad integrity, only small amounts of noble gases would be dissolved in the primary coolant.

Monitors used for this fission product barrier loss threshold are the Containment High Range Radiation Monitors GT-RE-59 (Panel RM-11 channel 591) and GT-RE-60 (Panel RM-11 channel 601). The threshold value of 59 R/hr is the HI (YELLOW) alarm setpoint (ref. 2).

The radiation monitor reading corresponds to an instantaneous release of all reactor coolant mass into the containment, assuming that reactor coolant activity equals Technical Specification allowable limits. This value is lower than that specified for Fuel Clad Barrier Loss threshold C.1 since it indicates a loss of the RCS Barrier only.

There is no Potential Loss threshold associated with RCS Activity / Containment Radiation.

Callaway Basis Reference(s):

1. EPCI-1701
2. OTA-SP-RM011, Radiation Monitor Control Panel RM-11
3. NEI 99-01, CMT Radiation / RCS Activity RCS Loss 3.A

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases**

Barrier: Reactor Coolant System
Category: C. CMT Radiation/ RCS Activity
Degradation Threat: Potential Loss
Threshold:

None.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases**

Barrier: Reactor Coolant System
Category: D. CMT Integrity or Bypass
Degradation Threat: Loss

Threshold:

None.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases**

Barrier: Reactor Coolant System
Category: D. CMT Integrity or Bypass
Degradation Threat: Potential Loss
Threshold:

None.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases**

Barrier: Reactor Coolant System
Category: E. Emergency Coordinator Judgment
Degradation Threat: Loss

Threshold:

1. **Any** condition in the opinion of the Emergency Coordinator that indicates loss of the RCS barrier.

Definition(s):

None

Basis:

The Emergency Coordinator judgment threshold addresses any other factors relevant to determining if the RCS barrier is lost. Such a determination should include imminent barrier degradation, barrier monitoring capability and dominant accident sequences.

- Imminent barrier degradation exists if the degradation will likely occur within relatively short period of time based on a projection of current safety system performance. The term “imminent” refers to recognition of the inability to reach safety acceptance criteria before completion of all checks.
- Barrier monitoring capability is decreased if there is a loss or lack of reliable indicators. This assessment should include instrumentation operability concerns, readings from portable instrumentation and consideration of offsite monitoring results.
- Dominant accident sequences lead to degradation of all fission product barriers and likely entry to the EOPs. The Emergency Coordinator should be mindful of the Loss of AC power (Station Blackout) and ATWS EALs to assure timely emergency classification declarations.

This threshold addresses any other factors that may be used by the Emergency Coordinator in determining whether the RCS Barrier is lost.

Callaway Basis Reference(s):

1. NEI 99-01, Emergency Director Judgment RCS Loss 6.A

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases**

Barrier: Reactor Coolant System

Category: E. Emergency Coordinator Judgment

Degradation Threat: Potential Loss

Threshold:

1. **Any** condition in the opinion of the Emergency Coordinator that indicates potential loss of the RCS barrier.

Definition(s):

None

Basis:

The Emergency Coordinator judgment threshold addresses any other factors relevant to determining if the RCS barrier is potentially lost. Such a determination should include imminent barrier degradation, barrier monitoring capability and dominant accident sequences.

- Imminent barrier degradation exists if the degradation will likely occur within relatively short period of time based on a projection of current safety system performance. The term “imminent” refers to recognition of the inability to reach safety acceptance criteria before completion of all checks.
- Barrier monitoring capability is decreased if there is a loss or lack of reliable indicators. This assessment should include instrumentation operability concerns, readings from portable instrumentation and consideration of offsite monitoring results.
- Dominant accident sequences lead to degradation of all fission product barriers and likely entry to the EOPs. The Emergency Coordinator should be mindful of the Loss of AC power (Station Blackout) and ATWS EALs to assure timely emergency classification declarations.

This threshold addresses any other factors that may be used by the Emergency Coordinator in determining whether the RCS Barrier is potentially lost. The Emergency Coordinator should also consider whether or not to declare the barrier potentially lost in the event that barrier status cannot be monitored.

Callaway Basis Reference(s):

1. NEI 99-01, Emergency Director Judgment RCS Potential Loss 6.A

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases**

Barrier: Containment
Category: A. RCS or SG Tube Leakage
Degradation Threat: Loss

Threshold:

1. A leaking or RUPTURED SG is FAULTED outside of containment.

Definition(s):

FAULTED - The term applied to a steam generator that has a steam leak on the secondary side of sufficient size to cause an uncontrolled drop in steam generator pressure or the steam generator to become completely depressurized.

RUPTURED - The condition of a steam generator in which primary-to-secondary leakage is of sufficient magnitude to require a safety injection.

Basis:

This threshold addresses a leaking or RUPTURED Steam Generator (SG) that is also FAULTED outside of containment. The condition of the SG, whether leaking or RUPTURED, is determined in accordance with the thresholds for RCS Barrier Potential Loss A.1 and Loss A.1, respectively. This condition represents a bypass of the containment barrier.

FAULTED is a defined term within the NEI 99-01 methodology; this determination is not necessarily dependent upon entry into, or diagnostic steps within, an EOP. For example, if the pressure in a steam generator is decreasing uncontrollably (part of the FAULTED definition) and the FAULTED steam generator isolation procedure is not entered because EOP user rules are dictating implementation of another procedure to address a higher priority condition, the steam generator is still considered FAULTED for emergency classification purposes.

The FAULTED criterion establishes an appropriate lower bound on the size of a steam release that may require an emergency classification. Steam releases of this size are readily observable with normal Control Room indications. The lower bound for this aspect of the containment barrier is analogous to the lower bound criteria specified in IC SU4 for the fuel clad barrier (i.e., RCS activity values) and IC SU5 for the RCS barrier (i.e., RCS leak rate values).

This threshold also applies to prolonged steam releases necessitated by operational considerations such as the forced steaming of a leaking or RUPTURED steam generator directly to atmosphere to cooldown the plant, or to drive an auxiliary (emergency) feedwater pump. These types of conditions will result in a significant and sustained release of radioactive steam to the environment (and are thus similar to a FAULTED condition). If the TDAFP is running and being supplied by a ruptured steam generator that has not been isolated, this threshold is met. Manual Operator action can NOT be credited.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases**

Steam releases associated with the expected operation of a Steam Generator Atmospheric Steam Dump or Main Steam Safety Valve do not meet the intent of this threshold. Such releases may occur intermittently for a short period of time following a reactor trip as operators process through emergency operating procedures to bring the plant to a stable condition and prepare to initiate a plant cooldown. Steam releases associated with the unexpected operation of a valve (e.g., a stuck-open safety valve) do meet this threshold.

Following an SG tube leak or rupture, there may be minor radiological releases through a secondary-side system component (e.g., air ejectors, glad seal exhausters, valve packing, etc.). These types of releases do not constitute a loss or potential loss of containment but should be evaluated using the Recognition Category R ICs.

The ECLs resulting from primary-to-secondary leakage, with or without a steam release from the FAULTED SG, are summarized below.

P-to-S Leak Rate	Affected SG is FAULTED Outside of Containment?	
	Yes	No
Less than or equal to 25 gpm	No classification	No classification
Greater than 25 gpm	Unusual Event per SU5.1	Unusual Event per SU5.1
Requires operation of a standby charging (makeup) pump (<i>RCS Barrier Potential Loss</i>)	Site Area Emergency per FS1.1	Alert per FA1.1
Requires an automatic or manual ECCS (SI) actuation (<i>RCS Barrier Loss</i>)	Site Area Emergency per FS1.1	Alert per FA1.1

There is no Potential Loss threshold associated with RCS or SG Tube Leakage.

Callaway Basis Reference(s):

1. E-2, Faulted Steam Generator Isolation
2. E-3, Steam Generator Tube Rupture
3. NEI 99-01, RCS or SG Tube Leakage Containment Loss 1.A

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases**

Barrier: Containment
Category: A. RCS or SG Tube Leakage
Degradation Threat: Potential Loss
Threshold:

None.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases****Barrier:** Containment**Category:** B. Inadequate Heat Removal**Degradation Threat:** Loss**Threshold:**

None.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases

Barrier: Containment
Category: B. Inadequate Heat Removal
Degradation Threat: Potential Loss

Threshold:

1. CSFST Core Cooling-RED path conditions met.
AND
Restoration procedures **not** effective within 15 min.
(Note 1)

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

Definition(s):

None

Basis:

Critical Safety Function Status Tree (CSFST) Core Cooling-RED path indicates significant core exit superheating and core uncover. The CSFSTs are normally monitored using the SPDS display on the Plant Computer (ref. 1).

The function restoration procedures are those emergency operating procedures that address the recovery of the core cooling critical safety functions. The procedure is considered effective if the temperature is decreasing or if the vessel water level is increasing (ref. 1, 2, 3).

A direct correlation to status trees can be made if the effectiveness of the restoration procedures is also evaluated. If core exit thermocouple (TC) readings are greater than 1,200°F (ref. 1), Fuel Clad barrier is also lost.

This threshold addresses any other factors that may be used by the Emergency Coordinator in determining whether the RCS Barrier is potentially lost. The Emergency Director should also consider whether or not to declare the barrier potentially lost in the event that barrier status cannot be monitored.

Callaway Basis Reference(s):

1. CSF-1, Critical Safety Function Status Trees Figure 2 Core Cooling
2. FR-C.1, Response to Inadequate Core Cooling
3. FR-C.2, Response to Degraded Core Cooling
4. NEI 99-01, Inadequate Heat Removal Containment Potential Loss 2.A

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases

Barrier: Containment
Category: C. CMT Radiation/RCS Activity
Degradation Threat: Loss

Threshold:

None.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases**

Barrier: Containment
Category: C. CMT Radiation/RCS Activity
Degradation Threat: Potential Loss

Threshold:

1. Containment radiation > 14,000 R/hr on GT-RE-59 (591) or GT-RE-60 (601).

Definition(s):

None

Basis:

Containment radiation monitor readings greater than 14,000 R/hr (ref. 1) indicate significant fuel damage well in excess of that required for loss of the RCS barrier and the Fuel Clad barrier.

The readings are higher than that specified for Fuel Clad barrier Loss C.1 and RCS barrier Loss C.1. Containment radiation readings at or above the Containment barrier Potential Loss threshold, therefore, signify a loss of two fission product barriers and Potential Loss of a third, indicating the need to upgrade the emergency classification to a General Emergency.

Monitors used for this fission product barrier loss threshold are the Containment High Range Radiation Monitors GT-RE-59 (Panel RM-11 channel 591) and GT-RE-60 (Panel RM-11 channel 601) (ref. 2).

The radiation monitor reading corresponds to an instantaneous release of all reactor coolant mass into the containment, assuming that 20% of the fuel cladding has failed. This level of fuel clad failure is well above that used to determine the analogous Fuel Clad Barrier Loss and RCS Barrier Loss thresholds.

NUREG-1228, Source Estimations During Incident Response to Severe Nuclear Power Plant Accidents, indicates the fuel clad failure must be greater than approximately 20% in order for there to be a major release of radioactivity requiring offsite protective actions. For this condition to exist, there must already have been a loss of the RCS Barrier and the Fuel Clad Barrier. It is therefore prudent to treat this condition as a potential loss of containment which would then escalate the ECL to a General Emergency.

Callaway Basis Reference(s):

1. EPCI-1701
2. OTA-SP-RM011, Radiation Monitor Control Panel RM-11
3. NEI 99-01, CMT Radiation / RCS Activity Containment Potential Loss 3.A

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases**

Barrier: Containment
Category: D. CMT Integrity or Bypass
Degradation Threat: Loss

Threshold:

1. Containment isolation is required.

AND EITHER:

- Containment integrity has been lost based on Emergency Coordinator judgment.
- UNISOLABLE pathway from containment to the environment exists.

Definition(s):

UNISOLABLE - An open or breached system line that cannot be isolated, remotely or locally.

Basis:

These thresholds address a situation where containment isolation is required and one of two conditions exists as discussed below. Users are reminded that there may be accident and release conditions that simultaneously meet both bulleted thresholds.

First Threshold – Containment integrity has been lost, i.e., the actual containment atmospheric leak rate likely exceeds that associated with allowable leakage (or sometimes referred to as design leakage). Following the release of RCS mass into containment, containment pressure will fluctuate based on a variety of factors; a loss of containment integrity condition may (or may not) be accompanied by a noticeable drop in containment pressure. Recognizing the inherent difficulties in determining a containment leak rate during accident conditions, it is expected that the Emergency Coordinator will assess this threshold using judgment, and with due consideration given to current plant conditions, and available operational and radiological data (e.g., containment pressure, readings on radiation monitors outside containment, operating status of containment pressure control equipment, etc.).

Refer to the middle piping run of Figure 1. Two simplified examples are provided. One is leakage from a penetration and the other is leakage from an in-service system valve. Depending upon radiation monitor locations and sensitivities, the leakage could be detected by any of the four monitors depicted in the figure.

Another example would be a loss or potential loss of the RCS barrier, and the simultaneous occurrence of two FAULTED locations on a steam generator where one fault is located inside containment (e.g., on a steam or feedwater line) and the other outside of containment. In this case, the associated steam line provides a pathway for the containment atmosphere to escape to an area outside the containment.

Following the leakage of RCS mass into containment and a rise in containment pressure, there may be minor radiological releases associated with allowable (design) containment leakage through various penetrations or system components. These releases do not constitute a loss or potential loss of containment but should be evaluated using the Recognition Category R ICs.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases**

Second Threshold – Conditions are such that there is an UNISOLABLE pathway for the migration of radioactive material from the containment atmosphere to the environment. As used here, the term “environment” includes the atmosphere of a room or area, outside the containment, that may, in turn, communicate with the outside-the-plant atmosphere (e.g., through discharge of a ventilation system or atmospheric leakage). Depending upon a variety of factors, this condition may or may not be accompanied by a noticeable drop in containment pressure.

Refer to the top piping run of Figure 1. In this simplified example, the inboard and outboard isolation valves remained open after a containment isolation was required (i.e., containment isolation was not successful). There is now an UNISOLABLE pathway from the containment to the environment.

The existence of a filter is not considered in the threshold assessment. Filters do not remove fission product noble gases. In addition, a filter could become ineffective due to iodine and/or particulate loading beyond design limits (i.e., retention ability has been exceeded) or water saturation from steam/high humidity in the release stream.

Leakage between two interfacing liquid systems, by itself, does not meet this threshold.

Refer to the bottom piping run of Figure 1. In this simplified example, leakage in an RCP seal cooler is allowing radioactive material to enter the Auxiliary Building. The radioactivity would be detected by the Process Monitor. If there is no leakage from the closed water cooling system to the Auxiliary Building, then no threshold has been met. If the pump developed a leak that allowed steam/water to enter the Auxiliary Building, then second threshold would be met. Depending upon radiation monitor locations and sensitivities, this leakage could be detected by any of the four monitors depicted in the figure and cause the first threshold to be met as well.

Following the leakage of RCS mass into containment and a rise in containment pressure, there may be minor radiological releases associated with allowable containment leakage through various penetrations or system components. Minor releases may also occur if a containment isolation valve(s) fails to close but the containment atmosphere escapes to an enclosed system. These releases do not constitute a loss or potential loss of containment but should be evaluated using the Recognition Category R ICs.

The status of the containment barrier during an event involving steam generator tube leakage is assessed using Loss Threshold A.1.

Callaway Basis Reference(s):

1. NEI 99-01, CMT Integrity or Bypass Containment Loss 4.A

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases****Barrier:** Containment**Category:** D. CMT Integrity or Bypass**Degradation Threat:** Loss**Threshold:**

2. Indications of RCS leakage outside of containment.

Definition(s):

None

Basis:

ECA-1.2 LOCA Outside Containment (ref. 1) provides instructions to identify and isolate a LOCA outside of the containment. Potential RCS leak pathways outside containment include (ref. 1, 2):

- Residual Heat Removal
- Safety Injection
- Chemical & Volume Control
- RCP seals
- PZR/RCS Loop sample lines

Containment sump, temperature, pressure and/or radiation levels will increase if reactor coolant mass is leaking into the containment. If these parameters have not increased, then the reactor coolant mass may be leaking outside of containment (i.e., a containment bypass sequence). Increases in sump, temperature, pressure, flow and/or radiation level readings outside of the containment may indicate that the RCS mass is being lost outside of containment.

Unexpected elevated readings and alarms on radiation monitors with detectors outside containment should be corroborated with other available indications to confirm that the source is a loss of RCS mass outside of containment. If the fuel clad barrier has not been lost, radiation monitor readings outside of containment may not increase significantly; however, other unexpected changes in sump levels, area temperatures or pressures, flow rates, etc. should be sufficient to determine if RCS mass is being lost outside of the containment.

The **sum** of the leakage rates of less than or equal to 1 gpm are acceptable outside of containment per Technical Specification. These systems include the recirculation portion of the Containment Spray, Safety Injection, Chemical and Volume Control, and Residual Heat Removal.

Refer to the middle piping run of Figure 1. In this simplified example, a leak has occurred at a reducer on a pipe carrying reactor coolant in the Auxiliary Building. Depending upon radiation monitor locations and sensitivities, the leakage could be detected by any of the four monitors depicted in the figure and cause threshold D.1 to be met as well.


To ensure proper escalation of the emergency classification, the RCS leakage outside of containment must be related to the mass loss that is causing the RCS Loss and/or Potential Loss threshold A.1 to be met.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases****Callaway Basis Reference(s):**

1. ECA-1.2, LOCA Outside Containment
2. E-1, Loss of Reactor or Secondary Coolant
3. NEI 99-01, CMT Integrity or Bypass Containment Loss
4. ESP-ZZ-00356, Technical Specification 5.5.2.B Verification Integrated Leak Rate Requirements for Primary Coolant Sources Outside Containment.
5. Technical Specification 5.5.2.B

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases

Figure 1: Containment Integrity or Bypass Examples

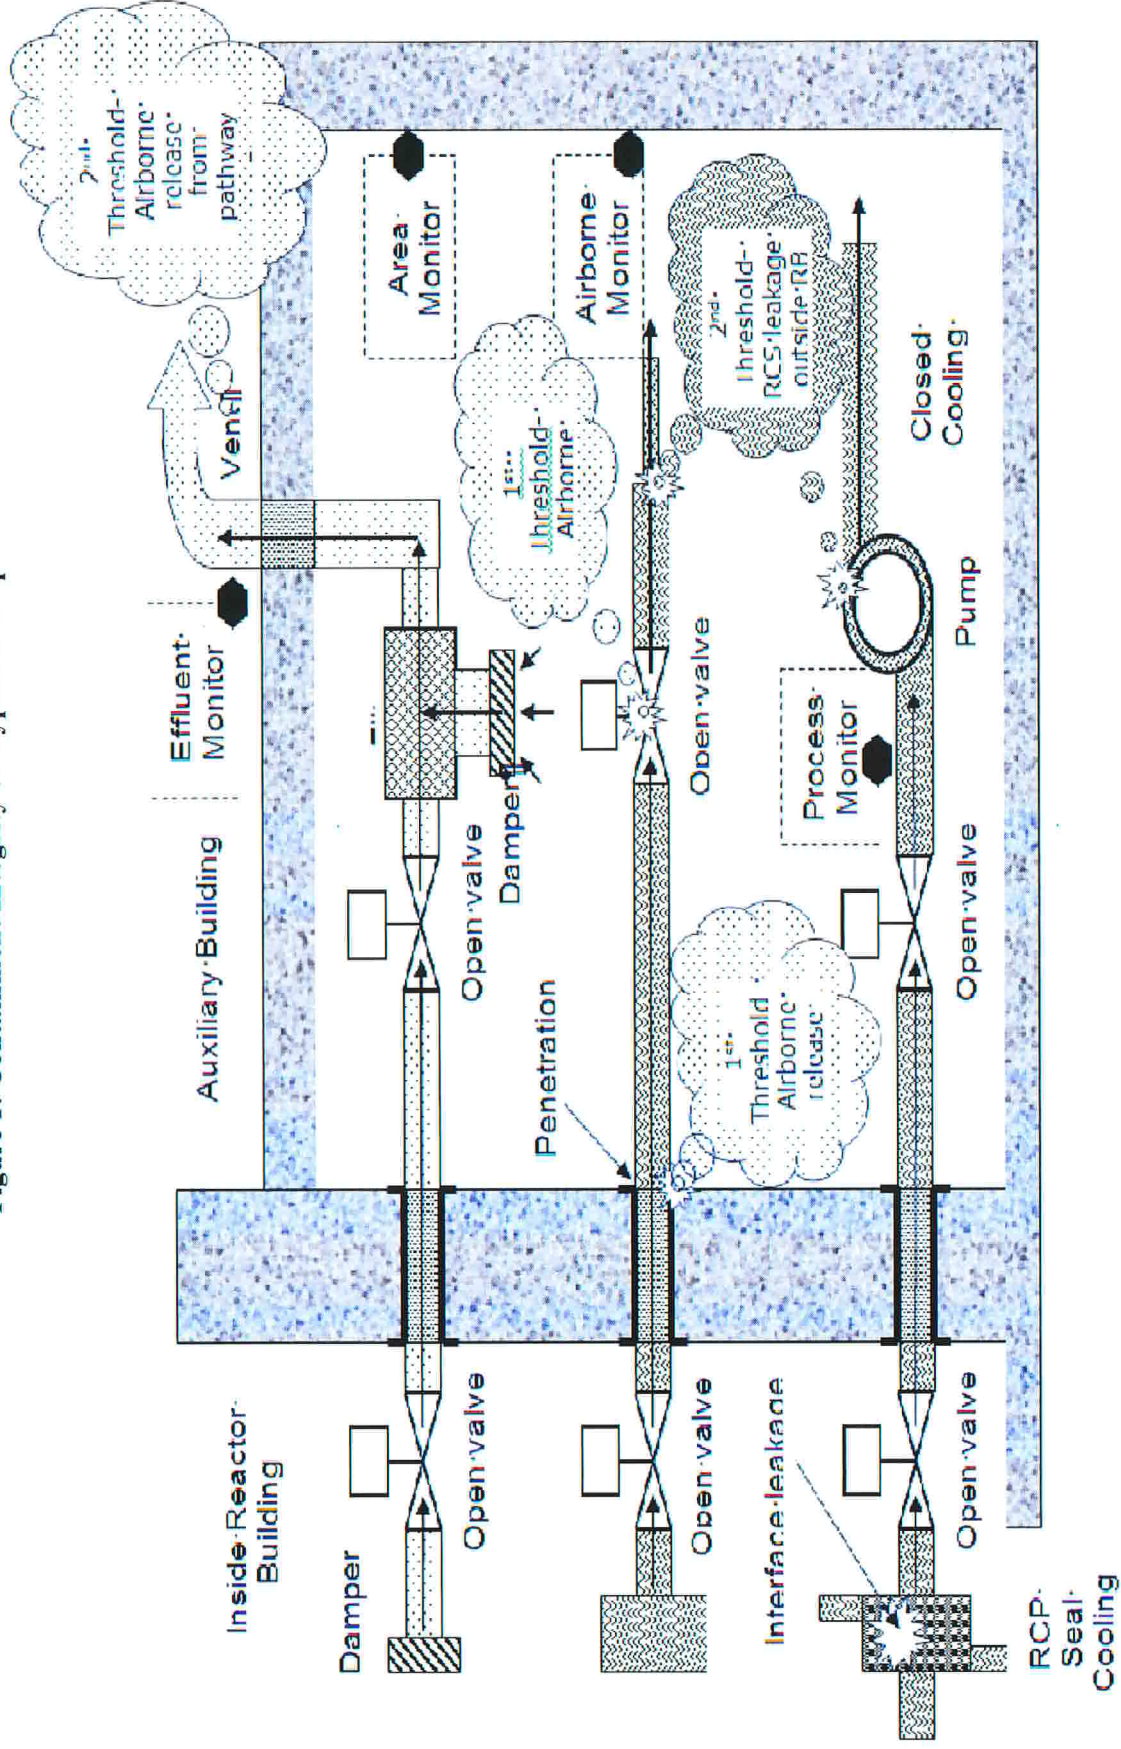

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases

Barrier: Containment
Category: D. CMT Integrity or Bypass
Degradation Threat: Potential Loss

Threshold:

1. CSFST Containment-RED path conditions met.

Definition(s):

None

Basis:

Critical Safety Function Status Tree (CSFST) Containment-RED path is entered if containment pressure is greater than or equal to 48 psig and represents an extreme challenge to safety function. The CSFSTs are normally monitored using the SPDS display on the Plant Computer (ref. 1).

48 psig is the containment pressure that is expected to occur following a design basis Loss of Coolant Accident (LOCA) (ref. 2) and is the pressure used to define CSFST Containment Red Path conditions.

If containment pressure exceeds the pressure that is expected to occur following a design basis Loss of Coolant Accident (LOCA), there exists a potential to lose the Containment Barrier. To reach this level, there must be an inadequate core cooling condition for an extended period of time; therefore, the RCS and Fuel Clad barriers would already be lost. Thus, this threshold is a discriminator between a Site Area Emergency and General Emergency since there is now a potential to lose the third barrier.

Callaway Basis Reference(s):

1. CSF-1, Critical Safety Function Status Trees Containment Figure 5
2. Calc No. 392.2 XX-95, Callaway Containment Parameters EOP Action Values, Setpoint ID T.03
3. NEI 99-01, CMT Integrity or Bypass Containment Potential Loss 4.A

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases

Barrier: Containment
Category: D. CMT Integrity or Bypass
Degradation Threat: Potential Loss

Threshold:

2. Containment hydrogen concentration $\geq 4\%$.

Definition(s):

None

Basis:

Following a design basis accident, hydrogen gas may be generated inside the containment by reactions such as zirconium metal with water, corrosion of materials of construction and radiolysis of aqueous solution in the core and sump. (ref. 1).

Callaway is equipped with a Hydrogen Control System (HCS) which serves to limit or reduce combustible gas concentrations in the Containment. The HCS is an engineered safety feature with redundant hydrogen recombiners, hydrogen mixing system, hydrogen monitoring subsystem, and a backup hydrogen purge subsystem. The HCS is designed to maintain the Containment hydrogen concentration below 4% by volume (ref. 1).

HCS operation is prescribed by EOPs if Containment hydrogen concentration should reach 0.5% by volume (ref. 4). If the Potential Loss threshold is reached or exceeded, the primary means of controlling Containment hydrogen concentration must have failed to perform its design function or has otherwise been inadequate in mitigating the hydrogen generation rate. For either case, continued hydrogen production may yield a flammable hydrogen concentration and a consequent threat to Containment integrity.

To generate such levels of combustible gas, loss of the Fuel Clad and RCS barriers must have occurred. With the Potential Loss of the containment barrier, the threshold hydrogen concentration, therefore, will likely warrant declaration of a General Emergency.

Two Containment hydrogen monitors (GS AI-10 and GS AI-19) with a range of 0% to 10% provide indication on Control Room Panel RL020 and ERFIS (ref. 3). The hydrogen monitors require a 2 hour warmup period when starting from the OFF position and 15 minutes when starting from STANDBY (ref. 4, 5). If an actual hydrogen concentration measurement is unavailable, CA-3 (ref. 6) may be used to estimate the Containment atmosphere hydrogen concentration.

The existence of an explosive mixture means, at a minimum, that the containment atmospheric hydrogen concentration is sufficient to support a hydrogen burn (i.e., at the lower deflagration limit). A hydrogen burn will raise containment pressure and could result in collateral equipment damage leading to a loss of containment integrity. It therefore represents a potential loss of the Containment Barrier.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases****Callaway Basis Reference(s):**

1. FSAR, Section 6.2 Containment Systems
2. FR-Z.4, Response to High Containment Hydrogen Concentration
3. FSAR, Table 7A-3 (Sheet 32 Data Sheet 6.4)
4. OTN-GS-00001, Containment Hydrogen Control System
5. Calc No. 392.2 XX-95, Callaway Containment Parameters EOP Action Values, Setpoint ID T101 & T102
6. CA-3, Hydrogen Flammability in Containment
7. NEI 99-01, CMT Integrity or Bypass Containment Potential Loss 4.B

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases**

Barrier: Containment

Category: D. CMT Integrity or Bypass

Degradation Threat: Potential Loss

Threshold:

3. Containment pressure > 27 psig with < one full train of containment depressurization equipment operating per design for ≥ 15 min.
(Notes 1, 9)

Note 1: The Emergency Coordinator should declare the event promptly upon determining that time limit has been exceeded, or will likely be exceeded.

Note 9: One Containment Spray System train and one Containment Cooling System train comprise one full train of depressurization equipment.

Definition(s):

None

Basis:

The Containment Spray System consists of two separate trains of equal capacity, each capable of meeting the design bases requirement. Each train includes a containment spray pump, spray headers, nozzles, valves, and piping. The refueling water storage tank (RWST) supplies borated water to the Containment Spray System during the injection phase of operation. In the recirculation MODE of operation, Containment Spray pump suction is transferred from the RWST to the Containment sumps (ref. 2).

The Containment Cooling System consists of two trains of Containment cooling, each of sufficient capacity to supply 100% of the design cooling requirement. Each train of two fan units is supplied with cooling water from a separate train of essential service water (ESW). Air is drawn into the coolers through the fan and discharged to the steam generator compartments, pressurizer compartment, and instrument tunnel, and outside the secondary shield in the lower areas of containment. During normal operation, all four fan units may be operating. In post-accident operation following an actuation signal, the Containment Cooling System fans are designed to start automatically in slow speed if not already running (ref. 3).

The Containment pressure setpoint (27 psig, ref. 4, 5, 6) is the pressure at which the equipment should actuate and begin performing its function. The design basis accident analyses and evaluations assume the loss of one Containment Spray System train and one Containment Cooling System train (ref. 7). Consistent with the design requirement, "one full train of depressurization equipment" is therefore defined to be the availability of one train of each system. If less than this equipment is operating and Containment pressure is above the actuation setpoint, the threshold is met.

This threshold describes a condition where containment pressure is greater than the setpoint at which containment energy (heat) removal systems are designed to automatically actuate, and less than one full train of equipment is capable of operating per design. The 15-minute criterion is included to allow operators time to manually start equipment that may not have automatically started, if possible. This threshold represents a potential loss of containment in that containment heat removal/depressurization systems (e.g., containment sprays, ice condenser fans, etc., but not including containment venting strategies) are either lost or performing in a degraded manner.

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases****Callaway Basis Reference(s):**

1. FSAR, Section 6.2.2
2. FSAR, Section 6.2.2.1.2.1
3. FSAR, Section 6.2.2.2.2
4. CSF-1, Critical Safety Function Status Trees (CSFST) Figure 5, Containment
5. FR-Z.1, Response to High Containment Pressure
6. Technical Specifications, Table 3.3.2-1
7. Technical Specifications, B3.6.6
8. NEI 99-01, CMT Integrity or Bypass Containment Potential Loss 4.C

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT

Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases

Barrier: Containment
Category: E. Emergency Coordinator Judgment
Degradation Threat: Loss

Threshold:

1. **Any** condition in the opinion of the Emergency Coordinator that indicates loss of the Containment barrier.

Definition(s):

None

Basis:

The Emergency Coordinator judgment threshold addresses any other factors relevant to determining if the Primary Containment barrier is lost. Such a determination should include imminent barrier degradation, barrier monitoring capability and dominant accident sequences.

- Imminent barrier degradation exists if the degradation will likely occur within relatively short period of time based on a projection of current safety system performance. The term “imminent” refers to recognition of the inability to reach safety acceptance criteria before completion of all checks.
- Barrier monitoring capability is decreased if there is a loss or lack of reliable indicators. This assessment should include instrumentation operability concerns, readings from portable instrumentation and consideration of offsite monitoring results.
- Dominant accident sequences lead to degradation of all fission product barriers and likely entry to the EOPs. The Emergency Coordinator should be mindful of the Loss of AC power (Station Blackout) and ATWS EALs to assure timely emergency classification declarations.

This threshold addresses any other factors that may be used by the Emergency Coordinator in determining whether the Containment Barrier is lost.

Callaway Basis Reference(s):

1. NEI 99-01, Emergency Director Judgment PC Loss 6.A

EMERGENCY ACTION LEVEL TECHNICAL BASES DOCUMENT**Attachment 2 - Fission Product Barrier Loss/Potential Loss Matrix and Bases****Barrier:** Containment**Category:** E. Emergency Coordinator Judgment**Degradation Threat:** Potential Loss**Threshold:**

1. **Any** condition in the opinion of the Emergency Coordinator that indicates potential loss of the Containment barrier.

Definition(s):

None

Basis:

The Emergency Coordinator judgment threshold addresses any other factors relevant to determining if the Primary Containment barrier is potentially lost. Such a determination should include imminent barrier degradation, barrier monitoring capability and dominant accident sequences.

- Imminent barrier degradation exists if the degradation will likely occur within relatively short period of time based on a projection of current safety system performance. The term “imminent” refers to recognition of the inability to reach safety acceptance criteria before completion of all checks.
- Barrier monitoring capability is decreased if there is a loss or lack of reliable indicators. This assessment should include instrumentation operability concerns, readings from portable instrumentation and consideration of offsite monitoring results.
- Dominant accident sequences lead to degradation of all fission product barriers and likely entry to the EOPs. The Emergency Coordinator should be mindful of the Loss of AC power (Station Blackout) and ATWS EALs to assure timely emergency classification declarations.

This threshold addresses any other factors that may be used by the Emergency Coordinator in determining whether the Containment Barrier is lost.

Callaway Basis Reference(s):

1. NEI 99-01, Emergency Director Judgment PC Potential Loss 6.A

Attachment 4 to ULNRC-06433

EIP-ZZ-00101 Addendum 1,
"Emergency Action Level Classification Matrix,"
Proposed Revision 009
(Clean Copy – Information Only)

(8 pages)



Callaway
Energy Center

EIP-ZZ-00101 ADDENDUM 1

EMERGENCY ACTION LEVEL CLASSIFICATION MATRIX

MAJOR Revision 009

EMERGENCY ACTION LEVEL CLASSIFICATION MATRIX

TABLE OF CONTENTS

Section	Page Number
1.0 PURPOSE	3
2.0 SCOPE	3
3.0 PROCEDURE INSTRUCTIONS	3
4.0 REFERENCES.....	7
4.1. Implementing	7
4.2. Developmental	7
5.0 RECORDS	7
6.0 SUMMARY OF CHANGES	8

EMERGENCY ACTION LEVEL CLASSIFICATION MATRIX

1.0 PURPOSE

Provide a method of consistently and accurately classifying Emergency Action Levels (EAL).

2.0 SCOPE

Covers EALs at the Callaway Nuclear Power Plant.

3.0 PROCEDURE INSTRUCTIONS

This document is a copy of the actual EAL Classification Matrix wall charts posted in required areas. The wall charts are designed for Hot Conditions ($RCS > 200^{\circ}\text{F}$) and Cold Conditions ($RCS \leq 200^{\circ}\text{F}$) with the left side of both charts identical for ease of use, as the left side covers All Conditions. The following pages of this document will break the wall chart in to 3 sections for ease of reading within the constraints of a procedure type document. During an Emergency, the actual wall charts should be used.

GENERAL EMERGENCY		SITE AREA EMERGENCY		ALERT	UNUSUAL EVENT
1 Loss of Emergency AC Power	Loss of all offsite and all onsite AC power to emergency buses SG1.1 (Base Pg. 151) 1 2 3 4 AND EITHER • Restoration of at least one emergency bus in 4 hours is not likely (Note 1) • CSPST Core Cooling RED Path conditions met	Loss of all offsite and all onsite AC power to emergency buses for 15 minutes or longer SS1.1 (Base Pg. 155) 1 2 3 4 Loss of all offsite and all onsite AC power to emergency A 15KV buses N801 and N802 for 15 min. (Note 5)	Loss of all full and one AC power to emergency buses for 15 minutes or longer SA1.1 (Base Pg. 162) 1 2 3 4 AC power capacity, Table S-1 to emergency A 15KV buses N801 and N802 is available for a single power source for 15 min. (Note 1) AND Any additional single power source failure will result in loss of all AC power to SAFETY SYSTEMS.	Loss of all offsite AC power capacity to emergency buses for 15 minutes or longer US1.1 (Base Pg. 163) 1 2 3 4 Loss of all offsite AC power capacity, Table S-1 to emergency A 15KV buses N801 and N802 for 15 min. (Note 1)	
	2 Loss of VAVDC Power	Loss of all AC and all DC power to emergency buses for 15 minutes or longer SG1.2 (Base Pg. 152) 1 2 3 4 AND Loss of all 120 VDC power based on battery bus voltage indications < 107 VDC on all DC buses N401, N402 (Division 1) and N402, N404 (Division 2) for 15 min.	Loss of all site DC power for 15 minutes or longer SS2.1 (Base Pg. 162) 1 2 3 4 Loss of all 120 VDC power based on battery bus voltage indications < 107 VDC on all site DC buses N401, N402 (Division 1) and N402, N404 (Division 2) for 15 min. (Note 5)	UNPLANNED loss of Control Room indications for 15 minutes or longer with a significant transient in progress SA1.1 (Base Pg. 163) 1 2 3 4 An UNPLANNED event results in the inability to monitor one or more Table S-2 parameters from within the Control Room for 15 min. (Note 5) AND Any significant transient in progress, Table S-1	UNPLANNED loss of Control Room indications for 15 minutes or longer US1.1 (Base Pg. 164) 1 2 3 4 An UNPLANNED event results in the inability to monitor one or more Table S-2 parameters from within the Control Room for 15 min. (Note 5)
3 Loss of Control Room Indications	Table S-1 AC Power Supplies Offsite: • Salparks XFMR A or B via EOP LTC XFMR N4001 • Marquardt XFMR A or B via EOP LTC XFMR N4002 • Main XFMR N4003 (unavailable) via EOP LTC XFMR N4002 • Onsite: • Alternate Emergency Power Supply (inadvertent or standby alignment) Onsite: • EDG N201 • EDG N202				
4 RCS Activity	Table S-2 Safety System Parameters • Reactor power • RCS level • RCS pressure • Core Exit Temperature • Leakage at least one SSG • Availability of emergency trip/slow down at least one SSG				
5 RCS Leakage	Table S-3 Significant Transients (phenomena or normal power) • Reactor trip • Reactor > 25% thermal power • Electrical load reaction > 25% reactor load • EDG exclusion	Ability to shut down the reactor causing a challenge to core cooling or RCS heat removal SS1.1 (Base Pg. 178) 1 2 3 4 An automatic or manual trip fails to shut down the reactor as indicated by reactor power < 5% AND All actions to shut down the reactor are not successful as indicated by reactor power < 5% AND EITHER • CSPST Core Cooling RED Path conditions met • CSPST Heat Sink RED Path conditions met	Automatic manual trip fails to shut down the reactor and subsequent manual actions based on the reactor control console are not successful in shutting down the reactor SA1.1 (Base Pg. 177) 1 2 3 4 An automatic or manual trip fails to shut down the reactor as indicated by reactor power < 5% AND Manual trip actions taken at the reactor control console (SS-HS-1 or SS-HS-2) are not successful in shutting down the reactor as indicated by reactor power < 5% (Note 8)	Automatic manual trip fails to shut down the reactor US1.1 (Base Pg. 176) 1 2 3 4 An automatic trip fails to shut down the reactor as indicated by reactor power < 5% after any manual trip action is initiated. AND A subsequent automatic trip or manual trip action taken at the reactor control console (SS-HS-1 or SS-HS-2) is successful in shutting down the reactor as indicated by reactor power < 5% (Note 8)	
S System Malfunction	Table S-4 Communications Methods System Onsite GRID NRC Generator X Plant Radio X Plant Emergency Distorted Phone X Plant Telephone System X X X END (Red Phone) Line X X Back-Up Radio System X Emergency Notification System X				
6 RTS Failure	Table S-5 Hazardous Events • EXPLOSION • FIRE • HIGH VAVDC or female wire • Internal or external FLOODING event • Seismic event earthquake • Other events with similar nuclear characteristics as determined by the Emergency Coordinator	Notes Note 1: The Emergency Coordinator should declare the event priority upon determining that time limit has been exceeded or will likely be exceeded. Note 2: A manual trip action is any operator action or set of actions which causes the control rods to be rapidly inserted into the core and does not include manually driving in control rods or reinsertion of boron reaction changes. Note 3: One Containment Spray System then and one Containment Cooling System then comprise one further of depressurizable equipment. Note 4: If the hazardous event only results in VISIBLE DAMAGE, with no indication of degraded performance, at least one train of a SAFETY SYSTEM from this emergency condition is not initiated. Note 5: This GALS is applicable when a Table S-4 Hazardous Event occurs in a CSPST SAFETY FUNCTION or a SAFETY SYSTEM needed for the current operating mode.	Hazardous event affecting a SAFETY SYSTEM needed for the current operating mode SA1.1 (Base Pg. 180) 1 2 3 4 The occurrence of any Table S-5 hazardous event AND Event damage has caused reduction of degraded performance in one train of a SAFETY SYSTEM needed for the current operating mode AND EITHER • Event damage has caused reduction of degraded performance in a second train of a SAFETY SYSTEM needed for the current operating mode • Event damage has resulted in VISIBLE DAMAGE to a second train of a SAFETY SYSTEM needed for the current operating mode (Notes 10, 12)	Loss of all onsite or offsite communications capabilities US1.1 (Base Pg. 180) 1 2 3 4 Loss of all Table S-4 onsite communication methods OR Loss of all Table S-4 GRID communication methods OR Loss of all Table S-4 NRC communication methods Failure to isolate containment or loss of containment pressure control US1.2 (Base Pg. 180) 1 2 3 4 Any penetration is not isolated within 15 min of a VAVDC containment isolation signal OR Containment pressure > 27 psig with one full train of containment depressurization equipment operating per design for 15 min (Notes 10, 12)	
7 Loss of Comm.					
8 CMT Initiation Failure					
9 Hazardous Event Affecting Safety Systems					
F Fission Product Barrier Degradation	FS1.1 (Base Pg. 182) 1 2 3 4 Loss of any two barriers AND Loss of potential loss of the barrier (Table F-1)	FS1.2 (Base Pg. 182) 1 2 3 4 Loss of potential loss of any two barriers (Table F-1)	FA1.1 (Base Pg. 182) 1 2 3 4 Any loss or any potential loss of either Fuel Clad or RCS (Table F-1)		

Table F-1 Fission Product Barrier Matrix				
Category	Fuel Clad (FC) Barrier		Reactor Coolant System (RCS) Barrier	Containment (CMT) Barrier
	Loss	Potential Loss	Loss	Potential Loss
A RCS or SG Tube Leakage			<p>1. An automatic or manual (ECCS) action required by EITHER:</p> <ul style="list-style-type: none"> UNDESIRABLE RCS leakage SG tube leakage (Base Pg. 208) 	<p>1. A leakage or rupture (SG or PAU) within containment (Base Pg. 215)</p>
B Inadequate Heat Removal	<p>1. CSPST Core Cooling RED Path conditions met (Base Pg. 188)</p>	<p>1. CSPST Core Cooling Path conditions met (Base Pg. 188)</p> <p>2. CSPST Heat Sink RED Path conditions met</p> <p>AND</p> <p>Heat sink required (Base Pg. 200)</p>	<p>1. CSPST Heat Sink RED Path conditions met</p> <p>AND</p> <p>Heat sink required (Base Pg. 213)</p>	<p>1. CSPST Core Cooling RED Path conditions met</p> <p>AND</p> <p>Heat sink required (Base Pg. 220)</p>
C CMT Radiation / RCS Activity	<p>1. Containment isolation - 1400 R/h on GT-RE-01 (01) or GT-RE-02 (02) (Base Pg. 215)</p> <p>2. Core equipment > 131 (containment activity) > 300 psig (Base Pg. 220)</p> <p>3. CMT isolation - 2500 R/h on GT-RE-01 (01) (Base Pg. 220)</p>		<p>1. Containment isolation - 15 R/h on GT-RE-01 (01) or GT-RE-02 (02) (Base Pg. 215)</p>	<p>1. Containment radiation > 1400 R/h on GT-RE-01 (01) or GT-RE-02 (02) (Base Pg. 227)</p>
D CMT Integrity or Bypass				<p>1. Containment isolation is required</p> <p>AND EITHER:</p> <ul style="list-style-type: none"> Containment integrity has been lost based on Emergency Coordinator's judgment UNDESIRABLE pathway from containment to the environment exists (Base Pg. 220) Indications of RCS leakage outside of containment (Base Pg. 233)
E Judgment	<p>1. Any condition in the opinion of the Emergency Coordinator that indicates loss of the Fuel Clad barrier (Base Pg. 220)</p>	<p>1. Any condition in the opinion of the Emergency Coordinator that indicates potential loss of the Fuel Clad barrier (Base Pg. 220)</p>	<p>1. Any condition in the opinion of the Emergency Coordinator that indicates loss of the RCS barrier (Base Pg. 218)</p>	<p>1. Any condition in the opinion of the Emergency Coordinator that indicates potential loss of the Containment barrier (Base Pg. 230)</p>

Modes: 1 Power Operation 2 Startup 3 Hot Standby 4 Hot Shutdown Cold Shutdown Refueling Defueled

HOT CONDITIONS (RCS > 200°F)

Ameren MISSOURI Callaway Energy Center EIP-ZZ-00101 Addendum 1 Emergency Action Level Classification Matrix Revision 009 Information Use

INFORMATION USE

INFORMATION USE

4.0 REFERENCES**4.1. Implementing**

- 4.1.1. EIP-ZZ-00101, Classification of Emergencies
- 4.1.2. EIP-ZZ-00260, Event Closeout / Plant Recovery
- 4.1.3. RERP Chapter 4
- 4.1.4. EAL Comparison Matrix
- 4.1.5. EAL Classification Matrix

4.2. Developmental

- 4.2.1. NEI 99-01, Methodology for Development of Emergency Action Levels
- 4.2.2. NUMARC/NESP-007 Rev. 2, Methodology for Development of Emergency Action Levels, "Questions and Answers"
- 4.2.3. NRC Regulatory Issue Summary (RIS) 2003-18, Supplement 2, Use of Nuclear Energy Institute (NEI) 99-01, Methodology for Development of Emergency Action Levels Revision 4, Dated January 2003 (December 12, 2005)
- 4.2.4. NRC Bulletin 2005-02 Emergency Preparedness and Response Actions for Security-Based Events
- 4.2.5. Callaway Plant Radiological Emergency Response Plan (RERP)
- 4.2.6. Technical Specifications B.3.9.4
- 4.2.7. OSP-GT-00003 Containment Closure
- 4.2.8. APA-ZZ-00102 EOP/OTO Writer's Manual
- 4.2.9. Procedure Writing Manual, Callaway Nuclear Power Plant
- 4.2.10. ULNRC-05281, "Docket Number 50-483, Callaway Plant Union Electric Co. Application for Amendment to Facility Operating License NPF-030 Adoption of Industry Traveler TSTF-490," May 9, 2006, Attachments 1, 2, 3 and 4
- 4.2.11. CR 201702763, NOS Insight – EP Risk Significant Planning Standard Performance Upper Tier Cause Evaluation Needed

5.0 RECORDS

None

6.0 SUMMARY OF CHANGES

Page(s)	Section or Step Number	Description
5	Old EAL HG1.1	Deleted HG1.1 due to the ambiguity of the EAL and that other EALs would cover escalation of a security event.
4 6	EAL SA9.1 EAL CA6.1 & Note block on each page	<p>Reworded the EAL to better address the intent. The new wording reads:</p> <p>"The occurrence of any Table C-6 (S-5) hazardous event</p> <p>AND</p> <p>Event damage has caused indication of degraded performance on train of a SAFETY SYSTEM needed for the current operating MODE</p> <p>AND EITHER:</p> <ul style="list-style-type: none"> • Event damage has caused indications of degraded performance in a second train of a SAFETY SYSTEM needed for the current operating MODE. • Event damage has resulted in VISIBLE DAMAGE to a second train of a SAFETY SYSTEM needed for the current operating MODE. <p>(Notes 11, 12)"</p> <p>And along with the revised EAL text, the following notes were also added:</p> <p>"Note 11: If the hazardous event only results in VISIBLE DAMAGE, with no indication of degraded performance to at least one train of a SAFETY SYSTEM, then this emergency classification is not warranted.</p> <p>Note 12: This EAL is applicable when a Table C-6 (S-5), Hazardous Events, causes a LOSS OF SAFETY FUNCTION on a SAFETY SYSTEM required for the current operating MODE."</p>