


NRC Pre-Submittal Meeting - License
Amendment Request to Reduce High Pressure
Service Water System Design Pressure &
Revise Technical Specifications for Temporary
Extension of Completion Times


Peach Bottom Atomic Power Station
September 18, 2018



Combined System Flowpath

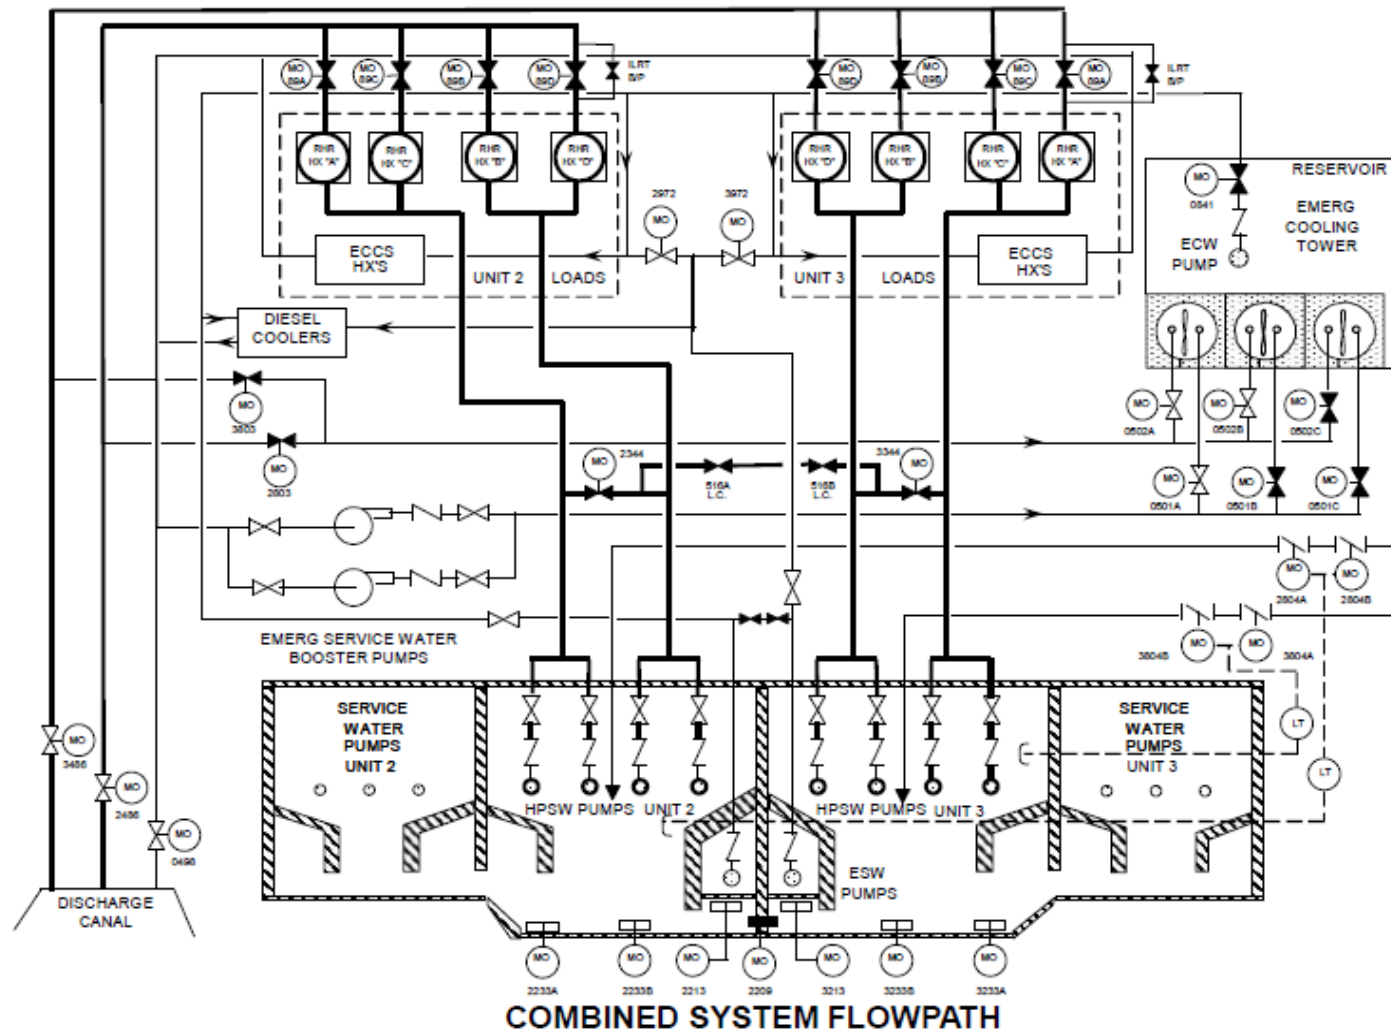

HPSW Current Configuration – Single Loop

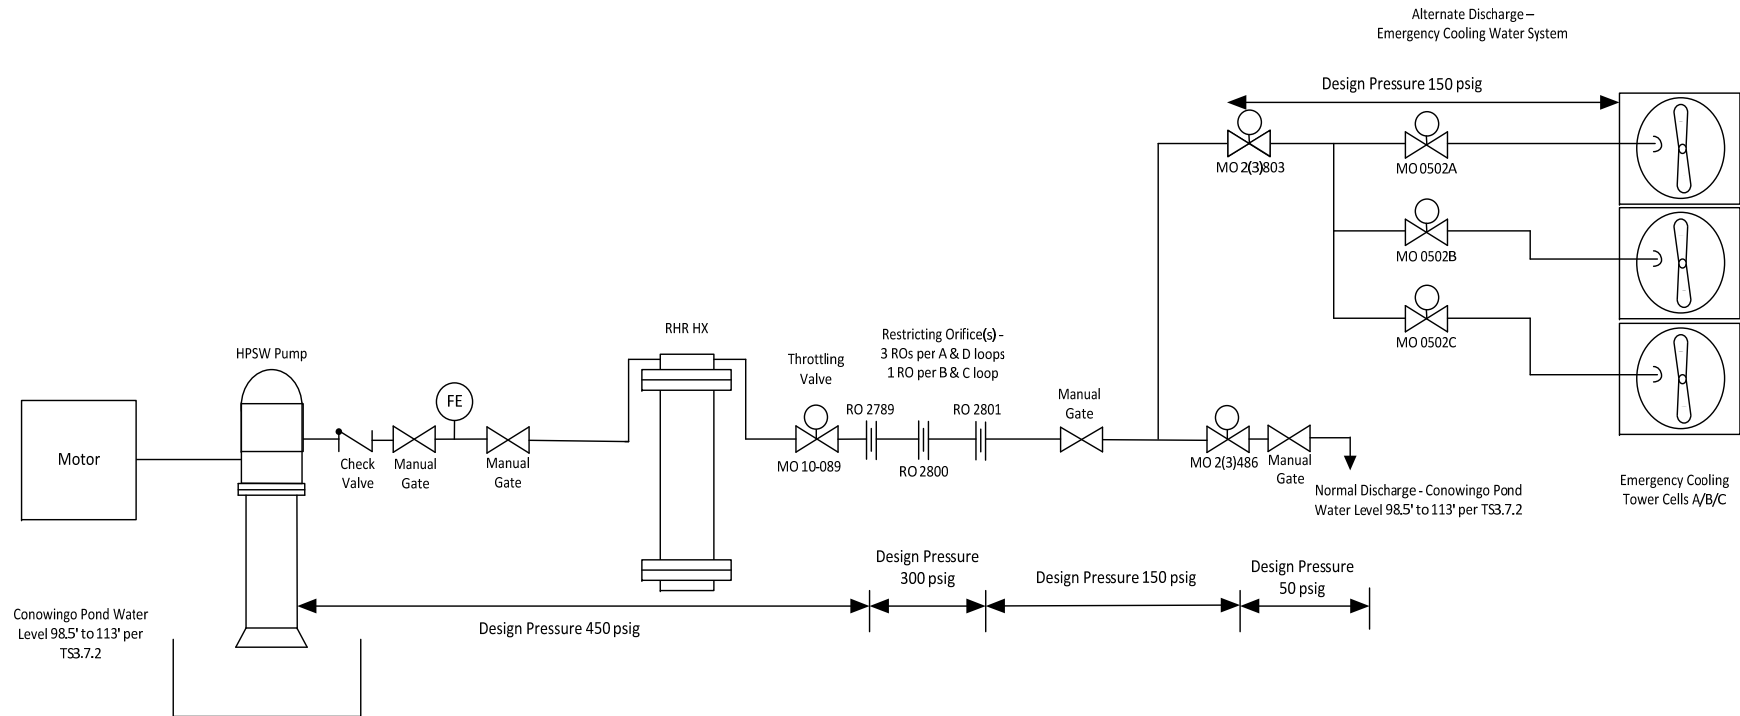

HPSW Modified Configuration to Reduce Design Pressure

