

NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL

FILE NUMBER
INCIDENT REPORT

TO: Norman C. Mosely

FROM: Tennessee Valley Authority
Chattanooga, Tennessee 37401
H. S. FoxDATE OF DOCUMENT
11-11-76DATE RECEIVED
11-18-76☒ LETTER
☒ ORIGINAL
☐ COPY☐ NOTORIZED
☒ UNCLASSIFIED

PROP

INPUT FORM

NUMBER OF COPIES RECEIVED
1 cy.

DESCRIPTION

Ltr. Trans. Following

ACKNOWLEDGED
DO NOT REMOVE

PLANT NAME: BROWNS FERRY UNIT 2

ENCLOSURE

Lic. Event Rpt. (RO-50-260-76-15)
which occurred on 10-13-76 providing details
on off gas post-treatment monitor (2-RM-90-
265) suction and discharge sample lines
found to be reversed during startup testing...

(1 cy encl. rec'd.)

NOTE: IF PERSONNEL EXPOSURE IS INVOLVED
SEND DIRECTLY TO KREGER/J. COLLINS

FOR ACTION/INFORMATION jcm 11-18-76

☒ BRANCH CHIEF: Schwencer
☐ W/3 CYS FOR ACTION
☒ LIC. ASST.: Sheppard
☐ W/1 CYS
☒ ACRS 14 CYS HOLDING/SENT TO Cat-B
on 11-19-76

INTERNAL DISTRIBUTION

☒ REG FILE
☒ NRC PDR
☒ I & E (2)
☒ MIPC
☒ SCHROEDER/IPPOLITO
☒ HOUSTON
☒ NOVAK/CHECK
☒ GRIMES
☒ CASE
☒ BUTLER
☒ HANAUER
☒ TEDESCO/MACCARY
☒ EISENHUT
☒ PAER
☒ SHAO
☒ VOLLMER/TINCH
☒ KREGER/J. COLLINS

EXTERNAL DISTRIBUTION

☒ TIDR: Athens Ala.
☒ TIG:
☒ NJICA

CONTROL NUMBER

11707

1944

1944

1944

1944

1944

1944

1944

1944

1944

1944


1944



TENNESSEE VALLEY AUTHORITY
CHATTANOOGA, TENNESSEE 37401

November 11, 1976

Regulatory Docket File

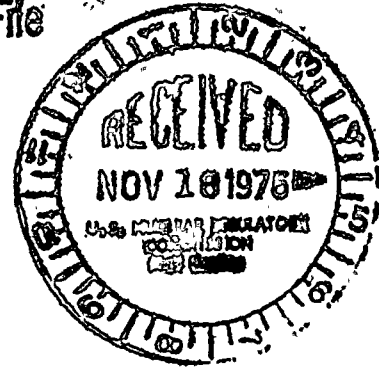

Mr. Norman C. Moseley, Director
U.S. Nuclear Regulatory Commission
Office of Inspection and Enforcement
Region II
230 Peachtree Street, NW., 8th Floor
Atlanta, Georgia 30303

Dear Mr. Moseley:

TENNESSEE VALLEY AUTHORITY - BROWNS FERRY NUCLEAR PLANT UNIT 2 -
DOCKET NO. 50-260 - FACILITY OPERATING LICENSE DPR-52 - REPORTABLE
OCCURRENCE REPORT BFRO-50-260/7615

The enclosed report is to provide details concerning the unit 2 offgas
post-treatment monitor (2-RM-90-265) suction and discharge sample lines
~~that were found to be reversed during startup testing.~~ This report
is submitted in accordance with Browns Ferry Technical Specifications
Section 6. This event occurred on Browns Ferry Nuclear Plant unit 2.

Very truly yours,

TENNESSEE VALLEY AUTHORITY

H. S. Fox
Director of Power Production



Enclosure (3)


CC (Enclosure):

Director (3)
Office of Management Information and Program Control
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

Director (40)
Office of Inspection and Enforcement
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

137497

Regulatory Docket File

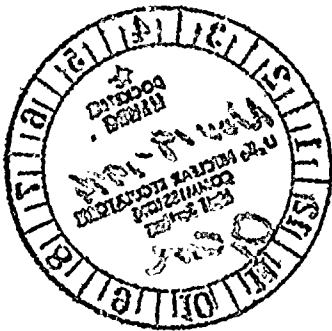

[PLEASE PRINT ALL REQUIRED INFORMATION]

EVENT DESCRIPTION

SYSTEM CODE		CAUSE CODE	COMPONENT CODE						COMPONENT SUPPLIER	COMPONENT MANUFACTURER				VIOLATION
B	3	A	I	N	S	T	R	U	N	Z	9	9	9	N
9	10	11	12					17	43	44			47	48

FACILITY STATUS	% POWER	OTHER STATUS	METHOD OF DISCOVERY	DISCOVERY DESCRIPTION
--------------------	---------	--------------	------------------------	-----------------------

PERSONNEL EXPOSURES

PERSONNEL INJURIES

OFFSITE CONSEQUENCES

LOSS OR DAMAGE TO FACILITY

PUBLICITY

ADDITIONAL FACTORS

19

GPO H81-667



Handwritten notes in the top right corner, including the word "Page" and some illegible scribbles.



TENNESSEE VALLEY AUTHORITY

CHATTANOOGA, TENNESSEE 37401

November 11, 1976

Mr. Norman C. Moseley, Director
U.S. Nuclear Regulatory Commission
Office of Inspection and Enforcement
Region II
230 Peachtree Street, NW., 8th Floor
Atlanta, Georgia 30303

Dear Mr. Moseley:

TENNESSEE VALLEY AUTHORITY - BROWNS FERRY NUCLEAR PLANT UNIT 2 -
DOCKET NO. 50-260 - FACILITY OPERATING LICENSE DPR-52 - REPORTABLE
OCCURRENCE REPORT BFRO-50-260/7615

The enclosed report is to provide details concerning the unit 2 offgas post-treatment monitor (2-RM-90-265) suction and discharge sample lines that were found to be reversed during startup testing. This report is submitted in accordance with Browns Ferry Technical Specifications Section 6. This event occurred on Browns Ferry Nuclear Plant unit 2.

Very truly yours,

TENNESSEE VALLEY AUTHORITY

for H. S. Fox
Director of Power Production

Enclosure (3)

CC (Enclosure):

Director (3)

Office of Management Information and Program Control
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

Director (40)

Office of Inspection and Enforcement
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

50-260

NO 4

Page 11, 1971

1. The above information is being furnished to you for your information and for your use in the event you are requested to provide information to the FBI.

2. The above information is being furnished to you for your information and for your use in the event you are requested to provide information to the FBI.

3. The above information is being furnished to you for your information and for your use in the event you are requested to provide information to the FBI.

4. The above information is being furnished to you for your information and for your use in the event you are requested to provide information to the FBI.

5. The above information is being furnished to you for your information and for your use in the event you are requested to provide information to the FBI.

6. The above information is being furnished to you for your information and for your use in the event you are requested to provide information to the FBI.

7. The above information is being furnished to you for your information and for your use in the event you are requested to provide information to the FBI.

8. The above information is being furnished to you for your information and for your use in the event you are requested to provide information to the FBI.

9. The above information is being furnished to you for your information and for your use in the event you are requested to provide information to the FBI.

10. The above information is being furnished to you for your information and for your use in the event you are requested to provide information to the FBI.

11. The above information is being furnished to you for your information and for your use in the event you are requested to provide information to the FBI.

12. The above information is being furnished to you for your information and for your use in the event you are requested to provide information to the FBI.

13. The above information is being furnished to you for your information and for your use in the event you are requested to provide information to the FBI.

LICENSEE EVENT REPORT

CONTROL BLOCK: 1 6

(PLEASE PRINT ALL REQUIRED INFORMATION)

LICENSEE
NAME

LICENSE NUMBER

LICENSE
TYPE

EVENT
TYPE

1 A L B R F 2 0 0 - 0 0 0 0 0 - 0 0 4 1 1 1 1 0 3

CATEGORY

REPORT
TYPE

REPORT
SOURCE

DOCKET NUMBER

EVENT DATE

REPORT DATE

0 1 CON'T L L 0 5 0 - 0 2 6 0 1 0 1 3 7 6

EVENT DESCRIPTION

0 2 During startup testing the unit 2 offgas post-treatment monitor (2-RM-90-265) suction
0 3 and discharge sample lines were found to be reversed. Since startup the monitor has
0 4 been indicating the activity upstream of the charcoal beds rather than downstream.
0 5 BFRO-50-260/7615
0 6

SYSTEM
CODE

CAUSE
CODE

COMPONENT CODE

PRIME
COMPONENT
SUPPLIER

COMPONENT
MANUFACTURER

VIOLATION

0 7 B 3 A I N S T R U N Z 9 9 9 N

CAUSE DESCRIPTION

0 8 Installation error.
0 9
1 0

FACILITY
STATUS

% POWER

OTHER STATUS

METHOD OF
DISCOVERY

DISCOVERY DESCRIPTION

1 1 B 0 5 9 NA C Unusual Monitor Response Noted

FORM OF
ACTIVITY
RELEASED

CONTENT
OF RELEASE

AMOUNT OF ACTIVITY

LOCATION OF RELEASE

1 2 Z Z NA NA

PERSONNEL EXPOSURES

NUMBER

TYPE

DESCRIPTION

1 3 0 0 0 Z NA

PERSONNEL INJURIES

NUMBER

DESCRIPTION

1 4 0 0 0 NA

OFFSITE CONSEQUENCES

1 5 NA

LOSS OR DAMAGE TO FACILITY

TYPE DESCRIPTION

1 6 Z NA

PUBLICITY

1 7 NA

ADDITIONAL FACTORS

1 8 Installation of similar lines on units 1 and 3 has been verified correct.

1 9

NAME:

PHONE:

